

MARITIME FIRE SIMULATOR MINIMUM REQUIREMENTS

40 LF CONTAINER

- FLOOR / ROOF SLOPE - 1" PER FOOT
- EXTERIOR MARINE LADDER TO 2nd FLOOR / ROOF
- 20LPG IN ROOM (MARINE ENGINE WITH ROLLOVER)
- INTERIOR RESIDENT STAIRS TO 2nd FLOOR
- OSHA COMPLAINT ROOF GUARDRAIL SYSTEM
- GATES ON ROOF GUARDRAIL (2)
- TEMPERATURE MONITORING SYSTEM
- AUTOMATIC FLAME MONITORING SYSTEM - HONEYWELL OR EQUIVALENT
- DRY STAND PIPE (SPRINKLERS)
- WALL SCUTTERS

20 LF CONTAINER

- FLOOR / ROOF SLOPE - 1/4" PER FOOT
- 10 Lb LPG BURN ROOM (GALLEY / PROP)
- INTERIOR WARMTH STAIRS TO 3rd FLOOR
- OSHA COMPLIANT ROOF GUARDRAIL SYSTEM
- GATE ON ROOF GUARDRAIL (1)
- EXTERIOR OSHA COMPLIANT LADDER W/CAGE TO 3rd FLOOR
- TEMPERATURE MONITORING SYSTEM
- AUTOMATIC FLAME MONITORING SYSTEM - HONEYWELL OR EQUIVALENT
- WALL SCUPPERS

10 LF CONTAINER

- FLOOR / ROOF SLOPE = 1" PER FOOT
- LPG CONTROL PANEL ALLOWING INDEPENDENT OPERATION OF BURN LOCATIONS
- OSHA COMPLIANT ROOF GUARDRAIL SYSTEM
- GATE ON ROOF GUARDRAIL (1)
- EXTERIOR OSHA COMPLIANT LADDER W/ GATE TO ROOF WALL SCUPPERS

NOTES

1. THE NUMBER OF WALL SLOPPERS ARE AS NEEDED BY DESIGN TO PREVENT ACCUMULATION OF WATER.
2. THE NUMBER OF WINDOWS AND DOORS ARE AS SHOWN. OWNER SHALL SPECIFY LOCATION.

[illegible]

M **M**
MOTT
MACDONALD

Mott MacDonald, Florida, LLC
220 West Garden Street
Suite 700
Pensacola, Florida 32502
United States of America
Telephone: (850) 484-6011
www.mottmac.com/americas

Architects AA - C000035
Engineers Surveyors EB - C000155
LB - C0006783

Client
City of Pensacola
Pensacola Fire Department
475 East Strong Street
Pensacola, Florida 32501



Fire Station #4
Maritime Simulator

ISSUED FOR BID

This Drawing is not for Construction

Project Number	B/O		Total	
396620				
Designed	YSS	Eng Check	LJD	
Drawn	KWD	Coordination		
Dwg Check	BFH	Approved		
Scale of ANSI D	Status	Rev	Security	
As Shown	BID SET	A		
Drawing Number				

S-001

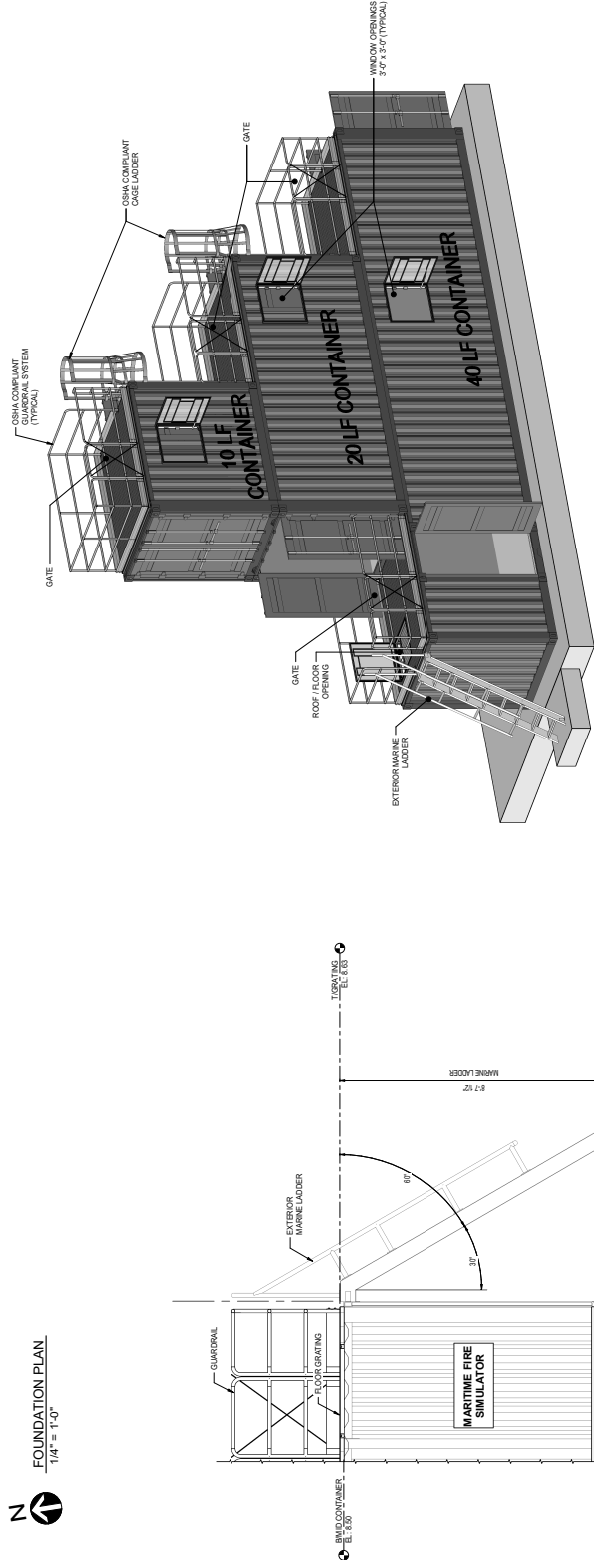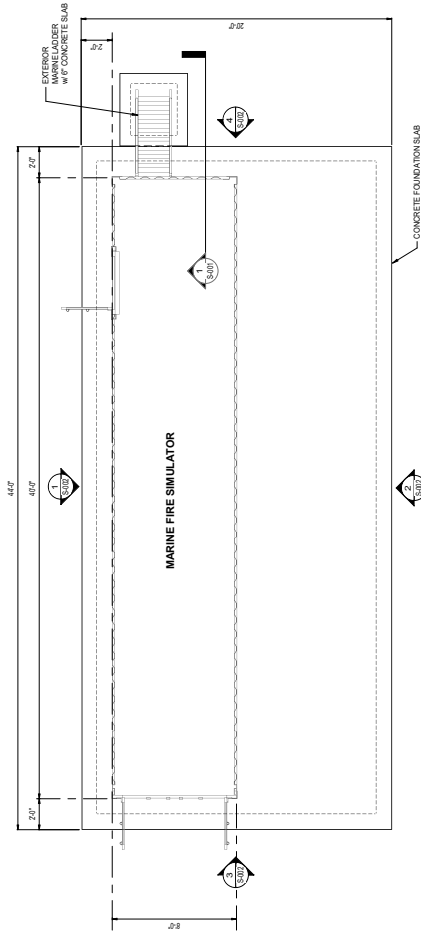

MARITIME FIRE SIMULATOR NORTH FACE

