

REFER TO UFC 3-110-03 FOR ADDITIONAL ROOF REQUIREMENTS

STANDING SEAM METAL ROOF

40 MIL SELF-ADHERED WATERPROOF BARRIER

1/2" COVER BOARD

R-30 RIGID INSULATION

R-13 UNFACED BATT INSULATION

1/2" GLASS MATT SHEATHING

GALVANIZED STEEL STUDS

PREFINISHED METAL SOFFIT SYSTEM

2" RIGID INSULATION

PREFINISHED ALUMINUM GUTTER WITH BRACKET AND STRAP STAGGERED AT 30" O.C.


PREFINISHED METAL WALL PANELS

FLUID APPLIED AIR BARRIER

2  
A-301

TYPICAL ROOF EDGE DETAIL

1 1/2" = 1'-0"

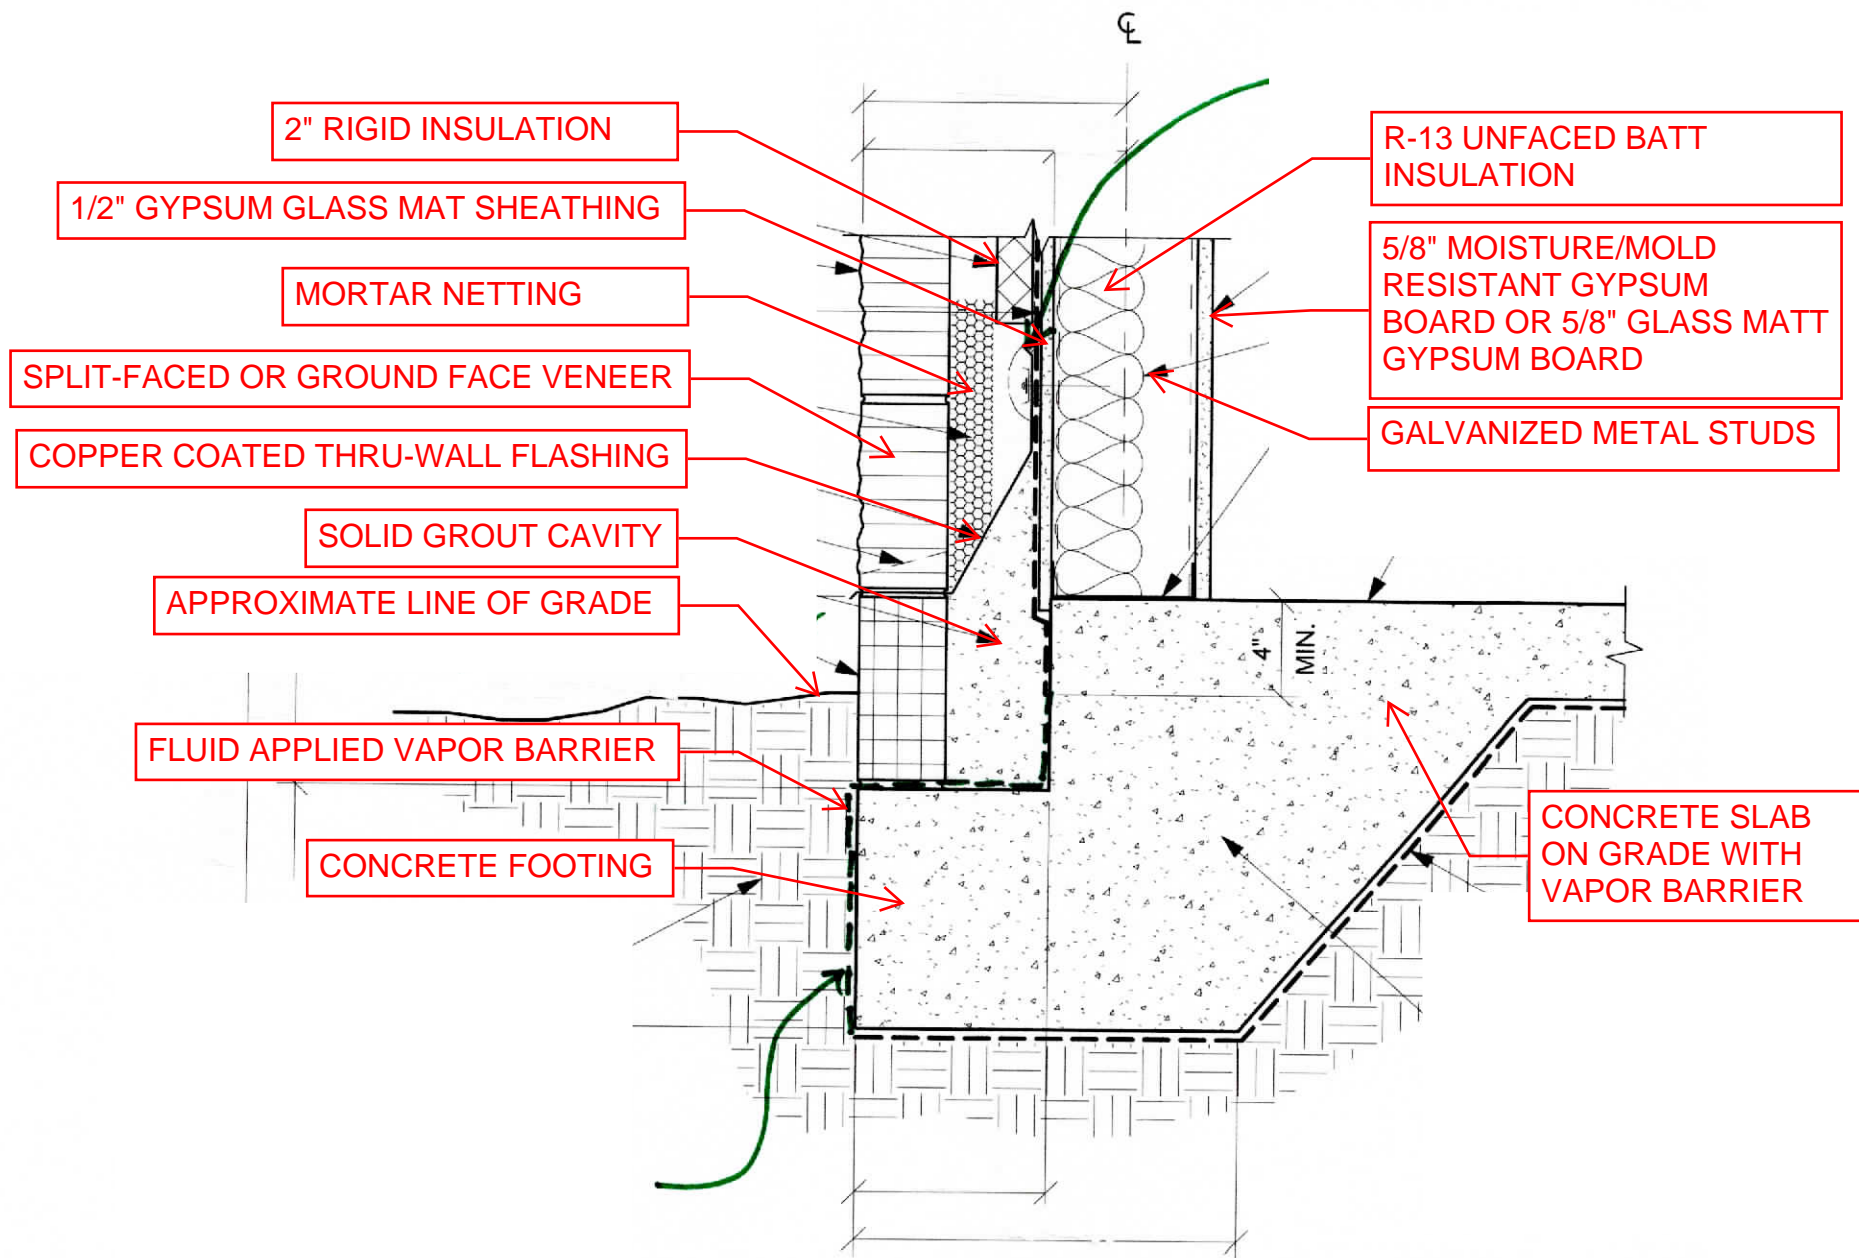

2" RIGID INSULATION

1/2" GYPSUM GLASS MAT SHEATHING

MORTAR NETTING

SPLIT-FACED OR GROUND FACE VENEER

COPPER COATED THRU-WALL FLASHING

SOLID GROUT CAVITY

APPROXIMATE LINE OF GRADE

FLUID APPLIED VAPOR BARRIER

CONCRETE FOOTING

R-13 UNFACED BATT INSULATION

5/8" MOISTURE/MOLD RESISTANT GYPSUM BOARD OR 5/8" GLASS MATT GYPSUM BOARD

GALVANIZED METAL STUDS

CONCRETE SLAB ON GRADE WITH VAPOR BARRIER

3  
A-301

# TYPICAL WALL BASE DETAIL

1 1/2" = 1'-0"