VA | U.S. Department of Veterans Affairs

Specifications

Birmingham Veterans Affairs Medical Center

700 South 19th Street

Birmingham, AL 35233

Renovate Wards 2k/2b For Optometry/Ophthalmology Building #1

VA Contract No. 36C24724C0036
Station Project No. 521-24-102
Bancroft-AE Project No. 23-135

IFB Construction Documents Submittal
Vol 1 - Divisions 00-14
Vol 2 - Divisions 21-48

05/15/2026

1471 E Business Center Dr,
Mount Prospect, IL 60056
T: 847-952-9362
www. bancroft-ae.com
BANCROFT ARCHITECTS + ENGINEERS
VA CONTRACT NO.36C24724C0036
Bancroft Project No. 23-135

VA | U.S. Department of Veterans Affairs

Specifications

Birmingham Veterans Affairs Medical Center

700 South 19th Street

Birmingham, AL 35233

Renovate Wards 2k/2b For Optometry/Ophthalmology

Building #1

VA Contract No. 36C24724C0036
Station Project No. 521-24-102
Bancroft-AE Project No. 23-135

VOLUME 2
Divisions 21-48

BANCROFT ARCHITECTS + ENGINEERS
VA CONTRACT NO.36C24724C0036

1471 E Business Center Dr,
Mount Prospect, IL 60056
T: 847-952-9362
www. bancroft-ae.com
Bancroft Project No. 23-135

DIVISION 21
FIRE SUPRESSION

11-1-16

SECTION 21 08 00

COMMISSIONING OF FIRE SUPPRESSION SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

A. The requirements of this Section apply to all sections of Division 21.

B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned is specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIRMENTS. A Commissioning Agent (CxA) appointed by the VA will manage the commissioning process.

1.2 RELATED WORK

A. Section 01 00 00 GENERAL REQUIREMENTS.

B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.3 SUMMARY

A. This Section includes requirements for commissioning the Fire Suppression systems, subsystems and equipment. This Section supplements the general requirements specified in Section 01 91 00 General Commissioning Requirements.

B. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more details regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

1.4 DEFINITIONS

A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

1.5 COMMISSIONED SYSTEMS

A. Commissioning of a system or systems specified in Division 21 is part of the construction process. Documentation and testing of these systems, as well as training of the VA’s Operation and Maintenance personnel in accordance with the requirements of Section 01 91 00 and of Division 21, is required in cooperation with the VA and the Commissioning Agent.

B. The Fire Suppression systems commissioning will include the systems listed in Section 01 91 00 General Commissioning Requirements:

1.6 SUBMITTALS

A. The commissioning process requires review of selected Submittals. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.

B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 CONSTRUCTION INSPECTIONS

A. Commissioning of the building fire suppression systems will require inspection of individual elements of the fire suppression construction throughout the construction period. The Contractor shall coordinate with the Commissioning Agent in accordance with Section 01 91 00 and the Commissioning plan to schedule inspections as required to support the Commissioning Process.

3.2 PRE-FUNCTIONAL CHECKLISTS

A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed

checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

3.3 CONTRACTORS TESTS

A. Contractor tests as required by other sections of Division 21 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. All testing shall be incorporated into the project schedule. Contractor shall provide no less than 7 calendar days' notice of testing. The Commissioning Agent will witness selected Contractor tests at the sole discretion of the Commissioning Agent. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

3.4 SYSTEMS FUNCTIONAL PERFORMANCE TESTING

A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the COR. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

3.5 TRAINING OF VA PERSONNEL

A. Training of the VA operation and maintenance personnel is required in cooperation with the COR and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and

maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. Contractor shall submit training agendas and trainer resumes in accordance with the requirements of Section 01 91 00. The instruction shall be scheduled in coordination with the COR after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 21 Sections for additional Contractor training requirements.

----- END -----

SECTION 21 13 13
WET-PIPE SPRINKLER SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

A. Design, installation and testing shall be in accordance with NFPA 13.

B. The design and installation of a hydraulically calculated automatic wet-pipe system complete and ready for operation, for all portions of Building 1 areas 2B and 2K.

C. Modification of the existing sprinkler system as indicated on the drawings and as further required by these specifications.

1.2 RELATED WORK

A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B.

C. Section 07 84 00, FIRESTOPPING.

D. Section 09 91 00, PAINTING.

E. Section 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING.

F. Section 28 31 00, FIRE DETECTION AND ALARM.

1.3 DESIGN CRITERIA

A. Design Basis Information: Provide design, materials, equipment, installation, inspection, and testing of the automatic sprinkler system in accordance with the requirements of NFPA 13.

1. Perform hydraulic calculations in accordance with NFPA 13 utilizing the Area/Density method. Do not restrict design area reductions permitted for using quick response sprinklers throughout by the required use of standard response sprinklers in the areas identified in this section.

2. Sprinkler Protection: Sprinkler hazard classifications shall be in accordance with NFPA 13. The hazard classification examples of uses and conditions identified in the Annex of NFPA 13 shall be mandatory for areas not listed below. Request clarification from the Government for any hazard classification not identified. To

determining spacing and sizing, apply the following coverage classifications:

a. Light Hazard Occupancies: Patient care, treatment, and customary access areas.
b. Ordinary Hazard Group 1 Occupancies: Laboratories, Mechanical Equipment Rooms, Transformer Rooms, Electrical Switchgear Rooms, Electric Closets, and Repair Shops.
c. Ordinary Hazard Group 2 Occupancies: Storage rooms, trash rooms, clean and soiled linen rooms, pharmacy and associated storage, laundry, kitchens, kitchen storage areas, retail stores, retail store storage rooms, storage areas, building management storage, boiler plants, energy centers, warehouse spaces, file storage areas for the entire area of the space up to 140 square meters (1500 square feet) and Supply Processing and Distribution (SPD).

3. Hydraulic Calculations: Calculated demand including hose stream requirements shall fall no less than 10 percent below the available water supply curve. Contractor may use annual fire pump test data that is no older than 12 months as the water supply information. If this data is used, contractor must verify the data is reasonable and make the test data part of the contract documents in the place of the information below.

4. Water Supply: Base water supply on a flow test of:
   a. Location __7th Ave mid-block between 18th and 19th St._____
   b. Elevation Static Test Gauge ___2___ft
   c. Elevation Residual Test Gauge ___2__ft)
   b. Static pressure: __76 psi__
   c. Residual pressure: __72 psi__
   d. Flow: 1,186 gpm
   g. Date: August 26, 2025 .
5. Zoning:
   a. For each sprinkler zone provide a control valve, flow switch, and a test and drain assembly with pressure gauge. For buildings

greater than two stories, provide a check valve at each control valve.

b. Sprinkler zones shall conform to the smoke barrier zones shown on the drawings.

6. Provide seismic protection in accordance with nfpa 13. Contractor shall submit load calculations for sizing of sway bracing for systems that are required to be protected against damage from earthquakes.//

1.4 SUBMITTALS

A. Submit as one package in accordance with section 01 33 23, shop drawings, product data, and samples. Prepare detailed working drawings that are signed by a NICET level iii or level iv sprinkler technician or stamped by a registered professional engineer licensed in the field of fire protection engineering. As the government review is for technical adequacy only, the installer remains responsible for correcting any conflicts with other trades and building construction that arise during installation. Partial submittals will not be accepted. Material submittals shall be approved prior to the purchase or delivery to the job site. Suitably bind submittals in notebooks or binders and provide an index referencing the appropriate specification section. In addition to the hard copies, provide submittal items in paragraphs 1.4(a)1 through 1.4(a)5 electronically in pdf format on a compact disc or as directed by the cor. Submittals shall include, but not be limited to, the following:

1. Qualifications:

a. Provide a copy of the installing contractors fire sprinkler state contractor’s license.

b. Provide a copy of the NICET certification for the NICET Level III or Level IV Sprinkler Technician who prepared and signed the detailed working drawings unless the drawings are stamped by a Registered Professional Engineer licensed in the field of Fire Protection Engineering.

c. Provide documentation showing that the installer has been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.

2. Drawings: Submit detailed 1/8 inch scale (minimum) working drawings conforming to the Plans and Calculations chapter of NFPA 13. Drawings shall include graphical scales that allow the user to determine lengths when the drawings are reduced in size.

Include a plan showing the piping to the water supply test location.

3. Manufacturer's Data Sheets: Provide data sheets for all materials and equipment proposed for use on the system. Include listing information and installation instructions in data sheets. Where data sheets describe items in addition to those proposed to be used for the system, clearly identify the proposed items on the sheet.
4. Calculation Sheets:
   a. Submit hydraulic calculation sheets in tabular form conforming to the requirements and recommendations of the Plans and Calculations chapter of NFPA 13.
   b. Submit calculations of loads for sizing of sway bracing in accordance with NFPA 13.
5. Valve Charts: Provide a valve chart that identifies the location of each control valve. Coordinate nomenclature and identification of control valves with COR. Where existing nomenclature does not exist, the chart shall include no less than the following: Tag ID No., Valve Size, Service (control valve, main drain, aux. drain, inspectors test valve, etc.), and Location.
6. Final Document Submittals: Provide as-built drawings, testing and maintenance instructions in accordance with the requirements in Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. In addition, submittals shall include, but not be limited to, the following:
   a. A complete set of as-built drawings showing the installed system with the specific interconnections between the system switches and the fire alarm equipment. Provide a complete set in the formats as follows. Submit items 2 and 3 below on a compact disc or as directed by the COR.
      1) One full size (or size as directed by the COR) printed copy.
      2) One complete set in electronic pdf format.
      3) One complete set in AutoCAD format or a format as directed by the COR.

b. Material and Testing Certificate: Upon completion of the sprinkler system installation or any partial section of the system, including testing and flushing, provide a copy of a completed Material and Testing Certificate as indicated in NFPA 13. Certificates shall be provided to document all parts of the installation.

c. Operations and Maintenance Manuals that include step-by-step procedures required for system startup, operation, shutdown, and routine maintenance and testing. The manuals shall include the manufacturer's name, model number, parts list, and tools that should be kept in stock by the owner for routine maintenance, including the name of a local supplier, simplified wiring and controls diagrams, troubleshooting guide, and recommended service organization, including address and telephone number, for each item of equipment.

d. One paper copy of the Material and Testing Certificates and the Operations and Maintenance Manuals above shall be provided in a binder. In addition, these materials shall be provided in pdf format on a compact disc or as directed by the COR.

e. Provide one additional copy of the Operations and Maintenance Manual covering the system in a flexible protective cover and mount in an accessible location adjacent to the riser or as directed by the COR.

1.5 QUALITY ASSURANCE

A. Installer Reliability: The installer shall possess a valid State of Alabama fire sprinkler contractor's license. The installer shall have been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.

B. Materials and Equipment: All equipment and devices shall be of a make and type listed by UL or approved by FM (Flex hose shall be FM listed), or other nationally recognized testing laboratory for the specific purpose for which it is used. All materials, devices, and equipment shall be approved by the VA. All materials and equipment shall be free from defect. All materials and equipment shall be new unless specifically indicated otherwise on the contract drawings.

1.6 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. National Fire Protection Association (NFPA):

13-22.....Installation of Sprinkler Systems

25-23.....Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems

101-24.....Life Safety Code

170-21.....Fire Safety Symbols

C. Underwriters Laboratories, Inc. (UL):

Fire Protection Equipment Directory (Current)

D. Factory Mutual Engineering Corporation (FM): Approval Guide

PART 2 - PRODUCTS

2.1 PIPING & FITTINGS

A. Piping and fittings for sprinkler systems shall be in accordance with NFPA 13.

1. Plain-end pipe fittings with locking lugs or shear bolts are not permitted.
2. Piping sizes 2 inches and smaller shall be black steel Schedule 40 with threaded end connections.
3. Piping sizes 2 ½ inches and larger shall be black steel Schedule 10 with grooved connections. Grooves in Schedule 10 piping shall be rolled grooved only.
5. Plastic piping shall not be permitted except for drain piping.
6. Flexible sprinkler hose shall be FM Approved and limited to hose with threaded end fittings with a minimum inside diameter or 1-inch and a maximum length of 6-feet.

2.2 VALVES

A. General:

1. Valves shall be in accordance with NFPA 13.
2. Do not use quarter turn ball valves for 2 inch or larger drain valves.

B. Control Valve: The control valves shall be a listed indicating type. Control valves shall be UL Listed or FM Approved for fire protection

installations. System control valve shall be rated for normal system pressure but in no case less than 175 PSI.

C. Check Valve: Shall be of the swing type with a flanged cast iron body and flanged inspection plate.

D. Automatic Ball Drips: Cast brass 3/4 inch in-line automatic ball drip with both ends threaded with iron pipe threads.

2.3 FIRE DEPARTMENT SIAMESE CONNECTION (NOT USED)

2.4 SPRINKLERS

A. All sprinklers shall be FM approved quick response except "institutional" type sprinklers shall be permitted to be UL Listed quick response. Provide FM approved quick response sprinklers in all areas, except that standard response sprinklers shall be provided in freezers, refrigerators, elevator hoistways, elevator machine rooms, electrical rooms, and generator rooms.

B. Temperature Ratings: In accordance with NFPA 13 except that sprinklers in elevator shafts and elevator machine rooms shall be no less than intermediate temperature rated and sprinklers in generator rooms shall be no less than high temperature rated.

C. Provide sprinkler guards in accordance with NFPA 13 and when the elevation of the sprinkler head is less than 7 feet 6 inches above finished floor. The sprinkler guard shall be UL listed or FM approved for use with the corresponding sprinkler.

2.5 SPRINKLER CABINET (NOT USED)

2.6 SPRINKLER SYSTEM SIGNAGE

Rigid plastic, steel or aluminum signs with white lettering on a red background with holes for easy attachment. Sprinkler system signage shall be attached to the valve or piping with chain.

2.7 SWITCHES:

A. OS&Y Valve Supervisory Switches shall be in a weatherproof die cast/red baked enamel, oil resistant, aluminum housing with tamper resistant screws, 1/2 inch conduit entrance and necessary facilities for attachment to the valves. Provide two SPDT switches rated at 2.5 amps at 24 VDC.

B. Water flow Alarm Switches: Mechanical, non-coded, non-accumulative retard and adjustable from 0 to 60 seconds minimum. Set flow switches at an initial setting between 20 and 30 seconds.

D. Valve Supervisory Switches for Ball and Butterfly Valves: May be integral with the valve.

2.8 GAUGES

Provide gauges as required by NFPA 13. Provide gauges where the normal pressure of the system is at the midrange of the gauge.

2.9 PIPE HANGERS, SUPPORTS AND RESTRAINT OF SYSTEM PIPING

Pipe hangers, supports, and restraint of system piping shall be in accordance with NFPA 13.

2.10 WALL, FLOOR AND CEILING PLATES

Provide chrome plated steel escutcheon plates.

2.11 ANTIFREEZE SOLUTION (NOT USED)

2.12 VALVE TAGS

Engraved black filled numbers and letters not less than 1/2 inch high for number designation, and not less than 1/4 inch for service designation on 19 gage, 1-1/2 inches round brass disc, attached with brass "S" hook, brass chain, or nylon twist tie.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Installation shall be accomplished by the licensed contractor. Provide a qualified technician, experienced in the installation and operation of the type of system being installed, to supervise the installation and testing of the system.

B. Installation of Piping: Accurately cut pipe to measurements established by the installer and work into place without springing or forcing. In any situation where bending of the pipe is required, use a standard pipe-bending template. Concealed piping in spaces that have finished ceilings. Where ceiling mounted equipment exists, such as in operating and radiology rooms, install sprinklers so as not to obstruct the movement or operation of the equipment. Sidewall heads may need to be utilized. In stairways, locate piping as near to the ceiling as possible to prevent tampering by unauthorized personnel and to provide

a minimum headroom clearance of seven feet six inches. Piping shall not obstruct the minimum means of egress clearances required by NFPA 101. Pipe hangers, supports, and restraint of system piping, and seismic bracing shall be installed accordance with NFPA 13.

C. Welding: Conform to the requirements and recommendations of NFPA 13.

D. Drains: Provide drips and drains, including low point drains, in accordance with NFPA 13. Pipe drains to discharge at safe points outside of the building or to sight cones attached to drains of adequate size to readily carry the full flow from each drain under maximum pressure. Do not provide a direct drain connection to sewer system or discharge into sinks. Install drips and drains where necessary and required by NFPA 13. The drain piping shall not be restricted or reduced and shall be of the same diameter as the drain collector.

E. Supervisory Switches: Provide supervisory switches for sprinkler control valves.

F. Waterflow Alarm Switches: Install waterflow alarm switches and valves in stairwells or other easily accessible locations.

G. Inspector's Test Connection: Install and supply in accordance with NFPA 13, locate in a secured area, and discharge to the exterior of the building.

H. Affix cutout disks, which are created by cutting holes in the walls of pipe for flow switches and non-threaded pipe connections to the respective waterflow switch or pipe connection near to the pipe from where they were cut.

I. Provide escutcheon plates for exposed piping passing through walls, floors or ceilings.

J. Clearances: For systems requiring seismic protection, piping that passes through floors or walls shall have penetrations sized 2 inches nominally larger than the penetrating pipe for pipe sizes 1 inch to 3 ½ inches and 4 inches nominally larger for penetrating pipe sizes 4 inches and larger.

K. Sleeves: Provide for pipes passing through masonry or concrete. Provide space between the pipe and the sleeve in accordance with NFPA 13. Seal this space with a UL Listed through penetration fire stop material in accordance with Section 07 84 00, FIRESTOPPING. Where core drilling is

used in lieu of sleeves, also seal space. Seal penetrations of walls, floors and ceilings of other types of construction, in accordance with Section 07 84 00, FIRESTOPPING.

L. Where dry pendent sprinklers are used for freezers or similar spaces and they are connected to the wet pipe system, provide an EPDM boot around the dry pendent sprinkler on the heated side and securely seal to the pipe and freezer to prevent condensation from entering the freezer.

M. Provide pressure gauges at each water flow alarm switch location and at each main drain connection.

N. For each fire department connection, provide the symbolic sign given in NFPA 170 and locate 8 to 10 feet above each connection location. Size the sign to 18 by 18 inches with the symbol being at least 14 by 14 inches.

O. Firestopping shall be provided for all penetrations of fire resistance rated construction. Firestopping shall comply with Section 07 84 00, FIRESTOPPING.

Q. Painting of Pipe: In finished areas where walls and ceilings have been painted, paint primed surfaces with two coats of paint to match adjacent surfaces, except paint valves and operating accessories with two coats of gloss red enamel. Exercise care to avoid painting sprinklers. Painting of sprinkler systems above suspended ceilings and in crawl spaces is not required. Painting shall comply with Section 09 91 00, PAINTING. Any painted sprinkler shall be replaced with a new sprinkler.

R. Sprinkler System Signage: Provide rigid sprinkler system signage in accordance with NFPA 13 and NFPA 25. Sprinkler system signage shall include, but not limited to, the following:

1. Identification Signs:
   a. Provide signage for each control valve, drain valve, sprinkler cabinet, and inspector’s test.
   b. Provide valve tags for each operable valve. Coordinate nomenclature and identification of operable valves with COR. Where existing nomenclature does not exist, the Tag Identification shall include no less than the following: (FP-B-F/SZ-#) Fire Protection, Building Number, Floor Number/Smoke Zone

(if applicable), and Valve Number. (E.g., FP-500-1E-001) Fire Protection, Building 500, First Floor East, Number 001.)

2. Instruction/Information Signs:
   a. Provide signage for each control valve to indicate valve function and to indicate what system is being controlled.
   b. Provide signage indicating the number and location of low point drains.
3. Hydraulic Placards:
   a. Provide signage indicating hydraulic design information. The placard shall include location of the design area, discharge densities, required flow and residual pressure at the base of riser, occupancy classification, hose stream allowance, flow test information, and installing contractor. Locate hydraulic placard information signs at each alarm check valve.

S. Repairs: Repair damage to the building or equipment resulting from the installation of the sprinkler system by the installer at no additional expense to the Government.

T. Interruption of Service: There shall be no interruption of the existing sprinkler protection, water, electric, or fire alarm services without prior permission of the Contracting Officer. Contractor shall develop an interim fire protection program where interruptions involve occupied spaces. Request in writing at least one week prior to the planned interruption.

3.2 INSPECTION AND TEST

A. Preliminary Testing: Flush newly installed systems prior to performing hydrostatic tests in order to remove any debris which may have been left as well as ensuring piping is unobstructed. Hydrostatically test system, including the fire department connections, as specified in NFPA 13, in the presence of the Contracting Officers Representative (COR) or his designated representative. Test and flush underground water line prior to performing these hydrostatic tests.

B. Final Inspection and Testing: Subject system to tests in accordance with NFPA 13, and when all necessary corrections have been accomplished, advise COR to schedule a final inspection and test. Connection to the fire alarm system shall have been in service for at least ten days prior to the final inspection, with adjustments made to

prevent false alarms. Furnish all instruments, labor and materials required for the tests and provide the services of the installation foreman or other competent representative of the installer to perform the tests. Correct deficiencies and retest system as necessary, prior to the final acceptance. Include the operation of all features of the systems under normal operations in test

3.3 INSTRUCTIONS

Furnish the services of a competent instructor for not less than two hours for instructing personnel in the operation and maintenance of the system, on the dates requested by the COR.

- - - E N D - - -

DIVISION 22
PLUMBING

SECTION 22 05 11
COMMON WORK RESULTS FOR PLUMBING

PART 1 - GENERAL

1.1 DESCRIPTION

A. The requirements of this Section will apply to all sections of Division 22.

B. Definitions:

1. Exposed: Piping and equipment exposed to view in finished rooms.
2. Exterior: Piping and equipment exposed to weather be it temperature, humidity, precipitation, wind or solar radiation.

C. Abbreviations/Acronyms:

1. ABS: Acrylonitrile Butadiene Styrene
2. AC: Alternating Current
3. ACR: Air Conditioning and Refrigeration
4. A/E: Architect/Engineer
5. AFF: Above Finish Floor
6. AFG: Above Finish Grade
7. AI: Analog Input
8. AISI: American Iron and Steel Institute
9. AO: Analog Output
10. ASHRAE: American Society of Heating Refrigeration, Air Conditioning Engineers
11. ASJ: All Service Jacket
12. ASME: American Society of Mechanical Engineers
13. ASPE: American Society of Plumbing Engineers
14. AWG: American Wire Gauge
15. BACnet: Building Automation and Control Network
16. BAg: Silver-Copper-Zinc Brazing Alloy
17. BAS: Building Automation System
18. BCuP: Silver-Copper-Phosphorus Brazing Alloy
19. bhp: Brake Horsepower
20. Btu: British Thermal Unit
21. Btu/h: British Thermal Unit per Hour

22. BSG: Borosilicate Glass Pipe
23. C: Celsius
24. CA: Compressed Air
25. CD: Compact Disk
26. CDA: Copper Development Association
27. CGA: Compressed Gas Association
28. CFM: Cubic Feet per Minute
29. CI: Cast Iron
30. CLR: Color
31. CO: Contracting Officer
32. COR: Contracting Officer’s Representative
33. CPVC: Chlorinated Polyvinyl Chloride
34. CR: Chloroprene
35. CRS: Corrosion Resistant Steel
36. CWP: Cold Working Pressure
37. CxA: Commissioning Agent
38. dB: Decibels
39. db(A): Decibels (A weighted)
40. DCW: Domestic Cold Water
41. DDC: Direct Digital Control
42. DFU: Drainage Fixture Units
43. DHW: Domestic Hot Water
44. DHWR: Domestic Hot Water Return
45. DHWS: Domestic How Water Supply
46. DI: Digital Input
47. DI: Deionized Water
48. DISS: Diameter Index Safety System
49. DN: Diameter Nominal
50. DO: Digital Output
51. DOE: Department of Energy
52. DVD: Digital Video Disc
53. DWG: Drawing
54. DWH: Domestic Water Heater
55. DWS: Domestic Water Supply

56. DWV: Drainage, Waste and Vent
57. ECC: Engineering Control Center
58. EL: Elevation
59. EMCS: Energy Monitoring and Control System
60. EPA: Environmental Protection Agency
61. EPACT: Energy Policy Act
62. EPDM: Ethylene Propylene Diene Monomer
63. EPT: Ethylene Propylene Terpolymer
64. ETO: Ethylene Oxide
65. F: Fahrenheit
66. FAR: Federal Acquisition Regulations
67. FD: Floor Drain
68. FDC: Fire Department (Hose) Connection
69. FED: Federal
70. FG: Fiberglass
71. FNPT: Female National Pipe Thread
72. FOR: Fuel Oil Return
73. FOS: Fuel Oil Supply
74. FOV: Fuel Oil Vent
75. FPM: Fluoroelastomer Polymer
76. FSK: Foil-Scrim-Kraft Facing
77. FSS: VA Construction & Facilities Management, Facility Standards Service
78. FU: Fixture Units
79. GAL: Gallon
80. GCO: Grade Cleanouts
81. GPD: Gallons per Day
82. GPH: Gallons per Hour
83. GPM: Gallons per Minute
84. HDPE: High Density Polyethylene
85. HEFP: Healthcare Environment and Facilities Program (replacement for OCAMES)
86. HEX: Heat Exchanger
87. Hg: Mercury

88. HOA: Hands-Off-Automatic
89. HP: Horsepower
90. HVE: High Volume Evacuation
91. Hz: Hertz
92. ID: Inside Diameter
93. IE: Invert Elevation
94. INV: Invert
95. IPC: International Plumbing Code
96. IPS: Iron Pipe Size
97. IW: Indirect Waste
98. IWH: Instantaneous Water Heater
99. Kg: Kilogram
100. kPa: Kilopascal
101. KW: Kilowatt
102. KWH: Kilowatt Hour
103. lb: Pound
104. lbs/hr: Pounds per Hour
105. LNG: Liquid Natural Gas
106. L/min: Liters per Minute
107. LOX: Liquid Oxygen
108. L/s: Liters per Second
109. m: Meter
110. MA: Medical Air
111. MAWP: Maximum Allowable Working Pressure
112. MAX: Maximum
113. MBH: 1000 Btu per Hour
114. MED: Medical
115. MER: Mechanical Equipment Room
116. MFG: Manufacturer
117. mg: Milligram
118. mg/L: Milligrams per Liter
119. ml: Milliliter
120. mm: Millimeter
121. MIN: Minimum

122. MV: Medical Vacuum
123. N2: Nitrogen
124. N20: Nitrogen Oxide
125. NC: Normally Closed
126. NF: Oil Free Dry (Nitrogen)
127. NG: Natural Gas
128. NIC: Not in Contract
129. NO: Normally Open
130. NOM: Nominal
131. NPTF: National Pipe Thread Female
132. NPS: Nominal Pipe Size
133. NPT: Nominal Pipe Thread
134. NTS: Not to Scale
135. O2: Oxygen
136. OC: On Center
137. OD: Outside Diameter
138. OSD: Open Sight Drain
139. OS&Y: Outside Stem and Yoke
140. PA: Pascal
141. PBPU: Prefabricated Bedside Patient Units
142. PD: Pressure Drop or Difference
143. PDI: Plumbing and Drainage Institute
144. PH: Power of Hydrogen
145. PID: Proportional-Integral-Differential
146. PLC: Programmable Logic Controllers
147. PP: Polypropylene
148. ppb: Parts per Billion
149. ppm: Parts per Million
150. PSI: Pounds per Square Inch
151. PSIA: Pounds per Square Inch Atmosphere
152. PSIG: Pounds per Square Inch Gauge
153. PTFE: Polytetrafluoroethylene
154. PVC: Polyvinyl Chloride
155. PVDF: Polyvinylidene Fluoride

156. RAD: Radians
157. RO: Reverse Osmosis
158. RPM: Revolutions Per Minute
159. RTD: Resistance Temperature Detectors
160. RTRP: Reinforced Thermosetting Resin Pipe
161. SAN: Sanitary Sewer
162. SCFM: Standard Cubic Feet per Minute
163. SDI: Silt Density Index
164. SMACNA: Sheet Metal and Air Conditioning Contractors National Association
165. SPEC: Specification
166. SPS: Sterile Processing Services
167. SQFT/SF: Square Feet
168. SS: Stainless Steel
169. STD: Standard
170. SUS: Saybolt Universal Second
171. SWP: Steam Working Pressure
172. TD: Temperature Difference
173. TDH: Total Dynamic Head
174. TEFC: Totally Enclosed Fan-Cooled
175. TEMP: Temperature
176. TFE: Tetrafluoroethylene
177. THERM: 100,000 Btu
178. THHN: Thermoplastic High-Heat Resistant Nylon Coated Wire
179. THWN: Thermoplastic Heat & Water Resistant Nylon Coated Wire
180. TIL: Technical Information Library
http//www.cfm.va.gov/til/indes.asp
181. T/P: Temperature and Pressure
182. TYP: Typical
183. USDA: U.S. Department of Agriculture
184. V: Vent
185. V: Volt
186. VA: Veterans Administration
187. VA CFM: VA Construction & Facilities Management

188. VA CFM CSS: VA Construction & Facilities Management, Consulting Support Service
189. VAC: Vacuum
190. VAC: Voltage in Alternating Current
191. VAMC: Veterans Administration Medical Center
192. VHA OCAMES: This has been replaced by HEFP.
193. VSD: Variable Speed Drive
194. VTR: Vent through Roof
195. W: Waste
196. WAGD: Waste Anesthesia Gas Disposal
197. WC: Water Closet
198. WG: Water Gauge
199. WOG: Water, Oil, Gas
200. WPD: Water Pressure Drop
201. WSFU: Water Supply Fixture Units

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.
B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
C. Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT.
D. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
E. Section 05 50 00, METAL FABRICATIONS.
F. Section 07 60 00, FLASHING AND SHEET METAL: Flashing for Wall and Roof Penetrations.
G. Section 07 84 00, FIRESTOPPING.
H. Section 07 92 00, JOINT SEALANTS.
I. Section 09 91 00, PAINTING.
J. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT.
K. Section 22 07 11, PLUMBING INSULATION.
L. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
M. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES.
N. Section 26 29 11, MOTOR CONTROLLERS.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below will form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standard will govern.

B. American Society of Mechanical Engineers (ASME):
B31.1-2013.....Power Piping
ASME Boiler and Pressure Vessel Code -
BPVC Section IX-2019.... Welding, Brazing, and Fusing Qualifications

C. American Society for Testing and Materials (ASTM):
A36/A36M-2019.....Standard Specification for Carbon Structural Steel
A575-96(2013)e1.....Standard Specification for Steel Bars, Carbon, Merchant Quality, M-Grades
E84-2013a.....Standard Test Method for Surface Burning Characteristics of Building Materials
E119-2012a.....Standard Test Methods for Fire Tests of Building Construction and Materials

D. International Code Council, (ICC):
IBC-2018.....International Building Code
IPC-2018.....International Plumbing Code

E. Manufacturers Standardization Society (MSS) of the Valve and Fittings Industry, Inc:
SP-58-2018.....Pipe Hangers and Supports - Materials, Design, Manufacture, Selection, Application and Installation

F. Military Specifications (MIL):
P-21035B.....Paint High Zinc Dust Content, Galvanizing Repair (Metric)

G. National Electrical Manufacturers Association (NEMA):
MG 1-2016.....Motors and Generators

H. National Fire Protection Association (NFPA):

51B-2024.....Standard for Fire Prevention During Welding, Cutting and Other Hot Work

54-2024.....National Fuel Gas Code

70-2023.....National Electrical Code (NEC)

99-2024.....Healthcare Facilities Code

I. NSF International (NSF):

5-2019.....Water Heaters, Hot Water Supply Boilers, and Heat Recovery Equipment

14-2019.....Plastic Piping System Components and Related Materials

61-2019.....Drinking Water System Components – Health Effects

372-2016.....Drinking Water System Components – Lead Content

J. Department of Veterans Affairs (VA):

PG-18-102014(R18).....Plumbing Design Manual

PG-18-13-2017(R18).....Barrier Free Design Guide

1.4 SUBMITTALS

A. Submittals, including number of required copies, will be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Information and material submitted under this section will be marked "SUBMITTED UNDER SECTION 22 05 11, COMMON WORK RESULTS FOR PLUMBING", with applicable paragraph identification.

C. If the project is phased, contractors will submit complete phasing plan/schedule with manpower levels prior to commencing work. The phasing plan will be detailed enough to provide milestones in the process that can be verified.

D. Contractor will make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements, and all equipment that requires regular maintenance, calibration, etc are accessable from the floor or permanent work platform. It is the Contractor’s responsibility to ensure all submittals meet the VA specifications and requirements and

it is assumed by the VA that all submittals do meet the VA specifications unless the Contractor has requested a variance in writing and approved by COR prior to the submittal. If at any time during the project it is found that any item does not meet the VA specifications and there was no variance approval the Contractor will correct at no additional cost or time to the Government even if a submittal was approved.

E. If equipment is submitted which differs in arrangement from that shown, provide documentation proving equivalent performance, design standards and drawings that show the rearrangement of all associated systems. Additionally, any impacts on ancillary equipment or services such as foundations, piping, and electrical will be the Contractor’s responsibility to design, supply, and install at no additional cost or time to the Government. VA approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.

F. Prior to submitting shop drawings for approval, Contractor will certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.

G. Submittals and shop drawings for interdependent items, containing applicable descriptive information, will be furnished together and complete in a group. Coordinate and properly integrate materials and equipment in each group to provide a completely compatible and efficient installation. Final review and approvals will be made only by groups.

H. Manufacturer's Literature and Data including: Manufacturer’s literature will be submitted under the pertinent section rather than under this section.

1. Electric motor data and variable speed drive data will be submitted with the driven equipment.
2. Equipment and materials identification.
3. Firestopping materials.

4. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
5. Wall, floor, and ceiling plates.

I. Coordination/Shop Drawings:

1. Submit complete consolidated and coordinated shop drawings for all new systems, and for existing systems that are in the same areas.
2. The coordination/shop drawings will include plan views, elevations and sections of all systems and will be on a scale of not less than 1:32 (3/8-inch equal to 1 foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings will clearly show locations and adequate clearance for all equipment, piping, valves, control panels and other items. Show the access means for all items requiring access for operations and maintenance. Provide detailed coordination/shop drawings of all piping and duct systems. The drawings should include all lockout/tagout points for all energy/hazard sources for each piece of equipment. Coordinate lockout/tagout procedures and practices with local VA requirements.
3. Do not install equipment foundations, equipment or piping until coordination/shop drawings have been approved.
4. In addition, for plumbing systems, provide details of the following:
   a. Mechanical equipment rooms.
   b. Hangers, inserts, supports, and bracing.
   c. Pipe sleeves.
   d. Duct or equipment penetrations of floors, walls, ceilings, or roofs.

J. Rigging Plan: Provide documentation of the capacity and weight of the rigging and equipment intended to be used. The plan will include the path of travel of the load, the staging area and intended access, and qualifications of the operator and signal person.

K. Plumbing Maintenance Data and Operating Instructions:

1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.

2. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replacement parts, and troubleshooting guide:
   a. Include complete list indicating all components of the systems.
   b. Include complete diagrams of the internal wiring for each item of equipment.
   c. Diagrams will have their terminals identified to facilitate installation, operation and maintenance.
3. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment. Include in the listing belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.

L. Provide copies of approved plumbing equipment submittals to the TAB and Commissioning Subcontractor.
Completed System Readiness Checklist provided by the COR and completed by the Contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 22 08 00 COMMISSIONING OF PLUMBING SYSTEMS.

Submit training plans, trainer qualifications and instructor qualifications in accordance with the requirements of Section 22 08 00 COMMISSIONING OF PLUMBING SYSTEMS.

QUALITY ASSURANCE

M. Mechanical, electrical, and associated systems will be safe, reliable, efficient, durable, easily and safely operable and maintainable, easily and safely accessible, and in compliance with applicable codes as specified. The systems will be comprised of high quality institutional-class and industrial-class products of manufacturers that are experienced specialists in the required product lines. All construction firms and personnel will be experienced and qualified specialists in industrial and institutional plumbing.

N. Products Criteria:
1. Standard Products: Material and equipment will be the standard products of a manufacturer regularly engaged in the manufacture, supply and servicing of the specified products for at least 5 years.

However, digital electronics devices, software and systems such as controls, instruments, computer work station, will be the current generation of technology and basic design that has a proven satisfactory service record of at least 5 years.

2. Equipment Service: There will be permanent service organizations, authorized and trained by manufacturers of the equipment supplied, located within 160 km (100 miles) of the project. These organizations will come to the site and provide acceptable service to restore operations within 4 hours of receipt of notification by phone, e-mail or fax in event of an emergency, such as the shut-down of equipment; or within 24 hours in a non-emergency. Names, mail and e-mail addresses and phone numbers of service organizations providing service under these conditions for (as applicable to the project): pumps, compressors, water heaters, critical instrumentation, computer workstation and programming will be submitted for project record and inserted into the operations and maintenance manual.
3. All items furnished will be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
4. The products and execution of work specified in Division 22 will conform to the referenced codes and standards as required by the specifications. Local codes and amendments enforced by the local code official will be enforced, if required by local authorities such as the natural gas supplier. If the local codes are more stringent, then the local code will apply. Any conflicts will be brought to the attention of the Contracting Officers Representative (COR).
5. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units will be of the same manufacturer and model number, or if different models are required they will be of the same manufacturer and identical to the greatest extent possible (i.e., same model series).

6. Assembled Units: Performance and warranty of all components that make up an assembled unit will be the responsibility of the manufacturer of the completed assembly.
7. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark will be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
8. Asbestos products or equipment or materials containing asbestos is prohibited.
9. Bio-Based Materials: For products designated by the USDA's bio-based Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

O. Welding: Before any welding is performed, Contractor will submit a certificate certifying that welders comply with the following requirements:
1. Qualify welding processes and operators for piping according to ASME BPVC, Section IX, "Welding and Brazing Qualifications". Provide proof of current certification to CO.
2. Comply with provisions of ASME B31 series "Code for Pressure Piping".
3. Certify that each welder and welding operator has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
4. All welds will be stamped according to the provisions of the AWS or ASME as required herein and by the association code.

P. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations will be furnished to the COR prior to installation. Installation of the item will not be allowed to proceed

until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.

Q. Execution (Installation, Construction) Quality:

1. All items will be applied and installed in accordance with manufacturer's written instructions. Conflicts between the manufacturer's instructions and the contract documents will be referred to the COR for resolution. Printed copies or electronic files of manufacturer’s installation instructions will be provided to the COR at least 10 working days prior to commencing installation of any item.
2. All items that require access, such as for operating, cleaning, servicing, maintenance, and calibration, will be easily and safely accessible by persons standing at floor level, or standing on permanent platforms, without the use of portable ladders. Examples of these items include but are not limited to: all types of valves, filters and strainers, transmitters, and control devices. Prior to commencing installation work, refer conflicts between this requirement and contract documents to COR for resolution. Failure of the Contractor to resolve or call attention to any discrepancies or deficiencies to the COR will result in the Contractor correcting at no additional cost or time to the Government.
3. Complete layout drawings will be required by Paragraph, SUBMITTALS. Construction work will not start on any system until the layout drawings have been approved by VA.
4. Installer Qualifications: Installer will be licensed and will provide evidence of the successful completion of at least five projects of equal or greater size and complexity. Provide tradesmen skilled in the appropriate trade.
5. Workmanship/craftsmanship will be of the highest quality and standards. The VA reserves the right to reject any work based on poor quality of workmanship this work will be removed and done again at no additional cost or time to the Government.

R. Upon request by Government, provide lists of previous installations for selected items of equipment. Include contact persons who will serve as references, with current telephone numbers and e-mail addresses.

S. Guaranty: Warranty of Construction, FAR clause 52.246-21.

T. Plumbing Systems: IPC, International Plumbing Code. Unless otherwise required herein, perform plumbing work in accordance with the latest version of the IPC. For IPC codes referenced in the contract documents, advisory provisions will be considered mandatory, the word "should" will be interpreted as "will". Reference to the "code official" or "owner" will be interpreted to mean the COR.

U. Cleanliness of Piping and Equipment Systems:

1. Care will be exercised in the storage and handling of equipment and piping material to be incorporated in the work. Debris arising from cutting, threading and welding of piping will be removed.
2. Piping systems will be flushed, blown or pigged as necessary to deliver clean systems.
3. The interior of all tanks will be cleaned prior to delivery and beneficial use by the Government. All piping will be tested in accordance with the specifications and the International Plumbing Code (IPC). All filters, strainers, fixture faucets will be flushed of debris prior to final acceptance.
4. Contractor will be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

1.5 DELIVERY, STORAGE AND HANDLING

A. Protection of Equipment:

1. Equipment and material placed on the job site will remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage or theft.
2. Damaged equipment will be replaced with an identical unit as determined and directed by the COR. Such replacement will be at no additional cost or additional time to the Government.

3. Interiors of new equipment and piping systems will be protected against entry of foreign matter. Both inside and outside will be cleaned before painting or placing equipment in operation.
4. Existing equipment and piping being worked on by the Contractor will be under the custody and responsibility of the Contractor and will be protected as required for new work.
5. Protect plastic piping and tanks from ultraviolet light (sunlight) while in pre-construction. Plastic piping and tanks will not be installed exposed to sunlight without metal jacketing to block ultraviolet rays.

1.6 AS-BUILT DOCUMENTATION

A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.

B. Submit operation and maintenance data updated to include submittal review comments, VA approved substitutions and construction revisions will be in electronic version on CD or DVD inserted into a three—ring binder. All aspects of system operation and maintenance procedures, including applicable piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation will be included in the operation and maintenance manual. The operations and maintenance manual will include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices will be included. A List of recommended spare parts (manufacturer, model number, and quantity) will be furnished. Information explaining any special knowledge or tools the owner will be required to employ will be inserted into the As-Built documentation.

C. The installing Contractor will maintain as-built drawings of each completed phase for verification; and, will provide the complete set at the time of final systems certification testing. Should the installing Contractor engage the testing company to provide as-built or any portion thereof, it will not be deemed a conflict of interest or breach of the 'third party testing company' requirement. Provide record drawings as follows:

1. Red-lined, hand-marked drawings are to be provided, with one paper copy and a scanned PDF version of the hand-marked drawings. .
2. As-built drawings are to be provided, with a copy of them saved in the latest AutoCAD version. The CAD drawings will use multiple line layers with a separate individual layer for each system.
3. As-built drawings are to be provided, with a copy of them in three-dimensional Building Information Modeling (BIM) software version REVIT 2023 provided on CD or DVD.

D. The as-built drawings will indicate the location and type of all lockout/tagout points for all energy sources for all equipment and pumps to include breaker location and numbers, valve tag numbers, etc. Coordinate lockout/tagout procedures and practices with local VA requirements.

E. Certification documentation will be provided to COR 21 working days prior to submitting the request for final inspection. The documentation will include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and provide documentation/certification that all results of tests were within limits specified. Test results will contain written sequence of test procedure with written test results annotated at each step along with the expected outcome or setpoint. The results will include all readings, including but not limited to data on device (make, model and performance characteristics_), normal pressures, switch ranges, trip points, amp readings, and calibration data to include equipment serial numbers or individual identifications, etc.

1.7 JOB CONDITIONS – WORK IN EXISTING BUILDING

A. Building Operation: Government employees will be continuously operating and managing all facilities, including temporary facilities that serve the VAMC.

B. Maintenance of Service: Schedule all work to permit continuous service as required by the VAMC.

C. Steam and Condensate Service Interruptions: Limited steam and condensate service interruptions, as required for interconnections of new and existing systems, will be permitted by the COR during periods

when the demands are not critical to the operation of the VAMC. These non-critical periods are limited to between 8 pm and 5 am in the appropriate off-season (if applicable). Provide at least 10 working days advance notice to the COR. The request will include a detailed plan on the proposed shutdown and the intended work to be done along with manpower levels. All equipment and materials must be onsite and verified with plan 5 work days prior to the shutdown or it will need to be rescheduled.

D. Phasing of Work: Comply with all requirements shown on contract documents. Contractor will submit a complete detailed phasing plan/schedule with manpower levels prior to commencing work. The phasing plan will be detailed enough to provide milestones in the process that can be verified.

E. Building Working Environment: Maintain the architectural and structural integrity of the building and the working environment at all times. Maintain the interior of building at 18 degrees C (65 degrees F) minimum. Limit the opening of doors, windows or other access openings to brief periods as necessary for rigging purposes. Storm water or ground water leakage is prohibited. Provide daily clean-up of construction and demolition debris on all floor surfaces and on all equipment being operated by VA. Maintain all egress routes and safety systems/devices.

F. Acceptance of Work for Government Operation: As new equipment, systems and facilities are made available for operation and these items are deemed of beneficial use to the Government, inspections and tests will be performed. Based on the inspections, a list of contract deficiencies will be issued to the Contractor. After correction of deficiencies as necessary for beneficial use, the Contracting Officer will process necessary acceptance and the equipment will then be under the control and operation of Government personnel.

G. Temporary Facilities: Refer to Paragraph, TEMPORARY PIPING AND EQUIPMENT in this section.

PART 2 - PRODUCTS

2.1 MATERIALS FOR VARIOUS SERVICES

A. Steel pipe will contain a minimum of 25 percent recycled content.

B. Plastic pipe, fittings and solvent cement will meet NSF 14 and will bear the NSF seal "NSF-PW". Polypropylene pipe and fittings will comply with NSF 14 and NSF 61. Solder or flux containing lead will not be used with copper pipe.

C. Material or equipment containing a weighted average of greater than 0.25 percent lead will not be used in any potable water system intended for human consumption and will be certified in accordance with NSF 61 or NSF 372.

D. In-line devices such as water meters, building valves, check valves, stops, valves, fittings, tanks and backflow preventers will comply with NSF 61 and NSF 372.

E. End point devices such as drinking fountains, lavatory faucets, kitchen and bar faucets, ice makers supply stops, and end-point control valves used to dispense drinking water must meet requirements of NSF 61 and NSF 372.

2.2 FACTORY-ASSEMBLED PRODUCTS

A. Standardization of components will be maximized to reduce spare part requirements.

B. Manufacturers of equipment assemblies that include components made by others will assume complete responsibility for final assembled unit.

1. All components of an assembled unit need not be products of same manufacturer.
2. Constituent parts that are alike will be products of a single manufacturer.
3. Components will be compatible with each other and with the total assembly for intended service.
4. Contractor will guarantee performance of assemblies of components and will repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly at no additional cost or time to the Government.

C. Components of equipment will bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.

D. Major items of equipment, which serve the same function, will be the same make and model.

2.3 COMPATIBILITY OF RELATED EQUIPMENT

A. Equipment and materials installed will be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational system that conforms to contract requirements.

2.4 SAFETY GUARDS

A. Pump shafts and couplings will be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material will be minimum 16-gauge sheet steel; ends will be braked and drilled and attached to pump base with minimum of four 8 mm (1/4 inch) bolts. Reinforce guard as necessary to prevent side play forcing guard onto couplings.

B. All Equipment will have moving parts protected from personal injury.

2.5 LIFTING ATTACHMENTS

A. Equipment will be provided with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments will withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

2.6 ELECTRIC MOTORS, MOTOR CONTROL, CONTROL WIRING

A. All material and equipment furnished and installation methods used will conform to the requirements of Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT; Section 26 29 11, MOTOR CONTROLLERS; and, Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES. All electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems will be provided. Premium efficient motors will be provided. Unless otherwise specified for a particular application, electric motors will have the following requirements.

B. Special Requirements:

1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 at no additional cost or time to the Government.
2. Assemblies of motors, starters, and controls and interlocks on factory assembled and wired devices will be in accordance with the requirements of this specification.
3. Wire and cable materials specified in the electrical division of the specifications will be modified as follows:
   a. Wiring material located where temperatures can exceed 71° C (160° F) will be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers and water heaters.
   b. Other wiring at boilers and water heaters, and to control panels, will be NFPA 70 designation THWN.
   c. Shielded conductors or wiring in separate conduits for all instrumentation and control systems will be provided where recommended by manufacturer of equipment.
4. Motor sizes will be selected so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps will be sized for non-overloading at all points on the pump performance curves.
5. Motors utilized with variable frequency drives will be rated "inverter-ready" per NEMA Standard, MG1.

C. Motor Efficiency and Power Factor: All motors, when specified as "high efficiency or Premium Efficiency" by the project specifications on driven equipment, will conform to efficiency and power factor requirements in Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT, with no consideration of annual service hours. Motor manufacturers generally define these efficiency requirements as "NEMA premium efficient" and the requirements generally exceed those of the Energy Policy Act (EPACT), revised 2005. Motors not specified as "high efficiency or premium efficient" will comply with EPACT.

D. Single-phase Motors: Capacitor-start type for hard starting applications. Motors for centrifugal pumps may be split phase or permanent split capacitor (PSC).

E. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type. Each two-speed motor will have two separate windings. A time delay (20 seconds minimum) relay will be provided for switching from high to low speed.

F. Rating: Rating will be continuous duty at 100 percent capacity in an ambient temperature of 40° C (104° F); minimum horsepower as shown on drawings; maximum horsepower in normal operation will not exceed nameplate rating without service factor.

G. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame will be measured at the time of final inspection.

2.7 VARIABLE SPEED MOTOR CONTROLLERS

A. Refer to Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS and Section 26 29 11, MOTOR CONTROLLERS for specifications.

B. The combination of controller and motor will be provided by the respective pump manufacturer and will be rated for 100 percent output performance. Multiple units of the same class of equipment, i.e. pumps, will be product of a single manufacturer.

C. Motors will be premium efficient type, “invertor duty”, and be approved by the motor controller manufacturer. The controller-motor combination will be guaranteed to provide full motor nameplate horsepower in variable frequency operation. Both driving and driven motor sheaves will be fixed pitch.

D. Controller will not add any current or voltage transients to the input AC power distribution system, DDC controls, sensitive medical equipment, etc., nor will be affected from other devices on the AC power system.

2.8 EQUIPMENT AND MATERIALS IDENTIFICATION

A. Use symbols, nomenclature and equipment numbers specified, shown in the drawings, or shown in the maintenance manuals. Coordinate equipment and valve identification with local VAMC shops. In addition, provide bar code identification nameplate for all equipment which will allow the

equipment identification code to be scanned into the system for maintenance and inventory tracking. Identification for piping is specified in Section 09 91 00, PAINTING.

B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 7 mm (3/16 inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING will be permanently fastened to the equipment. Unit components such as water heaters, tanks, coils, filters, etc. will be identified.

C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 7 mm (3/16 inch) high riveted or bolted to the equipment.

D. Control Items: All temperature, pressure, and controllers will be labeled and the component’s function identified. Identify and label each item as they appear on the control diagrams.

E. Valve Tags and Lists:

1. Plumbing: All valves will be provided with valve tags and listed on a valve list (Fixture stops not included).
2. Valve tags: Engraved black filled numbers and letters not less than 15 mm (1/2 inch) high for number designation, and not less than 8 mm (1/4 inch) for service designation on 19 gauge, 40 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
3. Valve lists: Valve lists will be created using a word processing program and printed on plastic coated cards. The plastic-coated valve list card(s), sized 215 mm (8-1/2 inches) by 275 mm (11 inches) will show valve tag number, valve function and area of control for each service or system. The valve list will be in a punched 3-ring binder notebook. An additional copy of the valve list will be mounted in picture frames for mounting to a wall. COR will instruct Contractor where frames will be mounted.
4. A detailed plan for each floor of the building indicating the location and valve number for each valve will be provided in the 3-ring binder notebook. Each valve location will be identified with a color-coded sticker or thumb tack in ceiling or access door.

2.9 FIRESTOPPING

A. Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping. Refer to Section 22 07 11, PLUMBING INSULATION, for pipe insulation.

2.10 GALVANIZED REPAIR COMPOUND

A. Mil. Spec. DOD-P-21035B, paint.

2.11 PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS

A. In lieu of the paragraph which follows, suspended equipment support and restraints may be designed and installed in accordance with the International Building Code (IBC) Submittals based on the International Building Code (IBCrequirements, or the following paragraphs of this Section will be stamped and signed by a professional engineer registered in the state where the project is located. The Support system of suspended equipment over 227 kg (500 pounds) will be submitted for approval of the COR in all cases. See the above specifications for lateral force design requirements.

B. Type Numbers Specified: For materials, design, manufacture, selection, application, and installation refer to MSS SP-58. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting.

C. For Attachment to Concrete Construction:

1. Concrete insert: Type 18, MSS SP-58.
2. Self-drilling expansion shields and machine bolt expansion anchors: Permitted in concrete not less than 100 mm (4 inches) thick when approved by the COR for each job condition.
3. Power-driven fasteners: Permitted in existing concrete or masonry not less than 100 mm (4 inches) thick when approved by the COR for each job condition.

D. For Attachment to Steel Construction: MSS SP-58.

1. Welded attachment: Type 22.
2. Beam clamps: Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23 mm (7/8 inch) outside diameter.

E. Attachment to Metal Pan or Deck: As required for materials specified in Section 05 31 00, STEEL DECKING. Section 05 36 00, COMPOSITE METAL DECKING.

F. For Attachment to Wood Construction: Wood screws or lag bolts.

G. Hanger Rods: Hot-rolled steel, ASTM A36/A36M or ASTM A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles will provide 40 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.

H. Multiple (Trapeze) Hangers: Galvanized, cold formed, lipped steel channel horizontal member, not less than 43 mm by 43 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (No. 12 gauge), designed to accept special spring held, hardened steel nuts.

1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).
2. Guide individual pipes on the horizontal member of every other trapeze hanger with 8 mm (1/4 inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 15 mm (1/2 inch) galvanized steel bands, or insulated calcium silicate shield for insulated piping at each hanger.

I. Pipe Hangers and Supports: (MSS SP-58), use hangers sized to encircle insulation on insulated piping. Refer to Section 22 07 11, PLUMBING INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or insulated calcium silicate shields. Provide Type 40 insulation shield or insulated calcium silicate shield at all other types of supports and hangers including those for insulated piping.

1. General Types (MSS SP-58):
   a. Standard clevis hanger: Type 1; provide locknut.
   b. Riser clamps: Type 8.
   c. Wall brackets: Types 31, 32 or 33.
   d. Roller supports: Type 41, 43, 44 and 46.
   e. Saddle support: Type 36, 37 or 38.
   f. Turnbuckle: Types 13 or 15.
   g. U-bolt clamp: Type 24.

h. Copper Tube:
   1) Hangers, clamps and other support material in contact with tubing will be painted with copper colored epoxy paint, copper-coated, plastic coated or taped with isolation tape to prevent electrolysis.
   2) For vertical runs use epoxy painted, copper-coated or plastic coated riser clamps.
   3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
   4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.

2. Plumbing Piping (Other Than General Types):
   a. Horizontal piping: Type 1, 5, 7, 9, and 10.
   b. Chrome plated piping: Chrome plated supports.
   c. Hangers and supports in pipe chase: Prefabricated system ABS self-extinguishing material, not subject to electrolytic action, to hold piping, prevent vibration and compensate for all static and operational conditions.
   d. Blocking, stays and bracing: Angle iron or preformed metal channel shapes, 1.3 mm (18 gauge) minimum.

J. Pre-insulated Calcium Silicate Shields:
   1. Provide 360-degree water resistant high density 965 kPa (140 psig) compressive strength calcium silicate shields encased in galvanized metal.
   2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
   3. Shield thickness will match the pipe insulation.
   4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
      a. Shields for supporting cold water will have insulation that extends a minimum of 25 mm (1 inch) past the sheet metal.
      b. The insulated calcium silicate shield will support the maximum allowable water filled span as indicated in MSS SP-58. To support

the load, the shields will have one or more of the following features: structural inserts 4138 kPa (600 psig) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36/A36M) wear plates welded to the bottom sheet metal jacket.

5. Shields may be used on steel clevis hanger type supports, trapeze hangers, roller supports or flat surfaces.

K. Seismic Restraint of Piping: Refer to Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

2.12 PIPE PENETRATIONS

A. Pipe penetration sleeves will be installed for all pipe other than rectangular blocked out floor openings for risers in mechanical bays.

B. Pipe penetration sleeve materials will comply with all firestopping requirements for each penetration.

C. To prevent accidental liquid spills from passing to a lower level, provide the following:

1. For sleeves: Extend sleeve 25 mm (1 inch) above finished floor and provide sealant for watertight joint.
2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.

D. Penetrations are prohibited through beams or ribs, but may be installed in concrete beam flanges, with structural engineer prior approval. Any deviation from these requirements must receive prior approval of COR.

E. Sheet metal, plastic, or moisture resistant fiber sleeves will be provided for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.

F. Cast iron or zinc coated pipe sleeves will be provided for pipe passing through exterior walls below grade. The space between the sleeve and pipe will be made watertight with a modular or link rubber seal. The link seal will be applied at both ends of the sleeve.

G. Galvanized steel or an alternate black iron pipe with asphalt coating sleeves will be for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. A galvanized steel sleeve will be provided for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, sleeves will be connected with a floor plate.

H. Brass Pipe Sleeves will be provided for pipe passing through quarry tile, terrazzo or ceramic tile floors. The sleeve will be connected with a floor plate.

I. Sleeve clearance through floors, walls, partitions, and beam flanges will be 25 mm (1 inch) greater in diameter than external diameter of pipe. Sleeve for pipe with insulation will be large enough to accommodate the insulation plus 25 mm (1 inch) in diameter. Interior openings will be caulked tight with firestopping material and sealant to prevent the spread of fire, smoke, water and gases.

J. Sealant and Adhesives: Will be as specified in Section 07 92 00, JOINT SEALANTS. Bio-based materials will be utilized when possible.

K. Pipe passing through roof will be installed through a 4.9 kg per square meter copper flashing with an integral skirt or flange. Skirt or flange will extend not less than 200 mm (8 inches) from the pipe and set in a solid coating of bituminous cement. Extend flashing a minimum of 250 mm (10 inches) up the pipe. Pipe passing through a waterproofing membrane will be provided with a clamping flange. The annular space between the sleeve and pipe will be sealed watertight.

2.13 TOOLS AND LUBRICANTS

A. Furnish, and turn over to the COR, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.

B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.

C. Tool Containers: metal, permanently identified for intended service and mounted, or located, where directed by the COR.

D. Lubricants: A minimum of 0.95 L (1 quart) of oil, and 0.45 kg (1 pound) of grease, of equipment manufacturer's recommended grade and type, in

unopened containers and properly identified as to use for each different application. Bio-based materials will be utilized when possible.

2.14 WALL, FLOOR AND CEILING PLATES

A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.

B. Thickness: Not less than 2.4 mm (3/32 inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025 inch) for up to 75 mm (3 inch) pipe, 0.89 mm (0.035 inch) for larger pipe.

C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Wall plates will be used where insulation ends on exposed water supply pipe drop from overhead. A watertight joint will be provided in spaces where brass or steel pipe sleeves are specified.

2.15 ASBESTOS

A. Materials containing asbestos are prohibited.

PART 3 - EXECUTION

3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING

A. Location of piping, sleeves, inserts, hangers, and equipment, access provisions will be coordinated with the work of all trades. Piping, sleeves, inserts, hangers, and equipment will be located clear of windows, doors, openings, light outlets, and other services and utilities. Equipment layout drawings will be prepared to coordinate proper location and personnel access of all facilities. The drawings will be submitted for review.

B. Manufacturer's published recommendations will be followed for installation methods not otherwise specified.

C. Operating Personnel Access and Observation Provisions: All equipment and systems will be arranged to provide clear view and easy access, without use of portable ladders, for maintenance, testing and operation of all devices including, but not limited to: all equipment items, valves, backflow preventers, filters, strainers, transmitters, sensors,

meters and control devices. All gauges and indicators will be clearly visible by personnel standing on the floor or on permanent platforms. Maintenance and operating space and access provisions that are shown in the drawings will not be changed nor reduced.

D. Structural systems necessary for pipe and equipment support will be coordinated to permit proper installation.

E. Location of pipe sleeves, trenches and chases will be accurately coordinated with equipment and piping locations.

F. Cutting Holes:

1. Holes will be located to avoid interference with structural members such as beams or grade beams. Holes will be laid out in advance and drilling done only after approval by COR. If the Contractor considers it necessary to drill through structural members, this matter will be referred to COR for approval.
2. Waterproof membrane will not be penetrated. Pipe floor penetration block outs will be provided outside the extents of the waterproof membrane.
3. Holes through concrete and masonry will be cut by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by COR where working area space is limited.

G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other services are not shown but must be provided.

H. Protection and Cleaning:

1. Equipment and materials will be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the COR. Damaged or defective items in the opinion of the COR, will be replaced at no additional cost or time to the Government.
2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with

caps or plugs during installation. Pipe openings, equipment, and plumbing fixtures will be tightly covered against dirt or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.

I. Concrete and Grout: Concrete and shrink compensating grout 25 MPa (3000 psig) minimum, specified in Section 03 30 00, CAST-IN-PLACE CONCRETE, will be used for all pad or floor mounted equipment.

J. Gauges, thermometers, valves and other devices will be installed with due regard for ease in reading or operating and maintaining said devices. Thermometers and gauges will be located and positioned to be easily read by operator or staff standing on floor or walkway provided. Servicing will not require dismantling adjacent equipment or pipe work.

K. Interconnection of Controls and Instruments: Electrical interconnection is generally not shown but will be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, alarms, instruments and computer workstations. Comply with NFPA 70.

L. Domestic cold and hot water systems interface with the HVAC control system for the temperature, pressure and flow monitoring requirements to mitigate legionella. See the HVAC control points list and Section 23 09 23, DIRECT DIGITAL CONTROL SYSTEM FOR HVAC.

M. Work in Existing Building:

1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will cause the least interfere with normal operation of the facility.

N. Work in Animal Research Areas: Seal all pipe penetrations with silicone sealant to prevent entrance of insects.

O. Work in bathrooms, restrooms, housekeeping closets: All pipe penetrations behind escutcheons will be sealed with plumbers’ putty.

P. Switchgear Drip Protection: Every effort will be made to eliminate the installation of pipe above data equipment, and electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints. Drain valve will be provided in low point of casement pipe.

Q. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment will be removed and reinstalled or remedial action performed as directed at no additional cost or additional time to the Government.
2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as electrical conduit, motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

3.2 TEMPORARY PIPING AND EQUIPMENT

A. Continuity of operation of existing facilities may require temporary installation or relocation of equipment and piping. Temporary equipment or pipe installation or relocation will be provided to maintain continuity of operation of existing facilities.

B. The Contractor will provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment will be properly supported, sloped to drain, operate without excessive stress, and will be insulated where injury can occur to personnel by contact with operating facilities. The requirements of paragraph 3.1 will apply.

C. Temporary facilities and piping will be completely removed back to the nearest active distribution branch or main pipe line and any openings in structures sealed. Dead legs are prohibited in potable water systems. Necessary blind flanges and caps will be provided to seal open piping remaining in service.

3.3 RIGGING

A. Openings in building structures will be planned to accommodate design scheme.

B. Alternative methods of equipment delivery may be offered and will be considered by Government under specified restrictions of phasing and service requirements as well as structural integrity of the building.

C. All openings in the building will be closed when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.

D. Contractor will provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures will be Contractor's full responsibility.

E. Contractor will check all clearances, weight limitations and will provide a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, will be at Contractor's cost, time and responsibility.

F. Rigging plan and methods will be referred to COR for evaluation prior to actual work.

3.4 PIPE AND EQUIPMENT SUPPORTS

A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Holes will be drilled or burned in structural steel ONLY with the prior written approval of the COR.

B. The use of chain pipe supports, wire or strap hangers; wood for blocking, stays and bracing, or hangers suspended from piping above will not be permitted. Rusty products will be replaced.

C. Hanger rods will be used that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. A minimum of 15 mm (1/2 inch) clearance between pipe or piping covering and adjacent work will be provided.

D. For horizontal and vertical plumbing pipe supports, refer to the International Plumbing Code (IPC) and these specifications.

E. Overhead Supports:

1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
3. Tubing and capillary systems will be supported in channel troughs.

F. Floor Supports:

1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Concrete bases and structural systems will be anchored and doweled to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
2. Bases and supports will not be located and installed until equipment mounted thereon has been approved. Bases will be sized to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Structural drawings will be reviewed for additional requirements. Bases will be neatly finished and smoothed, will have chamfered edges at the top, and will be suitable for painting.
3. All equipment will be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts will be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a grout material to permit alignment and realignment.
4. For seismic anchoring, refer to Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

3.5 LUBRICATION

A. All equipment and devices requiring lubrication will be lubricated prior to initial operation. All devices and equipment will be field checked for proper lubrication.

B. All devices and equipment will be equipped with required lubrication fittings. A minimum of 1 liter (1 quart) of oil and 0.45 kg (1 pound) of grease of manufacturer's recommended grade and type for each

different application will be provided. All materials will be delivered to COR in unopened containers that are properly identified as to application.

C. A separate grease gun with attachments for applicable fittings will be provided for each type of grease applied.

D. All lubrication points will be accessible without disassembling equipment, except to remove access plates.

E. All lubrication points will be extended to one side of the equipment.

3.6 PLUMBING SYSTEMS DEMOLITION

A. Rigging access, other than indicated in the drawings, will be provided after approval for structural integrity by the COR. Such access will be provided at no additional cost or time to the Government. Where work is in an operating plant, approved protection from dust and debris will be provided at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.

B. In an operating plant, cleanliness and safety will be maintained. The plant will be kept in an operating condition. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation. Work will be confined to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Dust and debris will not be permitted to accumulate in the area to the detriment of plant operation. All flame cutting will be performed to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities will be available at all times. All work will be performed in accordance with recognized fire protection standards including NFPA 51B. Inspections will be made by personnel of the VAMC, and the Contractor will follow all directives of the COR with regard to rigging, safety, fire safety, and maintenance of operations.

C. Unless specified otherwise, all piping, wiring, conduit, and other devices associated with the equipment not re-used in the new work will be completely removed from Government property per Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT. This includes all concrete equipment pads, pipe, valves, fittings, insulation, and all hangers including the

top connection and any fastenings to building structural systems. All openings will be sealed after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically covered. Structural integrity of the building system will be maintained. Reference will also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.

D. All valves including gate, globe, ball, butterfly and check, all pressure gauges and thermometers with wells will remain Government property and will be removed and delivered to COR and stored as directed. The Contractor will remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material will be removed from Government property expeditiously and will not be allowed to accumulate. Coordinate with the COR and Infection Control.

3.7 CLEANING AND PAINTING

A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems will be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.

B. In addition, the following special conditions apply:

1. Cleaning will be thorough. Solvents, cleaning materials and methods recommended by the manufacturers will be used for the specific tasks. All rust will be removed prior to painting and from surfaces to remain unpainted. Scratches, scuffs, and abrasions will be repaired prior to applying prime and finish coats.
2. The following Material and Equipment will NOT be painted:
   a. Motors, controllers, control switches, and safety switches.
   b. Control and interlock devices.
   c. Regulators.
   d. Pressure reducing valves.
   e. Control valves and thermostatic elements.
   f. Lubrication devices and grease fittings.

g. Copper, brass, aluminum, stainless steel and bronze surfaces.
h. Valve stems and rotating shafts.
i. Pressure gauges and thermometers.
j. Glass.
k. Name plates.

3. Control and instrument panels will be cleaned and damaged surfaces repaired. Touch-up painting will be made with matching paint type and color obtained from manufacturer or computer matched.
4. Pumps, motors, steel and cast-iron bases, and coupling guards will be cleaned, and will be touched-up with the same paint type and color as utilized by the pump manufacturer.
5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats per Section 09 91 00, Painting.
6. The final result will be a smooth, even-colored, even-textured factory finish on all items. The entire piece of equipment will be repainted, if necessary, to achieve this. Lead based paints will not be used.

3.8 IDENTIFICATION SIGNS

A. Laminated plastic signs, with engraved lettering not less than 7 mm (3/16 inch) high, will be provided that designates equipment function, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols will correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.

B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, and performance data will be placed on factory-built equipment.

C. Pipe Identification: Refer to Section 09 91 00, PAINTING.

3.9 STARTUP AND TEMPORARY OPERATION

A. Startup of equipment will be performed as described in the equipment specifications. Vibration within specified tolerance will be verified prior to extended operation. Temporary use of equipment is specified in

Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

3.10 OPERATING AND PERFORMANCE TESTS

A. Prior to the final inspection, all required tests will be performed as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the COR.

B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.

C. When completion of certain work or systems occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then conduct such performance tests and finalize control settings during the first actual seasonal use of the respective systems following completion of work. Rescheduling of these tests will be requested in writing to COR for approval.

D. Perform tests as required for commissioning provisions in accordance with Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS and Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

3.11 OPERATION AND MAINTENANCE MANUALS

A. All new and temporary equipment and all elements of each assembly will be included.

B. Data sheet on each device listing model, size, capacity, pressure, speed, horsepower, impeller size, and other information will be included.

C. Manufacturer’s installation, maintenance, repair, and operation instructions for each device will be included. Assembly drawings and parts lists will also be included. A summary of operating precautions and reasons for precautions will be included in the Operations and Maintenance Manual.

D. Lubrication instructions, type and quantity of lubricant will be included.

E. Schematic diagrams and wiring diagrams of all control systems corrected to include all field modifications will be included.

F. Set points of all interlock devices will be listed.

G. Trouble-shooting guide for the control system troubleshooting will be inserted into the Operations and Maintenance Manual.

H. The control system sequence of operation corrected with submittal review comments will be inserted into the Operations and Maintenance Manual.

I. Emergency procedures for shutdown and startup of equipment and systems.

3.12 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.13 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer’s technical representative for 4 hours to instruct each VA personnel responsible in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

SECTION 22 05 12
GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT

PART 1 - GENERAL

1.1 **DESCRIPTION**

A. This section describes the general motor requirements for plumbing equipment and applies to all sections of Division 22.

B. A complete listing of common acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.2 **RELATED WORK**

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

E. Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

F. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

G. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

H. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES.

I. Section 26 24 19, MOTOR-CONTROL CENTERS: Motor Control Centers.

J. Section 26 29 11, MOTOR CONTROLLERS: Starters, control and protection of motors.

1.3 **APPLICABLE PUBLICATIONS**

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and VHA standard will govern.

B. American Bearing Manufacturers Association (ABMA):

ABMA 9-2015.....Load Ratings and Fatigue Life for Ball Bearings

C. Institute of Electrical and Electronics Engineers, Inc. (IEEE):

112-2017.....IEEE Standard Test Procedure for Polyphase Induction Motors and Generators

841-2018.....IEEE Standard for Petroleum and Chemical Industry-Premium-Efficiency, Severe-Duty, Totally Enclosed Fan-Cooled (TEFC) Squirrel

Cage Induction Motors--Up to and Including 370 kW (500 HP)

D. International Code Council (ICC):

IPC-2018.....International Plumbing Code

E. National Electrical Manufacturers Association (NEMA):

MG 1-2016.....Motors and Generators

MG 2-2014.....Safety Standard for Construction and Guide for Selection, Installation and Use of Electric Motors and Generators

250-2018.....Enclosures for Electrical Equipment (1000 Volts Maximum)

F. National Fire Protection Association (NFPA):

70-2020.....National Electrical Code (NEC)

1.4 **SUBMITTALS**

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT", with applicable paragraph identification.

C. Submit motor submittals with drive equipment.

D. Shop Drawings:

1. Provide documentation to demonstrate compliance with contract documents.
2. Motor nameplate information shall be submitted including electrical ratings, efficiency, bearing data, power factor, frame size, dimensions, mounting details, materials, horsepower, voltage, phase, speed (RPM), enclosure, starting characteristics, torque characteristics, code letter, full load and locked rotor current, service factor, and lubrication method.
3. Motor parameters required for the determination of the Reed Critical Frequency of vertical hollow shaft motors shall be submitted.

E. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

F. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replaceable parts and troubleshooting guide:

1. Include complete list indicating all components of the systems.
2. Include complete diagrams of the internal wiring for each item of equipment.
3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.

G. Certification: Two weeks prior to final inspection, unless otherwise noted, the following certification shall be submitted to the Contracting Officer’s Representative (COR).

1. Certification shall be submitted stating that the motors have been properly applied, installed, adjusted, lubricated, and tested.

1.5 **QUALITY ASSURANCE**

A. Bio-Based Materials: For products designated by the USDA’s bio-based Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

B. Refer to Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for additional sustainable design requirements.

1.6 **AS-BUILT DOCUMENTATION**

A. Comply with requirements in Paragraph “AS-BUILT DOCUMENTATION” of Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

PART 2 - PRODUCTS

2.1 **MOTORS**

A. All material and equipment furnished and installation methods shall conform to the requirements of Section 26 29 11, MOTOR CONTROLLERS; and Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER

CONDUCTORS AND CABLES. Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide premium efficiency type motors. Unless otherwise specified for a particular application, use electric motors with the following requirements.

B. For alternating current, fractional and integral horsepower motors, NEMA MG 1 and NEMA MG 2 shall apply.

C. For severe duty totally enclosed motors, IEEE 841 shall apply. For severe duty totally enclosed motors, IEEE 841 shall apply.

D. Single-phase Motors: Motors for centrifugal fans and pumps may be split phase or permanent split capacitor (PSC) type. Provide capacitor-start type for hard starting applications.

E. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type.

1. Two Speed Motors: Each two-speed motor shall have two separate windings. Provide a time- delay (20 seconds minimum) relay for switching from high to low speed.

F. Voltage ratings shall be as follows:

1. Single phase:
   a. Motors connected to 120-volt systems: 115 volts.
   b. Motors connected to 208-volt systems: 200 volts.
   c. Motors connected to 240-volt or 480-volt systems: 230/460 volts, dual connection.
2. Three phase:
   a. Motors connected to 208-volt systems: 200 volts.
   b. Motors, less than 74.6 kW (100 HP), connected to 240-volt or 480-volt systems: 230/460 volts, dual connection.
   c. Motors, 74.6 kW (100 HP) or greater, connected to 240-volt systems: 230 volts.
   d. Motors, 74.6 kW (100 HP) or greater, connected to 480-volt systems: 460 volts.
   e. Motors connected to high voltage systems (Over 600V): Shall conform to NEMA MG 1 for connection to the nominal system voltage shown in the drawings.

G. Number of phases shall be as follows:

1. Motors, less than 373 W (1/2 HP): Single phase.
2. Motors, 373 W (1/2 HP) and greater: 3 phase.

3. Exceptions:
   a. Hermetically sealed motors.
   b. Motors for equipment assemblies, less than 746 W (1 HP), may be single phase provided the manufacturer of the proposed assemblies cannot supply the assemblies with three phase motors.

H. Horsepower ratings shall be adequate for operating the connected loads continuously in the prevailing ambient temperatures in areas where the motors are installed, without exceeding the NEMA standard temperature rises for the motor insulation.

I. Motor designs, as indicated by the NEMA code letters, shall be coordinated with the connected loads to assure adequate starting, acceleration and running torque without exceeding nameplate ratings or considering service factor.

J. Motor Enclosures:
   1. Shall be the NEMA types as specified and/or shown in the Contract Documents.
   2. Where the types of motor enclosures are not shown in the drawings, they shall be the NEMA types per NEMA 250, which are most suitable for the environmental conditions where the motors are being installed. Enclosure requirements for certain conditions are as follows:
      a. Motors located outdoors, indoors in wet or high humidity locations, or in unfiltered airstreams shall be totally enclosed type.
      b. Where motors are located in an NEC 511 classified area, provide TEFC explosion proof motor enclosures.
      c. Where motors are located in a corrosive environment, provide TEFC enclosures with corrosion resistant finish.
   3. Enclosures shall be primed and finish coated at the factory with manufacturer's prime coat and standard finish.

K. Electrical Design Requirements:
   1. Motors shall be continuous duty.
   2. The insulation system shall be rated minimum of Class B, 130 degrees C (266 degrees F).

3. The maximum temperature rise by resistance at rated power shall not exceed Class B limits, 80 degrees C (144 degrees F).
4. The speed/torque and speed/current characteristics shall comply with NEMA Design A or B, as specified.
5. Motors shall be suitable for full voltage starting, unless otherwise noted. Coordinate motor features with applicable motor controllers.
6. Motors for variable frequency drive applications shall adhere to NEMA MG 1, Part 30, Application Considerations for Constant Speed Motors Used on a Sinusoidal Bus with Harmonic Content and General Purpose Motors Used with Adjustable Voltage or Adjustable Frequency Controls, or both, or NEMA MG 1, Part 31, Definite Purpose Inverter Fed Polyphase Motors.

L. Mechanical Design Requirements:

1. Bearings shall be rated for a minimum fatigue life of 26,280 hours for belt-driven loads and 100,000 hours for direct-drive loads based on L10 (Basic Rating Life) at full load direct coupled, except vertical high thrust motors which require a 40,000 hour rating. A minimum fatigue life of 40,000 hours is required for VFD drives.
2. Vertical motors shall be capable of withstanding a momentary up thrust of at least 30 percent of normal down thrust.
3. Grease lubricated bearings shall be designed for electric motor use. Grease shall be capable of the temperatures associated with electric motors and shall be compatible with Polyurea based greases.
4. Grease fittings, if provided, shall be Alemite type or equivalent.
5. Oil lubricated bearings, when specified, shall have an externally visible sight glass to view oil level.
6. Vibration shall not exceed 3.8 mm (0.15 inch) per second, unfiltered peak.
7. Noise level shall meet the requirements of the application.
8. Motors on 180 frames and larger shall have provisions for lifting eyes or lugs capable of a safety factor of 5.
9. All external fasteners shall be corrosion resistant.

10. Condensation heaters, when specified, shall keep motor windings at least 5 degrees C (9 degrees F) above ambient temperature.
11. Winding thermostats, when specified shall be normally closed, connected in series.
12. Grounding provisions shall be in the main terminal box.

M. Special Requirements:

1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional cost or time to the Government.
2. Assemblies of motors, starters, controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:
   a. Wiring material located where temperatures can exceed 71 degrees C (160 degrees F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers.
   b. Other wiring at boilers and to control panels shall be NFPA 70 designation THWN.
   c. Provide shielded conductors or wiring in separate conduits for all instrumentation and control systems where recommended by manufacturer of equipment.
4. Select motor sizes so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
5. Motors utilized with variable frequency drives shall be rated “inverter-duty” per NEMA MG 1, Part 31, Definite-Purpose Inverter-Fed Polyphase Motors. Provide motor shaft grounding apparatus that will protect bearings from damage from stray currents.

N. Additional requirements for specific motors, as indicated in other sections, shall also apply.

O. NEMA Premium Efficiency Electric Motors, Motor Efficiencies: All permanently wired polyphase motors of 746 W (1 HP) or greater shall meet the minimum full-load efficiencies as indicated in the following table, and as specified in this specification. Motors of 746 W (1 HP) or greater with open, drip-proof or totally enclosed fan-cooled enclosures shall be NEMA premium efficiency type, unless otherwise indicated. Motors provided as an integral part of motor driven equipment are excluded from this requirement if a minimum seasonal or overall efficiency requirement is indicated for that equipment by the provisions of another section.

Minimum Efficiencies Open Drip-Proof				Minimum Efficiencies Totally Enclosed Fan-Cooled			
Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM	Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM
0.746 (1)	82.5%	85.5%	77.0%	0.746 (1)	82.5%	85.5%	77.0%
1.12 (1.5)	86.5%	86.5%	84.0%	1.12 (1.5)	87.5%	86.5%	84.0%
1.49 (2)	87.5%	86.5%	85.5%	1.49 (2)	88.5%	86.5%	85.5%
2.24 (3)	88.5%	89.5%	85.5%	2.24 (3)	89.5%	89.5%	86.5%
3.73 (5)	89.5%	89.5%	86.5%	3.73 (5)	89.5%	89.5%	88.5%
5.60 (7.5)	90.2%	91.0%	88.5%	5.60 (7.5)	91.0%	91.7%	89.5%
7.46 (10)	91.7%	91.7%	89.5%	7.46 (10)	91.0%	91.7%	90.2%
11.2 (15)	91.7%	93.0%	90.2%	11.2 (15)	91.7%	92.4%	91.0%
14.9 (20)	92.4%	93.0%	91.0%	14.9 (20)	91.7%	93.0%	91.0%
18.7 (25)	93.0%	93.6%	91.7%	18.7 (25)	93.0%	93.6%	91.7%
22.4 (30)	93.6%	94.1%	91.7%	22.4 (30)	93.0%	93.6%	91.7%
29.8 (40)	94.1%	94.1%	92.4%	29.8 (40)	94.1%	94.1%	92.4%
37.3 (50)	94.1%	94.5%	93.0%	37.3 (50)	94.1%	94.5%	93.0%
44.8 (60)	94.5%	95.0%	93.6%	44.8 (60)	94.5%	95.0%	93.6%
56.9 (75)	94.5%	95.0%	93.6%	56.9 (75)	94.5%	95.4%	93.6%
74.6 (100)	95.0%	95.4%	93.6%	74.6 (100)	95.0%	95.4%	94.1%
93.3 (125)	95.0%	95.4%	94.1%	93.3 (125)	95.0%	95.4%	95.0%
112 (150)	95.4%	95.8%	94.1%	112 (150)	95.8%	95.8%	95.0%
149.2 (200)	95.4%	95.8%	95.0%	149.2 (200)	95.8%	96.2%	95.4%

P. Minimum Power Factor at Full Load and Rated Voltage: 90 percent at 1200 RPM, 1800 RPM and 3600 RPM. Power factor correction capacitors shall be provided unless the motor meets the 0.9 requirement without it or if the motor is controlled by a variable frequency drive. The power factor correction capacitors shall be able to withstand high voltage transients and power line variations without breakdown.

Q. Energy Efficiency of Small Motors (Motor Efficiencies): All motors under 746 W (1 hp) shall meet the requirements of the DOE Small Motor Regulation.

Polyphase Open Motors Average full load efficiency				**Capacitor-start capacitor-run and capacitor-start induction run open motors Average full load efficiency**			
Rating kW (hp)	**6 poles**	**4 poles**	**2 poles**	**Rating kW (hp)**	**6 poles**	**4 poles**	**2 poles**
0.18 (0.25)	67.5	69.5	65.6	0.18 (0.25)	62.2	68.5	66.6
0.25 (0.33)	71.4	73.4	69.5	0.25 (0.33)	66.6	72.4	70.5
0.37 (0.5)	75.3	78.2	73.4	0.37 (0.5)	76.2	76.2	72.4
0.55 (0.75)	81.7	81.1	76.8	0.55 (0.75)	80.2	81.8	76.2

PART 3 - EXECUTION

3.1 **INSTALLATION**

A. Install motors in accordance with manufacturer’s recommendations, the NEC, NEMA, as shown in the drawings and/or as required by other sections of these specifications.

B. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or time to the Government.

3.2 **FIELD TESTS**

A. All tests shall be witnessed by the CxA or by the COR.

B. Perform an electric insulation resistance Test using a megohmmeter on all motors after installation, before startup. All shall test free from grounds.

C. Perform Load test in accordance with IEEE 112, Test Method B, to determine freedom from electrical or mechanical defects and compliance with performance data.

D. Insulation Resistance: Not less than 1/2 meg-ohm between stator conductors and frame, to be determined at the time of final inspection.

E. All test data shall be complied into a report form for each motor and provided to the contracting officer or their representative.

3.3 **STARTUP AND TESTING**

A. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed

simultaneously with the system of which each item is an integral part.

B. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

C. The CxA will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with COR and CxA. Provide a minimum notice of 10 working days prior to startup and testing.

3.4 **COMMISSIONING**

A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

B. Components provided under this section of the specification shall be tested as part of a larger system.

3.5 **DEMONSTRATION AND TRAINING**

A. Provide services of manufacturer’s technical representative for 4hoursto instruct each VA personnel responsible in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

SECTION 22 05 19
METERS AND GAUGES FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section describes the requirements for water meters and gauges primarily used for troubleshooting the system and to indicate system performance.

B. A complete listing of common acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

E. Section 25 10 10, ADVANCED UTILITY METERING SYSTEM.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standard will govern.

B. American Society of Mechanical Engineers (ASME):

B40.100-2013.....Pressure Gauges and Gauge Attachments

B40.200-2008.....Thermometers, Direct Reading and Remote Reading

C. American Water Works Association (AWWA):

C700-2015.....Cold Water Meters, Displacement Type, Bronze Main Case

C701-2015.....Cold Water Meters-Turbine Type, for Customer Service

C702-20115.....Cold Water Meters – Compound Type

C707-2010 (R2016).....Encoder-Type Remote-Registration Systems for Cold-Water Meters

D. Institute of Electrical and Electronics Engineers (IEEE):

C2–2017.....National Electrical Safety Code (NESC)

E. International Code Council (ICC):

IPC-2018.....International Plumbing Code

F. National Fire Protection Association (NFPA):

70-2023.....National Electrical Code (NEC)

G. NSF International (NSF):

61-2019.....Drinking Water System Components – Health Effects

372-2016.....Drinking Water System Components – Lead Content

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 05 19, METERS AND GAUGES FOR PLUMBING PIPING", with applicable paragraph identification.

C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Water Meter.
2. Pressure Gauges.
3. Thermometers.
4. Product certificates for each type of meter and gauge.
5. BACnet communication protocol.

D. Complete operating and maintenance manual shall including wiring diagrams, technical data sheets, information for ordering replaceable parts, and troubleshooting guide:

1. Include complete list indicating all components of the system.
2. Include complete diagrams of the internal wiring for each item of equipment.
3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.

E. Completed System Readiness Checklist provided by the CxA and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

F. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

1.5 S-BUILT DOCUMENTATION

A. Comply with requirements in Paragraph "AS-BUILT DOCUMENTATION" of Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

PART 2 - PRODUCTS

2.1 DISPLACEMENT WATER METER

A. For pipe sizes 50 mm (2 inches) and smaller, the water meter shall be displacement type, full size nutating disc, magnetic drive, sealed register, and fully conform to AWWA C700. Peak domestic flow shall be 2.2 L/s (34 gpm). The meter register shall indicate flow in liters (U.S. gallons).

B. The water meter shall be rated for use at temperatures ranging from -40 degrees C (-40 degrees F) and 70 degrees C (158 degrees F) and operate at a working pressure of 1035 kPa (150 psig).

C. The meter case, bottom caps, and register box lids shall be constructed from cast bronze.

D. The meter shall register plus or minus 3 percent of the water actually passing through it at any rate of flow within the normal test flow limits specified in AWWA 700.

E. The water meter shall conform to NSF 61 and NSF 372.

2.2 TURBINE WATER METER (NOT USED)

2.3 COMPOUND WATER METER (NOT USED)

2.4 WATER METER STRAINER

A. All meters shall be fitted with a factory installed integral strainer or bronze inlet strainer with top access. The strainer shall conform to AWWA C702.

B. The water meter strainer shall conform to NSF 61 and NSF 372.

2.5 WATER METER PROGRAMMING

A. All meters 50 mm or DN 50 (2 inches) and greater shall be programmable with software supplied by the meter manufacturer.

B. The software shall have a Microsoft based interface and operate on the latest Windows operating system. The software shall allow the user to configure the meter, troubleshoot the meter, query and display meter parameters, and configure data and stored values.

C. The meter firmware shall be upgradeable through one of the communication ports without removing the unit from service.

D. The meter shall include output for analog 4-20 milliamp signals and binary output.

E. The meter shall have two dry contact relays outputs for alarm or control functions.

2.6 WATER METER COMMUNICATION PROTOCOL

A. The meter shall use a native BACnet Ethernet communication protocol supporting Modbus. The communications shall be protected against surges induced on its communications channels.

2.7 REMOTE READOUT REGISTER

A. All meters shall be equipped with a remote readout register in accordance with AWWA C707.

2.8 PRESSURE GAUGES FOR WATER AND SEWAGE USAGE

A. ASME B40.100 all metal case 115 mm (4-1/2 inches) diameter, bottom connected throughout, graduated as required for service, and identity labeled. Range shall be 0 to 1380 kPa (0 to 200 psig) gauge.

B. The pressure element assembly shall be bourdon tube. The mechanical movement shall be lined to pressure element and connected to pointer.

C. The dial shall be non-reflective aluminum with permanently etched scale markings graduated in kPa and psig.

D. The pointer shall be dark colored metal.

E. The window shall be glass.

F. The ring shall be brass or stainless steel.

G. The accuracy shall be grade A, plus or minus 1 percent of middle half of scale range.

H. The pressure gauge for water domestic use shall conform to NSF 61 and NSF 372.

2.9 THERMOMETERS

A. Thermometers shall be straight stem, metal case, red liquid-filled thermometer, approximately 175 mm (7 inches) high, 4 degrees C to 100 degrees C (40 degrees F to 212 degrees F). Thermometers shall comply with ASME B40.200.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Direct mounted pressure gauges shall be installed in piping tees with pressure gauge located on pipe at the most readable position.

B. Valves and snubbers shall be installed in piping for each pressure gauge.

C. Test plugs shall be installed on the inlet and outlet pipes of all heat exchangers or water heaters serving more than one plumbing fixture.

D. Pressure gauges shall be installed where indicated in the drawings and at the following locations:
   1. Building water service entrance into building.
   2. Inlet and outlet of each pressure reducing valve.
   3. Suction and discharge of each domestic water pump or re-circulating hot water return pump.

E. Water meter installation shall conform to AWWA C700, AWWA C701, and AWWA C702. Electrical installations shall conform to IEEE C2, NFPA 70, and to the requirements specified herein. New materials shall be provided.

F. Remote readout register shall be mounted at the location indicated in the drawings or as directed by the COR.

G. Thermometers shall be installed on the water heater inlet and outlet piping, thermostatic mixing valve outlet piping, and the hot water circulation pump inlet piping.

H. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or time to the Government.

3.2 FIELD QUALITY CONTROL

A. The meter assembly shall be visually inspected and operationally tested. The correct multiplier placement on the face of the meter shall be verified.

3.3 STARTUP AND TESTING

A. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.

B. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

3.4 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.5 DEMONSTRATION AND TRAINING (NOT USED)

A. Provide services of manufacturer's technical representative for 4 hours to instruct each VA personnel responsible in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

SECTION 22 05 23
GENERAL-DUTY VALVES FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section describes the requirements for general-duty valves for domestic water and sewer systems.

B. A complete listing of common acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

E. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standard will govern.

B. American Society of Mechanical Engineers (ASME):

A112.14.1-2003.....Backwater Valves

C. American Society of Sanitary Engineering (ASSE):

1001-2017.....Performance Requirements for Atmospheric Type Vacuum Breakers

1003-2009.....Performance Requirements for Water Pressure Reducing Valves for Domestic Water Distribution Systems

1011-2017.....Performance Requirements for Hose Connection Vacuum Breakers

1013-2011.....Performance Requirements for Reduced Pressure Principle Backflow Preventers and Reduced Pressure Principle Fire Protection Backflow Preventers

1015-2011.....Performance Requirements for Double Check Backflow Prevention Assemblies and Double Check Fire Protection Backflow Prevention Assemblies

1017-2009.....Performance Requirements for Temperature Actuated Mixing Valves for Hot Water Distribution Systems

1020-2004.....Performance Requirements for Pressure Vacuum Breaker Assembly

1035-2008.....Performance Requirements for Laboratory Faucet Backflow Preventers

1069-2005.....Performance Requirements for Automatic Temperature Control Mixing Valves

1070-2015.....Performance Requirements for Water Temperature Limiting Devices

1071-2012.....Performance Requirements for Temperature Actuated Mixing Valves for Plumbed Emergency Equipment

D. American Society for Testing and Materials (ASTM):

A126-2004(R2019).....Standard Specification for Gray Iron Castings for Valves, Flanges, and Pipe Fittings

A276/A276M-2017.....Standard Specification for Stainless Steel Bars and Shapes

A536-1984(R2019e).....Standard Specification for Ductile Iron Castings

B62-2017.....Standard Specification for Composition Bronze or Ounce Metal Castings

B584-2014.....Standard Specification for Copper Alloy Sand Castings for General Applications

E. International Code Council (ICC):

IPC-2018.....International Plumbing Code

F. Manufacturers Standardization Society of the Valve and Fittings Industry, Inc. (MSS):

SP-25-2018.....Standard Marking Systems for Valves, Fittings, Flanges and Unions

SP-67-2017.....Butterfly Valves

SP-70-2011.....Gray Iron Gate Valves, Flanged and Threaded Ends

SP-71-2018.....Gray Iron Swing Check Valves, Flanged and Threaded Ends

SP-80-2019.....Bronze Gate, Globe, Angle, and Check Valves

SP-85-2011.....Gray Iron Globe & Angle Valves, Flanged and Threaded Ends

SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends

G. National Environmental Balancing Bureau (NEBB):

8th Edition 2015 Procedural Standards for Testing, Adjusting, Balancing of Environmental Systems

H. NSF International (NSF):

61-2019.....Drinking Water System Components – Health Effects

372-2016.....Drinking Water System Components – Lead Content

I. University of Southern California Foundation for Cross Connection Control and Hydraulic Research (USC FCCCHR):

10th Edition.....Manual of Cross-Connection Control

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING", with applicable paragraph identification.

C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Ball Valves.
2. Gate Valves.
3. Butterfly Valves.
4. Balancing Valves.
5. Check Valves.

6. Globe Valves.
7. Water Pressure Reducing Valves and Connections.
8. Backwater Valves.
9. Backflow Preventers.
10. Chainwheels.
11. Thermostatic Mixing Valves.

D. Test and Balance reports for balancing valves.

E. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replaceable parts and troubleshooting guide:
1. Include complete list indicating all components of the systems.
2. Include complete diagrams of the internal wiring for each item of equipment.
3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.
4. Piping diagrams of thermostatic mixing valves to be installed.

1.5 DELIVERY, STORAGE, AND HANDLING

A. Valves shall be prepared for shipping as follows:
1. Protect internal parts against rust and corrosion.
2. Protect threads, flange faces, grooves, and weld ends.
3. Set angle, gate, and globe valves closed to prevent rattling.
4. Set ball and plug valves open to minimize exposure of functional surfaces.
5. Set butterfly valves closed or slightly open.
6. Block check valves in either closed or open position.

B. Valves shall be prepared for storage as follows:
1. Maintain valve end protection.
2. Store valves indoors and maintain at higher than ambient dew point temperature.

C. A sling shall be used for large valves. The sling shall be rigged to avoid damage to exposed parts. Hand wheels or stems shall not be used as lifting or rigging points.

1.6 AS BUILT DOCUMENTATION

A. Comply with requirements in Paragraph “AS-BUILT DOCUMENTATION” of Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

PART 2 - PRODUCTS

2.1 VALVES, GENERAL

A. Asbestos packing and gaskets are prohibited.

B. Bronze valves shall be made with dezincification resistant materials. Bronze valves made with copper alloy (brass) containing greater than 15 percent zinc shall not be permitted.

C. Valves in insulated piping shall have 50 mm or DN50 (2 inch) stem extensions and extended handles of non-thermal conductive material that allows operating the valve without breaking the vapor seal or disturbing the insulation. Memory stops shall be fully adjustable after insulation is applied.

D. Exposed Valves over 65 mm or DN65 (2-1/2 inches) installed at an elevation over 3.6 m (12 feet) shall have a chain-wheel attachment to valve hand-wheel, stem, or other actuator.

E. All valves used to supply potable water shall meet the requirements of NSF 61 and NSF 372.

F. Bio-Based Materials: For products designated by the USDA's bio-based Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

G. Refer to Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for additional sustainable design requirements.

2.2 SHUT-OFF VALVES

A. Cold, Hot and Re-circulating Hot Water:

1. 50 mm or DN50 (2 inches) and smaller: Ball, MSS SP-110, Ball valve shall be full port three piece or two piece with a union design with adjustable stem package. Threaded stem designs are not allowed. The ball valve shall have a SWP rating of 1035 kPa (150 psig) and a CWP rating of 4138 kPa (600 psig). The body material shall be Bronze ASTM B584. The ends shall be non-lead solder.

2. Less than 100 mm DN100 (4 inches): Butterfly shall have an iron body with EPDM seal and aluminum bronze disc. The butterfly valve shall meet MSS SP-67, type I standard. The butterfly valve shall have a

SWP rating of 1380 kPa (200 psig). The valve design shall be lug type suitable for bidirectional dead-end service at rated pressure. The body material shall meet ASTM A536, ductile iron.

3. 100 mm DN100 (4 inches) and greater:
   a. Class 125, OS&Y, Cast Iron Gate Valve. The gate valve shall meet MSS SP-70 type I standard. The gate valve shall have a CWP rating of 1380 kPa (200 psig). The valve materials shall meet ASTM A126, grey iron with bolted bonnet, flanged ends, bronze trim, and positive-seal resilient solid wedge disc. The gate valve shall be gear operated for sizes under 200 mm or DN200 (8 inches) and crank operated for sizes 200 mm or DN200 (8 inches) and greater.
   b. Single flange, ductile iron butterfly valves: The single flanged butterfly valve shall meet the MSS SP-67 standard. The butterfly valve shall have a CWP rating of 1380 kPa (200 psig). The butterfly valve shall be lug type, suitable for bidirectional dead-end service at rated pressure without use of downstream flange. The body material shall comply with ASTM A536 ductile iron. The seat shall be EPDM with stainless steel disc and stem.
   c. Grooved end, ductile iron butterfly valves. The grooved butterfly valve shall meet the MSS SP-67 standard. The grooved butterfly valve shall have a CWP rating of 1380 kPa (200 psig). The valve materials shall be epoxy coated ductile iron conforming to ASTM A536 with two-piece stainless-steel stem, EPDM encapsulated ductile iron disc, and EPDM seal. The butterfly valve shall be gear operated.

B. Reagent Grade Water: Valves for reagent grade, reverse osmosis, or deionized water service shall be ball type of same material as used for pipe.

2.3 MANUAL BALANCING VALVES

A. Hot Water Re-circulating, 75 mm or DN75 (3 inches) and smaller manual balancing valve shall be of bronze body, brass ball construction with glass and carbon filled TFE seat rings and designed for positive shutoff. The manual balancing valve shall have differential pressure read-out ports across the valve seat area. The read out ports shall be fitted with internal EPT inserts and check valves. The valve body shall

have 8 mm or DN8 NPT (1/4 inch NPT) tapped drain and purge port. The valves shall have memory stops that allow the valve to close for service and then reopened to set point without disturbing the balance position. All valves shall have calibrated nameplates to assure specific valve settings.

B. Greater than 75 mm or DN75 (3 inches): Manual balancing valves shall be of heavy duty cast iron flanged construction with 861 kPa (125 psig) flange connections. The flanged manual balancing valves shall have either a brass ball with glass and carbon filled TFE seal rings or fitted with a bronze seat, replaceable bronze disc with EPDM seal insert and stainless steel stem. The design pressure shall be 1200 kPa (175 psig) at 121 degrees C (250 degrees F).

2.4 THERMOSTATIC BALANCING VALVES

A. Thermostatic recirculation balancing valves for domestic hot water and domestic cold water application. Thermostatically controlled, spring actuated automatic balancing valve to very recirculation flow to maintain constant return temperatures. Stainless steel body, spring and brass or stainless steel thermal actuator and actuator carrier. Provide with threaded inlet, integral outlet union and stainless steel check valve. Direct acting to maintain return hot water temperature at 110 degrees C (43 degrees F). PTFE seat seal ring and EPDM body seal.

2.5 CHECK VALVES

A. 75 mm or DN75 (3 inches) and smaller shall be Class 125, bronze swing check valves with non-metallic disc suitable for type of service. The check valve shall meet MSS SP-80 Type 4 standard. The check valve shall have a CWP rating of 1380 kPa (200 psig). The check valve shall have a Y pattern horizontal body design with bronze body material conforming to ASTM B62, solder joints, and PTFE or TFE disc.

B. 100 mm or DN100 (4 inches) and greater:

1. Check valves shall be Class 125, iron swing check valve with lever and weight closure control. The check valve shall meet MSS SP-71 Type I standard. The check valve shall have a CWP rating of 1380 kPa (200 psig). The check valve shall have a clear or full waterway body design with gray iron body material conforming to ASTM A126, bolted bonnet, flanged ends, bronze trim.

2. All check valves on the discharge side of submersible sump pumps shall have factory installed exterior level and weight with sufficient weight to prevent the check valve from hammering against the seat when the sump pump stops.

2.6 GLOBE VALVES

A. 75 mm or DN75 (3 inches) or smaller: Class 150, bronze globe valve with non-metallic disc. The globe valve shall meet MSS SP-80, Type 2 standard. The globe valve shall have a CWP rating of 2070 kPa (300 psig). The valve material shall be bronze with integral seal and union ring bonnet conforming to ASTM B62 with solder ends, copper-silicon bronze stem, PTFE or TFE disc, and malleable iron hand wheel.

B. Greater than 75 mm or DN75 (3 inches): Similar to above, except with cast iron body and bronze trim, Class 125, iron globe valve. The globe valve shall meet MSS SP-85, Type 1 standard. The globe valve shall have a CWP rating of 1380 kPa (200 psig). The valve material shall be gray iron with bolted bonnet conforming to ASTM A126 with flanged ends, bronze trim, and malleable iron handwheel.

2.7 WATER PRESSURE REDUCING VALVE AND CONNECTIONS

A. 75 mm or DN75 (3 inches) or smaller: The pressure reducing valve shall consist of a bronze body and bell housing, a separate access cover for the plunger, and a bolt to adjust the downstream pressure. The pressure reducing valve shall meet ASSE 1003. The bronze bell housing and access cap shall be threaded to the body and shall not require the use of ferrous screws. The assembly shall be of the balanced piston design and shall reduce pressure in both flow and no flow conditions. The assembly shall be accessible for maintenance without having to remove the body from the line.

B. 100 mm or DN100 (4 inches) and greater: The pressure reducing valve shall consist of a flanged cast iron body and rated to 1380 kPa (200 psig). The valve shall have a large elastomer diaphragm for sensitive response. The pressure reducing valve shall meet ASSE 1003.

C. The regulator shall have a tap for pressure gauge.

D. The regulator shall have a temperature rating of 100 degrees C (212 degrees F) for hot water or hot water return service. Pressure

regulators shall have accurate pressure regulation to 6.9 kPa (+/- 1 psig).

E. Setting: Entering water pressure, discharge pressure, capacity, size, and related measurements shall be as shown on the drawings.

F. Connections Valves and Strainers: Shut off valves shall be installed on each side of reducing valve and a bypass line equal in size to the regulator inlet pipe shall be installed with a normally closed globe valve. A strainer shall be installed on inlet side of, and same size as pressure reducing valve. A pressure gauge shall be installed on the inlet and outlet of the valve.

2.8 BACKWATER VALVE

A. The backwater valve shall have a cast iron body, automatic thermoplastic type valve seat and flapper suited for water service. The flapper shall be slightly open during periods of non-operation. The pressure reducing valve shall meet ASME A112.14.1. The cleanout shall be extended to the finish floor and fit with a threaded countersunk plug. A clamping device shall be included when the cleanout extends through the waterproofing membrane.

B. When the backwater valve is installed greater than 600 mm (24 inches) below the finish floor elevation, a pit or manhole large enough for a repair person can enter to service the backwater valve shall be installed.

2.9 BACKFLOW PREVENTERS

A. A backflow prevention assembly shall be installed at any point in the plumbing system where the potable water supply comes in contact with a potential source of contamination. The backflow prevention assembly shall be approved by the University of Southern California Foundation for Cross Connection Control and Hydraulic Research (USCFCCC).

B. The reduced pressure principle backflow prevention assembly shall be ASSE listed 1013 with full port OS&Y positive-seal resilient gate valves and an integral relief monitor switch. The main body and access cover shall be epoxy coated ductile iron conforming to ASTM A536 grade 4. The seat ring and check valve shall be the thermoplastic type suited for water service. The stem shall be stainless steel conforming to ASTM A276/A276M. The seat disc shall be the elastomer type suited for water

service. The checks and the relief valve shall be accessible for maintenance without removing the device from the line. An epoxy coated wye type strainer with flanged connections shall be installed on the inlet. Reduced pressure backflow preventers shall be installed in the following applications.

1. Deionizers.
2. Sterilizers.
3. Dialysis, Deionized or Reverse Osmosis Water Systems.
4. Water make up to heating systems, cooling tower, chilled water system, generators, and similar equipment consuming water.
5. Water service entrance from loop system.
6. Dental equipment.
7. Power washer.
8. Medical equipment.
9. Process equipment.
10. Autopsy, on each hot and cold water outlet at each table or sink.
11. Reclaimed water systems.

C. The pipe applied or integral atmospheric vacuum breaker shall be ASSE listed 1001. The main body shall be cast bronze. The seat disc shall be the elastomer type suited for water service. The device shall be accessible for maintenance without removing the device from the service line. The installation shall not be in a concealed or inaccessible location or where the venting of water from the device during normal operation is deemed objectionable. Atmospheric vacuum breakers shall be installed in the following applications.

1. Hose bibs and sinks with threaded outlets.
2. Disposers.
3. Showers (telephone/handheld type).
4. Hydrotherapy units.
5. All kitchen equipment, if not protected by air gap.
6. Ventilating hoods with wash down system.
7. Film processor.
8. Detergent system.
9. Fume hoods.
10. Glassware washers.

11. Service sinks (integral with faucet only).
12. Laundry tubs (integral with faucet only).
13. Sitz baths.

D. The hose connection vacuum breaker shall be ASSE listed 1011. The main body shall be cast brass with stainless steel working parts. The diaphragm and disc shall be the elastomer type suited for water service. The device shall permit the attachment of portable hoses to hose thread outlets. Hose connection vacuum breakers shall be installed in the following locations requiring non-continuous pressure:
   1. Hose bibbs and wall hydrants.

E. The pressure vacuum breaker shall be ASSE listed 1020. The main body shall be brass. The disc and O-ring seal shall be the elastomer type. The valve seat and disc float shall be the thermoplastic type. Tee handle or lever handle shut-off ball valves. Test cocks for testing and draining where freezing conditions occur. All materials shall be suitable for water service. The device shall be accessible for maintenance without removing the device from the service line. The installation shall not be in a concealed or inaccessible location or where the venting of water from the device during normal operation is deemed objectionable. Pressure vacuum breakers shall be installed in the following locations requiring continuous pressure and no backpressure including equipment with submerged inlet connections:
   1. Lawn Irrigation.

F. The laboratory faucet vacuum breaker shall be ASSE listed 1035. The main body shall be cast brass. Dual check valves with stainless steel working parts. The diaphragm and disc shall be the elastomer type suited for water service. The device shall permit the attachment of portable hoses to laboratory faucets for non-continuous pressure applications.

G. The double check backflow prevention assembly shall be ASSE listed 1015 and supply with full port, OS&Y, positive-seal, resilient gate valves. The main body and access cover shall be epoxy coated ductile iron conforming to ASTM A536 grade. The seat ring and check valve shall be the thermoplastic type suited for water service. The stem shall be stainless steel conforming to ASTM A276/A276M. The seat disc shall be

the elastomer type suited for water service. The first and second check valve shall be accessible for maintenance without removing the device from the line. Double check valves shall be installed in the following location requiring continuous pressure subject to backpressure and backsiphonage conditions.

1. Lawn Irrigation.
2. Food Processing Equipment.
3. Laundry equipment.

2.10 CHAINWHEELS (NOT USED)

2.11 THERMOSTATIC MIXING VALVES

A. Thermostatic Mixing Valves shall comply with the following general performance requirements:

1. Shall meet ASSE requirements for water temperature control.
2. The body shall be cast bronze or brass with corrosion resistant internal parts preventing scale and biofilm build-up. Provide chrome-plated finish in exposed areas.
3. No special tool shall be required for temperature adjustment, maintenance, replacing parts and disinfecting operations.
4. Valve shall be able to be placed in various positions without making temperature adjustment or reading difficult.
5. Valve finish shall be chrome plated in exposed areas.
6. Valve shall allow easy temperature adjustments to allow hot water circulation. Internal parts shall be able to withstand disinfecting operations of chemical and thermal treatment of water temperatures up to 82°C (180°F) for 30 minutes or 50 mg/L (50 ppm) chlorine residual concentration for 24 hours.
7. Parts shall be easily removed or replaced without dismantling the valves, for easy scale removal and disinfecting of parts.
8. Valve shall have a manual adjustable temperature control with locking mechanism to prevent tampering by end user. Outlet temperature shall be visible to ensure outlet temperature does not exceed specified limits, particularly after thermal eradication procedures.
9. Provide mixing valves with integral check valves with screens and stop valves.

B. Master Thermostatic Water Mixing Valves:
   1. Application: Tempered water distribution from hot water source.
   2. Standard: ASSE 1017.
   3. Pressure Rating: 861 kPa (125 psig).
   4. Type: Exposed-mounting or Cabinet-type, as indicated, thermostatically controlled water mixing valve.
   5. Connections: Flanged or threaded union inlets and outlet.
   6. Thermometers shall be provided to indicate mixed water temperature.

C. Hi-Lo Water-Mixing-Valve Assemblies:
   1. Application: Tempered water distribution from hot water source covering a wide range of flow.
   2. Description: Factory-fabricated, cabinet-type or exposed-mounting, thermostatically controlled, water-mixing-valve assembly in two-valve parallel arrangement including pressure regulators, pressure gauges and thermometer.
   3. Large-Flow Parallel: Master thermostatic water mixing valve and downstream pressure regulator with pressure gauges on inlet and outlet.
   4. Small-Flow Parallel: Master thermostatic water mixing valve.
   5. Master Thermostatic Mixing Valves: Comply with ASSE 1017.
   6. Water Regulator(s): Comply with ASSE 1003. Include pressure gauge on inlet and outlet.
   7. Component Pressure Ratings: 861 kPa (125 psig) minimum, unless otherwise indicated.
   8. Connections: Soldered or threaded union inlets and outlet.
   9. Thermometers shall be provided to indicate mixed water temperature.

D. Automatic Water Temperature Control Mixing Valves:
   1. Application: Gang plumbing fixtures point-of-use when no other mixing at fixtures occurs.
   2. Standard: ASSE 1069.
   3. Pressure Rating: 861 kPa (125 psig).
   4. Type: Thermostatically controlled water mixing valve set at 43 degrees C (110 degrees F).
   5. Connections: Threaded union or soldered inlets and outlet.
   6. Thermometers shall be provided to indicate mixed water temperature.

7. Upon cold water supply failure the hot water flow shall automatically be reduced to 0.5 gpm maximum.

E. Water Temperature Limiting Devices:
   1. Application: Single plumbing fixture point-of-use such as sinks or lavatories.
   2. Standard: ASSE 1070.
   3. Pressure Rating: 861 kPa (125 psig).
   4. Type: Thermostatically controlled water mixing valve set at 43 degrees C (110 degrees F).
   5. Connections: Threaded union, compression or soldered inlets and outlet.
   6. Upon cold water supply failure the hot water flow shall automatically be reduced to 0.2 gpm maximum.

F. Temperature Activated Mixing Valves:
   1. Application: Emergency eye/face/drench shower equipment.
   2. Standard: ASSE 1071.
   3. Pressure Rating: 861 kPa (125 psig).
   4. Type: Thermostatically controlled water mixing valve set at 24-30 degrees C (75-85 degrees F).
   5. Connections: Soldered or threaded union inlets and outlet.
   6. Thermometers shall be provided to indicate mixed water temperature.
   7. Upon cold water supply failure the hot water flow shall automatically be reduced to 0.5 gpm maximum.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Valve interior shall be examined for cleanliness, freedom from foreign matter, and corrosion. Special packing materials shall be removed, such as blocks, used to prevent disc movement during shipping and handling.

B. Valves shall be operated in positions from fully open to fully closed. Guides and seats shall be examined and made accessible by such operations.

C. Threads on valve and mating pipe shall be examined for form and cleanliness.

D. Mating flange faces shall be examined for conditions that might cause leakage. Bolting shall be checked for proper size, length, and

material. Gaskets shall be verified for proper size and that its material composition is suitable for service and free from defects and damage.

E. Do not attempt to repair defective valves; replace with new valves.

3.2 INSTALLATION

A. Install valves with unions or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.

B. Valves shall be located for easy access and shall be provide with separate support. Valves shall be accessible with access doors when installed inside partitions or above hard ceilings.

C. Valves shall be installed in horizontal piping with stem at or above center of pipe.

D. Valves shall be installed in a position to allow full stem movement.

E. Check valves shall be installed for proper direction of flow and as follows:

1. Swing Check Valves: In horizontal position with hinge pin level and on top of valve.

F. Install backflow preventers in each water supply to mechanical equipment and systems and to other equipment and water systems that shall be sources of contamination. Comply with authorities having jurisdiction. Locate backflow preventers in same room as connected equipment or system.

1. Install drain for backflow preventers with atmospheric-vent drain connection with air-gap fitting, fixed air-gap fitting, or equivalent positive pipe separation of at least two pipe diameters in drain piping and pipe to floor drain. Locate air-gap device attached to or under backflow preventer. Simple air breaks are prohibited for this application.

G. Install pressure gauges on outlet of backflow preventers.

H. Do not install bypass piping around backflow preventers.

I. Install temperature-actuated water mixing valves with check stops or shutoff valves on inlets.

1. Install thermometers if specified.

2. Install cabinet-type units recessed in or surface mounted on wall as specified.

J. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or time to the Government.

K. Install thermostatic balancing valves with inlet strainer and inlet and outlet isolation valves.

3.3 LABELING AND IDENTIFYING

A. Equipment Nameplates and Signs: Install engraved plastic-laminate equipment nameplate or sign on or near each of the following:

1. Calibrated balancing valves.
2. Master, thermostatic, water mixing valves.
3. Manifold, thermostatic, water-mixing-valve assemblies.

B. Distinguish among multiple units, inform operator of operational requirements, indicate safety and emergency precautions, and warn of hazards and improper operations, in addition to identifying unit.

3.4 ADJUSTING

A. Valve packing shall be adjusted or replaced after piping systems have been tested and put into service but before final adjusting and balancing. Valves shall be replaced if persistent leaking occurs.

B. Set field-adjustable flow set points of balancing valves and record data. Ensure recorded data represents actual measured or observed conditions. Permanently mark settings of valves and other adjustment devices allowing settings to be restored. Set and lock memory stops. After adjustment, take measurements to verify balance has not been disrupted or that such disruption has been rectified.

C. Set field-adjustable temperature set points of temperature-actuated water mixing valves.

D. Testing and adjusting of balancing valves shall be performed by an independent NEBB Accredited Test and Balance Contractor. A final settings and flow report shall be submitted to the VA Contracting Officer’s Representative (COR).

3.5 STARTUP AND TESTING

A. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove

full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.

B. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

3.6 COMMISSIONING

3.7 PROVIDE COMMISSIONING DOCUMENTATION IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

3.8 COMPONENTS PROVIDED UNDER THIS SECTION OF THE SPECIFICATION WILL BE TESTED AS PART OF A LARGER SYSTEM.

3.9 DEMONSTRATION AND TRAINING

3.10 PROVIDE SERVICES OF MANUFACTURER'S TECHNICAL REPRESENTATIVE FOR 4 HOURS TO INSTRUCT EACH VA PERSONNEL RESPONSIBLE IN OPERATION AND MAINTENANCE OF THE SYSTEM.

3.11 SUBMIT TRAINING PLANS AND INSTRUCTOR QUALIFICATIONS IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

- - E N D - - -

SECTION 22 07 11
PLUMBING INSULATION

PART 1 - GENERAL

1.1 DESCRIPTION

A. Field applied insulation for thermal efficiency and condensation control for the following:
   1. Plumbing piping and equipment.
   2. Re-insulation of plumbing piping and equipment after asbestos abatement and or replacement of any part of existing insulation system (insulation, vapor retarder jacket, protective coverings/jacket) damaged during construction.

B. Definitions:
   1. ASJ: All Service Jacket, Kraft paper, white finish facing or jacket.
   2. Air conditioned space: Space having air temperature and/or humidity controlled by mechanical equipment.
   3. All insulation systems installed within supply, return, exhaust, relief and ventilation air plenums shall be limited to uninhabited crawl spaces, areas above a ceiling or below the floor, attic spaces, interiors of air conditioned or heating ducts, and mechanical equipment rooms shall be noncombustible or shall be listed and labeled as having a flame spread indexes of not more than 25 and a smoke-developed index of not more than 50 when tested in accordance with ASTM E84 or UL 723. Note: ICC IMC, Section 602.2.1.
   4. Cold: Equipment or piping handling media at design temperature of 15 degrees C (60 degrees F) or below.
   5. Concealed: Piping above ceilings and in chases, and pipe spaces.
   6. Exposed: Piping and equipment exposed to view in finished areas including mechanical equipment rooms or exposed to outdoor weather. Shafts, chases, unfinished attics, crawl spaces and pipe basements are not considered finished areas.
   7. FSK: Foil-scrim-Kraft facing.
   8. Hot: Plumbing equipment or piping handling media above 40 degrees C (104 degrees F).
   9. Density: kg/m^3 - kilograms per cubic meter (Pcf - pounds per cubic foot).

10. Thermal conductance: Heat flow rate through materials.
    a. Flat surface: Watts per square meter (BTU per hour per square foot).
    b. Pipe or Cylinder: Watts per linear meter (BTU per hour per linear foot) for a given outside diameter.
11. Thermal Conductivity (k): Watts per meter, per degree K (BTU - inch thickness, per hour, per square foot, per degree F temperature difference).
12. Vapor Retarder (Vapor Barrier): A material which retards the transmission (migration) of water vapor. Performance of the vapor retarder is rated in terms of permeance (perms). For the purpose of this specification, vapor retarders/vapor barriers shall have a maximum published permeance of .02 perms.
13. HWR: Hot water recirculating.
14. CW: Cold water.
15. SW: Soft water.
16. HW: Hot water.
17. PVDC: Polyvinylidene chloride vapor retarder jacketing, white.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.
B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS: Insulation material and insulation production method.
D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.
G. Section 07 84 00, FIRESTOPPING: Mineral fiber and bond breaker behind sealant.
I. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: General mechanical requirements and items, which are common to more than one section of Division 22.
J. Section 22 05 19, METERS AND GAGES FOR PLUMBING PIPING: Hot and cold water piping.
K. Section 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING: Hot and cold water piping.
L. Section 22 05 33, HEAT TRACING FOR PLUMBING PIPING: Insulation over heating cables.
M. Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

N. Section 23 21 13, HYDRONIC PIPING: electrical heat tracing systems.

O. Section 26 32 13, ENGINE GENERATORS: Exhaust stacks and muffler.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.

B. American Society for Testing and Materials (ASTM):

B209-2014.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate

C411-2011.....Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation

C449-2007 (R2013).....Standard Specification for Mineral Fiber Hydraulic-Setting Thermal Insulating and Finishing Cement

C450-2008 (R2014).....Standard Practice for Fabrication of Thermal Insulating Fitting Covers for NPS Piping, and Vessel Lagging

Adjunct to C450.....Compilation of Tables that Provide Recommended Dimensions for Prefab and Field Thermal Insulating Covers, etc.

C533-2013.....Standard Specification for Calcium Silicate Block and Pipe Thermal Insulation

C534/C534M-2014.....Standard Specification for Preformed Flexible Elastomeric Cellular Thermal Insulation in Sheet and Tubular Form

C547-2015.....Standard Specification for Mineral Fiber Pipe Insulation

C552-2014.....Standard Specification for Cellular Glass Thermal Insulation

C553-2013.....Standard Specification for Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications

C591-2013.....Standard Specification for Unfaced Preformed Rigid Cellular Polyisocyanurate Thermal Insulation

C680-2014.....Standard Practice for Estimate of the Heat Gain or Loss and the Surface Temperatures of Insulated Flat, Cylindrical, and Spherical Systems by Use of Computer Programs

C612-2014.....Standard Specification for Mineral Fiber Block and Board Thermal Insulation

C1126-2014.....Standard Specification for Faced or Unfaced Rigid Cellular Phenolic Thermal Insulation

C1136-2012.....Standard Specification for Flexible, Low Permeance Vapor Retarders for Thermal Insulation

C1710-2011.....Standard Guide for Installation of Flexible Closed Cell Preformed Insulation in Tube and Sheet Form

D1668/D1668M-1997a (2014)e1 Standard Specification for Glass Fabrics (Woven and Treated) for Roofing and Waterproofing

E84-2015a.....Standard Test Method for Surface Burning Characteristics of Building Materials

E2231-2015.....Standard Practice for Specimen Preparation and Mounting of Pipe and Duct Insulation to Assess Surface Burning Characteristics

C. Federal Specifications (Fed. Spec.):

L-P-535E-1979.....Plastic Sheet (Sheeting): Plastic Strip; Poly (Vinyl Chloride) and Poly (Vinyl Chloride - Vinyl Acetate), Rigid.

D. International Code Council, (ICC):

IMC-2012.....International Mechanical Code

E. Military Specifications (Mil. Spec.):

MIL-A-3316C (2)-1990....Adhesives, Fire-Resistant, Thermal Insulation

MIL-A-24179A (2)-1987...Adhesive, Flexible Unicellular-Plastic Thermal Insulation

MIL-PRF-19565C (1)-1988.Coating Compounds, Thermal Insulation, Fire-and Water-Resistant, Vapor-Barrier

MIL-C-20079H-1987.....Cloth, Glass; Tape, Textile Glass; and Thread, Glass and Wire-Reinforced Glass

F. National Fire Protection Association (NFPA):

90A-2024.....Standard for the Installation of Air-Conditioning and Ventilating Systems

G. Underwriters Laboratories, Inc (UL):

723-2008 (R2013).....Standard for Test for Surface Burning Characteristics of Building Materials

1887-2004 (R2013).....Standard for Fire Test of Plastic Sprinkler Pipe for Visible Flame and Smoke Characteristics

H. 3E Plus® version 4.1 Insulation Thickness Computer Program: Available from NAIMA with free download; https://insulationinstitute.org/tools-resources/

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 07 11, PLUMBING INSULATION", with applicable paragraph identification.

C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

D. Shop Drawings:

1. All information, clearly presented, shall be included to determine compliance with drawings and specifications and ASTM Designation, Federal and Military specifications.
   a. Insulation materials: Specify each type used and state surface burning characteristics.
   b. Insulation facings and jackets: Each type used and state surface burning characteristics.
   c. Insulation accessory materials: Each type used.
   d. Manufacturer's installation and fitting fabrication instructions for flexible unicellular insulation shall follow the guidelines in accordance with ASTM C1710.

e. Make reference to applicable specification paragraph numbers for coordination.

f. All insulation fittings (exception flexible unicellular insulation) shall be fabricated in accordance with ASTM C450 and the referenced Adjunct to ASTM C450.

1.5 QUALITY ASSURANCE

A. Refer to article QUALITY ASSURANCE, in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

B. Criteria:

1. Comply with NFPA 90A, particularly paragraphs 4.3.3.1 through 4.3.3.6, 4.3.11.2.6, parts of which are quoted as follows:

4.3.3.1 Pipe and duct insulation and coverings, duct linings, vapor retarder facings, adhesives, fasteners, tapes, and supplementary materials added to air ducts, plenums, panels and duct silencers used in duct systems shall have, in the form in which they are used, a maximum flame spread index of 25 without evidence of continued progressive combustion and a maximum smoke developed index of 50 when tested in accordance with ASTM E84 and appropriate mounting practice, e.g. ASTM E2231.

4.3.3.3 Coverings and linings for air ducts, pipes, plenums and panels including all pipe and duct insulation materials shall not flame, glow, smolder, or smoke when tested in accordance with a similar test for pipe covering, ASTM C411, Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation, at the temperature to which they are exposed in service. In no case shall the test temperature be below 121 degrees C (250 degrees F).

4.3.11.2.6.3 Nonferrous fire sprinkler piping shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 1887, Standard for Safety Fire Test of Plastic Sprinkler Pipe for Visible Flame and Smoke Characteristics.

4.3.11.2.6.8 Smoke detectors shall not be required to meet the provisions of Section 4.3.

2. Test methods: ASTM E84, UL 723, and ASTM E2231.

3. Specified k factors are at 24 degrees C (75 degrees F) mean temperature unless stated otherwise. Where optional thermal insulation material is used, select thickness to provide thermal conductance no greater than that for the specified material. For pipe, use insulation manufacturer's published heat flow tables. For domestic hot water supply and return, run out insulation and

condensation control insulation, no thickness adjustment need be made.

4. All materials shall be compatible and suitable for service temperature, and shall not contribute to corrosion or otherwise attack surface to which applied in either the wet or dry state.

D. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

1.6 AS-BUILT DOCUMENTATION

A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.

B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be in hard copies or PDF version copies. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in Auto-CAD version __2021__ provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.

D. Certification documentation shall be provided prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

1.7 STORAGE AND HANDLING OF MATERIAL

A. Store materials in clean and dry environment, pipe insulation jackets shall be clean and unmarred. Place adhesives in original containers. Maintain ambient temperatures and conditions as required by printed instructions of manufacturers of adhesives, mastics and finishing cements.

PART 2 - PRODUCTS

2.1 MINERAL FIBER OR FIBER GLASS

A. ASTM C612 (Board, Block), Class 1 or 2, density 48 kg/m^3 (nominal 3 pcf), k = 0.037 (.26) at 24 degrees C (75 degrees F), external insulation for temperatures up to 204 degrees C (400 degrees F).

B. ASTM C553 (Blanket, Flexible) Type I, Class B-3, Density 16 kg/m^3 (nominal 1 pcf), k = 0.045 (0.31) at 24 degrees C (75 degrees F), for use at temperatures up to 204 degrees C (400 degrees F).

C. ASTM C547 (Pipe Fitting Insulation and Preformed Pipe Insulation), Class 1, k = 0.037 (0.26) at 24 degrees C (75 degrees F), for use at temperatures up to 230 degrees C (446 degrees F) with an all service vapor retarder jacket (ASJ) and with polyvinyl chloride (PVC) premolded fitting covering.

2.2 MINERAL WOOL OR REFRACTORY FIBER

A. Comply with Standard ASTM C612, Class 3, 450 degrees C (842 degrees F).

2.3 RIGID CELLULAR PHENOLIC FOAM

A. Preformed (molded) pipe insulation, ASTM C1126, Type III, grade 1, k = 0.021(0.15) at 10 degrees C (50 degrees F), for use at temperatures up to 121 degrees C (250 degrees F) with vapor retarder and all service vapor retarder jacket (ASJ) and with PVC premolded fitting covering.

B. Equipment Insulation, ASTM C1126, Type II, grade 1, k = 0.021 (0.15) at 10 degrees C (50 degrees F), for use at temperatures up to 121 degrees C (250 degrees F) with rigid cellular phenolic insulation and covering, and all service vapor retarder jacket (ASJ).

2.4 CELLULAR GLASS CLOSED-CELL

A. Comply with Standard ASTM C552, density 120 kg/m^3 (7.5 pcf) nominal, k = 0.033 (0.29) at 24 degrees C (75 degrees F).

B. Pipe insulation for use at process temperatures below ambient air to 482 degrees C (900 degrees F) with or without all service vapor retarder jacket (ASJ).

C. Pipe insulation for use at process temperatures for pipe and tube below ambient air temperatures or where condensation control is necessary are to be installed with a vapor retarder/barrier system of with or without all service vapor retarder sealed jacket (ASJ) system. Without ASJ shall require all longitudinal and circumferential joints to be vapor sealed with vapor barrier mastic.

D. Cellular glass thermal insulation intended for use on surfaces operating at temperatures between –268 and 482 degrees C (–450 and 900 degrees F). It is possible that special fabrication or techniques for pipe insulation, or both, shall be required for application in the temperature range from 121 to 427 degrees C (250 to 800 degrees F).

2.5 POLYISOCYANURATE CLOSED-CELL RIGID

A. Preformed (fabricated) pipe insulation, ASTM C591, Type IV, K=0.027(0.19) at 24 degrees C (75 degrees F), flame spread not over 25, smoke developed not over 50, for use at temperatures up to 149 degree C (300 degree F) with factory applied PVDC or all service vapor retarder jacket with PVC premolded fitting covers.

B. Equipment and duct insulation, ASTM C591, Type IV, K=0.027(0.19) at 24 degrees C (75 degrees F), for use at temperatures up to 149 degrees C (300 degrees F) with PVDC or all service jacket vapor retarder jacket.

2.6 FLEXIBLE ELASTOMERIC CELLULAR THERMAL

A. ASTM C534/C534M, k = 0.039 (0.27) at 24 degrees C (75 degrees F), flame spread not over 25, smoke developed not over 50, for temperatures from minus 4 degrees C (40 degrees F) to 93 degrees C (199 degrees F). Under high humidity exposures for condensation control an external vapor retarder/barrier jacket is required. Consult ASTM C1710.

2.7 CALCIUM SILICATE

A. Preformed pipe Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.

B. Premolded Pipe Fitting Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.

C. Equipment Insulation: ASTM C533, Type I and Type II.

D. Characteristics:

Insulation Characteristics		
ITEMS	**TYPE I**	**TYPE II**
Surface Temperature, maximum degrees C (degrees F)	649 (1200)	927 (1700)
Density (dry), Kg/m^3 (lb/ ft3)	240 (15)	352 (22)
Thermal conductivity: Min W/ m K (Btu in/h ft^2 degrees F)@ mean temperature of 93 degrees C (199 degrees F)	0.065 (0.45)	0.078 (0.540)
Surface burning characteristics: Flame spread Index, Maximum	0	0
Smoke Density index, Maximum	0	0

2.8 INSULATION FACINGS AND JACKETS

A. Vapor Retarder, higher strength with low water permeance = 0.02 or less perm rating, Beach puncture 50 units for insulation facing on pipe insulation jackets. Facings and jackets shall be ASJ or PVDC Vapor Retarder jacketing.

B. ASJ shall be white finish (kraft paper) bonded to 0.025 mm (1 mil) thick aluminum foil, fiberglass reinforced, with pressure sensitive adhesive closure. Comply with ASTM C1136. Beach puncture is 50 units, suitable for painting without sizing. Jackets shall have minimum 40 mm (1-1/2 inch) lap on longitudinal joints and minimum 75 mm (3 inch) butt strip on end joints. Butt strip material shall be same as the jacket. Lap and butt strips shall be self-sealing type with factory-applied pressure sensitive adhesive.

C. Vapor Retarder medium strength with low water vapor permeance of 0.02 or less perm rating), Beach puncture 25 units: FSK or PVDC type for concealed ductwork and equipment.

D. Except for flexible elastomeric cellular thermal insulation (not for high humidity exposures), field applied vapor barrier jackets shall be provided, in addition to the specified facings and jackets, on all

exterior piping as well as on interior piping conveying fluids below ambient temperature. The vapor barrier jacket shall consist of a multi-layer laminated cladding with a maximum water vapor permeance of 0.001 perms. The minimum puncture resistance shall be 35 cm-kg (30 inch-pounds) for interior locations and 92 cm-kg (80 inch-pounds) for exterior or exposed locations or where the insulation is subject to damage.

E. Except for cellular glass thermal insulation, when all longitudinal and circumferential joints are vapor sealed with a vapor barrier mastic or caulking, vapor barrier jackets may not be provided. For aesthetic and physical abuse applications, exterior jacketing is recommended. Otherwise field applied vapor barrier jackets shall be provided, in addition to the applicable specified facings and jackets, on all exterior piping as well as on interior piping conveying fluids below ambient temperature. The vapor barrier jacket shall consist of a multi-layer laminated cladding with a maximum water vapor permeance of 0.001 perms. The minimum puncture resistance shall be 35 cm-kg (30 inch-pounds) for interior locations and 92 cm-kg (80 inch-pounds) for exterior or exposed locations or where the insulation is subject to damage.

F. Glass Cloth Jackets: Presized, minimum 0.18 kg per square meter (7.8 ounces per square yard), 2070 kPa (300 psig) bursting strength with integral vapor retarder where required or specified. Weather proof if utilized for outside service.

G. Pipe fitting insulation covering (jackets): Fitting covering shall be premolded to match shape of fitting and shall be PVC conforming to Fed Spec L-P-535E, composition A, Type II Grade GU, and Type III, minimum thickness 0.7 mm (0.03 inches). Provide color matching vapor retarder pressure sensitive tape. Staples, tacks, or any other attachment that penetrates the PVC covering is not allowed on any form of a vapor barrier system in below ambient process temperature applications.

H. Aluminum Jacket-Piping systems and circular breeching and stacks: ASTM B209, 3003 alloy, H-14 temper, 0.6 mm (0.023 inch) minimum thickness with locking longitudinal joints. Jackets for elbows, tees and other fittings shall be factory-fabricated or with cut aluminum gores to match shape of fitting and of 0.6 mm (0.024 inch) minimum thickness

aluminum. Aluminum fittings shall be of same construction with an internal moisture barrier as straight run jackets but need not be of the same alloy. Factory-fabricated stainless steel bands with wing seals shall be installed on all circumferential joints. Bands shall be 15 mm (0.5 inch) wide on 450 mm (18 inch) centers. System shall be weatherproof if utilized for outside service.

I. Aluminum jacket-Rectangular breeching: ASTM B209, 3003 alloy, H-14 temper, 0.5 mm (0.020 inches) thick with 32 mm (1-1/4 inch) corrugations or 0.8 mm (0.032 inches) thick with no corrugations. System shall be weatherproof if used for outside service.

2.9 PIPE COVERING PROTECTION SADDLES

A. Cold pipe support: Premolded pipe insulation 180 degrees (half-shells) on bottom half of pipe at supports. Material shall be cellular glass or high density Polyisocyanurate insulation of the same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m^3 (3.0 pcf).

Nominal Pipe Size and Accessories Material (Insert Blocks)	
Nominal Pipe Size mm (inches)	**Insert Blocks mm (inches)**
Up through 125 (5)	150 (6) long
150 (6)	150 (6) long
200 (8), 250 (10), 300 (12)	225 (9) long
350 (14), 400 (16)	300 (12) long
450 through 600 (18 through 24)	350 (14) long

B. Warm or hot pipe supports: Premolded pipe insulation (180 degree half-shells) on bottom half of pipe at supports. Material shall be high density Polyisocyanurate (for temperatures up to 149 degrees C (300 degrees F)), cellular glass or calcium silicate. Insulation at supports shall have same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m^3 (3.0 pcf).

2.10 ADHESIVE, MASTIC, CEMENT

A. Mil. Spec. MIL-A-3316, Class 1: Jacket and lap adhesive and protective finish coating for insulation.

B. Mil. Spec. MIL-A-3316, Class 2: Adhesive for laps and for adhering insulation to metal surfaces.

C. Mil. Spec. MIL-A-24179A, Type II Class 1: Adhesive for installing flexible unicellular insulation and for laps and general use.

D. Mil. Spec. MIL-PRF-19565C, Type I: Protective finish for outdoor use.

E. Mil. Spec. MIL-PRFC-19565C, Type I or Type II: Vapor barrier compound for indoor use.

F. ASTM C449: Mineral fiber hydraulic-setting thermal insulating and finishing cement.

G. Other: Insulation manufacturers' published recommendations.

2.11 MECHANICAL FASTENERS

A. Pins, anchors: Welded pins, or metal or nylon anchors with galvanized steel or fiber washer, or clips. Pin diameter shall be as recommended by the insulation manufacturer.

B. Staples: Outward clinching galvanized steel. Staples are not allowed for below ambient vapor barrier applications.

C. Wire: 1.3 mm thick (18 gage) soft annealed galvanized or 1.9 mm (14 gage) copper clad steel or nickel copper alloy or stainless steel.

D. Bands: 13 mm (1/2 inch) nominal width, brass, galvanized steel, aluminum or stainless steel.

E. Tacks, rivets, screws or any other attachment device capable of penetrating the vapor retarder shall NOT be used to attach/close the any type of vapor retarder jacketing. Thumb tacks sometimes used on PVC jacketing and preformed fitting covers closures are not allowed for below ambient vapor barrier applications.

2.12 REINFORCEMENT AND FINISHES

A. Glass fabric, open weave: ASTM D1668/D1668M, Type III (resin treated) and Type I (asphalt or white resin treated).

B. Glass fiber fitting tape: Mil. Spec MIL-C-20079H, Type II, Class 1.

C. Tape for Flexible Elastomeric Cellular Insulation: As recommended by the insulation manufacturer.

D. Hexagonal wire netting: 25 mm (one inch) mesh, 0.85 mm thick (22 gage) galvanized steel.

E. Corner beads: 50 mm (2 inch) by 50 mm (2 inch), 0.55 mm thick (26 gage) galvanized steel; or, 25 mm (1 inch) by 25 mm (1 inch), 0.47 mm thick

(28 gage) aluminum angle adhered to 50 mm (2 inch) by 50 mm (2 inch) Kraft paper.

F. PVC fitting cover: Fed. Spec L-P-535E, Composition A, 11-86 Type II, Grade GU, with Form B Mineral Fiber insert, for media temperature 10 to 121 degrees C (50 to 250 degrees F). Below 10 degrees C (50 degrees F) and above 121 degrees C (250 degrees F) provide mitered pipe insulation of the same type as insulating straight pipe. Provide double layer insert. Provide vapor barrier pressure sensitive tape matching the color of the PVC jacket.

2.13 FIRESTOPPING MATERIAL

A. Other than pipe insulation, refer to Section 07 84 00, FIRESTOPPING.

2.14 FLAME AND SMOKE

A. Unless shown otherwise all assembled systems shall meet flame spread 25 and smoke developed 50 rating as developed under ASTM and UL standards and specifications. See paragraph "Quality Assurance".

PART 3 - EXECUTION

3.1 GENERAL REQUIREMENTS

A. Required pressure tests of piping joints and connections shall be completed and the work approved by the Contracting Officer’s Representative (COR) for application of insulation. Surface shall be clean and dry with all foreign materials, such as dirt, oil, loose scale and rust removed.

B. Except for specific exceptions or as noted, insulate all specified equipment, and piping (pipe, fittings, valves, accessories). Insulate each pipe individually. Do not use scrap pieces of insulation where a full length section will fit.

C. Where removal of insulation of piping and equipment is required to comply with Section 02 82 11, TRADITIONAL ASBESTOS ABATEMENT and Section 02 82 13.13, GLOVEBAG ASBESTOS ABATEMENT, such areas shall be reinsulated to comply with this specification.

D. Insulation materials shall be installed with smooth and even surfaces, with jackets and facings drawn tight and smoothly cemented down and sealed at all laps. Insulation shall be continuous through all sleeves and openings, except at fire dampers and duct heaters (NFPA 90A).

E. Vapor retarders shall be continuous and uninterrupted throughout systems with operating temperature 15 degrees C (60 degrees F) and

below. Lap and seal vapor barrier over ends and exposed edges of insulation. Anchors, supports and other metal projections through insulation on cold surfaces shall be insulated and vapor sealed for a minimum length of 150 mm (6 inches).

F. Install vapor stops with operating temperature 15 degrees C (60 degrees F) and below at all insulation terminations on either side of valves, pumps, fittings, and equipment and particularly in straight lengths every 4.6 to 6.1 meters (approx. 15 to 20 feet) of pipe insulation. The annular space between the pipe and pipe insulation of approx. 25 mm (1 inch) in length at every vapor stop shall be sealed with appropriate vapor barrier sealant. Bio-based materials shall be utilized when possible.

G. Construct insulation on parts of equipment such as cold water pumps and heat exchangers that must be opened periodically for maintenance or repair, so insulation can be removed and replaced without damage. Install insulation with bolted 1 mm thick (20 gage) galvanized steel or aluminum covers as complete units, or in sections, with all necessary supports, and split to coincide with flange/split of the equipment. Do not insulate over equipment nameplate data.

H. Insulation on hot piping and equipment shall be terminated square at items not to be insulated, access openings and nameplates. Cover all exposed raw insulation with white sealer coating (caution about coating’s maximum temperature limit) or jacket material.

I. Protect all insulations outside of buildings with aluminum jacket using lock joint or other approved system for a continuous weather tight system. Access doors and other items requiring maintenance or access shall be removable and sealable.

J. Plumbing work not to be insulated unless otherwise noted:
   1. Piping and valves of fire protection system.
   2. Chromium plated brass piping.
   3. Water piping in contact with earth.
   4. Distilled water piping.

K. Apply insulation materials subject to the manufacturer's recommended temperature limits. Apply adhesives, mastic and coatings at the manufacturer's recommended minimum wet or dry film thickness. Bio-based materials shall be utilized when possible.

L. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. Use of polyurethane or polyisocyanurate spray-foam to fill a PVC elbow jacket is prohibited on cold applications.

M. Firestop Pipe insulation:

1. Provide firestopping insulation at fire and smoke barriers through penetrations. Firestopping insulation shall be UL listed as defined in Section 07 84 00, FIRESTOPPING.
2. Pipe penetrations requiring fire stop insulation including, but not limited to the following:
   a. Pipe risers through floors
   b. Pipe chase walls and floors
   c. Smoke partitions
   d. Fire partitions
   e. Hourly rated walls

N. Freeze protection of above grade outdoor piping (over heat tracing tape): 20 mm (3/4 inch) thick insulation, for all pipe sizes 75 mm (3 inches) and smaller and 25 mm (1 inch) thick insulation for larger pipes. Provide metal jackets for all pipe insulations. Provide freeze protection for cold water make-up piping and equipment where indicated on the drawings as described in Section 23 21 13, HYDRONIC PIPING (electrical heat tracing systems).

O. Provide vapor barrier systems as follows: (NOT USED)

3.2 INSULATION INSTALLATION

A. Mineral Fiber Board:

1. Vapor retarder faced board: Apply board on pins spaced not more than 300 mm (12 inches) on center each way, and not less than 75 mm (3 inches) from each edge of board. In addition to pins, apply insulation bonding adhesive to entire underside of horizontal metal surfaces. (Bio-based materials shall be utilized when possible.) Butt insulation edges tightly and seal all joints with laps and butt strips. After applying speed clips cut pins off flush and apply vapor seal patches over clips.

2. Plain unfaced board:
   a. Insulation shall be scored, beveled or mitered to provide tight joints and be secured to equipment with bands spaced 225 mm (9 inches) on center for irregular surfaces or with pins and clips on flat surfaces. Use corner beads to protect edges of insulation.
   b. For hot equipment: Stretch 25 mm (1 inch) mesh wire, with edges wire laced together, over insulation and finish with insulating and finishing cement applied in one coat, 6 mm (1/4 inch) thick, trowelled to a smooth finish.
   c. For cold equipment: Apply meshed glass fabric in a tack coat 1.5 to 1.7 square meter per liter (60 to 70 square feet per gallon) of vapor mastic and finish with mastic at 0.3 to 0.4 square meter per liter (12 to 15 square feet per gallon) over the entire fabric surface.
3. Cold equipment: 40 mm (1-1/2inch) thick insulation faced with vapor retarder ASJ or FSK. Seal all facings, laps, and termination points and do not use staples or other attachments that may puncture ASJ or FSK.
   a. Water filter, chemical feeder pot or tank.
   b. Pneumatic, cold storage water and surge tanks.
4. Hot equipment: 40 mm (1-1/2 inch) thick insulation faced with unsealed ASJ or FSK.
   a. Domestic water heaters and hot water storage tanks (not factory insulated).
   b. Booster water heaters for dietetics dish and pot washers and for washdown grease-extracting hoods.

B. Molded Mineral Fiber Pipe and Tubing Covering:
1. Fit insulation to pipe, aligning all longitudinal joints. Seal longitudinal joint laps and circumferential butt strips by rubbing hard with a nylon sealing tool to assure a positive seal. Staples may be used to assist in securing insulation except for cold piping. Seal all vapor retarder penetrations on cold piping with a generous application of vapor barrier mastic. Provide cellar glass inserts and install with metal insulation shields at outside pipe supports. Install freeze protection insulation over heating cable.

2. Contractor's options for fitting, flange and valve insulation:
   a. Insulating and finishing cement for sizes less than 100 mm (4 inches) operating at surface temperature of 15 degrees C (60 degrees F) or more.
   b. Factory premolded, one piece PVC covers with mineral fiber, (Form B), inserts surface temperature of above 4 degrees C (40 degrees F) to 121 degrees C (250 degrees F). Provide mitered preformed insulation of the same type as the installed straight pipe insulation for pipe temperatures below 4 degrees C (40 degrees F). Secure first layer of mineral fiber insulation with twine. Seal seam edges with vapor barrier mastic and secure with fitting tape.
   c. Factory preformed, ASTM C547 or fabricated mitered sections, joined with adhesive or (hot only) wired in place. (Bio-based materials shall be utilized when possible.) For hot piping finish with a smoothing coat of finishing cement. For cold fittings, 15 degrees C (60 degrees F) or less, vapor seal with a layer of glass fitting tape imbedded between two 2 mm (1/16 inch) coats of vapor barrier mastic.
   d. Fitting tape shall extend over the adjacent pipe insulation and overlap on itself at least 50 mm (2 inches).
3. Nominal thickness in millimeters and inches specified in the schedule at the end of this section.

C. Rigid Cellular Phenolic Foam:
1. Rigid closed cell phenolic insulation may be provided, exterior only, for piping, ductwork and equipment for temperatures up to 121 degrees C (250 degrees F).
2. Note the ASTM E84 or UL 723 surface burning characteristics requirements of maximum 25/50 indexes in paragraph "Quality Assurance".
3. Provide secure attachment facilities such as welding pins.
4. Apply insulation with joints tightly drawn together.
5. Apply adhesives, coverings, neatly finished at fittings, and valves.
6. Final installation shall be smooth, tight, neatly finished at all edges.

7. Minimum thickness in millimeters (inches) specified in the schedule at the end of this section.
8. Condensation control insulation: Minimum 25 mm (1 inch) thick for all pipe sizes depending on high humidity exposures.
   a. Body of roof and overflow drains horizontal runs and offsets (including elbows) of interior downspout piping in all areas above pipe basement.
   b. Waste piping from electric water coolers and icemakers to drainage system.
   c. Waste piping located above basement floor from ice making and film developing equipment and air handling units, from equipment (including trap) to main vertical waste pipe.
   d. MRI quench vent piping.
   e. Bedpan sanitizer atmospheric vent
   f. Reagent grade water piping.
   g. Cold water piping, exterior only.

D. Cellular Glass Insulation:
1. Pipe and tubing, covering nominal thickness in millimeters and inches as specified in the schedule at the end of this section.
2. Underground piping other than or in lieu of that specified in Section 22 11 00, FACILITY WATER DISTRIBUTION: Type II, factory jacketed with a 3 mm laminate jacketing consisting of 3000 mm x 3000 mm (10 ft x 10 ft) asphalt impreganted glass fabric, bituminous mastic and outside protective plastic film.
   a. 75 mm (3 inches) thick for hot water piping.
   b. As scheduled at the end of this section for chilled water piping.
   c. Underground piping: Apply insulation with joints tightly butted. Seal longitudinal self-sealing lap. Use field fabricated or factory made fittings. Seal butt joints and fitting with jacketing as recommended by the insulation manufacturer. Use 100 mm (4 inch) wide strips to seal butt joints.
   d. Provide expansion chambers for pipe loops, anchors and wall penetrations as recommended by the insulation manufacturer.
   e. Underground insulation shall be inspected and approved by the COR as follows:
      1) Insulation in place before coating.

2) After coating.

f. Sand bed and backfill: Minimum 75 mm (3 inches) all around insulated pipe or tank, applied after coating has dried.

g. All piping up to 482 degrees C (900 degrees F) requiring protection from physical heavy contact/abuse including in mechanical rooms and exposures to the public.

3. Cold equipment: 50 mm (2 inch) thick insulation faced with ASJ.

E. Polyisocyanurate Closed-Cell Rigid Insulation:

1. Polyisocyanurate closed-cell rigid insulation (PIR) may be provided for exterior piping and equipment for temperature up to 149 degree C (300 degree F).
2. Install insulation, vapor retarder and jacketing per manufacturer's recommendations. Particular attention should be paid to recommendations for joint staggering, adhesive application, external hanger design, expansion/contraction joint design and spacing and vapor retarder integrity.
3. Install insulation with all joints tightly butted (except expansion) joints in hot applications). Provide insulation contractions joints for very cold process temperatures.
4. If insulation thickness exceeds 65 mm (2-1/2 inches), install as a double layer system with longitudinal (lap) and butt joint staggering as recommended by manufacturer.
5. For cold applications, vapor retarder shall be installed in a continuous manner. No staples, rivets, screws or any other attachment device capable of penetrating the vapor retarder shall be used to attach the vapor retarder or jacketing. No wire ties capable of penetrating the vapor retarder shall be used to hold the insulation in place. Stainless steel banding shall be used for cold applications to attach PVC or metal jacketing.
6. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/ fitting. Use of polyurethane or polyisocyanurate spray-foam to fill PVC elbow jacket is prohibited on cold applications.

7. For cold applications, the vapor retarder on elbows/fittings shall be either mastic-fabric-mastic or 2 mil thick PVDC vapor retarder adhesive tape. Bio-based materials shall be utilized when possible.
8. All PVC and metal jacketing shall be installed so as to naturally shed water. Joints shall point down and shall be sealed with either adhesive or caulking (except for periodic slip joints). Bio-based materials shall be utilized when possible.
9. Note the NFPA 90A burning characteristic requirements of 25/50 in paragraph "Quality Assurance". Refer to paragraph "General Requirements" for items not to be insulated.
10. Minimum thickness in millimeter (inches) specified in the schedule at the end of this section.

F. Flexible Elastomeric Cellular Thermal Insulation:

1. Apply insulation and fabricate fittings in accordance with the manufacturer's installation instructions and finish with two coats of weather resistant finish as recommended by the insulation manufacturer. External vapor barrier jacketing may be required for expected or anticipated high humidity exposures. See ASTM C1710.
2. Pipe and tubing insulation:
   a. Use proper size material. Do not stretch or strain insulation.
   b. To avoid undue compression of insulation, use supports as recommended by the elastomeric insulation manufacturer. Insulation shields are specified under Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
   c. Where possible, slip insulation over the pipe or tubing prior to connection, and seal the butt joints with adhesive. Where the slip-on technique is not possible, slit the insulation and apply it to the pipe sealing the seam and joints with contact adhesive. Optional tape sealing, as recommended by the manufacturer, may be employed. Bio-based materials shall be utilized when possible.
3. Apply sheet insulation to flat or large curved surfaces with 100 percent adhesive coverage. For fittings and large pipe, apply adhesive to seams only.
4. Pipe insulation: nominal thickness in millimeters (inches as specified in the schedule at the end of this section.

G. Calcium Silicate:

1. Minimum thickness in millimeter (inches) specified below for piping other than in boiler plant.

Nominal Thickness Of Calcium Silicate Insulation (Non-Boiler Plant)				
Nominal Pipe Size Millimeters (Inches)	Thru 25 (1)	32 to 75 (1-1/4 to 3)	100-200 (4 to 8)	Greater than 200 (8)
93-260 degrees C (199-500 degrees F)(HPS, HPR)	100(4)	125(5)	150(6)	Greater than 150(6)

2. MRI Quench Vent Insulation: Type I, class D, 150 mm (6 inch) nominal thickness.

3.3 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.4 PIPE INSULATION SCHEDULE

A. Provide insulation for piping systems as scheduled below:

Insulation Thickness Millimeters (Inches)					
		Nominal Pipe Size Millimeters (Inches)			
Operating Temperature Range/Service	**Insulation Material**	**Less than 25 (1)**	**25 – 32 (1 – 1¼)**	**38 – 75 (1½ - 3)**	**100 (4) and Greater**
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Mineral Fiber (Above ground piping only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Rigid Cellular Phenolic Foam (Above ground piping only) (exterior locations only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Polyiso-cyanurate Closed-Cell Rigid (Exterior	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)

	Locations only)				
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Flexible Elastomeric Cellular Thermal (Above ground piping only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Cellular Glass Thermal	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)

- - - E N D - - -

SECTION 22 08 00

COMMISSIONING OF PLUMBING SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

A. The requirements of this Section apply to all sections of Division 22.

B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the Department of Veterans Affairs will manage the commissioning process.

1.2 RELATED WORK

A. Section 01 00 00 GENERAL REQUIREMENTS.

B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.3 SUMMARY

A. This Section includes requirements for commissioning plumbing systems, subsystems and equipment. This Section supplements the general requirements specified in Section 01 91 00 General Commissioning Requirements.

B. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more specifics regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

1.4 DEFINITIONS

A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

1.5 COMMISSIONED SYSTEMS

A. Commissioning of a system or systems specified in Division 22 is part of the construction process. Documentation and testing of these systems, as well as training of the VA’s Operation and Maintenance personnel in accordance with the requirements of Section 01 91 00 and

of Division 22, is required in cooperation with the VA and the Commissioning Agent.

B. The Plumbing systems commissioning will include the systems listed in Section 01 91 00 General Commissioning Requirements:

1.6 SUBMITTALS

A. The commissioning process requires review of selected Submittals. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.

B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 CONSTRUCTION INSPECTIONS

A. Commissioning of the Building Plumbing Systems will require inspection of individual elements of the Plumbing construction throughout the construction period. The Contractor shall coordinate with the Commissioning Agent in accordance with Section 01 91 00 and the Commissioning Plan to schedule inspections as required to support the commissioning process.

3.2 PRE-FUNCTIONAL CHECKLISTS

A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist

to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

3.3 CONTRACTORS TESTS

A. Contractor tests as required by other sections of Division 22 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. . All testing shall be incorporated into the project schedule. Contractor shall provide no less than 7 calendar days' notice of testing. The Commissioning Agent will witness selected Contractor tests at the sole discretion of the Commissioning Agent. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

3.4 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:

A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the Contracting Officer's Representative. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

3.5 TRAINING OF VA PERSONNEL

A. Training of the VA operation and maintenance personnel is required in cooperation with the Contracting Officer's Representative and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. Contractor shall submit training agendas and trainer resumes in accordance with the requirements of Section 01 91 00. The instruction shall be scheduled in coordination with the Contracting Officer's Representative after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 22 Sections for additional Contractor training requirements.

----- END -----

SECTION 22 11 00
FACILITY WATER DISTRIBUTION

PART 1 - GENERAL

1.1 DESCRIPTION

A. Domestic water systems, including piping, equipment and all necessary accessories as designated in this section.

B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

E. Section 07 84 00, FIRESTOPPING.

F. Section 07 92 00, JOINT SEALANTS.

G. Section 09 91 00, PAINTING.

I. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

J. Section 22 07 11, PLUMBING INSULATION.

K. SECTION 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society of Mechanical Engineers (ASME):

A13.1-2007 (R2013).....Scheme for Identification of Piping Systems

B16.3-2011.....Malleable Iron Threaded Fittings: Classes 150 and 300

B16.9-2012.....Factory-Made Wrought Buttwelding Fittings

B16.11-2011.....Forged Fittings, Socket-Welding and Threaded

B16.12-2009 (R2014).....Cast Iron Threaded Drainage Fittings

B16.15-2013 .....Cast Copper Alloy Threaded Fittings: Classes 125 and 250

B16.18-2012.....Cast Copper Alloy Solder Joint Pressure Fittings

B16.22-2013.....Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings

B16.24-2011.....Cast Copper Alloy Pipe Flanges and Flanged Fittings: Classes 150, 300, 600, 900, 1500, and 2500

ASME Boiler and Pressure Vessel Code -

BPVC Section IX-2015....Welding, Brazing, and Fusing Qualifications

C. American Society of Sanitary Engineers (ASSE):

1010-2004.....Performance Requirements for Water Hammer Arresters

D. American Society for Testing and Materials (ASTM):

A47/A47M-1999 (R2014)...Standard Specification for Ferritic Malleable Iron Castings

A53/A53M-2012.....Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless

A183-2014.....Standard Specification for Carbon Steel Track Bolts and Nuts

A269/A269M-2014e1.....Standard Specification for Seamless and Welded Austenitic Stainless Steel Tubing for General Service

A312/A312M-2015.....Standard Specification for Seamless, Welded, and Heavily Cold Worked Austenitic Stainless Steel Pipes

A403/A403M-2014.....Standard Specification for Wrought Austenitic Stainless Steel Piping Fittings

A536-1984 (R2014).....Standard Specification for Ductile Iron Castings

A733-2013.....Standard Specification for Welded and Seamless Carbon Steel and Austenitic Stainless Steel Pipe Nipples

B32-2008 (R2014).....Standard Specification for Solder Metal

B43-2014.....Standard Specification for Seamless Red Brass Pipe, Standard Sizes

B61-2008 (R2013).....Standard Specification for Steam or Valve Bronze Castings

B62-2009.....Standard Specification for Composition Bronze or Ounce Metal Castings

B75/B75M-2011.....Standard Specification for Seamless Copper Tube

B88-2014.....Standard Specification for Seamless Copper Water Tube

B584-2014.....Standard Specification for Copper Alloy Sand Castings for General Applications

B687-1999 (R2011).....Standard Specification for Brass, Copper, and Chromium-Plated Pipe Nipples

C919-2012.....Standard Practice for Use of Sealants in Acoustical Applications

D1785-2012.....Standard Specification for Poly (Vinyl Chloride) (PVC) Plastic Pipe, Schedules 40, 80, and 120

D2000-2012.....Standard Classification System for Rubber Products in Automotive Applications

D2564-2012.....Standard Specification for Solvent Cements for Poly (Vinyl Chloride) (PVC) Plastic Piping Systems

D2657-2007.....Standard Practice for Heat Fusion Joining of Polyolefin Pipe and Fittings

D2855-1996 (R2010).....Standard Practice for Making Solvent-Cemented Joints with Poly (Vinyl Chloride) (PVC) Pipe and Fittings

D4101-2014.....Standard Specification for Polypropylene Injection and Extrusion Materials

E1120-2008.....Standard Specification for Liquid Chlorine

E1229-2008.....Standard Specification for Calcium Hypochlorite

F2389-2010.....Standard Specification for Pressure-rated Polypropylene (PP) Piping Systems

F2620-2013.....Standard Practice for Heat Fusion Joining of Polyethylene Pipe and Fittings

F2769-2014.....Standard Specification for Polyethylene of Raised Temperature (PE-RT) Plastic Hot and Cold-Water Tubing and Distribution Systems

E. American Water Works Association (AWWA):

C110-2012.....Ductile-Iron and Gray-Iron Fittings

C151-2009.....Ductile Iron Pipe, Centrifugally Cast

C153-2011.....Ductile-Iron Compact Fittings

C203-2008.....Coal-Tar Protective Coatings and Linings for Steel Water Pipelines - Enamel and Tape - Hot Applied

C213-2007.....Fusion-Bonded Epoxy Coating for the Interior and Exterior of Steel Water Pipelines

C651-2014.....Disinfecting Water Mains

F. American Welding Society (AWS):

A5.8M/A5.8-2011-AMD1....Specification for Filler Metals for Brazing and Braze Welding

G. International Code Council (ICC):

IPC-2012.....International Plumbing Code

H. Manufacturers Specification Society (MSS):

SP-58-2009.....Pipe Hangers and Supports - Materials, Design, Manufacture, Selection, Application, and Installation

SP-72-2010a.....Ball Valves with Flanged or Butt-Welding Ends for General Service

SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends

I. NSF International (NSF):

14-2015.....Plastics Piping System Components and Related Materials

61-2014a.....Drinking Water System Components – Health Effects

372-2011.....Drinking Water System Components – Lead Content

J. Plumbing and Drainage Institute (PDI):

PDI-WH 201-2010.....Water Hammer Arrestors

K. Department of Veterans Affairs:

H-18-8-2013.....Seismic Design Handbook

H-18-10.....Plumbing Design Manual

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 11 00, FACILITY WATER DISTRIBUTIONS", with applicable paragraph identification.

C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. All items listed in Part 2 - Products.

D. Complete operating and maintenance manuals including wiring diagrams, technical data sheets and information for ordering replacement parts:

1. Include complete list indicating all components of the systems.
2. Include complete diagrams of the internal wiring for each item of equipment.
3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.

1.5 QUALITY ASSURANCE

A. A certificate shall be submitted prior to welding of steel piping showing the Welder's certification. The certificate shall be current and no more than one year old. Welder's qualifications shall be in accordance with ASME BPVC Section IX.

B. All grooved joint couplings, fittings, valves, and specialties shall be the products of a single manufacturer. Grooving tools shall be by the same manufacturer as the groove components.

C. All pipe, couplings, fittings, and specialties shall bear the identification of the manufacturer and any markings required by the applicable referenced standards.

D. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more

information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

1.6 SPARE PARTS (NOT USED)

1.7 AS-BUILT DOCUMENTATION

A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.

B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be in hard copies or PDF version copies. . All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices shall be included. A list of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in Auto-CAD version __2021__ provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.

D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certificate if applicable that all results of tests were within limits specified. If a certificate is not available, all documentation shall be on the Certifier's letterhead.

PART 2 - PRODUCTS

2.1 MATERIALS

A. Material or equipment containing a weighted average of greater than 0.25 percent lead are prohibited in any potable water system intended for human consumption and shall be certified in accordance with NSF 61 or NSF 372. Endpoint devices used to dispense water for drinking shall meet the requirements of NSF 61, Section 9.

B. Plastic pipe, fittings, and solvent cement shall meet NSF 14 and shall be NSF listed for the service intended.

2.2 UNDERGROUND WATER SERVICE CONNECTIONS TO BUILDINGS

A. From inside face of exterior wall to approximately 1500 mm (5 feet) outside of building and underground inside building, material to be the same for the size specified inside the building.

B. 75 mm (3 inch) Diameter and Greater: Ductile iron, AWWA C151, 2413 kPa (350 psig) pressure class, exterior bituminous coating, and cement lined. Bio-based materials shall be utilized when possible. Provide flanged and anchored connection to interior piping.

C. Under 75 mm (3 inch) Diameter: Copper tubing, ASTM B88, Type K, seamless, annealed. Fittings are as specified in paragraph "Above Ground (Interior) Water Piping". Use brazing alloys, AWS A5.8M/A5.8, Classification BCuP.

D. Flexible Expansion Joint: Ductile iron with ball joints rated for 1725 kPa (250 psig) working pressure conforming to AWWA C153, capable of deflecting a minimum of 20 degrees in each direction. Flexible expansion joint size shall match the pipe size it is connected to and shall have the expansion capability designed as an integral part of the ductile iron ball castings. Pressure containing parts shall be lined with a minimum of 15 mils of fusion bonded epoxy conforming to the applicable requirements of AWWA C213 and shall be factory tested with a 1500-volt spark test. Flexible expansion joint shall have flanged connections conforming to AWWA C110. Bolts and nuts shall be 316 stainless steel and gaskets shall be neoprene. The flexible expansion fitting shall not expand or exert an axial thrust under internal water pressure. Provide piping joint restraints at each mechanical joint end connection and piping restraints at the penetration of the building

wall. The restraints shall be provided to address the developed thrust at the change of piping direction.

2.3 ABOVE GROUND (INTERIOR) WATER PIPING

A. Pipe: Copper tube, ASTM B88, Type K or L, drawn. For pipe 150 mm (6 inches) and larger, stainless steel, ASTM A312, schedule 10 shall be used.

B. Fittings for Copper Tube:

1. Wrought copper or bronze castings conforming to ASME B16.18 and B16.22. Unions shall be bronze, MSS SP-72, MSS SP-110, solder or braze joints. Use 95/5 tin and antimony for all soldered joints.
2. Grooved fittings, 50 to 150 mm (2 to 6 inch) wrought copper ASTM B75/B75M C12200, 125 to 150 mm (5 to 6 inch) bronze casting ASTM B584, C84400. Mechanical grooved couplings, 2070 kPa (300 psig) minimum ductile iron, ASTM A536 Grade 448-310-12 (Grade 65-45-12), or malleable iron, ASTM A47/A47M Grade 22410 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with copper colored alkyd enamel.
3. Mechanical press-connect fittings for copper pipe and tube **are prohibited**. See Plumbing Design Manual for additional information.
4. Mechanically formed tee connection: Form mechanically extracted collars in a continuous operation by drilling pilot hole and drawing out tube surface to form collar, having a height of not less than three times the thickness of tube wall. Adjustable collaring device shall ensure proper tolerance and complete uniformity of the joint. Notch and dimple joining branch tube in a single process to provide free flow where the branch tube penetrates the fitting. Braze joints.
5. Flanged fittings, bronze, class 150, solder-joint ends conforming to ASME B16.24.

C. Fittings for Stainless Steel:

1. Stainless steel butt-welded fittings, Type 316, Schedule 10, conforming to ASME B16.9.
2. Grooved fittings, stainless steel, Type 316, Schedule 10, conforming to ASTM A403/A403M. Segmentally fabricated fittings are not allowed. Mechanical grooved couplings, ductile iron, 4138 kPa (600 psig), ASTM A536 Grade 448-310-12 (Grade 65-45-12), or

malleable iron, ASTM A47/A47M Grade 22410 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with copper colored alkyd enamel.

D. Adapters: Provide adapters for joining pipe or tubing with dissimilar end connections.

E. Solder: ASTM B32 alloy type Sb5, HA or HB. Provide non-corrosive flux.

F. Brazing alloy: AWS A5.8M/A5.8, brazing filler metals shall be BCuP series for copper to copper joints and BAg series for copper to steel joints.

G. Re-agent Grade Water Piping and Dialysis Water Piping:

1. Polypropylene, ASTM F2389, Schedule 80 pressure pipe without additions of modifiers, plasticizers, colorants, stabilizers or lubricants. Bio-based materials shall be utilized when possible. This virgin un-plasticized pipe and fittings shall transport 10 megohm water with no loss of purity. Provide socket or butt end fittings with ASTM D2657 heat fusion joints.
2. Polyethylene, ASTM F2769, Schedule 80, food and medical grade, capable of transporting 10 megohm water with no loss of purity. Processed by continuous compression molding without the addition of fillers, polymer modifiers or processing aids. Uniform color with no cracks, flaws, blisters or other imperfections in appearance. Provide ASTM D2657 or ASTM F2620 heat fusion butt welded joints. In accordance with manufacturer's recommendations, provide continuous channel support under all horizontal piping.
3. Reverse Osmosis (RO) Water Piping:
   a. Low Pressure Feed, Reject and Recycle Piping: Less than or equal to 520 kPa (75 psig): ASTM D1785, Schedule 80 PVC, ASTM D2855 socket welded and flanged.
   b. RO Product Tubing from each Membrane Housing: ASTM D1785, Schedule 80 PVC, ASTM D2855 socket welded and flanged.
   c. Low Pressure Control and Pressure Gage Tubing: Polyethylene.
   d. High Pressure Reject and Recycle Piping: Greater than 520 kPa (75 psig): ASTM A269/A269M, Type 304 schedule 10 stainless steel with butt welded joints.
   e. High Pressure Control and Pressure Gage Tubing: 6895 kPa (1000 psig) burst nylon.

2.4 EXPOSED WATER PIPING

A. Finished Room: Use full iron pipe size chrome plated brass piping for exposed water piping connecting fixtures, casework, cabinets, equipment, and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
   1. Pipe: ASTM B43, standard weight.
   2. Fittings: ASME B16.15 cast bronze threaded fittings with chrome finish.
   3. Nipples: ASTM B687, Chromium-plated.
   4. Unions: MSS SP-72, MSS SP-110, brass or bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.

B. Unfinished Rooms, Mechanical Rooms and Kitchens: Chrome-plated brass piping is not required. Paint piping systems as specified in Section 09 91 00, PAINTING.

2.5 ETHYLENE OXIDE (ETO) STERILIZER WATER SUPPLY PIPING (NOT USED)

2.6 TRAP PRIMER WATER PIPING

A. Pipe: Copper tube, ASTM B88, type K, hard drawn.

B. Fittings: Bronze castings conforming to ASME B16.18 Solder joints.

C. Solder: ASTM B32 alloy type Sb5. Provide non-corrosive flux.

2.7 STRAINERS

A. Provide on high pressure side of pressure reducing valves, on suction side of pumps, on inlet side of indicating and control instruments and equipment subject to sediment damage and where shown on drawings. Strainer element shall be removable without disconnection of piping.

B. Water: Basket or "Y" type with easily removable cover and brass strainer basket.

C. Body: Less than 75 mm (3 inches), brass or bronze; 75 mm (3 inches) and greater, cast iron or semi-steel.

2.8 DIELECTRIC FITTINGS

A. Provide dielectric couplings or unions between pipe of dissimilar metals.

2.9 STERILIZATION CHEMICALS (NOT USED)

2.10 WATER HAMMER ARRESTER

A. Closed copper tube chamber with permanently sealed 413 kPa (60 psig) air charge above a Double O-ring piston. Two high heat Buna-N 0-rings pressure packed and lubricated with FDA approved silicone compound. All units shall be designed in accordance with ASSE 1010. Access shall be provided where devices are concealed within partitions or above ceilings. Size and install in accordance with PDI-WH 201 requirements. Provide water hammer arrestors at:

1. All solenoid valves.
2. All groups of two or more flush valves.
3. All quick opening or closing valves.
4. All medical washing equipment.

PART 3 - EXECUTION

3.1 INSTALLATION

A. General: Comply with the International Plumbing Code and the following:

1. Install branch piping for water from the piping system and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.
2. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe, except for plastic and glass, shall be reamed to remove burrs and a clean smooth finish restored to full pipe inside diameter.
3. All pipe runs shall be laid out to avoid interference with other work/trades.
4. Install union and shut-off valve on pressure piping at connections to equipment.
5. Pipe Hangers, Supports and Accessories:
   a. All piping shall be supported per the IPC, H-18-8 Seismic Design Handbook, MSS SP-58, and SMACNA as required.
   b. Shop Painting and Plating: Hangers, supports, rods, inserts and accessories used for pipe supports shall be shop coated with zinc chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.

c. Floor, Wall and Ceiling Plates, Supports, Hangers:

1) Solid or split un-plated cast iron.
2) All plates shall be provided with set screws.
3) Pipe Hangers: Height adjustable clevis type.
4) Adjustable Floor Rests and Base Flanges: Steel.
5) Concrete Inserts: "Universal" or continuous slotted type.
6) Hanger Rods: Mild, low carbon steel, fully threaded or Threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
7) Pipe Hangers and Riser Clamps: Malleable iron or carbon steel. Pipe Hangers and riser clamps shall have a copper finish when supporting bare copper pipe or tubing.
8) Rollers: Cast iron.
9) Self-drilling type expansion shields shall be "Phillips" type, with case hardened steel expander plugs.
10) Hangers and supports utilized with insulated pipe and tubing shall have 180-degree (minimum) metal protection shield centered on and welded to the hanger and support. The shield thickness and length shall be engineered and sized for distribution of loads to preclude crushing of insulation without breaking the vapor barrier. The shield shall be sized for the insulation and have flared edges to protect vapor-retardant jacket facing. To prevent the shield from sliding out of the clevis hanger during pipe movement, center-ribbed shields shall be used.
11) Miscellaneous Materials: As specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6.1 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. Provide all necessary auxiliary steel to provide that support.
12) With the installation of each flexible expansion joint, provide piping restraints for the upstream and downstream section of the piping at the flexible expansion joint. Provide calculations supporting the restraint length design and type of selected restraints. Restraint calculations shall be based

on the criteria from the manufacturer regarding their restraint design.

6. Install chrome plated cast brass escutcheon with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
7. Penetrations:
   a. Firestopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke, and gases as specified in Section 07 84 00, FIRESTOPPING. Completely fill and seal clearances between raceways and openings with the firestopping materials.
   b. Waterproofing: At floor penetrations, completely seal clearances around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS. Bio-based materials shall be utilized when possible.
   c. Acoustical sealant: Where pipes pass through sound rated walls, seal around the pipe penetration with an acoustical sealant that is compliant with ASTM C919.

B. Domestic Water piping shall conform to the following:
1. Grade all lines to facilitate drainage. Provide drain valves at bottom of risers and all low points in system. Design domestic hot and cold water circulating lines with no traps.
2. Connect branch lines at bottom of main serving fixtures below and pitch down so that main may be drained through fixture. Connect branch lines to top of main serving only fixtures located on floor above.

3.2 TESTS

A. General: Test system either in its entirety or in sections. Submit testing plan to COR 10 working days prior to test date.
B. Potable Water System: Test after installation of piping and domestic water heaters, but before piping is concealed, before covering is applied, and before plumbing fixtures are connected. Fill systems with water and maintain hydrostatic pressure of 1035 kPa (150 psig) gage for two hours. No decrease in pressure is allowed. Provide a pressure gage

with a shutoff and bleeder valve at the highest point of the piping being tested. Pressure gauge shall have 1 psig increments.

C. Re-agent Grade Water Systems: Fill system with water and maintain hydrostatic pressure of 1380 kPa (200 psig) gage during inspection and prove tight.

D. All Other Piping Tests: Test new installed piping under 1-1/2 times actual operating conditions and prove tight.

E. The test pressure shall hold for the minimum time duration required by the applicable plumbing code or authority having jurisdiction.

3.3 STERILIZATION

A. After tests have been successfully completed, thoroughly flush and sterilize the interior domestic water distribution system in accordance with AWWA C651.

B. Use liquid chlorine or hypochlorite for sterilization.

3.4 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.5 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer’s technical representative for fourhours to instruct VA Personnel in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

SECTION 22 11 23
DOMESTIC WATER PUMPS

PART 1 - GENERAL

1.1 DESCRIPTION

A. Hot water circulating pump, hot water recirculation pump and domestic water pressure booster system.

B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

E. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS: Seismic Restraint.

F. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

G. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT.

H. Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS: Requirements for commissioning, systems readiness checklist, and training.

I. Section 26 29 11, MOTOR CONTROLLERS.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society of Mechanical Engineers (ASME):

ASME Boiler and Pressure Code -

BPVC Section VIII-1-2015 Rules for Construction of Pressure Vessels, Division 1

BPVC Section VIII-2-2015 Rules for Construction of Pressure Vessels, Division 2-Alternative Rules

C. American Society for Testing and Materials (ASTM):

A48/A48M-2003 (R2012)...Standard Specification for Gray Iron Castings

B584-2014.....Standard Specification for Copper Alloy Sand Castings for General Applications

D. International Code Council (ICC)

IPC-2012.....International Plumbing Code

E. National Electrical Manufacturers Association (NEMA):

ICS 6-1993 (R2001, R2006) Industrial Control and Systems: Enclosures

250-2014.....Enclosures for Electrical Equipment (1000 Volts Maximum)

F. NSF International (NSF)

61-2014a.....Drinking Water System Components – Health Effects

372-2011.....Drinking Water System Components – Lead Content

G. Underwriters' Laboratories, Inc. (UL):

508-1999 (R2013).....Standards for Industrial Control Equipment

778-2010 (R2014).....Standard for Motor-Operated Water Pumps

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 11 23, DOMESTIC WATER PUMPS", with applicable paragraph identification.

C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Pump:
   a. Manufacturer and model.
   b. Operating speed.
   c. Capacity.
   d. Characteristic performance curves.
2. Motor:
   a. Manufacturer.

b. Speed.

c. Current Characteristics.

d. Efficiency.

4. Drive: Information in accordance with Section 26 29 11, MOTOR CONTROLLERS.

D. Certificate of shop test for domestic water booster system. Provide certified performance curves.

E. Certified copies of all the factory and construction site test data sheets and reports.

F. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replacement parts, and troubleshooting guide:

1. Include complete list indicating all components of the systems.
2. Include complete diagrams of the internal wiring for each item of equipment.
3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.

1.5 QUALITY ASSURANCE

A. General:

1. UL Compliance: Comply with UL 778 for motor-operated water pumps.
2. Design Criteria:
   a. Pump sizes, capacities, pressures, operating characteristics and efficiency shall be as scheduled.
   b. Head-capacity curves shall slope up to maximum head at shut-off. Select pumps near the midrange of the curve, and near the point of maximum efficiency, without approaching the pump curve end point and possible cavitation and unstable operation. Select pumps for open systems so that required net positive suction head (NPSHR) does not exceed the net positive head available (NPSHA).
   c. Pump Driver: Furnish with pump. Size shall be non-overloading at any point on the head-capacity curve, including in a parallel or series pumping installation with one pump in operation.

d. Provide all pumps with motors, impellers, drive assemblies, bearings, coupling guard and other accessories specified. Statically and dynamically balance all rotating parts.
e. Furnish each pump and motor with a nameplate giving the manufacturers name, serial number of pump, capacity in GPM and head in feet at design condition, horsepower, voltage, frequency, speed and full load current and motor efficiency.
f. Test all pumps before shipment. The manufacturer shall certify all pump ratings.
g. After completion of balancing, provide replacement of impellers or trim impellers to provide specified flow at actual pumping head, as installed.

B. Hot Water Circulating and Recirculating Pumps: Components shall be assembled by a single manufacturer and the pump motor assembly shall be the standard cataloged product of the manufacturer.

C. Domestic Water Pressure Booster System:
1. Components shall be furnished by a single manufacturer and the system shall be the standard cataloged product of the manufacturer.
2. Shop Test: Water booster unit and its component parts shall undergo a thorough electric and hydraulic operating test prior to shipment. Tests shall include a system operating flow test from zero to 100 percent of design flow rate under specified suction and system pressure conditions. Certified performance curves shall be furnished.

D. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

1.6 AS-BUILT DOCUMENTATION

A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.

B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be in hard copies or PDF version copies. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in Auto-CAD version __2021__ provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.

D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

PART 2 - PRODUCTS

2.1 MATERIALS

A. Material or equipment containing a weighted average of greater than 0.25 percent lead shall be prohibited in any potable water system intended for human consumption, and shall be certified in accordance with NSF 61 or NSF 372.

2.2 HOT WATER RECIRCULATING PUMP

A. General:

1. Centrifugal, single stage, pump. Driver shall be electric motor, close coupled or connected by flexible or magnetic coupling. Pump for hot water system shall be designed for quiet, trouble-free operation at a minimum of 82 degrees C (180 degrees F) water service and 1,035 kPa (150 psig).
2. Mounting shall be in-line, vertical or horizontal as indicated on drawing schedules.
3. Stamped or engraved stainless steel nameplate.
4. Motors: Maximum 40 degrees C (104 degrees F) ambient temperature rise, drip-proof, for operation with current, voltage, phase and cycle shown in schedule on Electrical drawings, conforming to NEMA Type 4. Motors shall be equipped with thermal overload protection. When motor has cooled down it shall re-start automatically if the operating control has been left on and the system requires pump to start.
5. Pump shall operate continuously with on-off switch, or with an HOA switch for automatically controlled pumps, for manual shut down. In the inlet and outlet piping of the pump, shutoff valves shall be installed to permit service to the pump, strainer, and check valve without draining the system.
6. A check valve shall be installed in the pump discharge piping immediately downstream of the pump. A strainer with drain valve and removable strainer screen or basket shall be installed immediately upstream of the pump.

B. Horizontal, Wet-Rotor Circulators: (NOT USED)

C. Horizontal, Permanently Lubricated Circulators:

1. Close-coupled pump and motor with maximum 3,500 rpm rotational speed.
2. Bronze body construction with solid steel shaft, plastic impeller, carbon/silicon carbide mechanical seal, and soldered

jointconnections. Pump shall be capable of pumping the capacity scheduled on drawings.

3. Bearings: Permanently oil lubricated and sealed, stainless steel ball bearings.

D. Horizontal, In-Line Pumps: (NOT USED)

E. Vertical, In-Line Pumps: (NOT USED)

2.3 HOT WATER CIRCULATING PUMP

A. General:

1. Centrifugal, single stage, pump. Driver shall be electric motor, close coupled or connected by flexible or magnetic coupling. Pump for hot water system shall be designed for quiet, trouble-free operation at a minimum of 82 degrees C (180 degrees F) water service and 1,035 kPa (150 psig).
2. Mounting shall be in-line, vertical or horizontal as indicated on drawing schedules.
3. Stamped or engraved stainless steel nameplate.
4. Motors: Maximum 40 degrees C (104 degrees F) ambient temperature rise, drip-proof, for operation with current, voltage, phase and cycle shown in schedule on Electrical drawings, conforming to NEMA Type 4. Motors shall be equipped with thermal overload protection. When motor has cooled down it shall re-start automatically if the operating control has been left on and the system requires pump to start.
5. Pump shall operate continuously with on-off switch, or with an HOA switch for automatically controlled pumps, for manual shut down. In the inlet and outlet piping of the pump, shutoff valves shall be installed to permit service to the pump, strainer, and check valve without draining the system.
6. A check valve shall be installed in the pump discharge piping immediately downstream of the pump. A strainer with drain valve and removable strainer screen or basket shall be installed immediately upstream of the pump.

B. Horizontal, Wet-Rotor Circulators: (NOT USED)

C. Horizontal, Permanently Lubricated Circulators: (NOT USED)

D. Horizontal, In-Line Pumps:

1. Flexibly-coupled pump and motor with maximum 1,800 rpm rotational speed.
2. Bearings: Permanently oil lubricated and sealed, stainless steel ball bearings.
3. Impeller shall be high grade, cast brass or bronze, accurately machined and properly balanced.
4. Seal: Mechanical, with carbon-steel rotating ring, stainless steel spring, ceramic seat, and rubber bellows and gasket. Include water slinger on shaft between motor and seal.

E. Vertical, In-Line Pumps: (NOT USED)

2.4 DOMESTIC WATER PRESSURE BOOSTER SYSTEM (NOT USED)

3.2 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.3 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer’s technical representative for fourhours to instruct VA Personnel in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

SECTION 22 13 00
FACILITY SANITARY AND VENT PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section pertains to sanitary sewer and vent systems, including piping, equipment and all necessary accessories as designated in this section.

B. A complete listing of common acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

E. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.

F. Section 07 92 00, JOINT SEALANTS: Sealant products.

G. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.

H. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.

I. Section 22 07 11, PLUMBING INSULATION.

J. Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS

K. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

L. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standard will govern.

B. American Society of Mechanical Engineers (ASME):

A13.1-2007.....Identification of Piping Systems

A112.36.2M-1991.....Cleanouts

A112.6.3-2019.....Floor and Trench Drains

B1.20.1-2013.....Pipe Threads, General Purpose (Inch)

B16.1-2015.....Gray Iron Pipe Flanges and Flanged Fittings Classes 25, 125, and 250

B16.4-2016.....Grey Iron Threaded Fittings Classes 125 and 250

B16.15-2018.....Cast Copper Alloy Threaded Fittings, Classes 125 and 250

B16.18-2018.....Cast Copper Alloy Solder Joint Pressure Fittings

B16.21-2016.....Nonmetallic Flat Gaskets for Pipe Flanges

B16.22-2018.....Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings

B16.23-2016.....Cast Copper Alloy Solder Joint Drainage Fittings: DWV

B16.24-2016.....Cast Copper Alloy Pipe Flanges and Flanged Fittings, and Valves: Classes 150, 300, 600, 900, 1500, and 2500

B16.29-2017.....Wrought Copper and Wrought Copper Alloy Solder-Joint Drainage Fittings: DWV

B16.39-2014.....Malleable Iron Threaded Pipe Unions Classes 150, 250, and 300

B18.2.1-2012.....Square, Hex, Heavy Hex, and Askew Head Bolts and Hex, Heavy Hex, Hex Flange, Lobed Head, and Lag Screws (Inch Series)

C. American Society of Sanitary Engineers (ASSE):

1001-2017.....Performance Requirements for Atmospheric Type Vacuum Breakers

1018-2001.....Performance Requirements for Trap Seal Primer Valves – Potable Water Supplied

1044-2015.....Performance Requirements for Trap Seal Primer Devices – Drainage Types and Electronic Design Types

1079-2012.....Performance Requirements for Dielectric Pipe Unions

D. American Society for Testing and Materials (ASTM):

A53/A53M-2018.....Standard Specification for Pipe, Steel, Black And Hot-Dipped, Zinc-coated, Welded and Seamless

A74-2017.....Standard Specification for Cast Iron Soil Pipe and Fittings

A888-2018a.....Standard Specification for Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications

B32-2008(R2014).....Standard Specification for Solder Metal

B43-2015.....Standard Specification for Seamless Red Brass Pipe, Standard Sizes

B88-2016.....Standard Specification for Seamless Copper Water Tube

B306-2013.....Standard Specification for Copper Drainage Tube (DWV)

B687-1999(R2016).....Standard Specification for Brass, Copper, and Chromium-Plated Pipe Nipples

B813-2016.....Standard Specification for Liquid and Paste Fluxes for Soldering of Copper and Copper Alloy Tube

B828-2016.....Standard Practice for Making Capillary Joints by Soldering of Copper and Copper Alloy Tube and Fittings

C564-2014.....Standard Specification for Rubber Gaskets for Cast Iron Soil Pipe and Fittings

D2321-2018.....Standard Practice for Underground Installation of Thermoplastic Pipe for Sewers and Other Gravity-Flow Applications

D2564-2012(R3018).....Standard Specification for Solvent Cements for Poly(Vinyl Chloride) (PVC) Plastic Piping Systems

D2665-2014.....Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Drain, Waste, and Vent Pipe and Fittings

D2855-2015.....Standard Practice for Two-Step (Primer and Solvent Cement) Method of Joining Poly(Vinyl Chloride) (PVC) or Chlorinated Poly (Vinyl Chloride) CPVCP Pipe and Piping Components with Tapered Sockets

D5926-2015.....Standard Specification for Poly(Vinyl Chloride) (PVC) Gaskets for Drain, Waste, and Vent (DWV), Sewer, Sanitary, and Storm Plumbing Systems

F402-2018.....Standard Practice for Safe Handling of Solvent Cements, Primers, and Cleaners Used for Joining Thermoplastic Pipe and Fittings

F477-2014.....Standard Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe

F1545-2015e1.....Standard Specification for Plastic-Lined Ferrous Metal Pipe, Fittings, and Flanges

E. Cast Iron Soil Pipe Institute (CISPI):

2006.....Cast Iron Soil Pipe and Fittings Handbook

301-2012.....Standard Specification for Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications

310-2012.....Specification for Coupling for Use in Connection with Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications

F. Copper Development Association, Inc. (CDA):

A4015-14/19.....Copper Tube Handbook

G. International Code Council (ICC):

IPC-2018.....International Plumbing Code

H. Manufacturers Standardization Society (MSS):

SP-123-2018.....Non-Ferrous Threaded and Solder-Joint Unions for Use with Copper Water Tube

I. National Fire Protection Association (NFPA):

70-2023.....National Electrical Code (NEC)

J. Underwriters' Laboratories, Inc. (UL):

508-99 (R2013).....Standard For Industrial Control Equipment

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 13 00, FACILITY SANITARY AND VENT PIPING", with applicable paragraph identification.

C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Piping.
2. Floor Drains.
3. Cleanouts.
4. Trap Seal Protection.
5. Penetration Sleeves.
6. Pipe Fittings.
7. Traps.
8. Exposed Piping and Fittings.

D. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane or the floor drain.

E. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replaceable parts, and troubleshooting guide:

1. Include complete list indicating all components of the systems.
2. Include complete diagrams of the internal wiring for each item of equipment.
3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.

F.

1.5 QUALITY ASSURANCE

A. Bio-Based Materials: For products designated by the USDA's bio-based Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

B. Refer to Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for additional sustainable design requirements.

1.6 AS-BUILT DOCUMENTATION

A. Comply with requirements in Paragraph "AS-BUILT DOCUMENTATION" of Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

PART 2 - PRODUCTS

2.1 SANITARY WASTE, DRAIN, AND VENT PIPING

A. Cast iron waste, drain, and vent pipe and fittings.

1. Cast iron waste, drain, and vent pipe and fittings shall be used for the following applications:
   a. Pipe buried in or in contact with earth.
   b. Sanitary pipe extensions to a distance of approximately 1500 mm (5 feet) outside of the building.
   c. Interior waste and vent piping above grade.
2. Cast iron Pipe shall be bell and spigot or hubless (plain end or no-hub or hubless).
3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI 301, ASTM A888, or ASTM A74.
4. Cast iron pipe and fittings shall be made from a minimum of 95 percent post-consumer recycled material.
5. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM C564.

B. Copper Tube, (DWV):

1. Copper DWV tube sanitary waste, drain and vent pipe may be used for piping above ground, except for urinal drains.
2. The copper DWV tube shall be drainage type, drawn temper conforming to ASTM B306.
3. The copper drainage fittings shall be cast copper or wrought copper conforming to ASME B16.23 or ASME B16.29.
4. The joints shall be lead free, using a water flushable flux, and conforming to ASTM B32.

2.2 PUMP DISCHARGE PIPING (NOT USED)

2.3 EXPOSED WASTE PIPING

A. Chrome plated brass piping of full iron pipe size shall be used in finished rooms for exposed waste piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.

1. The Pipe shall meet ASTM B43, regular weight.
2. The Fittings shall conform to ASME B16.15
3. Nipples shall conform to ASTM B687, Chromium-plated.
4. Unions shall be brass or bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.

B. In unfinished Rooms such as mechanical Rooms and Kitchens, Chrome-plated brass piping is not required. The pipe materials specified under the paragraph “Sanitary Waste, Drain, and Vent Piping” can be used. The sanitary pipe in unfinished rooms shall be painted as specified in Section 09 91 00, PAINTING.

2.4 SPECIALTY PIPE FITTINGS

A. Transition pipe couplings shall join piping with small differences in outside diameters or different materials. End connections shall be of the same size and compatible with the pipes being joined. The transition coupling shall be elastomeric, sleeve type reducing or transition pattern and include shear and corrosion resistant metal, tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:

1. For cast iron soil pipes, the sleeve material shall be rubber conforming to ASTM C564.
2. For dissimilar pipes, the sleeve material shall be PVC conforming to ASTM D5926, or other material compatible with the pipe materials being joined.

B. The dielectric fittings shall conform to ASSE 1079 with a pressure rating of 861 kPa (125 psig) at a minimum temperature of 82 degrees C (180 degrees F). The end connection shall be solder joint copper alloy and threaded ferrous.

C. Dielectric flange insulating kits shall be of non-conducting materials for field assembly of companion flanges with a pressure rating of 1035 kPa (150 psig). The gasket shall be neoprene or phenolic. The bolt sleeves shall be phenolic or polyethylene. The washers shall be phenolic with steel backing washers.

D. The di-electric nipples shall be electroplated steel nipple complying with ASTM F1545 with a pressure rating of 2070 kPa (300 psig) at 107 degrees C (225 degrees F). The end connection shall be male threaded. The lining shall be inert and noncorrosive propylene.

2.5 CLEANOUTS

A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); and not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. Minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged sanitary line.

B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside calk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2 inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the

carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts shall be provided where indicated in the contract document and at every building exit. The loading classification for cleanouts in sidewalk areas or subject to vehicular traffic shall be heavy duty type.

C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. If there are no fixtures installed on the lowest floor, the cleanout shall be installed at the base of the stack. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel-bronze square frame and stainless steel cover with minimum opening of 150 by 150 mm (6 by 6 inches) shall be furnished at each wall cleanout. Where the piping is concealed, a fixture trap or a fixture with integral trap, readily removable without disturbing concealed pipe, shall be accepted as a cleanout equivalent providing the opening to be used as a cleanout opening is the size required.

D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/hubless cast iron ferrule. Plain end (hubless) piping in interstitial space or above ceiling may use plain end (hubless) blind plug and clamp.

2.6 FLOOR DRAINS

A. General Data: floor drain shall comply with ASME A112.6.3. A caulking flange, inside gasket, or hubless connection shall be provided for connection to cast iron pipe, screwed or no hub outlets for connection to steel pipe. The drain connection shall be bottom outlet. A membrane clamp and extensions shall be provided, if required, where installed in connection with waterproof membrane. Puncturing membrane other than for drain opening shall not be permitted. Double drainage pattern floor drains shall have integral seepage pan for embedding into floor construction, and weep holes to provide adequate drainage from pan to drain pipe. For drains not installed in connection with a waterproof membrane, a.45 kg (16-ounce) soft copperflashing membrane, 600 mm (24 inches) square or another approved waterproof membrane shall be provided.

B. Type E (FD-E) floor drain shall comply with ASME A112.6.3. The type E floor drain shall have a heavy, cast iron body, double drainage pattern, heavy non-tilting ductile iron grate not less than 300 mm (12 inches) square, removable sediment bucket. Clearance between body and bucket shall be ample for free flow of waste water. For traffic use, an extra heavy duty load classification ductile iron grate shall be provided.

2.7 TRAPS

A. Traps shall be provided on all sanitary branch waste connections from fixtures or equipment not provided with traps. Exposed brass shall be polished brass chromium plated with nipple and set screw escutcheons. Concealed traps may be rough cast brass or same material as the piping they are connected to. Slip joints are prohibited on sewer side of trap. Traps shall correspond to fittings on cast iron soil pipe or steel pipe respectively, and size shall be as required by connected service or fixture.

2.8 PRIMER VALVES AND TRAP SEAL PRIMER SYSTEMS

A. Trap Primer (TP-1): The trap seal primer system shall be electronic type conforming to ASSE 1044.
   1. The controller shall have a 24 hour programmable timer, solid state, 6 outlet zones, minimum adjustable run time of 1 minute for each zone, 12 hour program battery backup, manual switch for 120VAC power, 120VAC to 24VAC internal transformer, fuse protected circuitry, UL listed, 120VAC input-24VAC output, constructed of enameled steel or plastic.
   2. The cabinet shall be recessed mounting with a stainless steel cover.
   3. The solenoid valve shall have a brass body, suitable for potable water service, normally closed, 861 kPa (125 psig) rated, 24VAC.
   4. The control wiring shall be copper in accordance with the National Electric Code (NFPA 70), Article 725 and not less than 18 gauge. All wiring shall be in conduit and in accordance with Division 26 of the specifications.
   5. The vacuum breaker shall conform to ASSE 1001.

B. Trap Primer (TP-2): The trap seal primer valve shall be hydraulic, supply type with a pressure rating of 861 kPa (125 psig) and conforming to standard ASSE 1018.

1. The inlet and outlet connections shall be 15 mm or DN15 (NPS 1/2 inch)
2. The trap seal primer valve shall be fully automatic with an all brass or bronze body.
3. The trap seal primer valve shall be activated by a drop in building water pressure, no adjustment required.
4. The trap seal primer valve shall include a manifold when serving two, three, or four traps.
5. The manifold shall be omitted when serving only one trap.

2.9 PENETRATION SLEEVES

A. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that shall extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that shall extend through the floor slab. A waterproof caulked joint shall be provided at the top hub.

PART 3 - EXECUTION

3.1 PIPE INSTALLATION

A. The pipe installation shall comply with the requirements of the International Plumbing Code (IPC) and these specifications.

B. Branch piping shall be installed for waste from the respective piping systems and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.

C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to full size after cutting.

D. All pipe runs shall be laid out to avoid interference with other work.

E. The piping shall be installed above accessible ceilings where possible.

F. The piping shall be installed to permit valve servicing or operation.

G. The piping shall be installed free of sags and bends.

H. Seismic restraint shall be installed where required by code.

I. Changes in direction for soil and waste drainage and vent piping shall be made using appropriate branches, bends and long sweep bends.

Sanitary tees and short sweep quarter bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and eighth bend fittings shall be used if two fixtures are installed back to back or side by side with common drain pipe. Straight tees, elbows, and crosses may be used on vent lines. Do not change direction of flow greater than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.

J. Buried soil and waste drainage and vent piping shall be laid beginning at the low point of each system. Piping shall be installed true to grades and alignment indicated with unbroken continuity of invert. Hub ends shall be placed upstream. Required gaskets shall be installed according to manufacturer's written instruction for use of lubricants, cements, and other installation requirements.

K. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"

L. Aboveground copper tubing shall be installed according to Copper Development Association's (CDA) "Copper Tube Handbook".

M. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or time to the Government.

3.2 JOINT CONSTRUCTION

A. Hub and spigot, cast iron piping with gasket joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.

B. Hub and spigot, cast iron piping with calked joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.

C. Hubless or No-hub, cast iron piping shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless piping coupling joints.

D. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc cutters. Threaded pipe ends shall be reamed to remove burrs and

restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:

1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service.
2. Pipe sections with damaged threads shall be replaced with new sections of pipe.

E. Copper tube and fittings with soldered joints shall be joined according to ASTM B828. A water flushable, lead free flux conforming to ASTM B813 and a lead-free alloy solder conforming to ASTM B32 shall be used.

3.3 SPECIALTY PIPE FITTINGS

A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.

B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

3.4 PIPE HANGERS, SUPPORTS AND ACCESSORIES

A. All piping shall be supported according to the International Plumbing Code (IPC), Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications. Where conflicts arise between these the code and Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING the most restrictive or the requirement that specifies supports with highest loading or shortest spacing shall apply.

B. Hangers, supports, rods, inserts and accessories used for pipe supports shall be painted according to Section 09 91 00, PAINTING. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.

C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.

D. Horizontal cast iron piping shall be supported with the following maximum horizontal spacing and minimum hanger rod diameters:

1. 40 mm or DN40 to 50 mm or DN50 (NPS 1-1/2 inch to NPS 2 inch): 1500 mm (60 inches) with 10 mm (3/8 inch) rod.
2. 75 mm or DN75 (NPS 3 inch): 1500 mm (60 inches) with 15 mm (1/2 inch) rod.
3. 100 mm or DN100 to 125 mm or DN125 (NPS 4 inch to NPS 5 inch): 1500 mm (60 inches) with 18 mm (5/8 inch) rod.

4. 150 mm or DN150 to 200 mm or DN200 (NPS 6 inch to NPS 8 inch): 1500 mm (60 inches) with 20 mm (3/4 inch) rod.
5. 250 mm or DN250 to 300 mm or DN300 (NPS 10 inch to NPS 12 inch): 1500 mm (60 inch) with 23 mm (7/8 inch) rod.

E. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.6 m (15 feet).

F. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, Floor, Wall and Ceiling Plates, Supports, Hangers shall have the following characteristics:
   1. Solid or split unplated cast iron.
   2. All plates shall be provided with set screws.
   3. Height adjustable clevis type pipe hangers.
   4. Adjustable floor rests and base flanges shall be steel.
   5. Hanger rods shall be low carbon steel, fully threaded or threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
   6. Riser clamps shall be malleable iron or steel.
   7. Rollers shall be cast iron.
   8. See Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, for requirements on insulated pipe protective shields at hanger supports.

G. Miscellaneous materials shall be provided as specified, required, directed or as noted in the contract documents for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6.1 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.

H. Cast escutcheon with set screw shall be provided at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.

I. Penetrations:
   1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances

between raceways and openings shall be completely filled and sealed with the fire stopping materials.

2. Water proofing: At floor penetrations, clearances shall be completely sealed around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.

J. Exhaust vents shall be extended separately through roof. Sanitary vents shall not connect to exhaust vents.

3.5 TESTS

A. Sanitary waste and drain systems shall be tested either in its entirety or in sections.

B. Waste System tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.

1. If entire system is tested for a water test, tightly close all openings in pipes except highest opening, and fill system with water to point of overflow. If the waste system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.

2. For an air test, an air pressure of 34 kPa (5 psig) gauge shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gauge shall be used for the air test.

3. After installing all fixtures and equipment, open water supply so that all p-traps can be observed. For 15 minutes of operation, all p-traps shall be inspected for leaks and any leaks found shall be corrected.

4. Final Tests: Either one of the following tests may be used.

a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with

smoke under pressure of .25 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.

b. Peppermint Test: Introduce 60 ml (2 ounces) of peppermint into each line or stack.

3.6 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

B. Components provided under this section of the specification shall be tested as part of a larger system.

3.7 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer’s technical representative for 4 hours to instruct each VA personnel responsible in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

SECTION 22 14 00
FACILITY STORM DRAINAGE

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section describes the requirements for storm drainage systems, including piping and all necessary accessories as designated in this section.

B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

E. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.

F. Section 07 92 00, JOINT SEALANTS.

G. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.

I. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.

J. Section 22 05 33, HEAT TRACING FOR PLUMBING PIPING.

K. Section 22 07 11, PLUMBING INSULATION.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society of Mechanical Engineers (ASME):

A112.6.4-2003 (R2012) ..Roof, Deck, and Balcony Drains
A13.1-2007 (R2013).....Scheme for Identification of Piping Systems
B1.20.1-2013.....Pipe Threads, General Purpose, Inch
B16.3-2011.....Malleable Iron Threaded Fittings: Classes 150 and 300
B16.9-2012.....Factory-Made Wrought Buttwelding Fittings
B16.11-2011.....Forged Fittings, Socket-Welding and Threaded
B16.12-2009 (R2014).....Cast Iron Threaded Drainage Fittings

B16.15-2013.....Cast Copper Alloy Threaded Fittings: Classes 125 and 250

B16.18-2012.....Cast Copper Alloy Solder-Joint Pressure Fittings

B16.22-2013.....Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings

B16.23-2011.....Cast Copper Alloy Solder Joint Drainage Fittings - DWV

B16.29-2012.....Wrought Copper and Wrought Copper Alloy Solder-Joint Drainage Fittings – DWV

C. American Society of Sanitary Engineering (ASSE)

1079-2012.....Performance Requirements for Dielectric Pipe Unions

D. American Society for Testing and Materials (ASTM):

A47/A47M-1999 (R2014)...Standard Specification for Ferritic Malleable Iron Castings

A53/A53M-2012.....Standard Specification for Pipe, Steel, Black And Hot-Dipped, Zinc-coated Welded and Seamless

A74-2013a.....Standard Specification for Cast Iron Soil Pipe and Fittings

A183-2014.....Standard Specification for Carbon Steel Track Bolts and Nuts

A312/A312M-2015.....Standard Specification for Seamless, Welded, and Heavily Cold Worked Austenitic Stainless Steel Pipes

A536-1984(R2014).....Standard Specification for Ductile Iron Castings

A733-2013.....Standard Specification for Welded and Seamless Carbon Steel and Austenitic Stainless Steel Pipe Nipples

A888-2013a.....Standard Specification for Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications

B32-2008 (R2014).....Standard Specification for Solder Metal

B61-2008 (R2013).....Standard Specification for Steam or Valve Bronze Castings

B62-2009.....Standard Specification for Composition Bronze or Ounce Metal Castings

B75/B75M-2011.....Standard Specification for Seamless Copper Tube

B88-2014.....Standard Specification for Seamless Copper Water Tube

B306-2013.....Standard Specification for Copper Drainage Tube (DWV)

B584-2014.....Standard Specification for Copper Alloy Sand Castings for General Applications

B687-1999 (R2011).....Standard Specification for Brass, Copper, and Chromium-Plated Pipe Nipples

B828-2002 (R2010).....Standard Practice for Making Capillary Joints by Soldering of Copper and Copper Alloy Tube and Fittings

B813-2010.....Standard Specification for Liquid and Paste Fluxes for Soldering of Copper and Copper Alloy Tube

C564-2014.....Standard Specification for Rubber Gaskets for Cast Iron Soil Pipe and Fittings

C1173-2010 (R2014).....Standard Specification for Flexible Transition Couplings for Underground Piping Systems

D1785-2012.....Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Pipe, Schedules 40, 80 and 120

D2000-2012.....Standard Classification System for Rubber Products in Automotive Applications

D2321-2014e1.....Standard Practice for Underground Installation of Thermoplastic Pipe for Sewers and Other Gravity-Flow Applications

D2564-2012.....Standard Specification for Solvent Cements for Poly (Vinyl Chloride) (PVC) Plastic Piping Systems

D2665-2014.....Standard Specification for Poly (Vinyl Chloride) (PVC) Plastic Drain, Waste, and Vent Pipe and Fittings

D2855-1996 (R2010).....Standard Practice for Making Solvent-Cemented Joints with Poly (Vinyl Chloride) (PVC) Pipe and Fittings

D4101-2014.....Standard Specification for Polypropylene Injection and Extrusion Materials

D5926-2011.....Standard for Poly (Vinyl Chloride) (PVC) Gaskets for Drain, Waste, and Vent (DWV), Sewer, Sanitary, and Storm Plumbing Systems

F477-2014.....Standard Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe

F656-2010.....Standard Specification for Primers for Use in Solvent Cement Joints of Poly (Vinyl Chloride) (PVC) Plastic Pipe and Fittings

F1545-2015.....Standard Specification for Plastic-Lined Ferrous Metal Pipe, Fittings, and Flanges

E. American Welding Society (AWS):

A5.8M/A5.8 AMD1-2011....Specification for Filler Metals for Brazing and Braze Welding

F. Copper Development Association (CDA):

A4015-2011.....Copper Tube Handbook

G. Cast Iron Soil Pipe Institute (CISPI):

301-2012.....Standard Specification for Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications

310-2012.....Standard Specification for Coupling for Use in Connection with Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications

H. International Code Council (ICC):

IPC-2012.....International Plumbing Code

I. Manufacturers Standardization Society of the Valve and Fittings Industry, Inc. (MSS):

SP-72-2010a.....Ball Valves with Flanged or Butt-Welding Ends for General Service

SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 14 00, FACILITY STORM DRAINAGE", with applicable paragraph identification.

C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Pipe and Fittings.
2. Specialty Pipe Fittings.
3. Cleanouts.
4. Roof Drains.
5. Expansion Joints.
6. Downspout Nozzles.
7. Sleeve Flashing Devices.

D. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane.

1.5 QUALITY ASSURANCE

A. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

1.6 AS-BUILT DOCUMENTATION

A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.

B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall in hard copies or PDF version copies. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in Auto-CAD version 2021 provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.

D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

PART 2 - PRODUCTS

2.1 STORM WATER DRAIN PIPING

A. Cast Iron Storm Pipe and Fittings:

1. Cast iron storm pipe and fittings shall be used for the following applications:

a. Pipe buried in or in contact with earth.
b. Extension of pipe to a distance of approximately 1500 mm (5 feet) outside of building walls.
c. Interior storm piping above grade.
d. All mechanical equipment rooms or other areas containing mechanical air handling equipment.

2. The cast iron storm pipe shall be bell and spigot, or hubless (plain end or no-hub) as required by selected jointing method.
3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI 301, ASTM A888, or ASTM A74.
4. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM C564.

B. Copper Tube, (DWV): May be used for piping above ground.
1. The copper DWV tube shall be drainage type, drawn temper conforming to ASTM B306.
2. The copper drainage fittings shall be cast copper or wrought copper conforming to ASME B16.23 or ASME 16.29.
3. The joints shall be lead free, using a water flushable flux, and conforming to ASTM B32.

C. Polyvinyl Chloride (PVC):
1. PVC storm sewer pipe and fittings are permitted for single story structures except for mechanical equipment rooms and other areas containing air handling equipment or hot water generation equipment.
2. PVC storm sewer pipe and fittings shall be schedule 40 solid core piping conforming to ASTM D1785 and ASTM D2665, Sewer and Drain Series, with ends for solvent cemented joints.
3. PVC joints shall be solvent welded socket type using solvent cement conforming to ASTM D2564 and adhesive primer conforming to ASTM F656. Bio-based materials shall be utilized when possible.

D. Roof drain piping and body of drain in locations where the outdoor conditions are subject to freezing shall be insulated.

2.2 PUMPED DRAIN PIPING (NOT USED)

2.3 SPECIALTY PIPE FITTINGS (NOT USED)

2.4 CLEANOUTS

A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. A minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged storm sewer line.

B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside caulk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2 inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts shall be provided where indicated on the drawings and at each building exit. The loading classification for cleanouts in sidewalk areas or subject to vehicular traffic shall be heavy duty.

C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel bronze square frame and stainless steel cover with minimum opening of 150 mm by 150 mm (6 inch by 6 inch) shall be provided at each wall cleanout.

D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/no hub cast iron ferrule. Plain end (no-hub) piping in interstitial space or above ceiling may use plain end (no-hub) blind plug and clamp.

2.5 ROOF DRAINS AND CONNECTIONS (NOT USED)

2.6 WATERPROOFING

A. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproofed caulked joint shall be provided at the top hub.

PART 3 - EXECUTION

3.1 PIPE INSTALLATION

A. The pipe installation shall comply with the requirements of the IPC and these specifications.

B. Branch piping shall be installed from the piping system and connect to all drains and outlets.

C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe, except for glass, shall be reamed to remove burrs and a clean smooth finish restored to full pipe inside diameter.

D. All pipe runs shall be laid out to avoid interference with other work/trades.

E. The piping shall be installed above accessible ceilings to allow for ceiling panel removal.

F. Unless otherwise stated on the documents, minimum horizontal slope shall be one inch for every 2.44 m (8 feet) (1 percent slope) of pipe length.

G. The piping shall be installed free of sags and bends.

H. Seismic restraint shall be installed where required by code.

I. Changes in direction for storm drainage piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and short sweep ¼ bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and 1/8 bend fittings shall be used if two drains are installed back to back or side by side with common drain pipe. Do not change

direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.

J. Buried storm drainage piping shall be laid beginning at the low point of each system. Piping shall be installed true to grades and alignment indicated with unbroken continuity of invert. Hub ends shall be placed upstream. Required gaskets shall be installed according to manufacturer's written instruction for use of lubricants, cements, and other installation requirements. Bio-based materials shall be utilized when possible.

K. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"

L. Aboveground copper tubing shall be installed according to CDA A4015.

M. Aboveground PVC piping shall be installed according to ASTM D2665. Underground PVC piping shall be installed according to ASTM D2321.

3.2 JOINT CONSTRUCTION

A. Hub and spigot, cast iron piping with gasket joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.

B. Hub and spigot, cast iron piping with calked joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.

C. Hubless, cast iron piping shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless piping coupling joints.

D. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc cutters. Threaded pipe ends shall be reamed to remove burrs and restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:

1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service

2. Pipe sections with damaged threads shall be replaced with new undamaged sections of pipe at no additional time or cost to Government.

E. Copper tube and fittings with soldered joints shall be joined according to ASTM B828. A water flushable, lead free flux conforming to ASTM B813 and a lead free alloy solder conforming to ASTM B32 shall be used.

F. For PVC piping, solvent cement joints shall be used for joints. All surfaces shall be cleaned and dry prior to applying the primer and solvent cement. Installation practices shall comply with ASTM F402. The joint shall conform to ASTM D2855 and ASTM D2665 appendices.

3.3 SPECIALTY PIPE FITTINGS

A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.

B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

3.4 PIPE HANGERS, SUPPORTS AND ACCESSORIES

A. All piping shall be supported according to the IPC, Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications.

B. Hangers, supports, rods, inserts and accessories used for Pipe supports shall be shop coated with zinc Chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.

C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.

D. Horizontal cast iron piping shall be supported with the following maximum horizontal spacing and minimum hanger rod diameters:

1. NPS 1-1/2 to NPS 2 (DN 40 to DN 50): 1500 mm (60 inches) with 10 mm (3/8 inch) rod.
2. NPS 3 (DN 80): 1500 mm (60 inches) with 15 mm (1/2 inch) rod.
3. NPS 4 to NPS 5 (DN 100 to DN 125): 1500 mm (60 inches) with 18 mm (5/8 inch) rod.
4. NPS 6 to NPS 8 (DN 150 to DN 200): 1500 mm (60 inches) with 20 mm (3/4 inch) rod.
5. NPS 10 to NPS 12 (DN 250 to DN 300): 1500 mm (60 inches) with 23 mm (7/8 inch) rod.

E. The maximum support spacing for horizontal plastic shall be 1.22 m (4 feet).

F. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.6 m (15 feet).

G. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, floor, wall and ceiling plates shall have the following characteristics:

1. Solid or split unplated cast iron.
2. All plates shall be provided with set screws.
3. Height adjustable clevis type pipe hangers.
4. Adjustable Floor Rests and Base Flanges shall be steel.
5. Hanger Rods shall be low carbon steel, fully threaded or threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
6. Riser Clamps shall be malleable iron or steel.
7. Roller shall be cast iron.
8. Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (minimum) metal protection shield centered on and welded to the hanger and support. The shield shall be 100 mm (4 inches) in length and be 1.6 mm (16 gage) steel. The shield shall be sized for the insulation.

H. Miscellaneous materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6.1 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.

I. Cast escutcheon with set screw shall be installed at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.

J. Penetrations:

1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances

between raceways and openings shall be completely filled and sealed with the fire stopping materials.

2. Water proofing: At floor penetrations, Clearances around the pipe shall be completely sealed and made watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS. Bio-based materials shall be utilized when possible.

3.5 INSULATION

A. Insulate horizontal sections and 600 mm (2 feet) past changes of direction to vertical sections for interior section of roof drains. Install insulation in accordance with the requirements of Section 22 07 11, PLUMBING INSULATION.

3.6 TESTS

A. Storm sewer system shall be tested either in its entirety or in sections.

B. Storm Water Drain tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.

1. If entire system is tested with water, tightly close all openings in pipes except the highest opening, and fill system with water to point of overflow. If system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.
2. For an air test, an air pressure of 34 kPa (5 psig) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the test.
3. Final Tests: While either one of the following tests may be used, Contractor shall check with VA as to which test will be performed.
   a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with

smoke under pressure of 0.25 kPa (1 inch of water) with a smoke machine. **Chemical smoke is prohibited.**

b. Peppermint Test: Introduce .06 liters (2 ounces) of peppermint into each line or stack.

C. COR shall witness all tests. Contractor shall coordinate schedules with the COR and CxA. Contractor shall provide a minimum of 10 working days prior to flushing, disinfection/sterilization, startup, and testing.

3.7 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.8 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer’s technical representative for fourhours to instruct VA Personnel in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

SECTION 22 40 00
PLUMBING FIXTURES

PART 1 - GENERAL

1.1 DESCRIPTION

A. Plumbing fixtures, associated trim and fittings necessary to make a complete installation from wall or floor connections to rough piping, and certain accessories.

B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

E. Section 07 92 00, JOINT SEALANTS: Sealing between fixtures and other finish surfaces.

F. Section 08 31 13, ACCESS DOORS AND FRAMES: Flush panel access doors.

G. Section 10 21 13, TOILET COMPARTMENTS: Through bolts.

H. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

I. Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS: Requirements for commissioning, systems readiness checklist, and training.

J. Section 22 13 00, FACILITY SANITARY AND VENT PIPING.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. The American Society of Mechanical Engineers (ASME):

A112.6.1M-1997 (R2012)..Supports for Off-the-Floor Plumbing Fixtures for Public Use

A112.19.1-2013.....Enameled Cast Iron and Enameled Steel Plumbing Fixtures

A112.19.2-2013.....Ceramic Plumbing Fixtures

A112.19.3-2008.....Stainless Steel Plumbing Fixtures

C. American Society for Testing and Materials (ASTM):

A276-2013a.....Standard Specification for Stainless Steel Bars and Shapes

B584-2008.....Standard Specification for Copper Alloy Sand Castings for General Applications

D. CSA Group:

B45.4-2008 (R2013).....Stainless Steel Plumbing Fixtures

E. National Association of Architectural Metal Manufacturers (NAAMM):

AMP 500-2006.....Metal Finishes Manual

F. American Society of Sanitary Engineering (ASSE):

1016-2011.....Automatic Compensating Valves for Individual Showers and Tub/Shower Combinations

G. NSF International (NSF):

14-2013.....Plastics Piping System Components and Related Materials

61-2013.....Drinking Water System Components – Health Effects

372-2011.....Drinking Water System Components – Lead Content

H. American with Disabilities Act (A.D.A)

I. International Code Council (ICC):

IPC-2015.....International Plumbing Code

1.4 SUBMITTALS

A. Submittals, including number of required copies, will be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section will be marked "SUBMITTED UNDER SECTION 22 40 00, PLUMBING FIXTURES", with applicable paragraph identification.

C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, connections, and capacity.

D. Operating Instructions: Comply with requirements in Section 01 00 00, GENERAL REQUIREMENTS.

E. Completed System Readiness Checklist provided by the CxA and completed by the Contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.F. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.//

1.5 QUALITY ASSURANCE

A. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

1.6 AS-BUILT DOCUMENTATION

A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.

B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions will be hard copies or PDF version copies. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation will be included in the operation and maintenance manual. The operations and maintenance manual will include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks will be included. A List of recommended spare parts (manufacturer, model number, and quantity) will be furnished. Information explaining any special knowledge or tools the owner will be required to employ will be inserted into the As-Built documentation.

C. The installing contractor will maintain as-built drawings of each completed phase for verification; and will provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in AutoCAD version __2021__ provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it will not be deemed a conflict of interest or breach of the 'third party testing company' requirement.

D. Certification documentation will be provided to COR 10 working days prior to submitting the request for final inspection. The documentation will include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

PART 2 - PRODUCTS

2.1 MATERIALS

A. Material or equipment containing a weighted average of greater than 0.25 percent lead is prohibited in any potable water system intended for human consumption and will be certified in accordance with NSF 61 or NSF 372. Endpoint devices used to dispense water for drinking will meet the requirements of NSF 61.

B. Plastic pipe, fittings, and solvent cement will meet NSF 14 and will be NSF listed for the service intended.

2.2 STAINLESS STEEL

A. Corrosion-resistant Steel (CRS):

1. Plate, Sheet and Strip: CRS flat products will conform to chemical composition requirements of any 300 series steel specified in ASTM A276.

2. Finish: Exposed surfaces will have standard polish (ground and polished) equal to NAAMM finish Number 4.

B. Die-cast zinc alloy products are prohibited.

2.3 STOPS

A. Provide lock-shield loose key or screw driver pattern angle stops, straight stops or stops integral with faucet, with each compression type faucet whether specifically called for or not, including sinks in solid-surface, wood and metal casework, laboratory furniture and pharmacy furniture. Locate stops centrally above or below fixture in accessible location.

B. Furnish keys for lock shield stops to the COR.

C. Supply from stops not integral with faucet will be chrome plated copper flexible tubing or flexible stainless steel with inner core of non-toxic polymer.

D. Supply pipe from wall to valve stop will be rigid threaded IPS copper alloy pipe, i.e. red brass pipe nipple, chrome plated where exposed.

E. Mental Health Area: Provide stainless steel drain guard for all lavatories not installed in casework.

2.4 ESCUTCHEONS

A. Heavy type, chrome plated, with set screws. Provide for piping serving plumbing fixtures and at each wall, ceiling and floor penetrations in exposed finished locations and within cabinets and millwork.

2.5 LAMINAR FLOW CONTROL DEVICE

A. Smooth, bright stainless steel or satin finish, chrome plated metal laminar flow device will provide non-aeration, clear, coherent laminar flow that will not splash in basin. Device will also have a flow control restrictor and have vandal resistant housing. **Aerators are prohibited.**

B. Flow Control Restrictor:

1. Capable of restricting flow from 32 ml/s to 95 ml/s (0.5 gpm to 1.5 gpm) for lavatories; 125 ml/s to 140 ml/s (2.0 gpm to 2.2 gpm) for sinks P-505 through P-520, P-524 and P-528; and 174 ml/s to 190 ml/s (2.75 gpm to 3.0 gpm) for dietary food preparation and rinse sinks or as specified.
2. Compensates for pressure fluctuation maintaining flow rate specified above within 10 percent between 170 kPa and 550 kPa (25 psig and 80 psig).
3. Operates by expansion and contraction, eliminates mineral/sediment build-up with self-cleaning action, and is capable of easy manual cleaning.

2.6 CARRIERS

A. ASME A112.6.1M, with adjustable gasket faceplate chair carriers for wall hung closets with auxiliary anchor foot assembly, hanger rod support feet, and rear anchor tie down.

B. ASME A112.6.1M, lavatory, concealed arm support. All lavatory chair carriers will be capable of supporting the lavatory with a 250-pound vertical load applied at the front of the fixture.

C. Where water closets, lavatories or sinks are installed back-to-back and carriers are specified, provide one carrier to serve both fixtures in lieu of individual carriers. The drainage fitting of the back-to-back carrier will be so constructed that it prevents the discharge from one fixture from flowing into the opposite fixture.

2.7 WATER CLOSETS

A. (P-102) Water Closet (Floor Mounted with Bedpan Washer ASME A112.19.2) wall outlet, with bed pan lugs-bedpan washer, flush valve operated, 4.8 L (1.28 gallons) per flush. Top of seat will be 450 mm (18 inches) above finished floor. Provide standoff bracket support between studs for bedpan washer at height as recommended by manufacturer.

1. Seat: Institutional/Industrial, extra heavy duty, chemical resistant, solid plastic, open front less cover for elongated bowls,

integrally molded bumpers, concealed check hinge with stainless steel post. Seat will be posture contoured body design. Color will be white.

2. Fittings and Accessories: Floor Flange fittings-cast iron; gaskets-wax; bolts with chromium plated cap nuts and washers.
3. Flush valve: Large chloramines resistant diaphragm, semi-red brass valve body, exposed chrome plated, non-hold open ADA approved side oscillating handle active infra-red sensor for automatic operation with courtesy flush button for flush with maximum 10 percent variance, offset top spud connection, adjustable tailpiece, one-inch IPS screwdriver back check angle stop with vandal resistant cap, sweat solder adapter with cover tube and cast set screw wall flange, solid-ring pipe support, and high back pressure vacuum breaker. Valve body, cover, tailpiece and control stop will be in conformance with ASTM Alloy classification for semi-red brass. Set centerline of inlet 673 mm (26-1/2 inches) above seat. Seat bumpers will be set in wall behind fixture at proper contact height.

2.8 URINALS (NOT USED)

2.9 BATHTUBS (NOT USED)

2.10 LAVATORIES

A. Dimensions for lavatories are specified, Length by width (distance from wall) and depth.

B. Brass components in contact with water will contain no more than 0.25 percent lead content by dry weight. Faucet flow rates will be 3.9 L/m (1.5 gpm) for private lavatories and either 1.9 L/m (0.5 gpm) or 1.0 liter (0.25 gallons) per cycle for public lavatories.

C. (P-402) Lavatory (Elbow Control, ASME A112.19.2) straight back, approximately 508 mm by 457 mm (20 inches by 18 inches) and a 102 mm (4 inches) maximum apron, first quality vitreous china. Punching for faucet on 203 mm (8 inches) centers. Set with rim 864 mm (34 inches) above finished floor.

1. Faucet: Solid cast brass construction with washerless ceramic disc mixing cartridge type and centrally exposed rigid gooseneck spout with outlet 127-152 mm (5-6 inches) above rim. Provide laminar flow control device. One hundred millimeters (4 inches) elbow handles on faucets will be cast, formed or drop forged copper alloy. Faucet, wall and floor escutcheons will be either copper alloy or CRS. Exposed metal parts, including exposed part under valve handle when

in open position, will have a smooth bright finish. Flow will be limited to 1.9 L/m (0.5 gpm) .

2. Drain: Cast or wrought brass with flat grid strainer and offset tailpiece, chrome plated finish.
3. Stops: Angle type, see paragraph "Stops".
4. Trap: Cast copper alloy, 38 mm by 32 mm (1 1/2 inches by 1 1/4 inches) P-trap. Adjustable with connected elbow and 1.4 mm thick (17 gauge) tubing extensions to wall. Exposed metal trap surfaces and connection hardware will be chrome plated with a smooth bright finish. Set trap parallel to wall.
5. Provide cover for exposed piping, drain, stops and trap per A.D.A.

D. (P-418) Lavatory (Sensor Control, Gooseneck Spout, ASME A112.19.2) straight back, approximately 508 mm by 457 mm (20 inches by 18 inches) and a 102 mm (4 inches) minimum apron, first quality vitreous china with punching for gooseneck spout. Set rim 864 mm (34 inches) above finished floor.

1. Faucet: Solid cast brass construction, chrome plated, gooseneck spout with outlet 102 mm to 127 mm (4 inches to 5 inches) above rim. Electronic sensor operated, 102 mm (4 inches) center set mounting, plug in transformer remote mounted transformer solid brass hot-cold water mixer adjusted from top deck with barrier free design control handle and inline filter. Provide laminar flow control device. Breaking the light beam will activate the water flow. Flow will stop when user moves away from light beam. Provide steel access door with key operated cylinder lock. See Section 08 31 13, ACCESS DOORS AND FRAMES All connecting wiring between transformer, solenoid valve and sensor will be cut to length with no excess hanging or wrapped up wiring allowed.
2. Drain: Cast or wrought brass with flat grid strainer with offset tailpiece, brass, chrome plated.
3. Stops: Angle type. See paragraph "Stops".
4. Trap: Cast copper alloy, 38 mm by 32 mm (1 1/2 inches by 1 1/4 inches) P-trap. Adjustable with connected elbow and 17 gage tubing extension to wall. Exposed metal trap surface and connection hardware will be chrome plated with a smooth bright finish. Set trap parallel to wall.
5. Provide cover for exposed piping, drain, stops and trap per A.D.A.

E. (P-421) Bariatric Floor Mounted Pedestal Lavatory (Sensor controlled ASME A112.19.2), 14 gage type 304 stainless steel construction with white powder coating of lavatory deck. Bio-based materials will be utilized when possible. Rated for bariatric use – 1000-pound minimum capacity.

1. Faucet: Brass, chrome plated, gooseneck spout with outlet 102 mm to 127 mm (4 inches to 5 inches) above rim. Electronic sensor operated, 102 mm (4 inches) center set mounting, solid brass hot/cold water mixer adjusted from top deck with barrier free design control handle. Provide laminar flow control device. Breaking the light beam will activate the water flow. Flow will stop when user moves away from light beam. All connecting wiring between transformer, solenoid valve and sensor will be cut to length with no excess hanging or wrapped up wiring allowed.

2.11 SINKS AND LAUNDRY TUBS

A. Dimensions for sinks and laundry tubs are specified, length by width (distance from wall) and depth.

B. (P-501) Service Sink (Regular, ASME A112.19.1) service sink, class 1, single bowl, acid resistant enameled cast iron, approximately 610 mm by 508 mm (24 inches by 20 inches) with a 229 to 305 mm (9 to 12 inches) raised back without faucet holes. Equip sink with CRS rim guard and mounted on trap standard. Set sinks rim 711 mm (28 inches) above finished floor.

1. Faucet: Part B, Type II, solid brass construction, 9.5 L/m (2.5 gpm) combination faucet with replaceable Monel seat, removable replacement unit containing all parts subject to wear, integral check/stops, mounted on wall above sink. Spout will have a pail hook, 19 mm (3/4 inch) hose coupling threads, vacuum breaker, and top or bottom brace to wall. Four-arm handles on faucets will be cast, formed, or drop forged copper alloy. Escutcheons will be either forged copper alloy or CRS. Exposed metal parts, including exposed part under valve handle when in open position, will have a smooth bright finish.
2. Drain: Grid.
3. Trap: Trap standard, painted outside and enameled inside with acid-resistant enamel, drain through adjoining wall.

C. (P-528) Sink (CRS, Single Compartment, Undermount ASME A112.19.2, Kitchen Sinks) self-rimming, back faucet ledge, approximately 533 mm by

559 mm (21 inches by 22 inches) with single compartment inside dimensions approximately 406 mm by 483 mm by 191 mm (16 inches by 19 inches by 7 1/2 inches) deep. Will be minimum of 1.3 mm thick (18 gauge) CRS. Corners and edges will be well rounded:

1. Faucet: Solid brass construction, 8.3 L/m (2.2 gpm) deck mounted combination faucet with Monel or ceramic seats, removable replacement unit containing all parts subject to ware, swivel gooseneck spout with approximately 203 mm (8 inches) reach with spout outlet 152 mm (6 inches above deck and 102 mm (4 inches) wrist blades. Faucet will be polished chrome plated.
2. Drain: Drain plug with cup strainer, stainless steel.
3. Trap: Cast copper alloy 38 mm (1 1/2 inches) P-trap with cleanout plug. Provide wall connection and escutcheon.
4. Provide cover for exposed piping, drain, stops and trap per A.D.A.

2.12 DISPENSER, DRINKING WATER

A. Standard rating conditions: 10 degrees C (50 degrees F) water with 27 degrees C (80 degrees F) inlet water temperature and 32 degrees C (90 degrees F) ambient air temperature.

B. Filters shall be as recommended or supplied by the manufacturer of drinking water dispensers; however all filters shall be free of carbon.

C. (P-604) Electric Water Cooler (Mechanically Cooled, Wall Hung, Self-contained, Wheelchair) bubbler style, 30 l/h (8 gph) minimum capacity, lead free. Top will be CRS anti-splash design. Cabinet, CRS, satin finish, approximately 457 mm by 457 mm by 635 mm (18 inches by 18 inches by 25 inches) high with mounting plate. Set bubbler 914 mm (36 inches) above finished floor. Unit will be push-bar operated with front and side bar and automatic stream regulator. All trim polished chrome plated. Provide with bottle filler option.

.

2.13 SHOWER BATH FIXTURE (NOT USED)

2.14 EMERGENCY FIXTURES (NOT USED)

2.16 MENTAL HEALTH PLUMBING FIXTURES (NOT USED)

PART 3 - EXECUTION

3.1 INSTALLATION

A. Fixture Setting: Opening between fixture and floor and wall finish will be sealed as specified under Section 07 92 00, JOINT SEALANTS. Bio-based materials will be utilized when possible.

B. Supports and Fastening: Secure all fixtures, equipment and trimmings to partitions, walls and related finish surfaces. Exposed heads of bolts and nuts in finished rooms will be hexagonal, polished chrome plated brass with rounded tops.

C. Through Bolts: For free standing marble and metal stud partitions refer to Section 10 21 13, TOILET COMPARTMENTS.

D. Toggle Bolts: For hollow masonry units, finished or unfinished.

E. Expansion Bolts: For brick or concrete or other solid masonry. Will be 6 mm (1/4 inch) diameter bolts, and to extend at least 76 mm (3 inches) into masonry and be fitted with loose tubing or sleeves extending into masonry. Wood plugs, fiber plugs, lead or other soft metal shields are prohibited.

F. Power Set Fasteners: May be used for concrete walls, will be 6 mm (1/4 inch) threaded studs, and will extend at least 32 mm (1 1/4 inches) into wall.

G. Tightly cover and protect fixtures and equipment against dirt, water and chemical or mechanical injury.

H. Where water closet waste pipe has to be offset due to beam interference, provide correct and additional piping necessary to eliminate relocation of water closet.

I. Aerators are prohibited on lavatories and sinks.

J. If an installation is unsatisfactory to the COR, the Contractor will correct the installation at no cost or additional time to the Government.

3.2 CLEANING

A. At completion of all work, fixtures, exposed materials and equipment will be thoroughly cleaned.

3.3 WATERLESS URINAL (NOT USED)

the proper care and maintenance of the urinals.

3.4 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.5 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer’s technical representative for fourhours to instruct VA Personnel in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

SECTION 22 67 19.16
REVERSE-OSMOSIS WATER EQUIPMENT

PART 1 – GENERAL

1.1 DESCRIPTION

A. Provide complete industrial-type packaged reverse osmosis (RO) water treatment system producing high purity water by removal of dissolved minerals, bacteria, particles and organic impurities. Designed for continuous automatic operation. The system shall include pre-filter, product storage tank and all devices necessary for fully operational system. RO system operation shall be controlled by the water level in the product storage tank.

B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

E. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS: Seismic Restraint.

F. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Systems for service other than boiler plant make-up water.

G. Section 22 07 11, PLUMBING INSULATION.

I. Section 22 31 11, WATER SOFTENERS.

J. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATION.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by their basic designation only.

B. American Society of Mechanical Engineers (ASME):
B40.100-2013.....Pressure Gauges and Gauge Attachments

C. ASTM International (ASTM):

A269/A269M-2014e1.....Standard Specification for Seamless and Welded Austenitic Stainless Steel Tubing for General Service

D1785-2012.....Standard Specification for Poly (Vinyl Chloride) (PVC) Plastic Pipe, Schedules 40, 80, and 120

D. American Water Works Association (AWWA):

B300-2010.....Hypochlorites

B301-2010.....Liquid Chlorine

C651-2014.....Disinfecting Water Mains

E. National Electrical Manufacturers Association (NEMA):

ICS 6-1993 (R2001, R2006) Industrial Control and Systems Enclosures

F. National Fire Protection Association (NFPA):

70-2023.....National Electrical Code

G. Department of Health and Human Services, Food and Drug Administration (FDA):

CFR 21, Chapter 1, Part 175.300, Resinous and Polymeric Coatings

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 67 19.16, REVERSE-OSMOSIS WATER EQUIPMENT", with applicable paragraph identification.

C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Catalog cuts, complete description and specifications of all equipment and accessories.
2. Accessories including filters, product storage tank, pressure gages and test kit.

3. Performance data including normal and maximum flow and pressure drop. Certification that required performance shall be achieved.
4. Piping.

D. Complete detailed layout, setting, arrangement, and installation drawings including. Drawings shall also show all parts of the apparatus including relative positions, dimensions, and sizes and general arrangement of connecting piping.

1.5 QUALITY ASSURANCE

A. Manufacturer shall have been engaged in the manufacture of RO systems as a primary product for at least ten years. The ten year requirement supersedes any conflicting requirement in other parts of the project specification.

B. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

1.6 PROJECT CONDITIONS

A. Influent Water Analysis: (Information Pending)

B. Design Parameters: (Scheduled on the drawings)

1.7 AS-BUILT DOCUMENTATION

A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.

B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be in hard copies or PDF version copies.All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts

(manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in Auto-CAD version _2021___ provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.

D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and a certification that all results of tests were within limits specified.

PART 2 - PRODUCTS

2.1 RO SYSTEM

A. Packaged automatic RO system mounted on steel frame, designed for project conditions. Equipment arranged on the frame to allow easy access for operating, maintenance and repair. Unit shall include RO membrane, pressure vessels, pre-filtration system, high pressure pump and all required piping, wiring and controls for a fully operational system.

B. Performance Requirements:
   1. Membrane reject ratio: 98 percent minimum. TDS of product is 2 percent maximum of input TDS.
   2. Capture rate: 75 percent minimum. Maximum amount of water to drain 25 percent of input.

C. RO Membrane Elements: Thin-film composite with fiberglass reinforced polyester (FRP) over-wrap, anti-telescoping device, u-cup brine seal. The design salt rejection shall be 98 percent based on 2000 ppm water at 1550 kPa (225 psig) at 25 degrees C (77 degrees F).

D. RO Element Housings: Type 304 stainless steel with PVC end caps held in place with stainless steel bands. Each housing assembly complete with one set of O-rings and O-ring lubricant. (Bio-based materials shall be utilized when possible.) Housings for systems over 34,070 L per day (9,000 gallons per day) shall be constructed of FRP. Provide cleaning connections.

E. High Pressure Pumps and Motors: Single multistage high efficiency centrifugal type with Type 304 stainless steel casing, shaft, impellers. Tungsten carbide and ceramic shaft seals. Cast iron frame with flanged piping connections. Premium efficiency TEFC motor selected to be non-overloading on the entire performance curve.

F. Manual Valves:

1. Pump Throttle Valve: Type 316 stainless steel ball valve, socket welded.
2. Concentrate Throttle Valve, Recycle Throttle Valve: In-line needle style, stainless steel, rated for 2070 kPa (300 psig) minimum.
3. Inlet Isolation Valve, Product and Concentrate Check Valves: PVC with EPDM seats and seals.
4. Feedwater Sample Valve, Product Water Sample Valve: PVC plug valve with EPDM seats and seals.
5. High Pressure Sample Valve: Type 316 stainless steel plug valve.

G. Automatic Valves:

1. Automatic Inlet Shut Off Valve: Solenoid type, diaphragm actuated, normally closed, constructed of glass-filled Noryl thermoplastic.
2. Automatic Membrane Flush Valve: Provide for purging the membranes with fresh water upon machine shut down.

H. Piping:

1. Low Pressure Feed, Reject and Recycle Piping 520 kPa (75 psig and under): ASTM D1785, Schedule 80 PVC, socket welded and flanged.
2. RO Product Tubing From Each Membrane Housing: ASTM D1785, Schedule 80 PVC, socket welded and flanged.
3. Low Pressure Control and Pressure Gage Tubing: Polyethylene.

4. High Pressure Reject and Recycle Piping 520 kPa (above 75 psig): ASTM A269/A269M, Type 304 Schedule 10 stainless steel with butt welded joints.
5. High Pressure Control and Pressure Gage Tubing: 6895 kPa (1000 psig) burst nylon.

I. Controls:

1. Electronic PLC controller providing automatic control for all operating functions. Motor starter panel. All in FRP enclosures rated NEMA 4. All wiring factory-installed and tested. Comply with Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES and NFPA 70.
2. Autoflush indicator and control to flush RO concentrate at shut down or at predetermined intervals.
3. Warning Alarms: Low quality product, low feed pressure, high feed temperature. Connect to BAS system.
4. Automatic Shutdowns and Alarms: Low feed pressure, low product quality, pretreatment out of service, storage tank full.
5. Status Indicators: Low feed pressure, low quality, flow alarm, high feed water temperature, product divert to drain valve open, pretreatment lockout, storage tank full.
6. Low and High pressure safety switches.
7. Tank water level control switches.
8. Pump Motor Starter: Comply with Section 26 29 11, MOTOR CONTROLLERS.
9. Miscellaneous Controls: Elapsed run time indicator, alarm horn, chemical pump receptacles, convenience receptacles, minimum 8 auxiliary contacts 2DI, 2DO, 2AI, 2AO.

J. Instrumentation and Displays:

1. All instrumentation readouts panel-mounted in FRP enclosures rated NEMA 4. All factory wiring. Comply with NFPA 70.
2. Digital flow indicators for, product, reject, recycle.
3. Pressure gages for inlet, cartridge filter outlet, RO feed, RO concentrate, and RO product.
4. Conductivity indicator measuring product quality with digital displays, alarm relays and automatic temperature compensation.

5. Conductivity probe mounted in the RO product.

K. Skid and Frame Assembly: RO machine shall be built on a skid and frame constructed of welded structural carbon steel. The entire surface shall be sand-blasted and coated with high solids epoxy coating. Bio-based materials shall be utilized when possible.

L. Reassembly: Unit shall be shipped to the site completely assembled and tested. If units or sections are to be disassembled at the site to allow for installation in a limited space, the unit shall be reassembled and tested for intended operation by a factory authorized technical representative.

2.2 PRE-FILTER

A. Single multi-media filter sized for the RO machine inlet flow rate. Filter designed for suspended solids removal down to 10 microns and automatic backwash cycle.

B. Media Tank: FRP designed for 1035 kPa (150 psig). Pre-piped internal backwash distributor and filtered water collector.

C. Filter Media: Top layer of anthracite, middle layer of silica sand, bottom layer of multi-grade garnet. Install filter media at job site.

D. Backwash Cycle: Top-mounted, piston-operated control valve with pre-sized drain line flow control orifice. The cycle shall be initiated by and adjustable seven day electronic time clock. Include RO lockout switch.

E. Replacement Filter Media: Provide elements for one complete replacement.

2.3 ACTIVATED CARBON FILTER

A. Single filter sized for the RO machine inlet flow rate. Designed to remove chlorine and prevent RO membrane damage.

B. Media Tank: FRP designed for 1035 kPa (150 psig). Pre-piped internal backwash distributor and filtered water collector.

C. Filter Media: 12 x 40 mesh bituminous coal-based activated carbon. Install media at job site.

D. Backwash Cycle: Top-mounted, piston-operated control valve with pre-sized drain line flow control orifice. The cycle shall be initiated by

and adjustable seven day electronic time clock. Include RO lockout switch.

2.4 RO WATER STORAGE TANK

A. Free-standing, closed-top, flat-bottom, // // cubic meters (// // cubic feet) total volume. Top access manway, PVC bulkhead fittings for high and low level alarm switches, RO permeate inlet, RO permeate discharge and drain. Install 0.2 micron tank vent filter at the top head. Vented to atmosphere.

B. Materials of Construction: Linear polyethylene in one piece.

C. Tank Water Level Control: Adjustable float switch that signal starting and stopping RO pump. High and low level alarm switches.

2.5 PRESSURE GAGES

A. ASME B40.100, Grade A, 1 percent accuracy, 115 mm (4-1/2 inches) diameter, all metal case, bottom connected. White dials, black hands, graduated from 0 to 690 kPa (0 to 100 psig) and identity labeled.

2.6 WATER TESTING EQUIPMENT

A. Furnish water testing equipment in a portable cabinet specially made for the installed equipment. Include sufficient materials for 6 months of normal testing procedures.

B. Silt Density Index (SDI) apparatus to measure degree of suspended solids feeding the RO membranes. Include pressure regulator, pressure gage, filter holder, 600 mL (20 ounce) beaker, sample valve, tubing and 0.45 micron filter papers.

C. Test kit to measure total water hardness, total iron, free chlorine, pH.

PART 3 – EXECUTION

3.1 REQUIRED TECHNICAL SERVICES

A. Provide services of a qualified manufacturer's representative to check complete installation for conformance to manufacturer's recommendations, put system into service, make all adjustments required for full conformance to design and specified requirements, and perform all demonstrations and tests.

3.2 FLUSHING AND DISINFECTING

A. Flush and disinfect new water lines and RO system and tank interiors in accordance with AWWA C651.

B. Material:

1. Liquid chlorine: AWWA B301.
2. Hypochlorite: AWWA B300.

3.3 STARTUP AND TESTING

A. Operating: Tests shall be run in presence of COR.

B. Procedure:

1. Operate RO system at constant maximum required capacity for one hour after demineralized RO product water is produced. When necessary, waste product water to sewer to maintain above flow rate. Product water production shall begin when a sample shows that demineralization complies with requirements.
2. Demonstrate all features of the control system including diagnostics and flow and cycle indications.

C. The CxA will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the COR and CxA. Contractor shall provide a minimum of 10 working days prior to startup and testing.

3.4 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.5 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer’s technical representative for fourhours to instruct VA Personnel in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

DIVISION 23

HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)

SECTION 23 05 11
COMMON WORK RESULTS FOR HVAC

PART 1 - GENERAL

1.1 DESCRIPTION

A. The requirements of this Section apply to all sections of Division 23, HEATING, VENTILATING, AND AIR CONDITIONING (HVAC).

B. Definitions:

1. Exposed: Piping, ductwork, and equipment exposed to view in finished rooms.
2. Exterior: Piping, ductwork, and equipment exposed to weather be it temperature, humidity, precipitation, wind, or solar radiation.

C. Abbreviations/Acronyms:

1. ac: Alternating Current
2. AC: Air Conditioning
3. ACU: Air Conditioning Unit
4. ACR: Air Conditioning and Refrigeration
5. AI: Analog Input
6. AISI: American Iron and Steel Institute
7. AO: Analog Output
8. ASJ: All Service Jacket
9. AWG: American Wire Gauge
10. BACnet: Building Automation and Control Networking Protocol
11. BAg: Silver-Copper-Zinc Brazing Alloy
12. BAS: Building Automation System
13. BCuP: Silver-Copper-Phosphorus Brazing Alloy
14. bhp: Brake Horsepower
15. Btu: British Thermal Unit
16. Btu/h: British Thermal Unit Per Hour
17. CDA: Copper Development Association
18. C: Celsius
19. CD: Compact Disk
20. CFM: Cubic Foot Per Minute
21. CH: Chilled Water Supply
22. CHR: Chilled Water Return
23. CLR: Color
24. CO: Carbon Monoxide

25. COR: Contracting Officer's Representative
26. CPD: Condensate Pump Discharge
27. CPM: Cycles Per Minute
28. CPVC: Chlorinated Polyvinyl Chloride
29. CRS: Corrosion Resistant Steel
30. CTPD: Condensate Transfer Pump Discharge
31. CTPS: Condensate Transfer Pump Suction
32. CW: Cold Water
33. CWP: Cold Working Pressure
34. CxA: Commissioning Agent
35. dB: Decibels
36. dB(A): Decibels (A weighted)
37. DDC: Direct Digital Control
38. DI: Digital Input
39. DO: Digital Output
40. DVD: Digital Video Disc
41. DN: Diameter Nominal
42. DWV: Drainage, Waste and Vent
43. EPDM: Ethylene Propylene Diene Monomer
44. EPT: Ethylene Propylene Terpolymer
45. ETO: Ethylene Oxide
46. F: Fahrenheit
47. FAR: Federal Acquisition Regulations
48. FD: Floor Drain
49. FED: Federal
50. FG: Fiberglass
51. FGR: Flue Gas Recirculation
52. FOS: Fuel Oil Supply
53. FOR: Fuel Oil Return
54. FSK: Foil-Scrim-Kraft facing
55. FWPD: Feedwater Pump Discharge
56. FWPS: Feedwater Pump Suction
57. GC: Chilled Glycol Water Supply
58. GCR: Chilled Glycol Water Return
59. GH: Hot Glycol Water Heating Supply
60. GHR: Hot Glycol Water Heating Return

61. gpm: Gallons Per Minute
62. HDPE: High Density Polyethylene
63. Hg: Mercury
64. HOA: Hands-Off-Automatic
65. hp: Horsepower
66. HPS: High Pressure Steam (414 kPa (60 psig) and above)
67. HPR: High Pressure Steam Condensate Return
68. HW: Hot Water
69. HWH: Hot Water Heating Supply
70. HWHR: Hot Water Heating Return
71. Hz: Hertz
72. ID: Inside Diameter
73. IPS: Iron Pipe Size
74. kg: Kilogram
75. klb: 1000 lb
76. kPa: Kilopascal
77. lb: Pound
78. lb/hr: Pounds Per Hour
79. L/s: Liters Per Second
80. L/min: Liters Per Minute
81. LPS: Low Pressure Steam (103 kPa (15 psig) and below)
82. LPR: Low Pressure Steam Condensate Gravity Return
83. MAWP: Maximum Allowable Working Pressure
84. MAX: Maximum
85. MBtu/h: 1000 Btu/h
86. MBtu: 1000 Btu
87. MED: Medical
88. m: Meter
89. MFG: Manufacturer
90. mg: Milligram
91. mg/L: Milligrams Per Liter
92. MIN: Minimum
93. MJ: Megajoules
94. ml: Milliliter
95. mm: Millimeter

96. MPS: Medium Pressure Steam (110 kPa (16 psig) through 414 kPa (60 psig))
97. MPR: Medium Pressure Steam Condensate Return
98. MW: Megawatt
99. NC: Normally Closed
100. NF: Oil Free Dry (Nitrogen)
101. Nm: Newton Meter
102. NO: Normally Open
103. NOx: Nitrous Oxide
104. NPT: National Pipe Thread
105. NPS: Nominal Pipe Size
106. OD: Outside Diameter
107. OSD: Open Sight Drain
108. OS&Y: Outside Stem and Yoke
109. PC: Pumped Condensate
110. PID: Proportional-Integral-Differential
111. PLC: Programmable Logic Controllers
112. PP: Polypropylene
113. PPE: Personal Protection Equipment
114. ppb: Parts Per Billion
115. ppm: Parts Per Million
116. PRV: Pressure Reducing Valve \
117. PSIA: Pounds Per Square Inch Absolute
118. psig: Pounds Per Square Inch Gauge
119. PTFE: Polytetrafluoroethylene
120. PVC: Polyvinyl Chloride
121. PVDC: Polyvinylidene Chloride Vapor Retarder Jacketing, White
122. PVDF: Polyvinylidene Fluoride
123. rad: Radians
124. RH: Relative Humidity
125. RO: Reverse Osmosis
126. rms: Root Mean Square
127. RPM: Revolutions Per Minute
128. RS: Refrigerant Suction
129. RTD: Resistance Temperature Detectors
130. RTRF: Reinforced Thermosetting Resin Fittings

131. RTRP: Reinforced Thermosetting Resin Pipe
132. SCFM: Standard Cubic Feet Per Minute
133. SPEC: Specification
134. SPS: Sterile Processing Services
135. STD: Standard
136. SDR: Standard Dimension Ratio
137. SUS: Saybolt Universal Second
138. SW: Soft water
139. SWP: Steam Working Pressure
140. TAB: Testing, Adjusting, and Balancing
141. TDH: Total Dynamic Head
142. TEFC: Totally Enclosed Fan-Cooled
143. TFE: Tetrafluoroethylene
144. THERM: 100,000 Btu
145. THHN: Thermoplastic High-Heat Resistant Nylon Coated Wire
146. THWN: Thermoplastic Heat & Water-Resistant Nylon Coated Wire
147. T/P: Temperature and Pressure
148. USDA: U.S. Department of Agriculture
149. V: Volt
150. VAC: Vacuum
151. VA: Veterans Administration
152. VAC: Voltage in Alternating Current
153. VA CFM: VA Construction & Facilities Management
154. VA CFM CSS: VA Construction & Facilities Management, Consulting Support Service
155. VAMC: Veterans Administration Medical Center
156. VHA OCAMES: Veterans Health Administration - Office of Capital Asset Management Engineering and Support
157. VR: Vacuum condensate return
158. WCB: Wrought Carbon Steel, Grade B
159. WG: Water Gauge or Water Column
160. WOG: Water, Oil, Gas

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT.

D. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

E. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

F. Section 02 82 11, TRADITIONAL ASBESTOS ABATEMENT.

G. Section 03 30 00, CAST-IN-PLACE CONCRETE.

H. Section 05 31 00, STEEL DECKING.

I. Section 05 36 00, COMPOSITE METAL DECKING.

J. Section 05 50 00, METAL FABRICATIONS.

K. Section 07 84 00, FIRESTOPPING.

L. Section 07 92 00, JOINT SEALANTS.

M. Section 09 91 00, PAINTING.

N. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

O. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.

P. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

Q. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.

R. Section 23 07 11, HVAC AND BOILER PLANT INSULATION.

S. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

T. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

U. Section 23 36 00, AIR TERMINAL UNITS.

V. Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.

W. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

X. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES.

Y. Section 26 29 11, MOTOR CONTROLLERS.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standard will govern.

B. Air-Conditioning, Heating, and Refrigeration Institute (AHRI):
430-2020.....Performance Rating of Central Station Air-Handling Unit Supply Fans

C. Air Movement and Control Association (AMCA):
410-1996.....Recommended Safety Practices for Users and Installers of Industrial and Commercial Fans

D. American Society of Mechanical Engineers (ASME):

B31.1-2020.....Power Piping

B31.9-2020.....Building Services Piping

ASME Boiler and Pressure Vessel Code:

BPVC Section IX-2021 Welding, Brazing, and Fusing Qualifications

E. American Society for Testing and Materials (ASTM):

A36/A36M-2019.....Standard Specification for Carbon Structural Steel

A575-1996(2020).....Standard Specification for Steel Bars, Carbon, Merchant Quality, M-Grades

F. A193/A193M-2024 Standard Specification for Alloy-Steel and Stainless Steel Bolting for High Temperature or High Pressure Service and Other Special Purpose Applications Association for Rubber Products Manufacturers (ARPM):

IP-20-2015.....Specifications for Drives Using Classical V-Belts and Sheaves

IP-21-2016.....Specifications for Drives Using Double-V (Hexagonal) Belts

IP-24-2016.....Specifications for Drives Using Synchronous Belts

IP-27-2015.....Specifications for Drives Using Curvilinear Toothed Synchronous Belts

G. Manufacturers Standardization Society of the Valve and Fittings Industry, Inc.(MSS):

SP-58-2018.....Pipe Hangers and Supports-Materials, Design, Manufacture, Selection, Application, and Installation

SP-127-2014a.....Bracing for Piping Systems: Seismic-Wind-Dynamic Design, Selection, and Application

H. Military Specifications (MIL):

MIL-P-21035B-2021.....Paint High Zinc Dust Content, Galvanizing Repair (Metric)

I. National Fire Protection Association (NFPA):

70-2023.....National Electrical Code (NEC)

101-2024.....Life Safety Code

J. Department of Veterans Affairs (VA):

PG-18-10-2020(R2021)....Physical Security and Resiliency Design Manual

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 05 11, COMMON WORK RESULTS FOR HVAC", with applicable paragraph identification.

C. If the project is phased submit complete phasing plan/schedule with manpower levels prior to commencing work. The phasing plan shall be detailed enough to provide milestones in the process that can be verified.

D. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements, and all equipment that requires regular maintenance, calibration, etc are accessable from the floor or permanent work platform. It is the Contractor's responsibility to ensure all submittals meet the VA specifications and requirements and it is assumed by the VA that all submittals do meet the VA specifications unless the Contractor has requested a variance in writing and approved by COR prior to the submittal. If at any time during the project it is found that any item does not meet the VA specifications and there was no variance approval the Contractor shall correct at no additional cost or time to the Government even if a submittal was approved.

E. If equipment is submitted which differs in arrangement from that shown, provide documentation proving equivalent performance, design standards and drawings that show the rearrangement of all associated systems. Additionally, any impacts on ancillary equipment or services such as foundations, piping, and electrical shall be the Contractor's responsibility to design, supply, and install at no additional cost or time to the Government. VA approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.

F. Prior to submitting shop drawings for approval, Contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed contract documents, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.

G. Submittals and shop drawings for interdependent items, containing applicable descriptive information, shall be furnished together. Coordinate and properly integrate materials and equipment to provide a completely compatible and efficient installation.

H. Samples: Samples will not be required, except for insulation or where materials offered differ from specification requirements. Samples shall be accompanied by full description of characteristics different from specification. The Government, at the Government’s expense, will perform evaluation and testing if necessary. The Contractor may submit samples of additional material at the Contractor's option; however, if additional samples of materials are submitted later, pursuant to Government request, adjustment in contract price and time will be made.

I. Mock-ups: Mock-ups are required for critical items and typical component installations replicated numerous times throughout the project as indicated in the individual Division 23 sections. The COR and VAMC representatives shall review and approve the mock-up prior to installation of additional applicable components.

J. Coordination/Shop Drawings:
   1. Submit complete consolidated and coordinated shop drawings for all new systems, and for existing systems that are in the same areas.
   2. The coordination/shop drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8 inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show locations and adequate clearance for all equipment, piping, valves, control panels and other items. Show the access means for all items requiring access for operations and maintenance. Provide detailed coordination/shop drawings of all piping and duct systems. The drawings should include all lockout/tagout points for all energy/hazard sources for each piece

of equipment. Coordinate lockout/tagout procedures and practices with local VA requirements.

3. Do not install equipment foundations, equipment or piping until coordination/shop drawings have been approved.
4. In addition, for HVAC systems, provide details of the following:
   a. Mechanical equipment rooms.
   b. Hangers, inserts, supports, and bracing.
   c. Pipe sleeves.
   d. Duct or equipment penetrations of floors, walls, ceilings, or roofs.

K. Manufacturer's Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity. Submit under the pertinent section rather than under this section.
   1. Submit belt drive with the driven equipment. Submit selection data for specific drives when requested by the COR.
   2. Submit electric motor data and variable speed drive data with the driven equipment.
   3. Equipment and materials identification.
   4. Fire-stopping materials.
   5. Hangers, inserts, supports and bracing. Provide complete stress analysis for variable spring and constant support hangers.
   6. Wall, floor, and ceiling plates.

L. Rigging Plan: Provide documentation of the capacity and weight of the rigging and equipment intended to be used. The plan shall include the path of travel of the load, the staging area and intended access, and qualifications of the operator and signal person.

M. HVAC Maintenance Data and Operating Instructions:
   1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, paragraph INSTRUCTIONS for systems and equipment.

   2. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replacement parts, and troubleshooting guide:

      a. Include complete list indicating all components of the systems.

b. Include complete diagrams of the internal wiring for each item of equipment.

c. Diagrams shall have their terminals identified to facilitate installation, operation, and maintenance.

3. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply for equipment. Include in the listing for belts: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.

N. Provide copies of approved HVAC equipment submittals to the TAB and Commissioning Subcontractor.

O. Completed System Readiness Checklist provided by the CxA and completed by the Contractor, signed by a qualified technician, and dated on the date of completion, in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

P. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

1.5 QUALITY ASSURANCE

A. Mechanical, electrical and associated systems shall be safe, reliable, efficient, durable, easily and safely operable and maintainable, easily and safely accessible, and in compliance with applicable codes as specified. The systems shall be comprised of high quality institutional-class and industrial-class products of manufacturers that are experienced specialists in the required product lines. All construction firms and personnel shall be experienced and qualified specialists in industrial and institutional HVAC.

B. Flow Rate Tolerance for HVAC Equipment: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.

C. Equipment Vibration Tolerance:

1. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT. Equipment shall be factory-balanced to this tolerance and re-balanced onsite, as necessary.

2. After HVAC air balance work is completed and permanent drive sheaves are in place, perform field mechanical balancing and adjustments required to meet the specified vibration tolerance.

D. Products Criteria:

1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years (or longer as specified elsewhere). The design, model and size of each item shall have been in satisfactory and efficient operation on at least three installations for approximately three years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years. See other specification sections for any exceptions and/or additional requirements.
2. Refer to all other sections for quality assurance requirements for systems and equipment specified therein.
3. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
4. The products and execution of work specified in Division 23 sections shall conform to the referenced codes and standards as required by the specifications. Local codes and amendments shall be enforced, along with requirements of local utility companies. The most stringent requirements of these specifications, local codes, or utility company requirements shall always apply. Any conflicts shall be brought to the attention of the COR.
5. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be of the same manufacturer and model number, or if different models are required they shall be of the same manufacturer and identical to the greatest extent possible (i.e., same model series).
6. Assembled Units: Performance and warranty of all components that make up an assembled unit shall be the responsibility of the manufacturer of the completed assembly.
7. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.

8. Use of asbestos products or equipment or materials containing asbestos is prohibited.

E. HVAC Equipment Service Providers: Service providers shall be authorized and trained by the manufacturers of the equipment supplied. These providers shall be capable of responding onsite and provide acceptable service to restore equipment operations within 4 hours of receipt of notification by phone, e-mail or fax in event of an emergency, such as the shutdown of equipment; or within 24 hours in a non-emergency. Submit names, mail and e-mail addresses and phone numbers of service personnel and companies providing service under these conditions for (as applicable to the project): fans, air handling units, chillers, cooling towers, control systems, pumps, critical instrumentation, computer workstation and programming.

F. HVAC Mechanical Systems Welding: Before any welding is performed, Contractor shall submit a certificate certifying that welders comply with the following requirements:

1. HVAC mechanical systems welding shall meet ASME BPVC Section IX. Provide proof of current certification.
2. Comply with provisions of ASME B31 series "Code for Pressure Piping".
3. Certify that each welder and welding operator has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
4. All welds shall be stamped according to the provisions of the AWS or ASME as required herein and by the associated code.

G. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the COR with submittals. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material and removal by the Contractor and no additional cost or time to the Government.

H. Execution (Installation, Construction) Quality:

1. Apply and install all items in accordance with manufacturer's written instructions. Refer conflicts between the manufacturer's

instructions and the contract documents to the COR for resolution. Provide written hard copies and computer files on CD or DVD of manufacturer's installation instructions to the COR with submittals prior to commencing installation of any item. Installation of the item will not be allowed to proceed until the recommendations are received and approved by the VA. Failure to furnish these recommendations is a cause for rejection of the material.

2. All items that require access, such as for operating, cleaning, servicing, maintenance, and calibration, shall be easily and safely accessible by persons standing at floor level, or standing on permanent platforms, without the use of portable ladders. Examples of these items include, but are not limited to, all types of valves, filters and strainers, transmitters, control devices. Prior to commencing installation work, refer conflicts between this requirement and contract documents to the COR for resolution. Failure of the Contractor to resolve, or point out any issues will result in the Contractor correcting at no additional cost or time to the Government.
3. Complete coordination/shop drawings shall be required in accordance with paragraph SUBMITTALS. Construction work shall not start on any system until the coordination/shop drawings have been approved by VA.
4. Workmanship/craftsmanship will be of the highest quality and standards. The VA reserves the right to reject any work based on poor quality of workmanship this work shall be removed and done again at no additional cost or time to the Government.

I. Upon request by Government, provide lists of previous installations for selected items of equipment. Include contact persons who will serve as references, with current telephone numbers and e-mail addresses.

J. Guaranty: Warranty of Construction, FAR Clause 52.246-21.

K. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specification section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

L. Refer to Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for additional sustainable design requirements.

1.6 DELIVERY, STORAGE AND HANDLING

A. Protection of Equipment:

1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage or theft.
2. Large equipment such as boilers, chillers, cooling towers, fans, and air handling units if shipped on open trailer trucks shall be covered with shrink on plastics or water proof tarpaulins that provide protection from exposure to rain, road salts and other transit hazards. Protection shall be kept in place until equipment is moved into a building or installed as designed.
3. Repair damaged equipment in first class, new operating condition and appearance; or, replace same as determined and directed by the COR. Such repair or replacement shall be at no additional cost or time to the Government.
4. Protect interiors of new equipment and piping systems against entry of foreign matter. Clean both inside and outside before painting or placing equipment in operation.
5. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.
6. Protect plastic piping and tanks from ultraviolet light (sunlight).

B. Cleanliness of Piping and Equipment Systems:

1. Exercise care in storage and handling of equipment and piping material to be incorporated in the work. Remove debris arising from cutting, threading and welding of piping.
2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
3. Clean interior of all tanks prior to delivery for beneficial use by the Government.
4. Boilers shall be left clean following final internal inspection by Government, insurance representative, or inspector.

5. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

1.7 AS-BUILT DOCUMENTATION

A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.

B. Submit operation and maintenance data updated to include submittal review comments, VA approved substitutions and construction revisions shall be in electronic version on CD or DVD inserted into a three-ring binder. All aspects of system operation and maintenance procedures, including applicable piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

C. The installing Contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. Should the installing Contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement. Provide record drawings as follows:

1. As-built drawings are to be provided, with a copy of them in three-dimensional Building Information Modeling (BIM) software version 2023 provided on CD or DVD.

D. The as-built drawings shall indicate the location and type of all lockout/tagout points for all energy sources for all equipment and pumps to include breaker location and numbers, valve tag numbers, etc. Coordinate lockout/tagout procedures and practices with local VA requirements.

E. Certification documentation shall be provided to COR 21 working days prior to submitting the request for final inspection. The documentation

shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and provide documentation/certification that all results of tests were within limits specified. Test results shall contain written sequence of test procedure with written test results annotated at each step along with the expected outcome or setpoint. The results shall include all readings, including but not limited to data on device (make, model and performance characteristics), normal pressures, switch ranges, trip points, amp readings, and calibration data to include equipment serial numbers or individual identifications, etc.

1.8 JOB CONDITIONS – WORK IN EXISTING BUILDING

A. Building Operation: Government employees will be continuously operating and managing all facilities, including temporary facilities that serve the VAMC.

B. Maintenance of Service: Schedule all work to permit continuous service as required by the VAMC.

C. Steam and Condensate Service Interruptions: Limited steam and condensate service interruptions, as required for interconnections of new and existing systems, will be permitted by the COR during periods when the demands are not critical to the operation of the VAMC. These non-critical periods are limited to between 8 pm and 5 am in the appropriate off-season (if applicable). Provide at least 10 working days advance notice to the COR. The request shall include a detailed plan on the proposed shutdown and the intended work to be done along with manpower levels. All equipment and materials shall be onsite and verified with plan 5 days prior to the shutdown or it will need to be rescheduled.

D. Phasing of Work: Comply with all requirements shown on contract documents. Contractor shall submit a complete detailed phasing plan/schedule with manpower levels prior to commencing work. The phasing plan shall be detailed enough to provide milestones in the process that can be verified.

E. Building Working Environment: Maintain the architectural and structural integrity of the building and the working environment at all times. Maintain the interior of building at 18 degrees C (65 degrees F)

minimum. Limit the opening of doors, windows or other access openings to brief periods as necessary for rigging purposes. Storm water or ground water leakage is prohibited. Provide daily clean-up of construction and demolition debris on all floor surfaces and on all equipment being operated by VA. Maintain all egress routes and safety systems/devices.

F. Acceptance of Work for Government Operation: As new equipment, systems and facilities are made available for operation and these items are deemed of beneficial use to the Government, inspections will be made and tests will be performed. Based on the inspections, a list of contract deficiencies will be issued to the Contractor. After correction of deficiencies as necessary for beneficial use, the Contracting Officer will process necessary acceptance and the equipment will then be under the control and operation of Government personnel.

G. Temporary Facilities: Refer to paragraph TEMPORARY PIPING AND EQUIPMENT in this section.

PART 2 - PRODUCTS

2.1 FACTORY ASSEMBLED PRODUCTS

A. Provide maximum standardization of components to reduce spare part requirements.

B. Performance and warranty of all components that make up an assembled unit shall be the responsibility of the manufacturer of the completed assembly.

1. All components of an assembled unit need not be products of same manufacturer.
2. Constituent parts that are alike shall be products of a single manufacturer.
3. Components shall be compatible with each other and with the total assembly for intended service.
4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.

C. Equipment and components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a nameplate securely affixed in a conspicuous place, or cast integral

with, stamped or otherwise permanently marked upon the components of the equipment.

D. Major items of equipment, which serve the same function, shall be the same make and model. Exceptions must be approved by the VA, but may be permitted if performance requirements cannot be met.

2.2 COMPATIBILITY OF RELATED EQUIPMENT

A. Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational plant that conforms to contract requirements.

2.3 V-BELT DRIVES

A. Type: ARPM standard V-belts with proper motor pulley and driven sheave. Belts shall be constructed of reinforced cord and rubber.

B. Dimensions, Rating and Selection Standards: ARPM IP-20 and ARPM IP-21.

C. Minimum Horsepower Rating: Motor horsepower plus recommended ARPM service factor (not less than 20 percent) in addition to the ARPM allowances for pitch diameter, center distance, and arc of contact.

D. Maximum Speed: 25 m/s (5000 feet per minute).

E. Adjustment Provisions: For alignment and ARPM standard allowances for installation and take-up.

F. Drives may utilize a single V-Belt (any cross section) when it is the manufacturer's standard.

G. Multiple Belts: Matched to ARPM specified limits by measurement on a belt measuring fixture. Seal matched sets together to prevent mixing or partial loss of sets. Replacement, when necessary, shall be an entire set of new matched belts.

H. Sheaves and Pulleys:

1. Material: Pressed steel, or close-grained cast-iron.
2. Bore: Fixed or bushing type for securing to shaft with keys.
3. Balanced: Statically and dynamically.
4. Groove spacing for driving and driven pulleys shall be the same.

I. Drive Types, Based on AHRI 430:

1. Provide adjustable-pitch drive as follows:
   a. Fan Speeds Up To 1800 RPM: 7.5 kW (10 horsepower) and smaller.
   b. Fan Speeds Over 1800 RPM: 2.2 kW (3 horsepower) and smaller.

2. Provide fixed-pitch drives for drives larger than those listed above.
3. The final fan speeds required to just meet the system CFM and pressure requirements, without throttling the design air flow branch, shall be determined by adjustment of a temporary adjustable-pitch motor sheave or by fan law calculation if a fixed-pitch drive is used initially.

J. Final Drive Set: If adjustment is required beyond the capabilities of the factory drive set, the final drive set shall be provided as part of this contract at no additional cost or time to the Government.

2.4 SYNCHRONOUS BELT DRIVES

A. Type: ARPM synchronous belts with proper motor pulley and driven sheave. Belts shall be constructed of reinforced cord and rubber.

B. Dimensions, Rating and Selection Standards: ARPM IP-24 and ARPM IP-27.

C. Minimum Horsepower Rating: Motor horsepower plus recommended ARPM service factor (not less than 20 percent) in addition to the ARPM allowances for pitch diameter, center distance, and arc of contact.

D. Maximum Speed: 25 m/s (5000 feet per minute).

E. Adjustment Provisions: For alignment and ARPM standard allowances for installation and take-up.

F. Drives may utilize a single belt of manufacturer’s standard width for the application.

G. Multiple Belts: Matched to ARPM specified limits by measurement on a belt measuring fixture. Seal matched sets together to prevent mixing or partial loss of sets. Replacement, when necessary, shall be an entire set of new matched belts.

H. Sheaves and Pulleys:
1. Material: Pressed steel, or close-grained cast-iron.
2. Bore: Fixed or bushing type for securing to shaft with keys.
3. Balanced: Statically and dynamically.

I. Final Drive Set: The final fan speeds required to just meet the system CFM and pressure requirements, without throttling the design air flow branch, shall be determined by fan law calculation. If adjustment is required beyond the capabilities of the factory drive set, the final drive set shall be provided as part of this contract at no additional cost or time to the Government.

2.5 DRIVE GUARDS

A. For machinery and equipment, provide guards as shown in AMCA 410 for belts, chains, couplings, pulleys, sheaves, shafts, gears and other moving parts regardless of height above the floor to prevent damage to equipment and injury to personnel. Drive guards may be excluded where motors and drives are inside factory-fabricated air handling unit casings.

B. Pump shafts and couplings shall be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material shall be minimum 16-gauge sheet steel; all edges shall be hemmed and ends shall be bent into flanges and the flanges shall be drilled and attached to pump base with minimum of four 6 mm (1/4 inch) bolts. Reinforce guard as necessary to prevent side play forcing guard onto couplings.

C. V-belt and sheave assemblies shall be totally enclosed, firmly mounted, non-resonant. Guard shall be an assembly of minimum 22-gauge sheet steel and expanded or perforated metal to permit observation of belts. 25 mm (1 inch) diameter hole shall be provided at each shaft centerline to permit speed measurement.

D. Materials: Sheet steel, expanded metal or wire mesh rigidly secured so as to be removable without disassembling pipe, duct, or electrical connections to equipment.

E. Access for Speed Measurement: 25 mm (1 inch) diameter hole at each shaft center.

2.6 LIFTING ATTACHMENTS

A. Provide equipment with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

2.7 ELECTRIC MOTORS

A. All material and equipment furnished, and installation methods shall conform to the requirements of Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT; Section 26 29 11, MOTOR CONTROLLERS; and, Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES. Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation

of the systems. Provide special energy efficient premium efficiency type motors as scheduled.

2.8 VARIABLE SPEED MOTOR CONTROLLERS

A. Refer to Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS and Section 26 29 11, MOTOR CONTROLLERS for specifications.

B. Coordinate variable speed motor controller communication protocol with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

C. Provide variable speed motor controllers with or without a bypass contactor as indicated in the contract documents.

D. The combination of controller and motor shall be provided by the manufacturer of the driven equipment, such as pumps and fans, and shall be rated for 100 percent output performance. Multiple units of the same class of equipment, i.e., air handlers, fans, pumps, shall be product of a single manufacturer.

E. Motors shall be premium efficiency type and be approved by the motor controller manufacturer. The controller-motor combination shall be guaranteed to provide full motor nameplate horsepower in variable frequency operation. Both driving and driven motor/fan sheaves shall be fixed pitch.

F. Controller shall not add any current or voltage transients to the input ac power distribution system, DDC controls, sensitive medical equipment, etc., nor shall be affected from other devices on the ac power system.

2.9 EQUIPMENT AND MATERIALS IDENTIFICATION

A. Use symbols, nomenclature and equipment numbers specified, shown in the contract documents, and shown in the maintenance manuals. In addition, provide bar code identification nameplate for all equipment which will allow the equipment identification code to be scanned into the system for maintenance and inventory tracking. Identification for piping is specified in Section 09 91 00, PAINTING.

B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 5 mm (3/16 inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING permanently fastened to the equipment. Identify unit components such as coils, filters, fans, etc.

C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 5 mm (3/16 inch) high riveted or bolted to the equipment.

D. Control Items: Label all instrumentation, temperature and humidity sensors, controllers and control dampers. Identify and label each item as they appear on the control diagrams.

E. Valve Tags and Lists:

1. HVAC and Mechanical Rooms: Provide for all valves other than for equipment in Section 23 82 00, CONVECTION HEATING AND COOLING UNITS and Section 23 36 00, AIR TERMNAL UNITS.
2. Valve Tags: Engraved black filled numbers and letters not less than 13 mm (1/2 inch) high for number designation, and not less than 6 mm (1/4 inch) for service designation on 19-gauge 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
3. Valve Lists: Typed or printed plastic coated card(s), sized 216 mm (8-1/2 inches) by 279 mm (11 inches) showing tag number, valve function and area of control, for each service or system. Punch sheets for a 3-ring notebook.
4. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color-coded thumb tack in ceiling.

F. Ceiling Grid Labels:

1. 50 mm (2 inch) long by 13 mm (1/2 inch) wide by 0.025 mm (1 mil) thick UV resistant metalized polyester label with red border color and black custom lettering on white background interior. Peel and stick adhesive backing. Label and adhesive manufactured specifically for use in equipment inventory tagging.
2. Custom print labels with above ceiling HVAC equipment numbers.

2.10 FIRESTOPPING

A. Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping and ductwork. Refer to Section 23 07 11, HVAC AND BOILER PLANT INSULATION, for firestop pipe and duct insulation.

2.11 GALVANIZED REPAIR COMPOUND

A. Mil-P-21035B, paint form.

2.12 HVAC PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS

A. Vibration Isolators: Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

B. Supports for Roof Mounted Items:

1. Equipment: Equipment rails shall be galvanized steel, minimum 1.3 mm (18 gauge), with integral baseplate, continuous welded corner seams, factory-installed 50 by 100 mm (2 by 4 inches) treated wood nailer, 1.3 mm (18 gauge) galvanized steel counter flashing cap with screws, built-in cant strip, (except for gypsum or tectum deck), minimum height 279 mm (11 inches). For surface insulated roof deck, provide raised cant strip to start at the upper surface of the insulation.
2. Pipe/Duct Pedestals: Provide a galvanized Unistrut channel welded to U-shaped mounting brackets which are secured to side of rail with galvanized lag bolts.

C. Pipe Supports: Comply with MSS SP-58. Type Numbers specified refer to this standard. For selection and application comply with MSS SP-58. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting requirements.

D. Attachment to Concrete Building Construction:

1. Concrete Insert: MSS SP-58, Type 18.
2. Self-Drilling Expansion Shields and Machine Bolt Expansion Anchors: Permitted in concrete not less than 100 mm (4 inches) thick when approved by the COR for each job condition.
3. Power-Driven Fasteners: Permitted in existing concrete or masonry not less than 100 mm (4 inches) thick when approved by the COR for each job condition.

E. Attachment to Steel Building Construction:

1. Welded Attachment: MSS SP-58, Type 22.
2. Beam Clamps: MSS SP-58, Types 20, 21, 28 or 29. Type 23 C-clamp shall be used for individual copper tubing up to 22 mm (7/8 inch) outside diameter.

F. Attachment to Existing Structure: Support from existing floor/roof frame.

G. Attachment to Wood Construction: Wood screws or lag bolts.

H. Hanger Rods: Hot-rolled steel, ASTM A36/A36M or ASTM A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for

controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.

I. Hangers Supporting Multiple Pipes (Trapeze Hangers): Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 by 41 mm (1-5/8 by 1-5/8 inches), 2.7 mm (12 gauge), designed to accept special spring held, hardened steel nuts. Trapeze hangers are prohibited for use for steam supply and condensate piping.

1. Allowable Hanger Load: Manufacturers rating less 91 kg (200 pounds).
2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4 inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 13 mm (1/2 inch) galvanized steel bands, or preinsulated calcium silicate shield for insulated piping at each hanger.

J. Supports for Piping Systems:

1. Select hangers sized to encircle insulation on insulated piping. Refer to Section 23 07 11, HVAC AND BOILER PLANT INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or preinsulated calcium silicate shields. Provide Type 40 insulation shield or preinsulated calcium silicate shield at all other types of supports and hangers including those for preinsulated piping.
2. Piping Systems Except High and Medium Pressure Steam (MSS SP-58):
   a. Standard Clevis Hanger: Type 1; provide locknut.
   b. Riser Clamps: Type 8.
   c. Wall Brackets: Types 31, 32 or 33.
   d. Roller Supports: Type 41, 43, 44 and 46.
   e. Saddle Support: Type 36, 37 or 38.
   f. Turnbuckle: Types 13 or 15. Preinsulate.
   g. U-bolt Clamp: Type 24.
   h. Copper Tube:
      1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with non-adhesive isolation tape to prevent electrolysis.

2) For vertical runs use epoxy painted or plastic-coated riser clamps.
3) For Supporting Tube to Strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.

i. Supports for Plastic Piping: As recommended by the pipe manufacturer with black rubber tape extending one inch beyond steel support or clamp.

3. High and Medium Pressure Steam (MSS SP-58):
   a. Provide eye rod or Type 17 eye nut near the upper attachment.
   b. Piping 50 mm (2 inches) and Greater: Type 43 roller hanger. For roller hangers requiring seismic bracing provide a Type 1 clevis hanger with Type 41 roller attached by flat side bars.
   c. Piping with Vertical Expansion and Contraction:
      1) Movement Up To 19 mm (3/4 inch): Type 51 or 52 variable spring unit with integral turn buckle and load indicator.
      2) Movement More Than 19 mm (3/4 inch): Type 54 or 55 constant support unit with integral adjusting nut, turn buckle and travel position indicator.
4. Convertor and Expansion Tank Hangers: May be Type 1 sized for the shell diameter. Insulation where required will cover the hangers.

K. Pre-Insulated Calcium Silicate Shields:
1. Provide 360-degree water resistant high density 965 kPa (140 psig) compressive strength calcium silicate shields encased in galvanized metal.
2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
3. Shield thickness shall match the pipe insulation.
4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
   a. Shields for supporting chilled or cold water shall have insulation that extends a minimum of 25 mm (1 inch) past the sheet metal. Provide for an adequate vapor barrier in chilled lines.

b. The pre-insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS SP-58. To support the load, the shields may have one or more of the following features: structural inserts 4138 kPa (600 psig) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36/A36M) wear plates welded to the bottom sheet metal jacket.

5. Shields may be used on steel clevis hanger type supports, roller supports or flat surfaces.

L. Seismic Restraint and Bracing of Piping and Ductwork: Refer to Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS. Comply with MSS SP-127. Refer to Seismic Design Requirements VA Handbook 18-8.

2.13 PIPE PENETRATIONS

A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.

B. To prevent accidental liquid spills from passing to a lower level, provide the following:

1. For Sleeves: Extend sleeve 25 mm (1 inch) above finished floor and provide sealant for watertight joint.
2. For Blocked Out Floor Openings: Provide 38 mm (1-1/2 inch) angle set in silicone adhesive around opening.
3. For Drilled Penetrations: Provide 38 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.

C. Penetrations through beams or ribs are prohibited but may be installed in concrete beam flanges. Any deviation from these requirements shall receive prior approval of COR.

D. Sheet Metal, Plastic, or Moisture-Resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.

E. Cast-Iron or Zinc Coated Pipe Sleeves: Provide for pipe passing through exterior walls below grade. Make space between sleeve and pipe watertight with a modular or link rubber seal. Seal shall be applied at both ends of sleeve.

F. Galvanized Steel or an Alternate Black Iron Pipe with Asphalt Coating Sleeves: Provide for pipe passing through concrete beam flanges, except

where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, connect sleeve with floor plate.

G. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.

H. Sleeves are not required for wall hydrants for fire department connections or in drywall construction.

I. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.

J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

2.14 DUCT PENETRATIONS

A. Provide curbs for roof mounted piping, ductwork and equipment. Curbs shall be 457 mm (18 inches) high with continuously welded seams, built-in cant strip, interior baffle with acoustic insulation, curb bottom, hinged curb adapter.

B. Provide firestopping for openings through fire and smoke barriers, maintaining minimum required rating of floor, ceiling or wall assembly. See section 07 84 00, FIRESTOPPING.

2.15 SPECIAL TOOLS AND LUBRICANTS

A. Furnish, and turn over to the COR, tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.

B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.

C. Refrigerant Tools: Provide system charging/Evacuation equipment, gauges, fittings, and tools required for maintenance of furnished equipment.

D. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the COR.

E. Lubricants: A minimum of 0.95 L (1 quart) of oil, and 0.45 kg (1 pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

2.16 WALL, FLOOR AND CEILING PLATES

A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.

B. Thickness: Not less than 2.4 mm (3/32 inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025 inch) for up to 75 mm (3 inch pipe), 0.89 mm (0.035 inch) for larger pipe.

C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

2.17 ASBESTOS

A. Materials containing asbestos are prohibited.

PART 3 – EXECUTION

3.1 GENERAL

A. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or time to the Government.

3.2 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING

A. Location of piping, sleeves, inserts, hangers, and equipment, access provisions shall be coordinated with the work of all trades. The coordination/shop drawings shall be submitted for review. Locate piping, sleeves, inserts, hangers, ductwork and equipment clear of windows, doors, openings, light outlets, and other services and utilities. Equipment coordination/shop drawings shall be prepared to coordinate proper location and personnel access of all facilities. The drawings shall be submitted for review. Follow manufacturer's published recommendations for installation methods not otherwise specified.

B. Operating Personnel Access and Observation Provisions: Select and arrange all equipment and systems to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to, all equipment items,

valves, filters, strainers, transmitters, sensors, control devices. All gauges and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Do not reduce or change maintenance and operating space and access provisions that are shown in the contract documents.

C. Equipment and Piping Support: Coordinate structural systems necessary for pipe and equipment support with pipe and equipment locations to permit proper installation.

D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.

E. Cutting Holes:

1. Cut holes through concrete and masonry by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill is prohibited, except as permitted by COR where working area space is limited.
2. Locate holes to avoid interference with structural members such as slabs, columns, ribs, beams or reinforcing. Holes shall be laid out in advance and drilling done only after approval by COR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to COR for approval.
3. Do not penetrate membrane waterproofing.

F. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but shall be provided.

G. Electrical Interconnection of Instrumentation or Controls: This generally not shown but shall be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Devices shall be located so they are easily accessible for testing, maintenance, calibration, etc. The COR has the final determination on what is accessible and what is not. Comply with NFPA 70.

H. Protection and Cleaning:

1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations

and as approved by the COR. Damaged or defective items in the opinion of the COR, shall be replaced.

2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Tightly cover and protect fixtures and equipment against dirt, water chemical, or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.

I. Concrete and Grout: Use concrete and non-shrink grout 20 MPa (3000 psig) minimum, specified in Section 03 30 00, CAST-IN-PLACE CONCRETE.

J. Install gauges, thermometers, valves and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position thermometers and gauges to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.

K. Install steam piping expansion joints as per manufacturer's recommendations.

L. Work in Existing Building:

1. Perform as specified in paragraphs OPERATIONS AND STORAGE AREAS, paragraph ALTERATIONS, and paragraph RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, paragraph OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will least interfere with normal operation of the facility.

M. Switchgear/Electrical Equipment Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and data/telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints. Installation of piping, ductwork, leak protection apparatus or other installations foreign to the electrical installation shall not be located in the space equal to the width and depth of the equipment and extending from to a height of 1.8 m (6 feet) above the equipment or to ceiling structure, whichever is lower (NFPA 70).

N. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance or inspections, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost or time to the Government.
2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to motors, fans, pumps, belt guards, transformers, high voltage lines, conduit and raceways, piping, hot surfaces, and ductwork. The COR has final determination on whether an installation meets this requirement or not.

3.3 TEMPORARY PIPING AND EQUIPMENT

A. Continuity of operation of existing facilities will generally require temporary installation or relocation of equipment, ducts, and piping.

B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of paragraph ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING apply.

C. Temporary facilities and piping shall be completely removed and any openings in structures sealed. Provide necessary blind flanges and caps to seal open piping remaining in service.

3.4 RIGGING

A. Design is based on application of available equipment. Openings in building structures are planned to accommodate design scheme.

B. Alternative methods of equipment delivery may be offered by Contractor and will be considered by Government under specified restrictions of phasing and maintenance of service requirements as well as structural integrity of the building.

C. Close all openings in the building when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.

D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility. Upon request, the Government will check structure adequacy and advise Contractor of recommended restrictions.

E. Contractor shall check all clearances, weight limitations and shall offer a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.

F. Follow approved rigging plan.

G. Restore building to original condition upon completion of rigging work.

3.5 PIPE AND EQUIPMENT SUPPORTS

A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels designed by a structural engineer, secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Drill or burn holes in structural steel only with the prior approval of the COR.

B. Use of chain pipe supports; wire or strap hangers; wood for blocking, stays and bracing; or, hangers suspended from piping above are prohibited. Replace or thoroughly clean rusty products and paint with zinc primer.

C. Hanger rods shall be used that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. Provide a minimum of 13 mm (1/2 inch) clearance between pipe or piping covering and adjacent work.

D. HVAC Horizontal Pipe Support Spacing: Refer to MSS SP-58. Provide additional supports at valves, strainers, inline pumps and other heavy components. Provide a support within one foot of each elbow.

E. HVAC Vertical Pipe Supports:

1. Up to 152 mm (6 inch pipe), 9 m (30 feet) long, bolt riser clamps to the pipe below couplings, or welded to the pipe and rests supports securely on the building structure.
2. Vertical pipe larger than the foregoing, support on base elbows or tees, or substantial pipe legs extending to the building structure.

F. Overhead Supports:
   1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
   2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
   3. Tubing and capillary systems shall be supported in channel troughs.

G. Floor Supports:
   1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Concrete bases and structural systems shall be anchored and doweled to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
   2. Bases and supports shall not be located and installed until equipment mounted thereon has been approved. Bases shall be sized to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Chiller foundations shall have horizontal dimensions that exceed chiller base frame dimensions by at least 152 mm (6 inches) on all sides. Structural contract documents shall be reviewed for additional requirements. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
   3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a granular material to permit alignment and realignment.
   4. For seismic anchoring, refer to Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

3.6 MECHANICAL DEMOLITION

A. Rigging access, other than indicated in the contract documents, shall be provided by the Contractor after approval for structural integrity by the COR. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, provide approved protection from dust and debris at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.

B. In an operating facility, maintain the operation, cleanliness and safety. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation. Confine the work to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Debris accumulated in the area to the detriment of plant operation is prohibited. Perform all flame cutting to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. Perform all work in accordance with recognized fire protection standards. Inspection will be made by personnel of the VAMC, and Contractor shall follow all directives of the COR with regard to rigging, safety, fire safety, and maintenance of operations.

C. Unless specified otherwise, all piping, wiring, conduit, and other devices associated with the equipment not re-used in the new work shall be completely removed from Government property per Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT. This includes all concrete pads, pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. All openings shall be sealed after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with contract documents where specifically covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the contract documents of the other disciplines in the project for additional facilities to be demolished or handled.

D. All indicated valves including gate, globe, ball, butterfly and check, all pressure gauges and thermometers with wells shall remain Government property and shall be removed and delivered to COR and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these contract documents. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate.

E. Asbestos Insulation Removal: Conform to Section 02 82 11, TRADITIONAL ASBESTOS ABATEMENT.

3.7 CLEANING AND PAINTING

A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.

B. In addition, the following special conditions apply:

1. Cleaning shall be thorough. Solvents, cleaning materials and methods recommended by the manufacturers shall be used for the specific tasks. All rust shall be removed prior to painting and from surfaces to remain unpainted. Repair scratches, scuffs, and abrasions prior to applying prime and finish coats.
2. The following material and equipment shall not be painted:
   a. Motors, controllers, control switches, and safety switches.
   b. Control and interlock devices.
   c. Regulators.
   d. Pressure reducing valves.
   e. Control valves and thermostatic elements.
   f. Lubrication devices and grease fittings.
   g. Copper, brass, aluminum, stainless-steel and bronze surfaces.
   h. Valve stems and rotating shafts.
   i. Pressure gauges and thermometers.
   j. Glass.
   k. Nameplates.
3. Control and instrument panels shall be cleaned, damaged surfaces repaired, and shall be touched-up with matching paint obtained from panel manufacturer.
4. Pumps, fans, motors, steel and cast-iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same paint type and color as utilized by the pump and fan manufacturer.
5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats. This may include painting exposed metals where hangers were removed or where equipment was moved or removed.
6. Paint shall withstand the following temperatures without peeling or discoloration:

a. Condensate and Feedwater: 38 degrees C (100 degrees F) on insulation jacket surface and 121 degrees C (250 degrees F) on metal pipe surface.
b. Steam: 52 degrees C (125 degrees F) on insulation jacket surface and 190 degrees C (374 degrees F) on metal pipe surface.

7. Final result shall be smooth, even-colored, even-textured factory finish on all items. Completely repaint the entire piece of equipment if necessary to achieve this.
8. Lead based paints are prohibited.

3.8 IDENTIFICATION SIGNS

A. Provide laminated plastic signs, with engraved lettering not less than 5 mm (3/16 inch) high, designating functions, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.

B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance.

C. Pipe Identification: Refer to Section 09 91 00, PAINTING.

D. Attach ceiling grid label on ceiling grid location directly underneath above ceiling air terminal, control system component, valve, filter unit, fan etc.

3.9 MOTOR AND DRIVES

A. Use synchronous belt drives only on equipment controlled by soft starters or variable frequency drive motor controllers without a bypass contactor. Use V-belt drives on all other applications.

B. Alignment of V-Belt Drives: Set driving and driven shafts parallel and align so that the corresponding grooves are in the same plane.

C. Alignment of Synchronous Belt Drives: Set driving and driven shafts parallel and align so that the corresponding pulley flanges are in the same plane.

D. Alignment of Direct-Connect Drives: Securely mount motor in accurate alignment so that shafts are per coupling manufacturer’s tolerances when both motor and driven machine are operating at normal temperatures.

3.10 LUBRICATION

A. All equipment and devices requiring lubrication shall be lubricated prior to initial operation. Field-check all devices for proper lubrication.

B. All devices and equipment shall be equipped with required lubrication fittings or devices. A minimum of 0.95 liter (1 quart) of oil and 0.45 kg (1 pound) of grease of manufacturer's recommended grade and type for each different application shall be provided; also provide 12 grease sticks for lubricated plug valves. Deliver all materials to COR in unopened containers that are properly identified as to application.

C. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.

D. All lubrication points shall be extended to one side of the equipment.

3.11 STARTUP, TEMPORARY OPERATION AND TESTING

A. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.

B. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

C. The CxA will observe startup and Contractor testing of selected equipment. Coordinate the startup and Contractor testing schedules with COR and CxA. Provide a minimum notice of 10 working days prior to startup and testing.

D. Startup of equipment shall be performed as described in equipment specifications. Vibration within specified tolerance shall be verified prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, paragraph TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

3.12 OPERATING AND PERFORMANCE TESTS

A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS paragraph TESTS, and in individual Division 23 sections and submit the test reports and records to the COR.

B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost or time to the Government.

C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then conduct such performance tests and finalize control settings for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work. Rescheduling of these tests shall be requested in writing to COR for approval.

D. No adjustments shall be made during the acceptance inspection. All adjustments shall have been made by this point.

E. Perform tests as required for commissioning provisions in accordance with Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS and Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

3.13 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.14 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer’s technical representative for 4 hours to instruct each VA personnel responsible in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

- - - E N D - - -

SECTION 23 05 12
GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the furnishing, installation and connection of motors for HVAC and steam generation equipment.

B. A complete listing of common acronyms and abbreviations are included in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

E. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

F. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

G. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

H. Section 26 24 19, MOTOR CONTROL CENTERS.

I. Section 26 29 11, MOTOR CONTROLLERS.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standards will govern.

B. American Bearing Manufacturers Association (ABMA):

9-2015.....Load Ratings and Fatigue Life for Ball Bearings

11-2014.....Load Ratings and Fatigue Life for Roller Bearings

C. American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE):

90.1-2019.....Energy Efficient Design of New Buildings Except Low-Rise Residential Buildings

D. Institute of Electrical and Electronics Engineers (IEEE):

112-2017.....Standard Test Procedure for Polyphase Induction Motors and Generators

841-2009.....IEEE Standard for Petroleum and Chemical Industry-Premium-Efficiency, Severe-Duty, Totally Enclosed Fan-Cooled (TEFC) Squirrel Cage Induction Motors--Up to and Including 370 kW (500 hp)

E. National Electrical Manufacturers Association (NEMA):

MG 1-2016 (R2019).....Motors and Generators

MG 2-2014.....Safety Standard for Construction and Guide for Selection, Installation and Use of Electric Motors and Generators

250-2020.....Enclosures for Electrical Equipment (1000 Volts Maximum)

F. National Fire Protection Association (NFPA):

70-2023.....National Electrical Code (NEC)

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT", with applicable paragraph identification.

C. Submit motor submittals with driven equipment.

D. Shop Drawings:

1. Provide documentation to demonstrate compliance with contract documents.
2. Motor nameplate information shall be submitted including electrical ratings, efficiency, bearing data, power factor, frame size, dimensions, mounting details, materials, horsepower, voltage, phase, speed (RPM), enclosure, starting characteristics, torque characteristics, code letter, full load and locked rotor current, service factor, and lubrication method.

E. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

F. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replacement parts, and troubleshooting guide:
   1. Include complete list indicating all components of the systems.
   2. Include complete diagrams of the internal wiring for each item of equipment.
   3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.

G. Certification: Two weeks prior to final inspection, unless otherwise noted, certification shall be submitted to the COR stating that the motors have been properly applied, installed, adjusted, lubricated, and tested.

H. Completed System Readiness Checklist provided by the CxA and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

I. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

1.5 AS-BUILT DOCUMENTATION

A. Comply with requirements in Paragraph "AS-BUILT DOCUMENTATION" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

PART 2 - PRODUCTS

2.1 MOTORS

A. For alternating current, fractional and integral horsepower motors, NEMA MG 1 and NEMA MG 2 shall apply.

B. For severe duty TEFC motors, IEEE 841 shall apply.

C. All material and equipment furnished and installation methods shall conform to the requirements of Section 26 29 11, MOTOR CONTROLLERS; and Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES. Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide premium efficiency type motors. Unless otherwise specified for a particular application, use electric motors with the following requirements.

D. Single-phase Motors:

1. Motors for centrifugal fans and pumps may be split phase or permanent split capacitor (PSC) type. Provide capacitor-start type for hard starting applications.
   a. In order to meet ASHRAE 90.1 requirements, motors for small packaged HVAC equipment may be Electrically Commutated motor (EC type). Motor shall be brushless DC type specifically designed for applications with heavy duty ball bearings and electronic communication. The motor shall be speed controllable down to 20 percent of full speed and 85 percent efficient at all speeds.

E. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type.
   1. Two Speed Motors: Each two-speed motor shall have two separate windings. Provide a time- delay (20 seconds minimum) relay for switching from high to low speed.

F. Voltage ratings shall be as follows:
   1. Single phase:
      a. Motors connected to 120-volt systems: 115 volts.
      b. Motors connected to 208-volt systems: 200 volts.
      c. Motors connected to 240-volt or 480-volt systems: 230/460 volts, dual connection.
   2. Three phase:
      a. Motors connected to 208-volt systems: 200 volts.
      b. Motors, less than 74.6 kW (100 hp), connected to 240-volt or 480-volt systems: 208-230/460 volts, dual connection.
      c. Motors, 74.6 kW (100 hp) or greater, connected to 240-volt systems: 230 volts.
      d. Motors, 74.6 kW (100 hp) or greater, connected to 480-volt systems: 460 volts.
      e. Motors connected to high voltage systems (Over 600V): Shall conform to NEMA MG 1 for connection to the nominal system voltage shown in the contract documents.

G. Number of phases shall be as follows:
   1. Motors, less than 373 W (1/2 hp): Single phase.
   2. Motors, 373 W (1/2 hp) and greater: 3 phase.
   3. Exceptions:
      a. Hermetically sealed motors.

b. Motors for equipment assemblies, less than 746 W (1 hp), shall be single phase provided the manufacturer of the proposed assemblies cannot supply the assemblies with three phase motors.

H. Horsepower ratings shall be adequate for operating the connected loads continuously in the prevailing ambient temperatures in areas where the motors are installed, without exceeding the NEMA standard temperature rises for the motor insulation.

I. Motor designs, as indicated by the NEMA code letters, shall be coordinated with the connected loads to assure adequate starting, acceleration, and running torque without exceeding nameplate ratings or considering service factor.

J. Motor Enclosures:

1. Shall be the NEMA types as specified and/or shown in the contract documents.
2. Where the types of motor enclosures are not shown in the contract documents, they shall be the NEMA types per NEMA 250, which are most suitable for the environmental conditions where the motors are being installed. Enclosure requirements for certain conditions are as follows:
   a. Motors located outdoors, indoors in wet or high humidity locations, or in unfiltered airstreams shall be totally enclosed type.
   b. Where motors are located in an NEC 511 classified area, provide TEFC explosion proof motor enclosures.
   c. Where motors are located in a corrosive environment, provide TEFC enclosures with corrosion resistant finish.
3. Enclosures shall be primed and finish coated at the factory with manufacturer's prime coat and standard finish.

K. Electrical Design Requirements:

1. Motors shall be continuous duty.
2. The insulation system shall be rated minimum of Class B, 130 degrees C (266 degrees F).
3. The maximum temperature rise by resistance at rated power shall not exceed Class B limits, 80 degrees C (176 degrees F).
4. The speed/torque and speed/current characteristics shall comply with NEMA Design A or B, as specified.

5. Motors shall be suitable for full voltage starting, unless otherwise noted. Coordinate motor features with applicable motor controllers.
6. Motors for variable frequency drive applications shall adhere to NEMA MG 1, Part 30, Application Considerations for Constant Speed Motors Used on a Sinusoidal Bus with Harmonic Content and General-Purpose Motors Used with Adjustable-Voltage or Adjustable-Frequency Controls or Both, or NEMA MG 1, Part 31, Definite-Purpose Inverter-Fed Polyphase Motors.

L. Mechanical Design Requirements:

1. Bearings shall be rated in accordance with ABMA 9 or ABMA 11 for a minimum fatigue life of 26,280 hours for belt-driven loads and 100,000 hours for direct-drive loads based on L10 (Basic Rating Life) at full load direct coupled, except vertical high thrust motors which require a 40,000 hours rating. A minimum fatigue life of 40,000 hours is required for VFD drives.
2. Vertical motors shall be capable of withstanding a momentary up thrust of at least 30 percent of normal down thrust.
3. Grease lubricated bearings shall be designed for electric motor use. Grease shall be capable of the temperatures associated with electric motors and shall be compatible with Polyurea based greases.
4. Grease fittings, if provided, shall be Alemite type or equivalent.
5. Oil lubricated bearings, when specified, shall have an externally visible sight glass to view oil level.
6. Vibration shall not exceed 3.8 mm (0.15 inch) per second, unfiltered peak.
7. Noise level shall meet the requirements of the application.
8. Motors on 180 frames and greater shall have provisions for lifting eyes or lugs capable of a safety factor of 5.
9. All external fasteners shall be corrosion resistant.
10. Condensation heaters, when specified, shall keep motor windings at least 5 degrees C (9 degrees F) above ambient temperature.
11. Winding thermostats, when specified shall be normally closed, connected in series.
12. Grounding provisions shall be in the main terminal box.

M. Special Requirements:

1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional cost or time to the Government.
2. Assemblies of motors, starters, controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:
   a. Wiring material located where temperatures can exceed 71 degrees C (160 degrees F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers.
   b. Other wiring at boilers and to control panels shall be NFPA 70 designation THWN.
   c. Provide shielded conductors or wiring in separate conduits for all instrumentation and control systems where recommended by manufacturer of equipment.
4. Select motor sizes so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
5. Motors utilized with variable frequency drives shall be rated "inverter-duty" per NEMA MG 1, Part 31, Definite-Purpose Inverter-Fed Polyphase Motors. Provide motor shaft grounding apparatus that shall protect bearings from damage from stray currents.

N. Additional requirements for specific motors, as indicated in the other sections listed in Article, RELATED SECTIONS shall also apply.

O. NEMA Premium Efficiency Electric Motors (Motor Efficiencies): All permanently wired polyphase motors of 746 W (1 hp) or more shall meet the minimum full-load efficiencies as indicated in the following table. Motors of 746 W (1 hp) or more with open, drip-proof, or TEFC enclosures shall be NEMA premium efficiency type, unless otherwise indicated. Motors provided as an integral part of motor driven equipment are excluded from this requirement if a minimum seasonal or

overall efficiency requirement is indicated for that equipment by the provisions of another section.

Minimum Premium Efficiencies Open Drip-Proof				**Minimum Premium Efficiencies Totally Enclosed Fan-Cooled (TEFC)**			
Rating kW (hp)	**1200 RPM**	**1800 RPM**	**3600 RPM**	**Rating kW (hp)**	**1200 RPM**	**1800 RPM**	**3600 RPM**
0.746 (1)	82.5%	85.5%	77.0%	0.746 (1)	82.5%	85.5%	77.0%
1.12 (1.5)	86.5%	86.5%	84.0%	1.12 (1.5)	87.5%	86.5%	84.0%
1.49 (2)	87.5%	86.5%	85.5%	1.49 (2)	88.5%	86.5%	85.5%
2.24 (3)	88.5%	89.5%	85.5%	2.24 (3)	89.5%	89.5%	86.5%
3.73 (5)	89.5%	89.5%	86.5%	3.73 (5)	89.5%	89.5%	88.5%
5.60 (7.5)	90.2%	91.0%	88.5%	5.60 (7.5)	91.0%	91.7%	89.5%
7.46 (10)	91.7%	91.7%	89.5%	7.46 (10)	91.0%	91.7%	90.2%
11.2 (15)	91.7%	93.0%	90.2%	11.2 (15)	91.7%	92.4%	91.0%
14.9 (20)	92.4%	93.0%	91.0%	14.9 (20)	91.7%	93.0%	91.0%
18.7 (25)	93.0%	93.6%	91.7%	18.7 (25)	93.0%	93.6%	91.7%
22.4 (30)	93.6%	94.1%	91.7%	22.4 (30)	93.0%	93.6%	91.7%
29.8 (40)	94.1%	94.1%	92.4%	29.8 (40)	94.1%	94.1%	92.4%
37.3 (50)	94.1%	94.5%	93.0%	37.3 (50)	94.1%	94.5%	93.0%
44.8 (60)	94.5%	95.0%	93.6%	44.8 (60)	94.5%	95.0%	93.6%
56.9 (75)	94.5%	95.0%	93.6%	56.9 (75)	94.5%	95.4%	93.6%
74.6 (100)	95.0%	95.4%	93.6%	74.6 (100)	95.0%	95.4%	94.1%
93.3 (125)	95.0%	95.4%	94.1%	93.3 (125)	95.0%	95.4%	95.0%
112 (150)	95.4%	95.8%	94.1%	112 (150)	95.8%	95.8%	95.0%
149.2 (200)	95.4%	95.8%	95.0%	149.2 (200)	95.8%	96.2%	95.4%

P. Minimum Power Factor at Full Load and Rated Voltage: 90 percent at 1200 RPM, 1800 RPM, and 3600 RPM. Power factor correction capacitors shall be provided unless the motor meets the 0.90 requirement without it or if the motor is controlled by a variable frequency drive. The power factor correction capacitors shall be able to withstand high voltage transients and power line variations without breakdown.

Q. Energy Efficiency of Small Motors (Motor Efficiencies): All motors under 746 W (1 hp) shall meet the requirements of the DOE Small Motor Regulation.

Polyphase Open Motors Average full load efficiency				**Capacitor-start capacitor-run and capacitor-start induction run open motors Average full load efficiency**			
Rating kW (hp)	**6 poles**	**4 poles**	**2 poles**	**Rating kW (hp)**	**6 poles**	**4 poles**	**2 poles**
0.18 (0.25)	67.5	69.5	65.6	0.18 (0.25)	62.2	68.5	66.6
0.25 (0.33)	71.4	73.4	69.5	0.25 (0.33)	66.6	72.4	70.5
0.37 (0.5)	75.3	78.2	73.4	0.37 (0.5)	76.2	76.2	72.4
0.55 (0.75)	81.7	81.1	76.8	0.55 (0.75)	80.2	81.8	76.2

PART 3 – EXECUTION

3.1 INSTALLATION

A. Install motors in accordance with manufacturer's recommendations, the NEC, NEMA, as shown in the contract documents and/or as required by other sections of these specifications.

B. If in the substantiated evaluation of the COR, the installation fails to meet the requirements of the construction documents with respect to function and maintainability, an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or time to the Government.

3.2 FIELD TESTS

A. All tests shall be witnessed by the CxA or by the COR.

B. Perform an electric insulation resistance Test using a megohmmeter on all motors after installation, before startup. All shall test free from grounds.

C. Perform Load test in accordance with IEEE 112, Test Method B, to determine freedom from electrical or mechanical defects and compliance with performance data.

D. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame, to be determined at the time of final inspection.

E. All test data shall be complied into a report form for each motor and provided to the contracting officer or their representative.

3.3 STARTUP AND TESTING

A. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the

various items of equipment shall be performed simultaneously with the system of which each item is an integral part.

B. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

C. The CxA shall observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with COR and CxA. Provide a minimum notice of 10 working days prior to startup and testing.

3.4 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

B. Components provided under this section of the specification shall be tested as part of a greater system.

3.5 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer’s technical representative for 1 hour to instruct each VA personnel responsible in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

- - - E N D - - -

SECTION 23 05 41
NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the application of noise control measures, seismic restraints for equipment, tolerance and vibration isolation for HVAC work, and vibration control techniques to boiler plant rotating equipment and parts including chillers, cooling towers, boilers, pumps, fans, compressors, motors, and steam turbines.

B. A complete listing of common acronyms and abbreviations are included in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA and SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

E. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

F. Section 23 31 00, HVAC DUCTS and CASINGS.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standards will govern.

B. American Society of Civil Engineers (ASCE):

ASCE 7-2016.....Minimum Design Loads for Buildings and Other Structures

C. American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE):

Handbook-2019.....ASHRAE Handbook - HVAC Applications

Handbook-2021.....ASHRAE Handbook - Fundamentals, Chapter 8, Sound and Vibration

D. American Society for Testing and Materials (ASTM):

A123/A123M-2017.....Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products

A307-2021.....Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60,000 PSI Tensile Strength

A193/A193M-2024.....Standard Specification for Alloy-Steel and Stainless-Steel Bolting for High Temperature or High-Pressure Service and Other Special Purpose Applications

B117-2019.....Standard Practice for Operating Salt Spray (Fog) Apparatus

D2240-2015(R2021).....Standard Test Method for Rubber Property – Durometer Hardness

E. International Code Council (ICC):

IBC-2021.....International Building Code

F. Manufacturers Standardization Society (MSS):

SP-58-2018.....Pipe Hangers and Supports – Materials, Design, Manufacture, Selection, Application, and Installation

G. Occupational Safety and Health Administration (OSHA):

29 CFR 1910.95.....Occupational Noise Exposure

H. Sheet Metal and Air Conditioning Contractor’s National Association (SMACNA):

001-2008.....Seismic Restraint Manual: Guidelines for Mechanical Systems, 3rd Edition

I. Department of Veterans Affairs (VA):

H-18-8-//2019(R2020)....Seismic Design Requirements

PG-18-10-2024.....HVAC Design Manual

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Information and material submitted under this section shall be marked “SUBMITTED UNDER SECTION 23 XX XX, SECTION TITLE”, with applicable paragraph identification.

C. Manufacturer's Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights,

materials, applications, standard compliance, model numbers, size, and capacity.

1. Vibration isolators:
   a. Floor mountings
   b. Hangers
   c. Snubbers
   d. Thrust restraints
2. Bases.
3. Seismic restraint provisions and bolting.
4. Acoustical enclosures.

D. Isolator manufacturer shall furnish with submittal load calculations for selection of isolators, including supplemental bases, based on lowest operating speed of equipment supported.

E. Seismic Requirements: Submittals are required for all equipment anchors, supports and seismic restraints. Submittals shall include weights, dimensions, standard connections, and manufacturer's certification that all specified equipment will withstand seismic Lateral Force requirements as shown in the contract documents.

1.5 QUALITY ASSURANCE

A. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

B. Refer to Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for additional sustainable design requirements.

B. Noise Criteria:

1. Perform an acoustic analysis to demonstrate that the specified room noise levels are achieved in all octave bands for all air-handling units, heating and ventilating units, fans, chillers, boilers, generators, and outdoor noise producing equipment, such as cooling towers and chillers. Refer to VA HVAC Design Manual Chapter 6 Room Data Sheets for the required Noise Criteria (NC) levels. If the necessary room type is not listed in Chapter 6 of VA HVAC Design Manual then consult the ASHRAE Handbook - HVAC Applications. The

analysis shall consider both air duct borne noise and noise transmission through walls, floors and roofs and shall be completed for all duct systems and all HVAC equipment.

2. For equipment which has no sound power ratings scheduled on the plans, the contractor shall select equipment such that the foregoing noise criteria, local ordinance noise levels, and OSHA 29 CFR 1910.95 requirements are not exceeded. Selection procedure shall be in accordance with ASHRAE Handbook - Fundamentals, Chapter 8, Sound and Vibration.
3. An allowance, not to exceed 5 db, may be added to the measured value to compensate for the variation of the room attenuating effect between room test condition prior to occupancy and design condition after occupancy which may include the addition of sound absorbing material, such as, furniture. This allowance may not be taken after occupancy. The room attenuating effect is defined as the difference between sound power level emitted to room and sound pressure level in room.
4. In absence of specified measurement requirements, measure equipment noise levels three feet from equipment and at an elevation of maximum noise generation.

C. Seismic Restraint Requirements:

1. Equipment:
   a. All mechanical equipment not supported with isolators external to the unit shall be securely anchored to the structure. Such mechanical equipment shall be properly supported to resist a horizontal force of 50 percent of the weight of the equipment furnished.
   b. All mechanical equipment mounted on vibration isolators shall be provided with seismic restraints capable of resisting a horizontal force of 100 percent of the weight of the equipment furnished.
2. Piping: Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
3. Ductwork: Refer to Section 23 31 00, HVAC DUCTS AND CASINGS

D. Allowable Vibration Tolerances for Rotating, Non-reciprocating Equipment: Not to exceed a self-excited vibration maximum velocity of 5 mm per second (0.20 inch per second) RMS, filter in, when measured with

a vibration meter on bearing caps of machine in vertical, horizontal, and axial directions or measured at equipment mounting feet if bearings are concealed. Measurements for internally isolated fans and motors may be made at the mounting feet.

1.6 AS-BUILT DOCUMENTATION

A. Comply with requirements in paragraph AS-BUILT DOCUMENTATION of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

PART 2 - PRODUCTS

2.1 GENERAL REQUIREMENTS

A. Type of isolator, base, and minimum static deflection shall be as required for each specific equipment application as recommended by isolator or equipment manufacturer. Refer to ASHRAE Handbook - HVAC Applications Chapter 49, Noise and Vibration Control, Table 47 for selection guide for Vibration Isolation.

B. Elastomeric isolators shall comply with ASTM D2240 and be oil resistant neoprene with a maximum stiffness of 60 durometer and have a straight-line deflection curve.

C. Exposure to Weather: Isolator housings to be either hot dipped galvanized or powder coated to ASTM B117 salt spray testing standards. Springs to be powder coated or electro galvanized. All hardware to be electro galvanized. In addition, provide limit stops to resist wind velocity. Velocity pressure established by wind shall be calculated in accordance with Section 1609 of the International Building Code. A minimum wind velocity of 75 mph shall be employed.

D. Uniform Loading: Select and locate isolators to produce uniform loading and deflection even when equipment weight is not evenly distributed.

E. Color code isolators by type and size for easy identification of capacity.

2.2 SEISMIC RESTRAINT REQUIREMENTS FOR EQUIPMENT

A. Bolt pad mounted equipment, without vibration isolators, to the floor or other support using ASTM A307 standard bolting material.

B. Provide floor mounted equipment with Type SS vibration Isolators. Where Type N isolators are used provide channel frame base horizontal restraints bolted to the floor, or other support, on all sides of the equipment. Size and material required for the base shall be as recommended by the isolator manufacturer.

C. On all sides of suspended equipment, provide bracing for rigid supports and provide restraints for resiliently supported equipment.

2.3 VIBRATION ISOLATORS

A. Floor Mountings:

1. Double Deflection Neoprene (Type N): Shall include neoprene covered steel support plated (top and bottom), friction pads, and necessary bolt holes.
2. Captive Spring Mount for Seismic Restraint (Type SS):
   a. Design mounts to resiliently resist seismic forces in all directions. Snubbing shall take place in all modes with adjustment to limit upward, downward, and horizontal travel to a maximum of 6 mm (1/4 inch) before contacting snubbers. Mountings shall have a minimum rating of one G coefficient of gravity as calculated and certified by a registered structural engineer.
   b. All mountings shall have leveling bolts that are rigidly bolted to the equipment. Spring diameters shall be no less than 0.8 of the compressed height of the spring at rated load. Springs shall have a minimum additional travel to solid equal to 50 percent of the rated deflection. Mountings shall have ports for spring inspection. Provide an all directional neoprene cushion collar around the equipment bolt.
3. Spring Isolators with Vertical Limit Stops (Type SP): Similar to spring isolators noted above, except include a vertical limit stop to limit upward travel if weight is removed and also to reduce movement and spring extension due to wind loads. Provide clearance around restraining bolts to prevent mechanical short circuiting. Isolators shall have a minimum seismic rating of one G.

B. Hangers: Shall be combination neoprene and springs unless otherwise noted and shall allow for expansion of pipe.

1. Combination Neoprene and Spring (Type H): Vibration hanger shall contain a spring and double deflection neoprene element in series. Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.

2. Hanger supports for piping 50 mm (2 inches) and greater shall have a pointer and scale deflection indicator.

C. Snubbers: Each spring mounted base shall have a minimum of four all-directional or eight two directional (two per side) seismic snubbers that are double acting. Elastomeric materials shall be shock absorbent neoprene bridge quality bearing pads, maximum 60 durometer, replaceable and have a minimum thickness of 6 mm (1/4 inch). Air gap between hard and resilient material shall be not less than 3.2 mm (1/8 inch) nor greater than 6 mm (1/4 inch). Restraints shall be capable of withstanding design load without permanent deformation.

D. Thrust Restraints (Type THR): Restraints shall provide a spring element contained in a steel frame with neoprene pads at each end attachment. Restraints shall have factory preset thrust and be field adjustable to allow a maximum movement of 6 mm (1/4 inch) when the fan starts and stops. Restraint assemblies shall include rods, angle brackets and other hardware for field installation.

2.4 BASES

A. Rails (Type R): Design rails with isolator brackets to reduce mounting height of equipment and cradle machines having legs or bases that do not require a complete supplementary base. To assure adequate stiffness, height of members shall be a minimum of 1/12 of longest base dimension but not less than 100 mm (4 inches). Where rails are used with neoprene mounts for small fans or close coupled pumps, extend rails to compensate overhang of housing.

B. Inertia Base (Type I): Base shall be a reinforced concrete inertia base. Pour concrete into a welded steel channel frame, incorporating prelocated equipment anchor bolts and pipe sleeves. Level the concrete to provide a smooth uniform bearing surface for equipment mounting. Provide grout under uneven supports. Channel depth shall be a minimum of 1/12 of longest dimension of base but not less than 152 mm (6 inches). Form shall include 13 mm (1/2 inch) reinforcing bars welded in place on minimum of 203 mm (8 inch) centers running both ways in a layer 38 mm (1-1/2 inches) above bottom. Use height saving brackets in all mounting locations. Weight of inertia base shall be equal to or greater than weight of equipment supported to provide a maximum peak-to-peak displacement of 1.6 mm (1/16 inch).

C. Curb Mounted Isolation Base (Type CB): Fabricate from aluminum to fit on top of standard curb with overlap to allow water run-off and have wind and water seals which shall not interfere with spring action. Provide resilient snubbers with 6 mm (1/4 inch) clearance for wind resistance. Top and bottom bearing surfaces shall have sponge type weather seals.

2.5 SOUND ATTENUATING UNITS

A. Refer to Section 23 31 00, HVAC DUCTS and CASINGS.

2.6 ACOUSTICAL ENCLOSURES IN MECHANICAL ROOMS (NOT USED)

PART 3 - EXECUTION

3.1 INSTALLATION

A. If an installation is unsatisfactory to the COR, the contractor shall correct the installation at no additional cost or time to the Government.

B. Vibration Isolation:

1. No metal-to-metal contact will be permitted between fixed and floating parts.
2. Connections to Equipment: Allow for deflections equal to or greater than equipment deflections. Electrical, drain, piping connections, and other items made to rotating or reciprocating equipment (pumps, compressors, etc.) which rests on vibration isolators, shall be isolated from building structure for first three hangers or supports with a deflection equal to that used on the corresponding equipment.
3. Common Foundation: Mount each electric motor on same foundation as driven machine. Hold driving motor and driven machine in positive rigid alignment with provision for adjusting motor alignment and belt tension. Bases shall be level throughout length and width. Provide shims to facilitate pipe connections, leveling, and bolting.
4. Provide heat shields where elastomers are subject to temperatures over 38 degrees C (l00 degrees F).
5. Extend bases for pipe elbow supports at discharge and suction connections at pumps. Pipe elbow supports shall not short circuit pump vibration to structure.
6. Non-rotating equipment such as heat exchangers and convertors shall be mounted on isolation units having the same static deflection as

the isolation hangers or support of the pipe connected to the equipment.

C. Inspection and Adjustments: Check for vibration and noise transmission through connections, piping, ductwork, foundations, and walls. Adjust, repair, or replace isolators as required to reduce vibration and noise transmissions to specified levels.

3.2 ADJUSTING

A. Adjust vibration isolators after piping systems are filled and equipment is at operating weight.

B. Adjust limit stops on restrained spring isolators to mount equipment at normal operating height. After equipment installation is complete, adjust limit stops so they are out of contact during normal operation.

C. Attach thrust limits at centerline of thrust and adjust to a maximum of 6 mm (1/4 inch) movement during start and stop.

D. Adjust active height of spring isolators.

E. Adjust snubbers according to manufacturer's recommendations.

F. Adjust seismic restraints to permit free movement of equipment within normal mode of operation.

G. Torque anchor bolts according to equipment manufacturer's recommendations to resist seismic forces.

- - - E N D - - -

SECTION 23 05 93
TESTING, ADJUSTING, AND BALANCING FOR HVAC

PART 1 - GENERAL

1.1 DESCRIPTION

A. A complete listing of common acronyms and abbreviations are included in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

B. Testing, adjusting, and balancing (TAB) of heating, ventilating and air conditioning (HVAC) systems. TAB includes the following:
   1. Planning systematic TAB procedures.
   2. Design Review Report.
   3. Systems Inspection Report.
   4. Duct Air Leakage Test Report.
   5. Systems Readiness Report.
   6. Balancing air and water distribution systems; adjustment of total system to provide design performance; and testing performance of equipment and automatic controls.
   7. Vibration and sound measurements.
   8. Recording and reporting results.
   9. Document critical paths of flow on reports.

C. Definitions:
   1. Basic TAB used in this Section: Chapter 39, "Testing, Adjusting and Balancing" of ASHRAE Handbook "HVAC Applications".
   2. TAB: Testing, Adjusting and Balancing; the process of checking and adjusting HVAC systems to meet design objectives.
   3. AABC: Associated Air Balance Council.
   4. NEBB: National Environmental Balancing Bureau.
   5. TABB: Testing Adjusting and Balancing Bureau.
   6. SMACNA: Sheet Metal and Air Conditioning Contractors' National Association.
   7. Hydronic Systems: Includes chilled water, condenser water, heating hot water.
   8. Air Systems: Includes all outside air, supply air, return air, exhaust air and relief air systems.

9. Flow Rate Tolerance: The allowable percentage variation, minus to plus, of actual flow rate from values (design) in the contract documents.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

D. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

E. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

F. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

G. Section 23 07 11, HVAC AND BOILER PLANT INSULATION.

H. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

I. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

J. Section 23 31 00, HVAC DUCTS AND CASINGS.

K. Section 23 36 00, AIR TERMINAL UNITS.

1.3 APPLICABLE PUBLICATIONS

A. The following publications form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standards will govern.

B. American Society of Heating, Refrigerating and Air Conditioning Engineers, Inc. (ASHRAE):

2019.....ASHRAE Handbook - HVAC Applications, Chapter 39, Testing, Adjusting, and Balancing and Chapter 49, Noise and Vibration Control

C. Associated Air Balance Council (AABC):

2016.....National Standards for Total System Balance, 7th Edition

D. National Environmental Balancing Bureau (NEBB):

2019.....Procedural Standard for Testing, Adjusting, and Balancing of Environmental Systems, 9th Edition

2015.....Procedural Standard for the Measurement of Sound and Vibration, 2nd Edition

S110-2019.....Whole Building Technical Commissioning of New Construction, 2nd Edition

E. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):

2002.....HVAC Systems Testing, Adjusting and Balancing, 3rd Edition

2003.....TAB Procedural Guide 1st Edition

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION XX XX XX, SECTION TITLE", with applicable paragraph identification.

C. Submit names and qualifications of TAB agency and TAB Specialists within 60 days after the notice to proceed. Submit information on three recently completed projects and a list of proposed test equipment.

D. For use by the COR staff, submit one complete set of applicable AABC, NEBB or TABB publications that will be the basis of TAB work.

E. Submit the following for review and approval:

1. Design Review Report within 90 days for conventional design projects after the system layout on air and water side is completed by the Contractor.
2. Systems inspection report on equipment and installation for conformance with design.
3. Duct Air Leakage Test Report.
4. Systems Readiness Report.
5. Intermediate and Final TAB reports covering flow balance and adjustments, performance tests, vibration tests and sound tests.
6. Include in final reports uncorrected installation deficiencies noted during TAB and applicable explanatory comments on test results that differ from design requirements.
7. Include in each report the critical path for each balanced branch (air and hydronic). Every branch shall have at least one terminal device damper 100 percent open.

F. Prior to request for Final or Partial Final inspection, submit completed Test and Balance report for the area with noted critical paths.

1.5 QUALITY ASSURANCE

A. Refer to paragraphs QUALITY ASSURANCE and SUBMITTALS, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC, Section 23 05 10, COMMON WORK RESULTS FOR BOILER PLANT and STEAM GENERATION, and Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

B. Qualifications:

1. TAB Agency: The TAB agency shall be a subcontractor of the General Contractor and shall report to and be paid by the General Contractor.
2. The TAB agency shall be either a certified member of AABC, NEBB, or TABB to perform TAB service for HVAC, water balancing of equipment. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the agency loses subject certification during this period, the General Contractor shall immediately notify the COR and submit another qualified TAB firm for approval. Any agency that has been the subject of disciplinary action by either the AABC, TABB or NEBB within the five (5) years preceding Contract Award shall not be eligible to perform any work related to the TAB. All work performed in this Section and in other related Sections by the TAB agency shall be considered invalid if the TAB agency loses its certification prior to Contract completion, and the successor agency’s review shows unsatisfactory work performed by the predecessor agency.
3. TAB Specialist: The TAB Specialist shall be either a member of AABC or TABB or an experienced technician of the Agency certified by NEBB. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the Specialist loses subject certification during this period, the General Contractor shall immediately notify the COR and submit another TAB Specialist for approval. Any individual that has been the subject of disciplinary action by either the AABC or the NEBB within the five (5) years preceding Contract Award shall not be eligible to perform any duties related to the HVAC systems, including TAB. All work

specified in this Section and in other related Sections performed by the TAB Specialist shall be considered invalid if the TAB Specialist loses its certification prior to Contract completion and shall be performed by an approved successor.

4. TAB Specialist shall be identified by the General Contractor within sixty (60) days after the Notice to Proceed. The TAB Specialist will be coordinating, scheduling, and reporting all TAB work and related activities and will provide necessary information as required by the COR. The responsibilities shall specifically include:
   a. Directly supervising all TAB work.
   b. Sign the TAB reports that bear the seal of the TAB standard. The reports shall be accompanied by report forms and schematic drawings required by the TAB standard, AABC, TABB or NEBB.
   c. Following all TAB work through its satisfactory completion.
   d. Providing final markings of settings of all HVAC adjustment devices.
   e. Permanently mark location of duct test ports.
   f. Documenting critical paths from the fan or pump. These critical paths are ones in which are 100 percent open from the fan or pump to the terminal device. This will show the least amount of restriction is being imposed on the system by the TAB firm.
5. All TAB technicians performing actual TAB work shall be experienced and shall have done satisfactory work on a minimum of three (3) projects comparable in size and complexity to this project. Qualifications shall be certified by the TAB agency in writing. The lead technician shall be certified by AABC, TABB or NEBB.

C. Test Equipment Criteria: The instrumentation shall meet the accuracy/calibration requirements established by AABC National Standards, TABB/SMACNA International Standards, or by NEBB Procedural Standard for Testing, Adjusting and Balancing of Environmental Systems and instrument manufacturer. Provide calibration history of the instruments to be used for test and balance purpose. All equipment shall remain in calibration, or be re-calibrated if certification expires, during the TAB procedures.

D. TAB Criteria:

1. One or more of the applicable AABC, NEBB, TABB or SMACNA publications, supplemented by Chapter 39, "Testing, Adjusting and Balancing" of ASHRAE Handbook "HVAC Applications" and requirements stated herein shall be the basis for planning, procedures, and reports.

2. Flow Rate Tolerance: Following tolerances are allowed. For tolerances not mentioned herein follow Chapter 39, "Testing, Adjusting and Balancing" of ASHRAE Handbook "HVAC Applications" as a guideline. Air Filter resistance during tests, artificially imposed, if necessary, shall be at least 100 percent of manufacturer recommended change over pressure drop values for pre-filters and after-filters.
   a. Air handling unit and all other fans, cubic meters/min (cubic feet per minute): Minus 5 percent to plus 10 percent.
   b. Air Terminal Units (maximum values): Minus 5 percent to plus 10 percent
   c. Exhaust Hoods/Cabinets: 0 percent to plus 10 percent.
   d. Minimum Outside Air: 0 percent to plus 10 percent.
   e. Individual room air outlets and inlets, and air flow rates not mentioned above: Minus 5 percent to plus 10 percent except if the air to air space is 100 CFM or less the tolerance will be minus 5 to plus 5 percent.
   f. Heating Hot Water Pumps and Hot Water Coils: Minus 5 percent to plus 5 percent.
   g. Chilled Water and Condenser Water Pumps: Minus 5 percent to plus 5 percent.
   h. Chilled Water Coils: Minus 5 percent to plus 5 percent.
3. Systems shall be adjusted for energy efficient operation as described in PART 3.
4. Typical TAB procedures and critical path results shall be demonstrated to the COR for one air distribution system (including all fans, 3 terminal units, 3 rooms randomly selected by the COR, one of which shall be a critical path) and 1 hydronic system (pumps and 3 coils) as follows:
   a. When field TAB work begins.

b. During each partial final inspection and the final inspection for the project if requested by VA.

PART 2 – PRODUCTS

2.1 PLUGS

A. Provide plastic plugs to seal holes drilled in ductwork for test purposes.

2.2 INSULATION REPAIR MATERIAL

A. See Section 23 07 11, HVAC and BOILER PLANT INSULATION. Provide for repair of insulation removed or damaged for TAB work.

PART 3 – EXECUTION

3.1 GENERAL

A. Refer to TAB Criteria in Paragraph QUALITY ASSURANCE.

B. Obtain applicable contract documents and copies of approved submittals for HVAC equipment and automatic control systems.

3.2 DESIGN REVIEW REPORT

A. The TAB Specialist shall review the contract documents and advise the COR of any design deficiencies that would prevent the HVAC systems from effectively operating in accordance with the sequence of operation specified or prevent the effective and accurate TAB of the system. The TAB Specialist shall provide a report individually listing each deficiency and the corresponding proposed corrective action necessary for proper system operation.

3.3 SYSTEMS INSPECTION REPORT

A. Inspect equipment and installation for conformance with design.

B. The inspection and report shall be done after air distribution and hydronic equipment is onsite and duct and piping installation has begun, but well in advance of performance testing and balancing work. The purpose of the inspection is to identify and report deviations from design and ensure that systems will be ready for TAB at the appropriate time.

C. Reports: Follow checklist format developed by AABC, NEBB or SMACNA (TABB), supplemented by narrative comments, with emphasis on air-handling units and fans. Check for conformance with submittals. Verify that diffuser and register sizes are correct. Check air terminal unit installation including their duct sizes and routing.

3.4 DUCT AIR LEAKAGE TEST REPORT

A. TAB Agency shall perform the leakage test as outlined in "Duct Leakage Tests and Repairs" in Section 23 31 00, HVAC DUCTS and CASINGS for TAB agency's role and responsibilities in witnessing, recording and reporting of deficiencies.

3.5 SYSTEM READINESS REPORT

A. The TAB Contractor shall measure existing air and water flow rates associated with existing systems utilized to serve renovated areas as indicated in the contract documents. Submit report of findings to COR.
   1. The TAB Contractor shall measure existing air and water flow rates for all systems that will remain in service and continue to serve areas outside the scope of work. Measurements shall be limited to the extent necessary to collect sufficient data to rebalance these existing systems, ensuring that unmodified areas are restored to their pre-construction flow rates.

B. Inspect each system to ensure that it is complete including installation and operation of controls. Submit report to COR in standard format and forms prepared and/or approved by the CxA.

C. Verify that all items such as ductwork piping, dampers, valves, ports, terminals, connectors, etc., that are required for TAB are installed. Provide a report to the COR.

3.6 TAB REPORTS

A. Submit an intermediate report for 25 percent of systems and equipment tested and balanced to establish satisfactory test results.

B. The TAB Contractor shall provide raw data immediately in writing to the COR if there is a problem in achieving intended results before submitting a formal report.

C. If over 20 percent of readings in the intermediate report fall outside the acceptable range, the TAB report shall be considered invalid and all contract TAB work shall be repeated after engineering and construction have been evaluated and re-submitted for approval at no additional cost to the owner.

D. Do not proceed with the remaining systems until intermediate report is approved by the COR.

3.7 TAB PROCEDURES

A. TAB shall be performed in accordance with the requirement of the Standard under which TAB agency is certified by either AABC, TABB or NEBB. Balancing shall be done proportionally to all applicable systems.
   1. At least 1 trunk damper shall be 100 percent open.
   2. At least 1 branch damper shall be 100 percent open per trunk.
   3. At least 1 terminal device duct be 100 percent open per branch.
   4. At least one hydronic balancing valve shall be 100 percent open per hydronic system.

B. General: During TAB all related system components shall be in full operation. Fan and pump rotation, motor loads and equipment vibration shall be checked and corrected as necessary before proceeding with TAB. Set controls and/or block off parts of distribution systems to simulate design operation of variable volume air or water systems for test and balance work.

C. Coordinate TAB procedures with existing systems and any phased construction completion requirements for the project. Provide TAB reports for pre-construction air and water flow rate and for each phase of the project prior to partial final inspections of each phase of the project. Return existing areas outside the work area to pre-constructed conditions.

D. Allow 14 days'time in construction schedule for TAB and submission of all reports for an organized and timely correction of deficiencies.

E. Air Balance and Equipment Test: Include air-handling units, fans, terminal units, fan coil units, room diffusers/outlets/inlets, computer room AC units, and laboratory fume hoods and biological safety cabinets.
   1. Artificially load air filters by partial blanking to produce static air pressure drop of manufacturer's recommended pressure drop.
   2. Adjust fan speeds to provide design air flow. V-belt drives, including fixed pitch pulley requirements, are specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Provide new drive sets as required to adjust fan speeds.
   3. Test and balance systems in all specified modes of operation, including variable volume, economizer, and fire emergency modes. Verify that dampers and other HVAC controls function properly.

4. Variable Air Volume (VAV) Systems:
   a. Coordinate TAB, including system volumetric controls, with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
   b. Section 23 36 00, AIR TERMINAL UNITS, specifies that maximum and minimum flow rates for air terminal units (ATU) be factory set. Check and readjust ATU flow rates if necessary to meet design criteria. Balance air distribution from ATU on full cooling maximum scheduled cubic meters per minute (cubic feet per minute). Reset room thermostats and check ATU operation from maximum to minimum cooling, to the heating mode, and back to cooling. Record and report the heating coil leaving air temperature when the ATU is in the maximum heating mode. Record and report outdoor air flow rates under all operating conditions (The test shall demonstrate that the minimum outdoor air ventilation rate shall remain constant under all operating conditions).
   c. Adjust operating pressure control setpoint to maintain the design flow to each space with the lowest setpoint. Confirm static pressure reset is operational and functioning properly.
5. Record final measurements for air handling equipment performance data sheets.
6. Record final damper settings for all manual volume dampers.

F. Water Balance and Equipment Test: Include circulating pumps, convertors, coils, coolers and condensers:
1. Coordinate water chiller flow balancing with Section 23 64 00, PACKAGED WATER CHILLERS.
2. Adjust flow rates for equipment. Set coils and evaporator to values on equipment submittals, if different from values in the contract documents.
3. Primary-Secondary (variable volume) Systems: Coordinate TAB with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. Balance systems at design water flow and then verify that variable flow controls function as designed.
4. Record final measurements for hydronic equipment on performance data sheets. Include entering and leaving water temperatures for heating and cooling coils, and for convertors. Include entering and leaving

air temperatures (DB/WB for cooling coils) for air-handling units and reheat coils. Make air and water temperature measurements at the same time.

5. On coils with automatic flow limiting valves (automatic balancing valves) measure and report Delta P across valve and measure Delta P across 100 percent open temperature control valve and using control valve CV calculate and report gpm.
6. Record final valve setting for all balancing valves.

3.8 VIBRATION TESTING

A. Furnish instruments and perform vibration measurements as specified in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT. Field vibration balancing is specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Provide measurements for all rotating HVAC equipment of 373 watts (1/2 horsepower) and larger, including centrifugal/screw compressors, cooling towers, pumps, fans and motors.

B. Record initial measurements for each unit of equipment on test forms and submit a report to the COR. Where vibration readings exceed the allowable tolerance Contractor shall be directed to correct the problem. The TAB agency shall verify that the corrections are done and submit a final report to the COR.

3.9 SOUND TESTING

A. Perform and record required sound measurements in accordance with paragraph QUALITY ASSURANCE in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

1. Take readings in rooms, approximately ten (10) percent of all rooms. The COR may designate the specific rooms to be tested.
2. Provide chiller and cooling tower sound measurements. Refer to Section 23 64 00, PACKAGED WATER CHILLERS and Section 23 65 00, COOLING TOWERS.

B. Take measurements with a calibrated sound level meter and octave band analyzer of the accuracy required by AABC, TABB or NEBB.

C. Sound reference levels, formulas and coefficients shall be according to ASHRAE Handbook "HVAC Applications", Chapter 49, “Noise and Vibration Control”.

D. Determine compliance with contract documents as follows:

1. When sound pressure levels are specified, including the NC Criteria in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT:
   a. Reduce the background noise as much as possible by shutting off unrelated audible equipment.
   b. Measure octave band sound pressure levels with specified equipment "off."
   c. Measure octave band sound pressure levels with specified equipment "on."
   d. Use the DIFFERENCE in corresponding readings to determine the sound pressure due to equipment.

DIFFERENCE:	0	1	2	3	4	5 to 9	10 or More
FACTOR:	10	7	4	3	2	1	0

   Sound pressure level due to equipment equals sound pressure level with equipment "on" minus FACTOR.
   e. Plot octave bands of sound pressure level due to equipment for typical rooms on a graph which also shows noise criteria (NC) curves.
2. When sound power levels are specified:
   a. Perform steps 1.a. through 1.d., as specified above.
   b. For Indoor Equipment: Determine room attenuating effect, i.e., difference between sound power level and sound pressure level. Determined sound power level will be the sum of sound pressure level due to equipment plus the room attenuating effect.
   c. For Outdoor Equipment: Use directivity factor and distance from noise source to determine distance factor, i.e., difference between sound power level and sound pressure level. Measured sound power level will be the sum of sound pressure level due to equipment plus the distance factor. Use 9 meters (30 feet) for sound level location.
3. Where sound pressure levels are specified in terms of dB(A), as in Section 23 65 00, COOLING TOWERS, measure sound levels using the "A" scale of meter. Single value readings will be used instead of octave band analysis.

E. Where measured sound levels exceed specified level, the installing contractor or equipment manufacturer shall take remedial action approved by the COR and the necessary sound tests shall be repeated.

F. Test readings for sound testing could go higher than 15 percent if determination is made by the COR based on the recorded sound data.

3.10 MARKING OF SETTINGS

A. Following approval of TAB Final Report, the setting of all HVAC adjustment devices including valves, splitters and dampers shall be permanently marked by the TAB Specialist so that adjustment can be restored if disturbed at any time. Style and colors used for markings shall be coordinated with the COR.

3.11 IDENTIFICATION OF TEST PORTS

A. The TAB Specialist shall permanently and legibly identify the location points of duct test ports. If the ductwork has exterior insulation, the identification shall be made on the exterior side of the insulation. All penetrations through ductwork and ductwork insulation shall be sealed to prevent air leaks and maintain integrity of vapor barrier.

3.12 PHASING

A. Phased Projects: Testing and Balancing Work to follow project with areas shall be completed per the project phasing. Upon completion of the project all areas shall have been tested and balanced per the contract documents.

B. Existing Areas: Systems that serve areas outside of the project scope shall not be adversely affected. Measure existing parameters where shown to document system capacity.

3.13 CRITICAL FLOW PATH

A. Provide a documented critical path for all fluid flows. There shall be at least one (1) terminal device that can be traced back to the fan or pump where there is no damper or valves that are less than 100 percent open.

3.14 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

- - E N D - -

SECTION 23 07 11
HVAC AND BOILER PLANT INSULATION

PART 1 - GENERAL

1.1 DESCRIPTION

A. Field applied insulation for thermal efficiency and condensation control for
   1. HVAC piping, ductwork and equipment.
   2. Re-insulation of HVAC piping, ductwork and equipment after asbestos abatement.

B. Definitions
   1. ASJ: All service jacket, white finish facing or jacket.
   2. Air conditioned space: Space having air temperature and/or humidity controlled by mechanical equipment.
   3. Cold: Equipment, ductwork or piping handling media at design temperature of 16 degrees C (60 degrees F) or below.
   4. Concealed: Ductwork and piping above ceilings and in chases, and pipe spaces.
   5. Exposed: Piping, ductwork, and equipment exposed to view in finished areas including mechanical and electrical equipment rooms or exposed to outdoor weather. Attics and crawl spaces where air handling units are located are considered to be mechanical rooms. Shafts, chases, unfinished attics, crawl spaces and pipe basements are not considered finished areas.
   6. FSK: Foil-scrim-kraft facing.
   7. Hot: HVAC Ductwork handling air at design temperature above 16 degrees C (60 degrees F);HVAC equipment or piping handling media above 41 degrees C (105 degrees F).
   8. Density: kg/m^3 - kilograms per cubic meter (Pcf - pounds per cubic foot).
   9. Runouts: Branch pipe connections up to 25-mm (one-inch) nominal size to fan coil units or reheat coils for terminal units.
   10. Thermal conductance: Heat flow rate through materials.
       a. Flat surface: Watt per square meter (BTU per hour per square foot).

b. Pipe or Cylinder: Watt per square meter (BTU per hour per linear foot).

11. Thermal Conductivity (k): Watt per meter, per degree C (BTU per inch thickness, per hour, per square foot, per degree F temperature difference).
12. Vapor Retarder (Vapor Barrier): A material which retards the transmission (migration) of water vapor. Performance of the vapor retarder is rated in terms of permeance (perms). For the purpose of this specification, vapor retarders shall have a maximum published permeance of 0.1 perms and vapor barriers shall have a maximum published permeance of 0.001 perms.
13. HPS: High pressure steam (415 kPa [60 psig] and above).
14. HPR: High pressure steam condensate return.
15. MPS: Medium pressure steam (110 kPa [16 psig] thru 414 kPa [59 psig].
16. MPR: Medium pressure steam condensate return.
17. LPS: Low pressure steam (103 kPa [15 psig] and below).
18. LPR: Low pressure steam condensate gravity return.
19. PC: Pumped condensate.
20. HWH: Hot water heating supply.
21. HWHR: Hot water heating return.
22. GH: Hot glycol-water heating supply.
23. GHR: Hot glycol-water heating return.
24. FWPD: Feedwater pump discharge.
25. FWPS: Feedwater pump suction.
26. CTPD: Condensate transfer pump discharge.
27. CTPS: Condensate transfer pump suction.
28. VR: Vacuum condensate return.
29. CPD: Condensate pump discharge.
30. R: Pump recirculation.
31. FOS: Fuel oil supply.
32. FOR: Fuel oil return.
33. CW: Cold water.
34. SW: Soft water.
35. HW: Hot water.
36. CH: Chilled water supply.

37. CHR: Chilled water return.
38. GC: Chilled glycol-water supply.
39. GCR: Chilled glycol-water return.
40. RS: Refrigerant suction.
41. PVDC: Polyvinylidene chloride vapor retarder jacketing, white.

1.2 RELATED WORK

A Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Section 02 82 11, TRADITIONAL ASBESTOS ABATEMENT.

C. Section 02 82 13. GLOVEBAG ASBESTOS ABATEMENT.

D. Section 07 84 00, FIRESTOPPING.

E. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

F. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

G. Section 23 21 13, HYDRONIC PIPING.

H. Section 23 22 13, STEAM and CONDENSATE HEATING PIPING

I. Section 23 22 23, STEAM CONDENSATE PUMPS

1.3 QUALITY ASSURANCE

A. Refer to article QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

B. Criteria:

1. Comply with NFPA 90A, particularly paragraphs 4.3.3.1 through 4.3.3.6, 4.3.10.2.6, and 5.4.6.4, parts of which are quoted as follows:

> **4.3.3.1** Pipe insulation and coverings, duct coverings, duct linings, vapor retarder facings, adhesives, fasteners, tapes, and supplementary materials added to air ducts, plenums, panels, and duct silencers used in duct systems, unless otherwise provided for in 4.3.3.1.1 or 4.3.3.1.2., shall have, in the form in which they are used, a maximum flame spread index of 25 without evidence of continued progressive combustion and a maximum smoke developed index of 50 when tested in accordance with NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*.
>
> **4.3.3.1.1** Where these products are to be applied with adhesives, they shall be tested with such adhesives applied, or the adhesives used shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when in the final dry state. *(See 4.2.4.2.)*
>
> **4.3.3.1.2** The flame spread and smoke developed index requirements of 4.3.3.1.1 shall not apply to air duct weatherproof coverings where they are located entirely outside of a building, do not penetrate a wall or roof, and do not create an exposure hazard.

4.3.3.2 Closure systems for use with rigid and flexible air ducts tested in accordance with UL 181, Standard for Safety Factory-Made Air Ducts and Air Connectors, shall have been tested, listed, and used in accordance with the conditions of their listings, in accordance with one of the following:

(1) UL 181A, Standard for Safety Closure Systems for Use with Rigid Air Ducts and Air Connectors

(2) UL 181B, Standard for Safety Closure Systems for Use with Flexible Air Ducts and Air Connectors

4.3.3.3 Air duct, panel, and plenum coverings and linings, and pipe insulation and coverings shall not flame, glow, smolder, or smoke when tested in accordance with a similar test for pipe covering, ASTM C 411, Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation, at the temperature to which they are exposed in service.

4.3.3.3.1 In no case shall the test temperature be below 121°C (250°F).

4.3.3.4 Air duct coverings shall not extend through walls or floors that are required to be fire stopped or required to have a fire resistance rating, unless such coverings meet the requirements of 5.4.6.4.

4.3.3.5* Air duct linings shall be interrupted at fire dampers to prevent interference with the operation of devices.

4.3.3.6 Air duct coverings shall not be installed so as to conceal or prevent the use of any service opening.

4.3.10.2.6 Materials exposed to the airflow shall be noncombustible or limited combustible and have a maximum smoke developed index of 50 or comply with the following.

4.3.10.2.6.1 Electrical wires and cables and optical fiber cables shall be listed as noncombustible or limited combustible and have a maximum smoke developed index of 50 or shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with NFPA 262, Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces.

4.3.10.2.6.4 Optical-fiber and communication raceways shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 2024, Standard for Safety Optical-Fiber Cable Raceway.

4.3.10.2.6.6 Supplementary materials for air distribution systems shall be permitted when complying with the provisions of 4.3.3.

5.4.6.4 Where air ducts pass through walls, floors, or partitions that are required to have a fire resistance rating and where fire dampers are not required, the opening in the construction around the air duct shall be as follows:

(1) Not exceeding a 25.4 mm (1 in.) average clearance on all sides

(2) Filled solid with an approved material capable of preventing the passage of flame and hot gases sufficient to ignite cotton waste when subjected to the time-temperature fire conditions required for fire barrier penetration as specified in NFPA 251, *Standard Methods of Tests of Fire Endurance of Building Construction and Materials*

2. Test methods: ASTM E84, UL 723, or NFPA 255.
3. Specified k factors are at 24 degrees C (75 degrees F) mean temperature unless stated otherwise. Where optional thermal insulation material is used, select thickness to provide thermal conductance no greater than that for the specified material. For pipe, use insulation manufacturer's published heat flow tables. For domestic hot water supply and return, run out insulation and condensation control insulation, no thickness adjustment need be made.
4. All materials shall be compatible and suitable for service temperature, and shall not contribute to corrosion or otherwise attack surface to which applied in either the wet or dry state.

C. Every package or standard container of insulation or accessories delivered to the job site for use must have a manufacturer's stamp or label giving the name of the manufacturer and description of the material.

1.4 SUBMITTALS

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Shop Drawings:

1. All information, clearly presented, shall be included to determine compliance with drawings and specifications and ASTM, federal and military specifications.
   a. Insulation materials: Specify each type used and state surface burning characteristics.
   b. Insulation facings and jackets: Each type used. Make it clear that white finish will be furnished for exposed ductwork, casings and equipment.
   c. Insulation accessory materials: Each type used.

d. Manufacturer's installation and fitting fabrication instructions for flexible unicellular insulation.

e. Make reference to applicable specification paragraph numbers for coordination.

C. Samples:

1. Each type of insulation: Minimum size 100 mm (4 inches) square for board/block/ blanket; 150 mm (6 inches) long, full diameter for round types.
2. Each type of facing and jacket: Minimum size 100 mm (4 inches square).
3. Each accessory material: Minimum 120 ML (4 ounce) liquid container or 120 gram (4 ounce) dry weight for adhesives mastic.

1.5 STORAGE AND HANDLING OF MATERIAL

Store materials in clean and dry environment, pipe covering jackets shall be clean and unmarred. Place adhesives in original containers. Maintain ambient temperatures and conditions as required by printed instructions of manufacturers of adhesives, mastics and finishing cements.

1.6 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.

B. Federal Specifications (Fed. Spec.):

L-P-535E (2)- 1999.....Plastic Sheet (Sheeting): Plastic Strip; Poly (Vinyl Chloride) and Poly (Vinyl Chloride - Vinyl Acetate), Rigid.

C. Military Specifications (Mil. Spec.):

MIL-A-3316C -1987 Adhesives, Fire-Resistant, Thermal Insulation

MIL-A-24179A (1)-2016 Adhesive, Flexible Unicellular-Plastic Thermal Insulation

MIL-C-19565C (1)- 2016 Coating Compounds, Thermal Insulation, Fire-and Water-Resistant, Vapor-Barrier

MIL-C-20079H-1987 .....Cloth, Glass; Tape, Textile Glass; and Thread, Glass and Wire-Reinforced Glass

D. American Society for Testing and Materials (ASTM):

A167-99 2014.....Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip

B209-2014.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate

C411-2019.....Standard test method for Hot-Surface Performance of High-Temperature Thermal Insulation

C449-2019.....Standard Specification for Mineral Fiber Hydraulic-Setting Thermal Insulating and Finishing Cement

C533-2017.....Standard Specification for Calcium Silicate Block and Pipe Thermal Insulation

C534-2017.....Standard Specification for Preformed Flexible Elastomeric Cellular Thermal Insulation in Sheet and Tubular Form

C547-2017.....Standard Specification for Mineral Fiber pipe Insulation

C552-07 .....Standard Specification for Cellular Glass Thermal Insulation

C553-2015.....Standard Specification for Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications

C585-2016.....Standard Practice for Inner and Outer Diameters of Rigid Thermal Insulation for Nominal Sizes of Pipe and Tubing (NPS System) R (1998)

C612-2014.....Standard Specification for Mineral Fiber Block and Board Thermal Insulation

C1126- 2019.....Standard Specification for Faced or Unfaced Rigid Cellular Phenolic Thermal Insulation

C1136- 2017.....Standard Specification for Flexible, Low Permeance Vapor Retarders for Thermal Insulation

D1668-97a 2017 .....Standard Specification for Glass Fabrics (Woven and Treated) for Roofing and Waterproofing

E84-2014.....Standard Test Method for Surface Burning Characteristics of Building Materials

E119-2007.....Standard Test Method for Fire Tests of Building Construction and Materials

E136-2019.....Standard Test Methods for Behavior of Materials in a Vertical Tube Furnace at 750 degrees C (1380 F)

E. National Fire Protection Association (NFPA):

90A-2024.....Standard for the Installation of Air Conditioning and Ventilating Systems

96-2024.....Standard~~s~~ for Ventilation Control and Fire Protection of Commercial Cooking Operations

101-2024.....Life Safety Code

251-2014 .....Standard methods of Tests of Fire Endurance of Building Construction Materials

255-2006.....Standard Method of tests of Surface Burning Characteristics of Building Materials

F. Underwriters Laboratories, Inc (UL):

723-2018.....UL Standard for Safety Test for Surface Burning Characteristics of Building Materials with Revision of 09/08

G. Manufacturer's Standardization Society of the Valve and Fitting Industry (MSS):

SP58-2018.....Pipe Hangers and Supports Materials, Design, and Manufacture

PART 2 - PRODUCTS

2.1 MINERAL FIBER OR FIBER GLASS

A. ASTM C612 (Board, Block), Class 1 or 2, density 48 kg/m^3 (3 pcf), k = 0.037 (0.26) at 24 degrees C (75 degrees F), external insulation for temperatures up to 204 degrees C (400 degrees F) with foil scrim (FSK) facing.

B. ASTM C553 (Blanket, Flexible) Type I, Class B-3, Density 16 kg/m^3 (1 pcf), k = 0.045 (0.31) at 24 degrees C (75 degrees F), for use at

temperatures up to 204 degrees C (400 degrees F) with foil scrim (FSK) facing.

C. ASTM C547 (Pipe Fitting Insulation and Preformed Pipe Insulation), Class 1, k = 0.037 (0.26) at 24 degrees C (75 degrees F), for use at temperatures up to 230 degrees C (450 degrees F) with an all service vapor retarder jacket with polyvinyl chloride premolded fitting covering.

2.2 MINERAL WOOL OR REFRACTORY FIBER

A. Comply with Standard ASTM C612, Class 3, 450 degrees C (850 degrees F).

2.3 RIGID CELLULAR PHENOLIC FOAM

A. Preformed (molded) pipe insulation, ASTM C1126, type III, grade 1, k = 0.021(0.15) at 10 degrees C (50 degrees F), for use at temperatures up to 121 degrees C (250 degrees F) with all service vapor retarder jacket with polyvinyl chloride premolded fitting covering.

B. Equipment and Duct Insulation, ASTM C 1126, type II, grade 1, k = 0.021 (0.15) at 10 degrees C (50 degrees F), for use at temperatures up to 121 degrees C (250 degrees F) with rigid cellular phenolic insulation and covering, and all service vapor retarder jacket.

2.4 CELLULAR GLASS CLOSED-CELL

A. Comply with Standard ASTM C177, C518, density 120 kg/m^3 (7.5 pcf) nominal, k = 0.033 (0.29) at 24~~0~~ degrees C (75 degrees F).

B. Pipe insulation for use at temperatures up to 200 degrees C (400 degrees F) with all service vapor retarder jacket.

2.5 POLYISOCYANURATE CLOSED-CELL RIGID (NOT USED)

2.6 FLEXIBLE ELASTOMERIC CELLULAR THERMAL

ASTM C177, C518, k = 0.039 (0.27) at 24 degrees C (75 degrees F), flame spread not over 25, smoke developed not over 50, for temperatures from minus 4 degrees C (40 degrees F) to 93 degrees C (200 degrees F). No jacket required.

2.7 DUCT WRAP FOR KITCHEN HOOD GREASE DUCTS (NOT USED)

2.8 CALCIUM SILICATE (NOT USED)

2.9 INSULATION FACINGS AND JACKETS

A. Vapor Retarder, higher strength with low water permeance $\underline{=}$ 0.02 or less perm rating, Beach puncture 50 units for insulation facing on exposed ductwork, casings and equipment, and for pipe insulation jackets.

Facings and jackets shall be all service type (ASJ) or PVDC Vapor Retarder jacketing.

B. ASJ jacket shall be white kraft bonded to 0.025 mm (1 mil) thick aluminum foil, fiberglass reinforced, with pressure sensitive adhesive closure. Comply with ASTM C1136. Beach puncture 50 units, Suitable for painting without sizing. Jackets shall have minimum 40 mm (1-1/2 inch) lap on longitudinal joints and minimum 75 mm (3 inch) butt strip on end joints. Butt strip material shall be same as the jacket. Lap and butt strips shall be self-sealing type with factory-applied pressure sensitive adhesive.

C. Vapor Retarder medium strength with low water vapor permeance of 0.02 or less perm rating), Beach puncture 25 units: Foil-Scrim-Kraft (FSK) or PVDC vapor retarder jacketing type for concealed ductwork and equipment.

D. Field applied vapor barrier jackets shall be provided, in addition to the specified facings and jackets, on all exterior piping and ductwork as well as on interior piping and ductwork exposed to outdoor air (i.e.; in ventilated attics, piping in ventilated (not air conditioned) spaces, etc.)in high humidity areas conveying fluids below ambient temperature. The vapor barrier jacket shall consist of a multi-layer laminated cladding with a maximum water vapor permeance of 0.001 perms. The minimum puncture resistance shall be 35 cm-kg (30 inch-pounds) for interior locations and 92 cm-kg (80 inch-pounds) for exterior or exposed locations or where the insulation is subject to damage.

E. Glass Cloth Jackets: Presized, minimum 0.18 kg per square meter (7.8 ounces per square yard), 2000 kPa (300 psig) bursting strength with integral vapor retarder where required or specified. Weather proof if utilized for outside service.

F. Factory composite materials may be used provided that they have been tested and certified by the manufacturer.

G. Pipe fitting insulation covering (jackets): Fitting covering shall be premolded to match shape of fitting and shall be polyvinyl chloride (PVC) conforming to Fed Spec L-P-335, composition A, Type II Grade GU, and Type III, minimum thickness 0.7 mm (0.03 inches). Provide color matching vapor retarder pressure sensitive tape.

H. Aluminum Jacket-Piping systems: ASTM B209, 3003 alloy, H-14 temper, 0.6 mm (0.023 inch) minimum thickness with locking longitudinal joints. Jackets for elbows, tees and other fittings shall be factory-fabricated to match shape of fitting and of 0.6 mm (0.024) inch minimum thickness aluminum. Fittings shall be of same construction as straight run jackets but need not be of the same alloy. Factory-fabricated stainless steel bands shall be installed on all circumferential joints. Bands shall be 13 mm (0.5 inch) wide on 450 mm (18 inch) centers. System shall be weatherproof if utilized for outside service.

2.10 REMOVABLE INSULATION JACKETS (NOT USED)

2.11 PIPE COVERING PROTECTION SADDLES

A. Cold pipe support: Premolded pipe insulation 180 degrees (half-shells) on bottom half of pipe at supports. Material shall be cellular glass or high density Polyisocyanurate insulation of the same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m^3 (3.0 pcf).

Nominal Pipe Size and Accessories Material (Insert Blocks)	
Nominal Pipe Size mm (inches)	Insert Blocks mm (inches)
Up through 125 (5)	150 (6) long
150 (6)	150 (6) long
200 (8), 250 (10), 300 (12)	225 (9) long
350 (14), 400 (16)	300 (12) long
450 through 600 (18 through 24)	350 (14) long

B. Warm or hot pipe supports: Premolded pipe insulation (180 degree half-shells) on bottom half of pipe at supports. Material shall be high density Polyisocyanurate (for temperatures up to 149 degrees C [300 degrees F]), cellular glass or calcium silicate. Insulation at supports shall have same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m^3 (3.0 pcf).

2.12 ADHESIVE, MASTIC, CEMENT

A. Mil. Spec. MIL-A-3316, Class 1: Jacket and lap adhesive and protective finish coating for insulation.

B. Mil. Spec. MIL-A-3316, Class 2: Adhesive for laps and for adhering insulation to metal surfaces.

C. Mil. Spec. MIL-A-24179, Type II Class 1: Adhesive for installing flexible unicellular insulation and for laps and general use.

D. Mil. Spec. MIL-C-19565, Type I: Protective finish for outdoor use.

E. Mil. Spec. MIL-C-19565, Type I or Type II: Vapor barrier compound for indoor use.

F. ASTM C449: Mineral fiber hydraulic-setting thermal insulating and finishing cement.

G. Other: Insulation manufacturers' published recommendations.

2.13 MECHANICAL FASTENERS

A. Pins, anchors: Welded pins, or metal or nylon anchors with galvanized steel-coated or fiber washer, or clips. Pin diameter shall be as recommended by the insulation manufacturer.

B. Staples: Outward clinching galvanized steel.

C. Wire: 1.3 mm thick (18 gage) soft annealed galvanized or 1.9 mm (14 gage) copper clad steel or nickel copper alloy.

D. Bands: 13 mm (0.5 inch) nominal width, brass, galvanized steel, aluminum or stainless steel.

2.14 REINFORCEMENT AND FINISHES

A. Glass fabric, open weave: ASTM D1668, Type III (resin treated) and Type I (asphalt treated).

B. Glass fiber fitting tape: Mil. Spec MIL-C-20079, Type II, Class 1.

C. Tape for Flexible Elastomeric Cellular Insulation: As recommended by the insulation manufacturer.

D. Hexagonal wire netting: 25 mm (one inch) mesh, 0.85 mm thick (22 gage) galvanized steel.

E. Corner beads: 50 mm (2 inch) by 50 mm (2 inch), 0.55 mm thick (26 gage) galvanized steel; or, 25 mm (1 inch) by 25 mm (1 inch), 0.47 mm thick (28 gage) aluminum angle adhered to 50 mm (2 inch) by 50 mm (2 inch) Kraft paper.

F. PVC fitting cover: Fed. Spec L-P-535, Composition A, 11-86 Type II, Grade GU, with Form B Mineral Fiber insert, for media temperature 4 degrees C (40 degrees F) to 121 degrees C (250 degrees F). Below 4 degrees C (40 degrees F) and above 121 degrees C (250 degrees F). Provide double layer insert. Provide color matching vapor barrier pressure sensitive tape.

2.15 FIRESTOPPING MATERIAL

Other than pipe and duct insulation, refer to Section 07 84 00 FIRESTOPPING.

2.16 FLAME AND SMOKE

Unless shown otherwise all assembled systems shall meet flame spread 25 and smoke developed 50 rating as developed under ASTM, NFPA and UL standards and specifications. See paragraph 1.3 "Quality Assurance".

PART 3 - EXECUTION

3.1 GENERAL REQUIREMENTS

A. Required pressure tests of duct and piping joints and connections shall be completed and the work approved by the Contracting Officer's Representative for application of insulation. Surface shall be clean and dry with all foreign materials, such as dirt, oil, loose scale and rust removed.

B. Except for specific exceptions, insulate entire specified equipment, piping (pipe, fittings, valves, accessories), and duct systems. Insulate each pipe and duct individually. Do not use scrap pieces of insulation where a full length section will fit.

C. Where removal of insulation of piping, ductwork and equipment is required to comply with Section 02 82 11, TRADITIONAL ASBESTOS ABATEMENT and Section 02 82 13.13, GLOVEBAG ASBESTOS ABATEMENT, such areas shall be reinsulated to comply with this specification.

D. Insulation materials shall be installed in a first class manner with smooth and even surfaces, with jackets and facings drawn tight and smoothly cemented down at all laps. Insulation shall be continuous through all sleeves and openings, except at fire dampers and duct heaters (NFPA 90A). Vapor retarders shall be continuous and uninterrupted throughout systems with operating temperature 16 degrees C (60 degrees F) and below. Lap and seal vapor retarder over ends and exposed edges of insulation. Anchors, supports and other metal projections through insulation on cold surfaces shall be insulated and vapor sealed for a minimum length of 150 mm (6 inches).

E. Install vapor stops at all insulation terminations on either side of valves, pumps and equipment and particularly in straight lengths of pipe insulation.

F. Construct insulation on parts of equipment such as chilled water pumps and heads of chillers, convertors and heat exchangers that must be opened periodically for maintenance or repair, so insulation can be removed and replaced without damage. Install insulation with bolted 1 mm thick (20 gage) galvanized steel or aluminum covers as complete units, or in sections, with all necessary supports, and split to coincide with flange/split of the equipment.

G. Insulation on hot piping and equipment shall be terminated square at items not to be insulated, access openings and nameplates. Cover all exposed raw insulation with white sealer or jacket material.

H. Protect all insulations outside of buildings with aluminum jacket using lock joint or other approved system for a continuous weather tight system. Access doors and other items requiring maintenance or access shall be removable and sealable.

I. Insulate PRVs, flow meters, and steam traps.

I. HVAC work not to be insulated:

1. Internally insulated ductwork and air handling units.
2. Relief air ducts (Economizer cycle exhaust air).
3. Exhaust air ducts and plenums, and ventilation exhaust air shafts.
4. Equipment: Expansion tanks, flash tanks, hot water pumps.
5. In hot piping: Unions, flexible connectors, control valves, safety valves and discharge vent piping, vacuum breakers, thermostatic vent valves, steam traps 20 mm (3/4 inch) and smaller, exposed piping through floor for convectors and radiators. Insulate piping to within approximately 75 mm (3 inches) of uninsulated items.

J. Apply insulation materials subject to the manufacturer's recommended temperature limits. Apply adhesives, mastic and coatings at the manufacturer's recommended minimum coverage.

K. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/ fitting. Use of polyurethane spray-foam to fill a PVC elbow jacket is prohibited on cold applications.

L. Firestop Pipe and Duct insulation:

1. Provide firestopping insulation at fire and smoke barriers through penetrations. Fire stopping insulation shall be UL listed as defines in Section 07 84 00, FIRESTOPPING.
2. Pipe and duct penetrations requiring fire stop insulation including, but not limited to the following:
   a. Pipe risers through floors
   b. Pipe or duct chase walls and floors
   c. Smoke partitions
   d. Fire partitions

M. Provide vapor barrier jackets over insulation as follows:
1. All piping and ductwork exposed to outdoor weather.

N. Provide metal jackets over insulation as follows:
1. All piping and ducts exposed to outdoor weather.
2. Piping exposed in building, within 1800 mm (6 feet) of the floor, that connects to sterilizers, kitchen and laundry equipment. Jackets may be applied with pop rivets. Provide aluminum angle ring escutcheons at wall, ceiling or floor penetrations.
3. A 50 mm (2 inch) overlap is required at longitudinal and circumferential joints.

3.2 INSULATION INSTALLATION

A. Mineral Fiber Board:
1. Faced board: Apply board on pins spaced not more than 300 mm (12 inches) on center each way, and not less than 75 mm (3 inches) from each edge of board. In addition to pins, apply insulation bonding adhesive to entire underside of horizontal metal surfaces. Butt insulation edges tightly and seal all joints with laps and butt strips. After applying speed clips cut pins off flush and apply vapor seal patches over clips.
2. Plain board:
   a. Insulation shall be scored, beveled or mitered to provide tight joints and be secured to equipment with bands spaced 225 mm (9 inches) on center for irregular surfaces or with pins and clips on flat surfaces. Use corner beads to protect edges of insulation.
   b. For hot equipment: Stretch 25 mm (1 inch) mesh wire, with edges wire laced together, over insulation and finish with insulating

and finishing cement applied in one coat, 6 mm (1/4 inch) thick, trowel led to a smooth finish.

c. For cold equipment: Apply meshed glass fabric in a tack coat 1.5 to 1.7 square meter per liter (60 to 70 square feet per gallon) of vapor mastic and finish with mastic at 0.3 to 0.4 square meter per liter (12 to 15 square feet per gallon) over the entire fabric surface.

d. Chilled water pumps: Insulate with removable and replaceable 1 mm thick (20 gage) aluminum or galvanized steel covers lined with insulation. Seal closure joints/flanges of covers with gasket material. Fill void space in enclosure with flexible mineral fiber insulation.

3. Exposed, unlined ductwork and equipment in unfinished areas, mechanical and electrical equipment rooms and attics, and duct work exposed to outdoor weather:
   a. 40 mm (1-1/2 inch) thick insulation faced with ASJ (white all service jacket): Supply air duct and after filter housing.
   b. 40 mm (1-1/2 inch) thick insulation faced with ASJ: Return air duct, mixed air plenums and prefilter housing.
   c. Outside air intake ducts: 25 mm (one inch) thick insulation faced with ASJ.
   d. Exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a reinforcing membrane and two coats of vapor barrier mastic or multi-layer vapor barrier with a maximum water vapor permeability of 0.001 perms.
4. Supply air duct in the warehouse and in the laundry: 25 mm (one inch) thick insulation faced with ASJ.
5. Cold equipment: 40 mm (1-1/2inch) thick insulation faced with ASJ.
   a. Chilled water pumps, water filter, chemical feeder pot or tank.
   b. Pneumatic, cold storage water and surge tanks.
6. Hot equipment: 40 mm (1-1/2 inch) thick insulation faced with ASJ.

   a. Convertors, air separators, steam condensate pump receivers.
   b. Reheat coil casing and separation chambers on steam humidifiers located above ceilings.

c. Domestic water heaters and hot water storage tanks (not factory insulated).

d. Booster water heaters for dietetics dish and pot washers and for washdown grease-extracting hoods.

7. Laundry: Hot exhaust ducts from dryers and from ironers, where duct is exposed in the laundry.

B. Flexible Mineral Fiber Blanket:

1. Adhere insulation to metal with 75 mm (3 inch) wide strips of insulation bonding adhesive at 200 mm (8 inches) on center all around duct. Additionally secure insulation to bottom of ducts exceeding 600 mm (24 inches) in width with pins welded or adhered on 450 mm (18 inch) centers. Secure washers on pins. Butt insulation edges and seal joints with laps and butt strips. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations with mastic. Sagging duct insulation will not be acceptable. Install firestop duct insulation where required.
2. Supply air ductwork to be insulated includes main and branch ducts from AHU discharge to room supply outlets, and the bodies of ceiling outlets to prevent condensation. Insulate sound attenuator units, coil casings and damper frames. To prevent condensation insulate trapeze type supports and angle iron hangers for flat oval ducts that are in direct contact with metal duct.
3. Concealed supply air ductwork.
   a. Above ceilings at a roof level, in attics, and duct work exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with FSK.
   b. Above ceilings for other than roof level: 40 mm (1 ½ inch) thick insulation faced with FSK.
4. Concealed return air duct:
   a. Above ceilings at a roof level, unconditioned areas, and in chases with external wall or containing steam piping; 40 mm (1-1/2 inch) thick, insulation faced with FSK.
   b. Concealed return air ductwork in other locations need not be insulated.
5. Concealed outside air duct: 40 mm (1-1/2 inch) thick insulation faced with FSK.

6. Exhaust air branch duct from autopsy refrigerator to main duct: 40 mm (1-1/2 inch) thick insulation faced with FSK.

C. Molded Mineral Fiber Pipe and Tubing Covering:

1. Fit insulation to pipe or duct, aligning longitudinal joints. Seal longitudinal joint laps and circumferential butt strips by rubbing hard with a nylon sealing tool to assure a positive seal. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations on cold piping with a generous application of vapor barrier mastic. Provide inserts and install with metal insulation shields at outside pipe supports. Install freeze protection insulation over heating cable.
2. Contractor's options for fitting, flange and valve insulation:
   a. Insulating and finishing cement for sizes less than 100 mm (4 inches) operating at surface temperature of 16 degrees C (61 degrees F) or more.
   b. Factory premolded, one piece PVC covers with mineral fiber, (Form B), inserts. Provide two insert layers for pipe temperatures below 4 degrees C (40 degrees F), or above 121 degrees C (250 degrees F). Secure first layer of insulation with twine. Seal seam edges with vapor barrier mastic and secure with fitting tape.
   c. Factory molded, ASTM C547 or field mitered sections, joined with adhesive or wired in place. For hot piping finish with a smoothing coat of finishing cement. For cold fittings, 16 degrees C (60 degrees F) or less, vapor seal with a layer of glass fitting tape imbedded between two 2 mm (1/16 inch) coats of vapor barrier mastic.
   d. Fitting tape shall extend over the adjacent pipe insulation and overlap on itself at least 50 mm (2 inches).
3. Nominal thickness in millimeters and inches specified in the schedule at the end of this section.

D. Rigid Cellular Phenolic Foam:

1. Rigid closed cell phenolic insulation may be provided for piping, ductwork and equipment for temperatures up to 121 degrees C (250 degrees F).

2. Note the NFPA 90A burning characteristics requirements of 25/50 in paragraph 1.3.B
3. Provide secure attachment facilities such as welding pins.
4. Apply insulation with joints tightly drawn together
5. Apply adhesives, coverings, neatly finished at fittings, and valves.
6. Final installation shall be smooth, tight, neatly finished at all edges.
7. Minimum thickness in millimeters (inches) specified in the schedule at the end of this section.
8. Exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a multi-layer vapor barrier with a maximum water vapor permeance of 0.00 perms.
9. Condensation control insulation: Minimum 25 mm (1.0 inch) thick for all pipe sizes.
   a. HVAC: Cooling coil condensation piping to waste piping fixture or drain inlet. Omit insulation on plastic piping in mechanical rooms.

E. Cellular Glass Insulation:

1. Pipe and tubing, covering nominal thickness in millimeters and inches as specified in the schedule at the end of this section.
2. Underground Piping Other than or in lieu of that Specified in Section 23 21 13, HYDRONIC PIPING and Section 33 63 00, STEAM ENERGY DISTRIBUTION: Type II, factory jacketed with a 3 mm laminate jacketing consisting of 3000 mm x 3000 mm (10 ft x 10 ft) asphalt impregnated glass fabric, bituminous mastic and outside protective plastic film.
   a. 75 mm (3 inches) thick for hot water piping.
   b. As scheduled at the end of this section for chilled water piping.
   c. Underground piping: Apply insulation with joints tightly butted. Seal longitudinal self-sealing lap. Use field fabricated or factory made fittings. Seal butt joints and fitting with jacketing as recommended by the insulation manufacturer. Use 100 mm (4 inch) wide strips to seal butt joints.
   d. Provide expansion chambers for pipe loops, anchors and wall penetrations as recommended by the insulation manufacturer.
   e. Underground insulation shall be inspected and approved by the Contracting Officer’s Representative as follows:

1) Insulation in place before coating.

2) After coating.

f. Sand bed and backfill: Minimum 75 mm (3 inches) all around insulated pipe or tank, applied after coating has dried.

3. Cold equipment: 50 mm (2 inch) thick insulation faced with ASJ for chilled water pumps, water filters, chemical feeder pots or tanks, expansion tanks, air separators and air purgers.

4. Exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a reinforcing membrane and two coats of vapor barrier mastic or multi-layer vapor barrier with a water vapor permeability of 0.00 perms.

F. Flexible Elastomeric Cellular Thermal Insulation:

1. Apply insulation and fabricate fittings in accordance with the manufacturer's installation instructions and finish with two coats of weather resistant finish as recommended by the insulation manufacturer.

2. Pipe and tubing insulation:

a. Use proper size material. Do not stretch or strain insulation.

b. To avoid undue compression of insulation, provide cork stoppers or wood inserts at supports as recommended by the insulation manufacturer. Insulation shields are specified under Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

c. Where possible, slip insulation over the pipe or tubing prior to connection, and seal the butt joints with adhesive. Where the slip-on technique is not possible, slit the insulation and apply it to the pipe sealing the seam and joints with contact adhesive. Optional tape sealing, as recommended by the manufacturer, may be employed. Make changes from mineral fiber insulation in a straight run of pipe, not at a fitting. Seal joint with tape.

3. Apply sheet insulation to flat or large curved surfaces with 100 percent adhesive coverage. For fittings and large pipe, apply adhesive to seams only.

4. Pipe insulation: nominal thickness in millimeters (inches as specified in the schedule at the end of this section.

5. Minimum 20 mm (0.75 inch) thick insulation for pneumatic control lines for a minimum distance of 6 m (20 feet) from discharge side of the refrigerated dryer.
6. Use Class S (Sheet), 20 mm (3/4 inch) thick for the following:
   a. Chilled water pumps
   b. Bottom and sides of metal basins for winterized cooling towers (where basin water is heated).
   c. Chillers, insulate any cold chiller surfaces subject to condensation which has not been factory insulated.
   d. Piping inside refrigerators and freezers: Provide heat tape under insulation.
7. Exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a multi-layer vapor barrier with a water vapor permeance of 0.00 perms.

3.3 APPLICATION –BOILER PLANT, PIPE, VALVES, STRAINERS AND FITTINGS: (NOT USED)

3.4 APPLICATION–BOILER FLUE GAS SYSTEMS (NOT USED)

3.5 APPLICATION–BOILER DEAERATING FEEDWATER HEATER, TANKS (NOT USED)

3.6 APPLICATION ON HEATED OR TRACED OIL FACILITIES OUTSIDE OF BUILDING (NOT USED)

3.7 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.

B. Components provided under this section of the specification will be tested as part of a larger system. Refer to section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.8 PIPE INSULATION SCHEDULE

Provide insulation for piping systems as scheduled below:

Insulation Wall Thickness Millimeters (Inches)					
		Nominal Pipe Size Millimeters (Inches)			
Operating Temperature Range/Service	Insulation Material	Less than 25 (1)	25 – 32 (1 – 1¼)	38 – 75 (1½ – 3)	100 (4) and Above
	Insulation Wall Thickness Millimeters (Inches)				
100-121 degrees C (212-250 degrees F) (HPR, MPR, LPS, vent piping from PRV Safety Valves, Condensate receivers and flash tanks)	Mineral Fiber (Above ground piping only)	62 (2.5)	62 (2.5)	75 (3.0)	75 (3.0)
100-121 degrees C (212-250 degrees F) (HPR, MPR, LPS, vent piping from PRV Safety Valves, Condensate receivers and flash tanks)	Rigid Cellular Phenolic Foam	50 (2.0)	50 (2.0)	75 (3.0)	75 (3.0)
38-94 degrees C (100-200 degrees F) (LPR, PC, HWH, HWHR, GH and GHR)	Mineral Fiber (Above ground piping only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-99 degrees C (100-211 degrees F) (LPR, PC, HWH, HWHR, GH and GHR)	Rigid Cellular Phenolic Foam	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-94 degrees C (100-200 degrees F) (LPR, PC, HWH, HWHR, GH and GHR)	Flexible Elastomeric Cellular Thermal (Above ground piping only)	38 (1.5)	38 (1.5)	----	----
4-16 degrees C (40-60 degrees F) (CH, CHR, GC, GCR and RS for DX refrigeration)	Rigid Cellular Phenolic Foam	38 (1.5)	38 (1.5)	38 (1.5)	38 (1.5)
4-16 degrees C (40-60 degrees F) (CH and CHR within chiller room and	Cellular Glass Closed-Cell	50 (2.0)	50 (2.0)	75 (3.0)	75 (3.0)

pipe chase and underground)					
4-16 degrees C (40-60 degrees F) (CH, CHR, GC, GCR and RS for DX refrigeration)	Cellular Glass Closed-Cell	38 (1.5)	38 (1.5)	38 (1.5)	38 (1.5)
(40-60 degrees F) (CH, CHR, GC, GCR and RS for DX refrigeration)	Flexible Elastomeric Cellular Thermal (Above ground piping only)	38 (1.5)	38 (1.5)	38 (1.5)	38 (1.5)

- - - E N D - - -

SECTION 23 08 00
COMMISSIONING OF HVAC SYSTEMS

PART 1 – GENERAL

1.1 DESCRIPTION

A. The requirements of this Section apply to all sections of Division 23.

B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned is specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIRMENTS. A Commissioning Agent (CxA) appointed by the VA will manage the commissioning process.

1.2 RELATED WORK

A. Section 01 00 00 GENERAL REQUIREMENTS.

B. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

D. Section 23 05 41 NOISE AND VIBRATION CONTROL for HVAC PIPING AND EQUIPMENT.

E. Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC.

F. Section 23 09 23 DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

1.3 SUMMARY

A. This Section includes requirements for commissioning the HVAC systems of the related subsystems and equipment. This Section supplements the general requirements specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

B. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more details regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

1.4 DEFINITIONS

A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

1.5 COMMISSIONED SYSTEMS

A. Commissioning of a system or systems specified in Division 23 is part of the construction process. Documentation and testing of these systems, as well as training of the VA’s Operation and Maintenance

personnel in accordance with the requirements of Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and of Division 23, is required in cooperation with the VA and the Commissioning Agent.

B. The Facility HVAC systems commissioning will include the systems listed in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

1.6 SUBMITTALS

A. The commissioning process requires review of selected Submittals that pertain to the systems to be commissioned. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.

B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

1.7 APPLICABLE PUBLICATIONS

A. The following publications form a part of this specification to the extent indicated by the reference thereto. In text the publications are referenced to by the acronym of the organization.

B. Department of Veterans Affairs (VA):
PG 18-10 2007.....Mission Critical Facilities - DRAFT
PG 18-10 2007.....Life-Safety Protected Facilities - DRAFT

C. American Society of Heating, Refrigerating and Air Conditioning Engineers, Inc. (ASHRAE):
HANDBOOK 2019.....HVAC Applications ASHRAE Handbook, Chapter 39, Testing, Adjusting, and Balancing, Chapter 44, HVAC Commissioning and Chapter 49, Sound and Vibration Control
HANDBOOK 2017.....HVAC Fundamentals ASHRAE Handbook, Chapter 8, Sound and Vibration

D. Associated Air Balance Council (AABC):
7th Edition 2016.....AABC National Standards for Total System Balance

E. National Environmental Balancing Bureau (NEBB):

9th Edition 2019.....Procedural Standards for Testing, Adjusting, Balancing of Environmental Systems

3rd Edition 2015 .....Procedural Standards for the Measurement of Sound and Vibration

2nd Edition 2019 ... Standard for Whole Building Technical Commissioning of New Construction

F. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):

0062006.....HVAC Duct Construction Standard - Metal and Flexible Duct

3rd Edition 2005 ... HVAC Systems Testing, Adjusting and Balancing

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 CONSTRUCTION INSPECTIONS

A. Commissioning of HVAC systems will require inspection of individual elements of the HVAC systems construction throughout the construction period. The Contractor shall coordinate with the Commissioning Agent in accordance with Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and the Commissioning plan to schedule HVAC systems inspections as required to support the Commissioning Process.

3.2 PRE-FUNCTIONAL CHECKLISTS

A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. Refer to Sections 23 05 41 NOISE AND VIBRATION CONTROL for HVAC PIPING AND EQUIPMENT, Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC and Section 23 09 23 DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC requirements. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of

completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

3.3 CONTRACTORS TESTS

A. Contractor tests as required by other sections of Division 23 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. All testing shall be incorporated into the project schedule. Contractor shall provide no less than 7 calendar days' notice of testing. The Commissioning Agent will witness selected Contractor tests at the sole discretion of the Commissioning Agent. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

3.4 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:

A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the COR. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional requirements.

3.5 TRAINING OF VA PERSONNEL

A. Training of the VA operation and maintenance personnel is required in cooperation with the COR and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and

maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. Contractor shall submit training agendas and trainer resumes in accordance with the requirements of Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The instruction shall be scheduled in coordination with the VA COR after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 23 Sections for additional Contractor training requirements.

----- END -----

SECTION 23 09 23
DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC

PART 1 - GENERAL

1.1 DESCRIPTION

A. General Contractor shall provide direct-digital control system(s) as indicated on the project documents, point list, interoperability tables, drawings and as described in these specifications. Include a complete and working direct-digital control system. Include all engineering, programming, configuration/setup hardware and software, controls and installation materials, installation labor, commissioning and startup, training, final project documentation and warranty..

1. The direct-digital control system(s) shall consist of high-speed, peer-to-peer network of DDC controllers, a control system server, all configuration and setup software and hardware devices, and an Engineering Control Center. Provide a remote user using a standard HTML 5 web browser to access the control system graphics and change adjustable setpoints with the proper password.
2. All new building controllers shall be native BACnet. All new BACnet workstations, controllers, devices and components shall be listed by BACnet Testing Laboratories. All new BACnet workstations, controllers, devices and components shall be accessible using a HTML5 Web browser interface. Browsers shall not require the use of an extension or add on software in order to access aforementioned workstations, controllers, devices, and components.

   a. If used, gateways shall be BTL listed.

   b. If used, gateways shall provide all object properties and read/write services shown on VA-approved interoperability schedules.

3. The work administered by this Section of the technical specifications shall include all labor, materials, special tools, equipment, enclosures, power supplies, software, software licenses, Project specific software configurations and database entries, interfaces, wiring, tubing, installation, labeling, engineering,

calibration, documentation, submittals, testing, verification, training services, permits and licenses, transportation, shipping, handling, administration, supervision, management, insurance, Warranty, specified services and any other items required for a complete and fully functional Controls System.

4. The control systems shall be designed such that each mechanical system shall operate under stand-alone mode. The A/E shall designate what each "mechanical systems" is composed of. The contractor administered by this Section of the technical specifications shall provide controllers for each mechanical system. In the event of a network communication failure, or the loss of any other controller, the control system shall continue to operate independently. Failure of the ECC shall have no effect on the field controllers, including those involved with global strategies.

5. The control system shall accommodate 1 Engineering Control Center and the control system shall accommodate 10 web-based Users simultaneously, and the access to the system should be limited only by operator password.

B. Some products are furnished but not installed by the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the installation of the products. These products include but are not limited to the following:

1. Control valves.
2. Flow switches.
3. Flow meters.
4. Sensor wells and sockets in piping.
5. Terminal unit controllers.

C. Some products are installed but not furnished by the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the procurement of the products. These products include but are not limited to the following:

1. Factory-furnished accessory thermostats and sensors furnished with unitary equipment.

D. Some products are not provided by, but are nevertheless integrated with the work executed by, the contractor administered by this Section of the technical specifications. These products include but are not limited to the following:

1. Fire alarm systems. If zoned fire alarm is required by the project-specific requirements, this interface shall require multiple relays, which are provided and installed by the fire alarm system contractor, to be monitored.
2. Terminal units' velocity sensors
3. Variable frequency drives. These controls, if not native BACnet, will require a BACnet Gateway.
4. The following systems have limited control (as individually noted below) from the ECC:
   a. Constant temperature rooms: temperature out of acceptable range and status alarms.
   b. Building lighting systems: on/off and scene control.

E. Responsibility Table:

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
Control system low voltage and communication wiring	23 09 23	23 09 23	23 09 23	N/A
Terminal units	23	23	N/A	26
Controllers for terminal units	23 09 23	23	23 09 23	16
LAN conduits and raceway	23 09 23	23 09 23	N/A	N/A
Automatic dampers (not furnished with equipment)	23 09 23	23	N/A	N/A
Automatic damper actuators	23 09 23	23 09 23	23 09 23	23 09 23
Manual valves	23	23	N/A	N/A
Automatic valves	23 09 23	23	23 09 23	23 09 23
Pipe insertion devices and taps, flow and pressure stations.	23	23	N/A	N/A
Thermowells	23 09 23	23	N/A	N/A

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
Current Switches	23 09 23	23 09 23	23 09 23	N/A
Control Relays	23 09 23	23 09 23	23 09 23	N/A
Power distribution system monitoring interfaces	23 09 23	23 09 23	23 09 23	26
Interface with chiller/boiler controls	23 09 23	23 09 23	23 09 23	26
Chiller/boiler controls interface with control system	23	23	23 09 23	26
All control system nodes, equipment, housings, enclosures and panels.	23 09 23	23 09 23	23 09 23	26
Smoke detectors	28 31 00	28 31 00	28 31 00	28 31 00
Fire/Smoke Dampers	23	23	28 31 00	28 31 00
Smoke Dampers	23	23	28 31 00	28 31 00
Fire Dampers	23	23	N/A	N/A
Chiller/starter interlock wiring	N/A	N/A	26	26
Chiller Flow Switches	23	23	23	N/A
Boiler interlock wiring	23	23	23	26
Boiler Flow Switches	23	23	23	N/A
Water treatment system	23	23	23	26
VFDs	23	26	23 09 23	26
Refrigerant monitors	23	23 09 23	23 09 23	26
Laboratory Environmental Controls	23 09 23	23 09 23	23 09 23	26
Fume hood controls	23 09 23	23 09 23	23 09 23	26
Medical gas panels	23	23	26	26
Laboratory Air Valves	23	23	23 09 23	N/A
Computer Room A/C Unit field-mounted controls	23	23	26	26
Control system interface with CRU A/C controls	23 09 23	23 09 23	23 09 23	26
CRU A/C unit controls interface with control system	23	23 09 23	23 09 23	26

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
Fire Alarm shutdown relay interlock wiring	28	28	28	26
Control system monitoring of fire alarm smoke control relay	28	28	23 09 23	28
Fire-fighter's smoke control station (FSCS	28	28	28	28
Fan Coil Unit controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Unit Heater controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Packaged RTU space-mounted controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Packaged RTU unit-mounted controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Cooling Tower Vibration Switches	23	23	23 09 23	23 09 23
Cooling Tower Level Control Devices	23	23	23 09 23	23 09 23
Cooling Tower makeup water control devices	23	23	23 09 23	23 09 23
Starters, HOA switches	23	23	N/A	26
Steam Trap Monitoring in Boiler Plant	23 21 11	23 21 11	26	26
Steam Trap Monitoring not in Boiler Plant	23 22 13	23 22 13	26	26

F. This facility's existing direct-digital control (DDC) system is manufactured by Johnson Controls, and its ECC is located at Boiler Plant. The existing system's top-end communications is via BacNET. The contractor administered by this Section of the technical specifications shall observe the capabilities, communication network, services, spare capacity of the existing control system and its ECC prior to beginning work.

1. Provide a new BACnet ECC, communications network, and controllers. Provide a programmable internetworking gateway allowing for real-time communication between the existing direct-digital control system and the new BACnet control system. Real-time communication shall provide all object properties and read/write services shown on VA-approved interoperability schedules. The contractor administered by this Section of the technical specifications shall provide all necessary investigation and site-specific programming to execute the interoperability schedules.

    a. The combined system shall operate and function as one complete system including one database of control point objects and global control logic capabilities. Facility operators shall have complete operations and control capability over all systems, new and existing including; monitoring, trending, graphing, scheduling, alarm management, global point sharing, global strategy deployment, graphical operations interface and custom reporting as specified.

G. This campus has standardized on an existing standard ASHRAE Standard 135, BACnet/IP Control System supported by a preselected controls service company. This entity is referred to as the "Control System Integrator" in this Section of the technical specifications. The Control system integrator is responsible for ECC system graphics and expansion. It also prescribes control system-specific commissioning/ verification procedures to the contractor administered by this Section of the technical specification. It lastly provides limited assistance to the contractor administered by this Section of the technical specification in its commissioning/verification work.

1. The General Contractor of this project shall directly hire the Control System Integrator in a contract separate from the contract procuring the controls contractor administered by this Section of the technical specifications.
2. The contractor administered by this Section of the technical specifications shall coordinate all work with the Control System Integrator. The contractor administered by this Section of the technical specifications shall integrate the ASHRAE Standard 135,

BACnet/IP control network(s) with the Control System Integrator's B-AWS through an Ethernet connection provided by either the Control System Integrator or VA.

3. The contractor administered by this Section of the technical specifications shall provide a peer-to-peer networked, stand-alone, distributed control system. This direct digital control (DDC) system at least shall include one portable operator terminal - laptop, one digital display unit, microprocessor-based controllers, instrumentation, end control devices, wiring, piping, software, and related systems. This contractor is responsible for all device mounting and wiring.
4. Responsibility Table:

Item/Task	Section 23 09 23 contactor	Control system integrator	VA
ECC expansion		X	
ECC programming		X	
Devices, controllers, control panels and equipment	X		
Point addressing: all hardware and software points including setpoint, calculated point, data point(analog/ binary), and reset schedule point	X		
Point mapping		X	
Network Programming	X		
ECC Graphics		X	
Controller programming and sequences	X		
Integrity of LAN communications			X
Electrical wiring	X		
Operator system training		X	
LAN connections to devices			X
LAN connections to ECC			X
IP addresses			X
Overall system verification (Cx)		X	
Controller and system verification	X		

H. Unitary standalone systems including Unit Heaters, Cabinet Unit Heaters, Fan Coil Units, Base Board Heaters, thermal comfort ventilation fans, and similar units for control of room environment conditions may be equipped with integral controls furnished and installed by the equipment manufacturer or field mounted. Refer to equipment specifications and as indicated in project documents. Application of standalone unitary controls is limited to at least those systems wherein remote monitoring, alarm and startup are not necessary. Examples of such systems include:

1. Light-switch-operated toilet exhaust
2. Vestibule heater
3. Exterior stair heater
4. Attic heating and ventilation
5. Mechanical or electrical room heating and ventilation.

I. The direct-digital control system shall start and stop equipment, move (position) damper actuators and valve actuators, and vary speed of equipment to execute the mission of the control system. Use electricity as the motive force for all damper and valve actuators, unless use of pneumatics as motive force is specifically granted in writing by the VA.

1.2 RELATED WORK

A. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
B. Section 13 21 29, Constant Temperature Rooms.
C. Section 23 21 13, Hydronic Piping.
D. Section 23 22 13, Steam and Condensate Heating Piping.
E. Section 23 31 00, HVAC Ducts and Casings.
F. Section 23 36 00, Air Terminal Units.
G. Section 23 73 00, Indoor Central-Station Air-Handling Units.
H. Section 26 05 11, Requirements for Electrical Installations.
I. Section 26 05 21, Low-Voltage Electrical Power Conductors and Cables (600 Volts and Below).
J. Section 26 05 26, Grounding and Bonding for Electrical Systems.
K. Section 26 05 33, Raceway and Boxes for Electrical Systems.
L. Section 26 09 23, Lighting Controls.
M. Section 26 22 21, Specialty Transformers.
N. Section 26 27 26, Wiring Devices.
O. Section 26 29 11, Motor Starters.
P. Section 26 32 13, Engine Generators.

Q. Section 27 15 00, Communications Horizontal Cabling

R. Section 28 31 00, Fire Detection and Alarm.

1.3 DEFINITION

A. Algorithm: A logical procedure for solving a recurrent mathematical problem; A prescribed set of well-defined rules or processes for the solution of a problem in a finite number of steps.

B. Analog: A continuously varying signal value (e.g., temperature, current, velocity etc

C. BACnet: A Data Communication Protocol for Building Automation and Control Networks –as defined by ANSI/ASHRAE Standard 135. This communications protocol allows diverse building automation devices to communicate data and services over a network.

D. BACnet/IP: Annex J of Standard 135. It defines and allows for using a reserved UDP socket to transmit BACnet messages over IP networks. A BACnet/IP network is a collection of one or more IP sub-networks that share the same BACnet network number.

E. BACnet Internetwork: Two or more BACnet networks connected with routers. The two networks may use different LAN technologies.

F. BACnet Network: One or more BACnet segments that have the same network address and are interconnected by bridges at the physical and data link layers.

G. BACnet Segment: One or more physical segments of BACnet devices on a BACnet network, connected at the physical layer by repeaters.

H. BACnet Broadcast Management Device (BBMD): A communications device which broadcasts BACnet messages to all BACnet/IP devices and other BBMDs connected to the same BACnet/IP network.

I. BACnet Interoperability Building Blocks (BIBBs): BACnet Interoperability Building Blocks (BIBBs) are collections of one or more BACnet services. These are prescribed in terms of an "A" and a "B" device. Both of these devices are nodes on a BACnet internetwork.

J. BACnet Testing Laboratories (BTL). The organization responsible for testing products for compliance with the BACnet standard, operated under the direction of BACnet International.

K. Baud: It is a signal change in a communication link. One signal change can represent one or more bits of information depending on type of transmission scheme. Simple peripheral communication is normally one bit per

Baud. (e.g., Baud rate = 78,000 Baud/sec is 78,000 bits/sec, if one signal change = 1 bit).

L. Binary: A two-state system where a high signal level represents an "ON" condition and an "OFF" condition is represented by a low signal level.

M. BMP or bmp: Suffix, computerized image file, used after the period in a DOS-based computer file to show that the file is an image stored as a series of pixels.

N. Bus Topology: A network topology that physically interconnects workstations and network devices in parallel on a network segment.

O. Control Unit (CU): Generic term for any controlling unit, stand-alone, microprocessor based, digital controller residing on secondary LAN or Primary LAN, used for local controls or global controls

P. Deadband: A temperature range over which no heating or cooling is supplied, i.e., 22-25 degrees C (72-78 degrees F), as opposed to a single point change over or overlap).

Q. Device: a control system component that contains a BACnet Device Object and uses BACnet to communicate with other devices.

R. Device Object: Every BACnet device requires one Device Object, whose properties represent the network visible properties of that device. Every Device Object requires a unique Object Identifier number on the BACnet internetwork. This number is often referred to as the device instance.

S. Device Profile: A specific group of services describing BACnet capabilities of a device, as defined in ASHRAE Standard 135, Annex L. Standard device profiles include BACnet Operator Workstations (B-OWS), BACnet Building Controllers (B-BC), BACnet Advanced Application Controllers (B-AAC), BACnet Application Specific Controllers (B-ASC), BACnet Smart Actuator (B-SA), and BACnet Smart Sensor (B-SS). Each device used in new construction is required to have a PICS statement listing which service and BIBBs are supported by the device.

T. Diagnostic Program: A software test program, which is used to detect and report system or peripheral malfunctions and failures. Generally, this system is performed at the initial startup of the system.

U. Direct Digital Control (DDC): Microprocessor based control including Analog/Digital conversion and program logic. A control loop or subsystem in which digital and analog information is received and processed by a microprocessor, and digital control signals are generated based on control

algorithms and transmitted to field devices in order to achieve a set of predefined conditions.

V. Distributed Control System: A system in which the processing of system data is decentralized and control decisions can and are made at the subsystem level. System operational programs and information are provided to the remote subsystems and status is reported back to the Engineering Control Center. Upon the loss of communication with the Engineering Control center, the subsystems shall be capable of operating in a stand-alone mode using the last best available data.

W. Download: The electronic transfer of programs and data files from a central computer or operation workstation with secondary memory devices to remote computers in a network (distributed) system.

X. DXF: An AutoCAD 2-D graphics file format. Many CAD systems import and export the DXF format for graphics interchange.

Y. Electrical Control: A control circuit that operates on line or low voltage and uses a mechanical means, such as a temperature sensitive bimetal or bellows, to perform control functions, such as actuating a switch or positioning a potentiometer.

Z. Electronic Control: A control circuit that operates on low voltage and uses a solid-state components to amplify input signals and perform control functions, such as operating a relay or providing an output signal to position an actuator.

AA. Engineering Control Center (ECC): The centralized control point for the intelligent control network. The ECC comprises of personal computer and connected devices to form a single workstation.

BB. Ethernet: A trademark for a system for exchanging messages between computers on a local area network using coaxial, fiber optic, or twisted-pair cables.

CC. Firmware: Firmware is software programmed into read only memory (ROM) chips. Software may not be changed without physically altering the chip.

DD. Gateway: Communication hardware connecting two or more different protocols. It translates one protocol into equivalent concepts for the other protocol. In BACnet applications, a gateway has BACnet on one side and non-BACnet (usually proprietary) protocols on the other side.

EE. GIF: Abbreviation of Graphic interchange format.

FF. Graphic Program (GP): Program used to produce images of air handler systems, fans, chillers, pumps, and building spaces. These images can be animated and/or color-coded to indicate operation of the equipment.

GG. Graphic Sequence of Operation: It is a graphical representation of the sequence of operation, showing all inputs and output logical blocks.

HH. I/O Unit: The section of a digital control system through which information is received and transmitted. I/O refers to analog input (AI, digital input (DI), analog output (AO) and digital output (DO). Analog signals are continuous and represent temperature, pressure, flow rate etc., whereas digital signals convert electronic signals to digital pulses (values), represent motor status, filter status, on-off equipment etc.

II. I/P: a method for conveying and routing packets of information over LAN paths. User Datagram Protocol (UDP) conveys information to “sockets” without confirmation of receipt. Transmission Control Protocol (TCP) establishes "sessions", which have end-to-end confirmation and guaranteed sequence of delivery.

JJ. JPEG: A standardized image compression mechanism stands for Joint Photographic Experts Group, the original name of the committee that wrote the standard.

KK. Local Area Network (LAN): A communication bus that interconnects operator workstation and digital controllers for peer-to-peer communications, sharing resources and exchanging information.

LL. Network Repeater: A device that receives data packet from one network and rebroadcasts to another network. No routing information is added to the protocol.

MM. MS/TP: Master-slave/token-passing (ISO/IEC 8802, Part 3). It uses twisted-pair wiring for relatively low speed and low cost communication.

NN. Native BACnet Device: A device that uses BACnet as its primary method of communication with other BACnet devices without intermediary gateways. A system that uses native BACnet devices at all levels is a native BACnet system.

OO. Network Number: A site-specific number assigned to each network segment to identify for routing. This network number must be unique throughout the BACnet internetwork.

PP. Object: The concept of organizing BACnet information into standard components with various associated properties. Examples include analog input objects and binary output objects.

QQ. Object Identifier: An object property used to identify the object, including object type and instance. Object Identifiers must be unique within a device.

RR. Object Properties: Attributes of an object. Examples include present value and high limit properties of an analog input object. Properties are defined in ASHRAE 135; some are optional and some are required. Objects are controlled by reading from and writing to object properties.

SS. Operating system (OS): Software, which controls the execution of computer application programs.

TT. PCX: File type for an image file. When photographs are scanned onto a personal computer they can be saved as PCX files and viewed or changed by a special application program as Photo Shop.

UU. Peripheral: Different components that make the control system function as one unit. Peripherals include monitor, printer, and I/O unit.

VV. Peer-to-Peer: A networking architecture that treats all network stations as equal partners- any device can initiate and respond to communication with other devices.

WW. PICS: Protocol Implementation Conformance Statement, describing the BACnet capabilities of a device. All BACnet devices have published PICS.

XX. PID: Proportional, integral, and derivative control, used to control modulating equipment to maintain a setpoint.

YY. Repeater: A network component that connects two or more physical segments at the physical layer.

ZZ. Router: a component that joins together two or more networks using different LAN technologies. Examples include joining a BACnet Ethernet LAN to a BACnet MS/TP LAN.

AAA. Sensors: devices measuring state points or flows, which are then transmitted back to the DDC system.

BBB. Thermostats : devices measuring temperatures, which are used in control of standalone or unitary systems and equipment not attached to the DDC system.

1.4 QUALITY ASSURANCE

A. Criteria:

1. Single Source Responsibility of subcontractor: Either the DDC Contractor or the System Integrator shall obtain hardware and software supplied under this Section and delegate the responsibility to a single source controls installation subcontractor. The Integration subcontractor shall be responsible for the complete design, installation, integration, and commissioning of the system. The controls subcontractor shall be in the business of design, installation and service of such building automation control systems similar in size and complexity.
2. Equipment and Materials: Equipment and materials shall be cataloged products of manufacturers regularly engaged in production and installation of HVAC control systems. Products shall be manufacturer's latest standard design and have been tested and proven in actual use.
3. The controls subcontractor shall provide a list of no less than five similar projects which have building control systems as specified in this Section. These projects must be on-line and functional such that the Department of Veterans Affairs (VA) representative could observe the control systems in full operation.
4. The controls subcontractor shall have an in-place facility within 50 miles with technical staff, spare parts inventory for the next five (5) years, and necessary test and diagnostic equipment to support the control systems.
5. The controls subcontractor shall have minimum of three years of experience in design and installation of building automation systems similar in performance to those specified in this Section. Provide evidence of experience by submitting resumes of the project manager, the local branch manager, project engineer, the application engineering staff, and the electronic technicians who would be involved with the supervision, the engineering, and the installation of the control systems. Training and experience of these personnel shall not be less than three years. Failure to disclose this information will be a ground for disqualification of the supplier.
6. Provide a competent and experienced Project Manager employed by the Controls Contractor. The Project Manager shall be supported as necessary by other Contractor employees in order to provide

professional engineering, technical and management service for the work. The Project Manager shall attend scheduled Project Meetings as required and shall be empowered to make technical, scheduling and related decisions on behalf of the Controls Contractor.

B. Codes and Standards:

1. All work shall conform to the applicable Codes and Standards.
2. Electronic equipment shall conform to the requirements of FCC Regulation, Part 15, Governing Radio Frequency Electromagnetic Interference, and be so labeled.

1.5 PERFORMANCE

A. The system shall conform to the following:

1. Graphic Display: The system shall display up to four (4) graphics on a single screen with a minimum of twenty (20) dynamic points per graphic. All current data shall be displayed within ten (10) seconds of the request.
2. Graphic Refresh: The system shall update all dynamic points with current data within eight (8) seconds. Data refresh shall be automatic, without operator intervention.
3. Object Command: The maximum time between the command of a binary object by the operator and the reaction by the device shall be two(2) seconds. Analog objects shall start to adjust within two (2) seconds.
4. Object Scan: All changes of state and change of analog values shall be transmitted over the high-speed network such that any data used or displayed at a controller or work-station will be current, within the prior six (6) seconds.
5. Alarm Response Time: The maximum time from when an object goes into alarm to when it is annunciated at the workstation shall not exceed (10) seconds.
6. Program Execution Frequency: Custom and standard applications shall be capable of running as often as once every (5) seconds. The Contractor shall be responsible for selecting execution times consistent with the mechanical process under control.
7. Multiple Alarm Annunciations: All workstations on the network shall receive alarms within five (5) seconds of each other.

8. Performance: Programmable Controllers shall be able to execute DDC PID control loops at a selectable frequency from at least once every one (1) second. The controller shall scan and update the process value and output generated by this calculation at this same frequency.

9. Reporting Accuracy: Listed below are minimum acceptable reporting end-to-end accuracies for all values reported by the specified system:

Measured Variable	Reported Accuracy
Space temperature	±0.5 degrees C (±1 degrees F)
Ducted air temperature	±0.5 degrees C [±1 degrees F]
Outdoor air temperature	±1.0 degrees C [±2 degrees F]
Dew Point	±1.5 degrees C [±3 degrees F]
Water temperature	±0.5 degrees C [±1 degrees F]
Relative humidity	±2 percent RH
Water flow	±1 percent of reading
Air flow (terminal)	±10 percent of reading
Air flow (measuring stations)	±5 percent of reading
Carbon Monoxide (CO)	±5 percent of reading
Carbon Dioxide (CO_2)	±50 ppm
Air pressure (ducts)	±25 Pa [±0.1 inch wg]
Air pressure (space)	±0.3 Pa [±0.001 inch wg]
Water pressure	±2 percent of full scale *Note 1
Electrical Power	±0.5 percent of reading

Note 1: for both absolute and differential pressure

10. Control stability and accuracy: Control sequences shall maintain measured variable at setpoint within the following tolerances:

Controlled Variable	Control Accuracy	Range of Medium
Air Pressure	±50 Pa (±0.2 inch wg)	0-1.5 kPa (0-6 inch wg)

Controlled Variable	Control Accuracy	Range of Medium
Air Pressure	±3 Pa (±0.01 inch wg)	-25 to 25 Pa (-0.1 to 0.1 inch wg)
Airflow	±10 percent of full scale	
Space Temperature	±1.0°C (±2.0 degrees F)	
Duct Temperature	±1.5°C (±3 degrees F)	
Humidity	±5 percent RH	MRI, SPS, PHARMACY
Fluid Pressure	±10 kPa (±1.5 psig)	0-1 MPa (1-150 psig)
Fluid Pressure	±250 Pa (±1.0 inch wg)	0-12.5 kPa (0-50 inch wg) differential

11. Extent of direct digital control: control design shall allow for at least the points indicated on the points lists on the drawings.

1.6 WARRANTY

A. Labor and materials for control systems shall be warranted for a period as specified under Warranty in FAR clause 52.246-21.

B. Control system failures during the warranty period shall be adjusted, repaired, or replaced at no cost or reduction in service to the owner. The system includes all computer equipment, transmission equipment, and all sensors and control devices.

C. The on-line support service shall allow the Controls supplier to dial out over telephone lines to or connect via (through password-limited access) VPN through the internet to monitor and control the facility's building automation system. This remote connection to the facility shall be within two (2) hours of the time that the problem is reported. This coverage shall include normal business hours, after business hours, weekend and holidays. If the problem cannot be resolved with on-line support services, the Controls supplier shall dispatch the qualified personnel to the job site to resolve the problem within 8 hours after the problem is reported.

D. Controls subcontractor shall be responsible for temporary operations and maintenance of the control systems during the construction period until final commissioning, training of facility operators and acceptance of the project by VA.

1.7 SUBMITTALS

A. Submit shop drawings in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC", with applicable paragraph identification.

C. Manufacturer's Literature and Data Including:

1. A wiring diagram for each type of input device and output device including DDC controllers, modems, repeaters, etc. Diagram shall show how the device is wired and powered, showing typical connections at the digital controllers and each power supply, as well as the device itself. Show for all field connected devices, including but not limited to, control relays, motor starters, electric or electronic actuators, and temperature pressure, flow and humidity sensors and transmitters.
2. A diagram of each terminal strip, including digital controller terminal strips, terminal strip location, termination numbers and the associated point names.
3. Control dampers and control valves schedule, including the size and pressure drop.
4. Control air-supply components, and computations for sizing compressors, receivers and main air-piping, if pneumatic controls are furnished.
5. Catalog cut sheets of all equipment used. This includes, but is not limited to software (by manufacturer and by third parties), DDC controllers, panels, peripherals, airflow measuring stations and associated components, and auxiliary control devices such as sensors, actuators, and control dampers. When manufacturer's cut sheets apply to a product series rather than a specific product, the data specifically applicable to the project shall be highlighted. Each submitted piece of literature and drawings should clearly reference the specification and/or drawings that it supposed to represent.
6. Sequence of operations for each system and the associated control diagrams. Equipment and control labels shall correspond to those shown on the drawings.

7. Color prints of proposed graphics with a list of points for display.
8. Furnish a BACnet Protocol Implementation Conformance Statement (PICS) for each BACnet-compliant device.
9. Schematic wiring diagrams for all control, communication and power wiring. Provide a schematic drawing of the central system installation. Label all cables and ports with computer manufacturers' model numbers and functions. Show all interface wiring to the control system.
10. An instrumentation list for each controlled system. Each element of the controlled system shall be listed in table format. The table shall show element name, type of device, manufacturer, model number, and product data sheet number.
11. Riser diagrams of wiring between central control unit (CCU) and all control panels.
12. Plan drawings showing routing of LAN and locations of control panels, controllers, routers, gateways, ECC, and larger controlled devices.
13. Construction details for all installed conduit, cabling, raceway, cabinets, and similar. Construction details of all penetrations and their protection.
14. Quantities of submitted items may be reviewed but it is the responsibility of the contractor administered by this Section of the technical specifications to provide sufficient quantities for a complete and working system.

D. Product Certificates: Compliance with Article, QUALITY ASSURANCE.

E. Validation Test Plan: Along with manufacturer's literature, product certificates, wiring and functional diagrams, and sequence of operations, submit for review and approval a Validation Test Plan which is specific to the work of this project and which references the specific controls component nomenclatures found in the control contractor's wiring and functional diagrams and the specific sequences of controls for this project and which describes how the contractor will implement the controls system validation and demonstration as specified in paragraph 3.2 SYSTEM VALIDATION AND DEMONSTRATION found in this section.

F. Licenses: Provide licenses for all software residing on and used by the Controls Systems, ECC, and portable OWS and transfer these licenses to the Owner prior to completion.

G. As Built Control Drawings:

1. Furnish three (3) copies of as-built drawings for each control system. The documents shall be submitted for approval prior to final completion.
2. Furnish one (1) set of applicable control system prints for each mechanical system for wall mounting. The documents shall be submitted for approval prior to final completion.
3. Furnish one (1) CD-ROM in CAD DWG and/or .DXF format for the drawings noted in subparagraphs above.

H. Operation and Maintenance (O/M) Manuals):

1. Submit in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS.
2. Include the following documentation:
   a. General description and specifications for all components, including logging on/off, alarm handling, producing trend reports, overriding computer control, and changing set points and other variables.
   b. Detailed illustrations of all the control systems specified for ease of maintenance and repair/replacement procedures, and complete calibration procedures.
   c. One copy of the final version of all software provided including operating systems, programming language, operator workstation software, and graphics software.
   d. Complete troubleshooting procedures and guidelines for all systems.
   e. Complete operating instructions for all systems.
   f. Recommended preventive maintenance procedures for all system components including a schedule of tasks for inspection, cleaning and calibration. Provide a list of recommended spare parts needed to minimize downtime.
   g. Training Manuals: Submit the course outline and training material to the Owner for approval three (3) weeks prior to the training to VA facility personnel. These persons will be responsible for

maintaining and the operation of the control systems, including programming. The Owner reserves the right to modify any or all of the course outline and training material.

h. Licenses, guaranty, and other pertaining documents for all equipment and systems.

I. Submit Performance Report to COR prior to final inspection.

1.8 INSTRUCTIONS

A. Instructions to VA operations personnel: Perform in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS, and as noted below. Contractor shall also video tape instruction sessions noted below.

1. First Phase: Formal instructions to the VA facilities personnel for a total of 32 hours, given in multiple training sessions (each no longer than four hours in length), conducted sometime between the completed installation and prior to the performance test period of the control system, at a time mutually agreeable to the Contractor and the VA.

2. Second Phase: This phase of training shall comprise of on the job training during startup, checkout period, and performance test period. VA facilities personnel will work with the Contractor's installation and test personnel on a daily basis during startup and checkout period. During the performance test period, controls subcontractor will provide 32 hours of instructions, given in multiple training sessions (each no longer than four hours in length), to the VA facilities personnel.
3. The O/M Manuals shall contain approved submittals as outlined in Article 1.7, SUBMITTALS. The Controls subcontractor will review the manual contents with VA facilities personnel during second phase of training.
4. Training shall be given by direct employees of THE CONTROLS system subcontractor.

1.9 PROJECT CONDITIONS (ENVIRONMENTAL CONDITIONS OF OPERATION)

A. The ECC and peripheral devices and system support equipment shall be designed to operate in ambient condition of 20 to 35 degrees C (65 to 90 degrees F) at a relative humidity of 20 to 80 percent non-condensing.

B. The Controllers used outdoors shall be mounted in NEMA 4 waterproof enclosures, and shall be rated for operation at -40 to 65 degrees C (-40 to 150 degrees F).

C. All electronic equipment shall operate properly with power fluctuations of plus 10 percent to minus 15 percent of nominal supply voltage.

D. Sensors and controlling devices shall be designed to operate in the environment, which they are sensing or controlling.

1.10 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standards will govern.

B. American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE):

135-2020.....BACnet A Data Communication Protocol for Building Automation and Control Networks

147-2019.....Reducing the Release of Halogenated Refrigerants from Refrigerating and Air-Conditioning Equipment and Systems

C. Federal Communication Commission (FCC):

Rules and Regulations Title 47 Chapter 1-2014 Part 15: Radio Frequency Devices

D. Institute of Electrical and Electronic Engineers (IEEE):

802.3-2018.....Standard for Ethernet

F. National Fire Protection Association (NFPA):

70-2023.....National Electric Code

PART 2 - PRODUCTS

2.1 MATERIALS

A. Use new products that the manufacturer is currently manufacturing and that have been installed in a minimum of 25 installations. Spare parts shall be available for at least five years after completion of this contract.

2.2 CONTROLS SYSTEM ARCHITECTURE

A. General

1. The Controls Systems shall consist of multiple Nodes and associated equipment connected by industry standard digital and communication network arrangements.
2. The ECC, building controllers and principal communications network equipment shall be standard products of recognized major manufacturers available through normal PC and computer vendor channels – not "Clones" assembled by a third-party subcontractor.
3. The networks shall, at minimum, comprise, as necessary, the following:
   a. A fixed ECC and a portable operator's terminal.
   b. Network computer processing, data storage and BACnet-compliant communication equipment including Servers and digital data processors.
   c. BACnet-compliant routers, bridges, switches, hubs, modems, gateways, interfaces and similar communication equipment.
   d. Active processing BACnet-compliant building controllers connected to other BACnet-compliant controllers together with their power supplies and associated equipment.
   e. Addressable elements, sensors, transducers and end devices.
   f. Third-party equipment interfaces and gateways as described and required by the Contract Documents.
   g. Other components required for a complete and working Control Systems as specified.

B. The Specifications for the individual elements and component subsystems shall be minimum requirements and shall be augmented as necessary by the Contractor to achieve both compliance with all applicable codes, standards, and to meet all requirements of the Contract Documents.

C. Network Architecture

1. The Controls communication network shall utilize BACnet communications protocol operating over a standard Ethernet LAN and operate at a minimum speed of 100 Mb/sec.
2. The networks shall utilize only copper and optical fiber communication media as appropriate and shall comply with applicable codes, ordinances and regulations.
3. All necessary telephone lines, ISDN lines and internet Service Provider services and connections will be provided by the VA.

D. Third Party Interfaces:

1. The contractor administered by this Section of the technical specifications shall include necessary hardware, equipment, software and programming to allow data communications between the controls systems and building systems supplied by other trades.
2. Other manufacturers and contractors supplying other associated systems and equipment shall provide their necessary hardware, software and startup at their cost and shall cooperate fully with the contractor administered by this Section of the technical specifications in a timely manner and at their cost to ensure complete functional integration.

E. Servers:

1. Provide data storage server(s) to archive historical data including trends, alarm and event histories and transaction logs.
2. Equip these server(s) with the same software tool set that is located in the BACnet building controllers for system configuration and custom logic definition and color graphic configuration.
3. Access to all information on the data storage server(s) shall be through the same browser functionality used to access individual nodes. When logged onto a server the operator will be able to also interact with any other controller on the control system as required for the functional operation of the controls systems. The contractor administered by this Section of the technical specifications shall provide all necessary digital processor programmable data storage server(s).
4. These server(s) shall be utilized for controls systems application configuration, for archiving, reporting and trending of data, for

operator transaction archiving and reporting, for network information management, for alarm annunciation, for operator interface tasks, for controls application management and similar.

5. These server(s) shall utilize IT industry standard data base platforms which utilize a database declarative language designed for managing data in relational database management systems (RDBMS) such as SQL.

2.3 COMMUNICATION

A. Control products, communication media, connectors, repeaters, hubs, and routers shall comprise a BACnet internetwork. Controller and operator interface communication shall conform to ANSI/ASHRAE Standard 135, BACnet.

1. The Data link / physical layer protocol between the ECC and all B-BC's (for communication) acceptable to the VA throughout its facilities is Ethernet (ISO 8802-3) and BACnet/IP.

2. The MS/TP data link / physical layer protocol is prohibited to the VA in any new BACnet network or sub-network in its healthcare or lab facilities.

B. Each controller shall have a communication port for connection to an operator interface.

C. Internetwork operator interface and value passing shall be transparent to internetwork architecture.

1. An operator interface connected to a controller shall allow the operator to interface with each internetwork controller as if directly connected. Controller information such as data, status, reports, system software, and custom programs shall be viewable and editable from each internet controller.
2. Inputs, outputs, and control variables used to integrate control strategies across multiple controllers shall be readable by each controller on the internetwork. Program and test all cross-controller links required to execute specified control system operation. An authorized operator shall be able to edit cross-controller links by typing a standard object address.

D. System shall be expandable to at least twice the required input and output objects with additional controllers, associated devices, and wiring.

Expansion shall not require operator interface hardware additions or software revisions.

E. ECCs and Controllers with real-time clocks shall use the BACnet Time Synchronization service. The system shall automatically synchronize system clocks daily from an operator-designated device via the internetwork. The system shall automatically adjust for daylight savings and standard time as applicable.

2.4 ENGINEERING CONTROL CENTER (ECC)

A. The ECC shall reside on a high-speed network with controllers as shown on system drawings. The ECC and each standard browser connected to server shall be able to access all system information.

B. ECC and controllers shall communicate using BACnet protocol. ECC and control network backbone shall communicate using ISO 8802-3 (Ethernet) Data Link/Physical layer protocol and BACnet/IP addressing as specified in ASHRAE/ANSI 135, BACnet Annex J.

C. Hardware: ECC shall conform to the BACnet Advanced Workstation (B-AWS) Profile and shall be BTL-Listed as a B-AWS device.

1. ECC shall be based on commercially available server grade hardware. Computers based on desktop architectures shall not be permitted. ECC shall have remote management capabilities.
2. Processor(s):
   a. Processors shall be either Intel Xeon or AMD EPYC chips sets designed specifically for server use. Desktop processors will not be allowed.
   b. Minimum core count shall be 16 cores. Each Core shall be capable of executing 2 threads simultaneously.
   c. Minimum base clock speed shall be 3.0 GHz
3. Memory:
   a. Engineering Control Center shall be equipped with a minimum of 32G of DDR4 Error Correcting Code (ECC) memory. After installation of required 32G of RAM, the motherboard must still have a minimum of 2 DIMM slots open for expansion. Motherboard shall be capable of minimum of 64GB of ECC memory.
   b. Minimum speed shall be 2133MHz for memory
4. Storage:

a. ECC shall be equipped with a RAID capable drive controller capable of handling at least 8 internal, hot swappable drives.
b. All installed drives shall be "Enterprise Class" drives designed specifically for server use.
c. Minimum configuration shall consist of 6 drives in 2 separate RAID arrays:
    1) The operating system shall be stored on a RAID 1 array compromising of 2 drives with each drive having a minimum capacity of 1TB each.
    2) The B-AWS software and all its related databases shall be stored in RAID 5 array consisting of 4 drives with each drive have a minimum of 4TB capacity for a minimum storage capacity of 12TB's.
    3) An alternative configuration for the 2 RAID arrays described above is 8 drives arrayed in a RAID 10 configuration. In this case the OS RAID array would consist of 4 drives of 1TB minimum each, and the B-AWS RAID array consisting of 4 drives of 16TB minimum each. This configuration would provide faster write times and much quicker rebuild times in the event of a drive failure.
d. ECC will include an 16X DVD R/W drive

5. Case:
    a. Case shall have space for a minimum of 8 hot swap 3.5 inch hard drives and one internal optical drive
    b. Real-time clock:
        1) Accuracy: Plus or minus 1 minute per month.
        2) Time Keeping Format: 24-hour time format including seconds, minutes, hours, date, day, and month; automatic reset by software.
        3) Clock shall function for one year without power.
        4) Provide automatic time correction once every 24 hours by synchronizing clock with the Time Service Department of the U.S. Naval Observatory.
    c. Serial ports: Four USB ports and two RS-232-F serial ports for general use, with additional ports as required. Data transmission rates shall be selectable under program control.

d. Parallel port: Enhanced.
e. Sound card: For playback and recording of digital WAV sound files associated with audible warning and alarm functions.
f. Color monitor: PC compatible, not less than 22 inches, LCD type, with a minimum resolution of 1280 by 1024 pixels, non-interlaced, and a maximum dot pitch of 0.28 mm.
g. Keyboard: Minimum of 64 characters, standard ASCII character set based on ANSI INCITS 154.
h. Mouse: Standard, compatible with installed software.
i. Removable disk storage: Include the following, each with appropriate controller:
   1) Minimum 1 TB removable hard disk, maximum average access time of 10 ms.
j. Network interface card (NIC): integrated 10-100-1000 Base-TX Ethernet NIC with an RJ45 connector or a 100Base-FX Ethernet NIC with an SC/ST connector.

6. Cable modem: 42.88 MBit/s, DOCSIS 2.0 Certified, also backwards compatible with DOCSIS 1.1/1.0 standards. Provide Ethernet or USB connectivity.
7. Optical modem: full duplex link, for use on 10 GBase-R single-mode and multi-mode fiber with a XENPAK module.
8. Audible Alarm: Manufacturer's standard.
9. Printers:
   a. Provide a dedicated, minimum resolution 600 dpi, color laser printer, connected to the ECC through a USB interface.
      1) If a network printer is used instead of this dedicated printer, it shall have a 100Base-T interface with an RJ45 connection and shall have a firmware print spooler compatible with the Operating System print spooler.
      2) RAM: 512 MB, minimum.
      3) Printing Speed: Minimum twenty-six pages per minute (color); minimum 30 pages per minute (black/white).
      4) Paper Handling: Automatic sheet feeder with 250-sheet x 8.5 inch x 11 inch paper cassette and with automatic feed.
   b. Provide a dedicated black/white tractor-feed dot matrix printer for status/alarm message printing, minimum 10 characters per

inch, minimum 160 characters per second, connected to the ECC through a USB interface.

1) Paper: One box of 2000 sheets of 8-1/2 x 11 inch multi-fold type printer paper

10. RS-232 ASCII Interface

a. ASCII interface shall allow RS-232 connections to be made between a meter or circuit monitor operating as the host PC and any equipment that will accept RS-232 ASCII command strings, such as local display panels, dial-up modems, and alarm transmitters.

1) Pager System Interface: Alarms shall be able to activate a pager system with customized message for each input alarm.

b. Alarm System Interface: RS-232 output shall be capable of transmitting alarms from other monitoring and alarm systems to workstation software.

c. RS-232 output shall be capable of connection to a pager interface that can be used to call a paging system or service and send a signal to a portable pager. System shall allow an individual alphanumeric message per alarm input to be sent to paging system. This interface shall support both numeric and alphanumeric pagers.

d. Cables: provide Plenum-Type, RS-232 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, plastic insulation, and individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage; plastic jacket. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.

1) NFPA 70, Type CMP.

2) Flame Resistance: NFPA 262, Flame Test.

11. Self-contained uninterruptible power supply (UPS):

a. Size: Provide a minimum of six hours of operation of ECC equipment, including two hours of alarm printer operation.

b. Batteries: Sealed, valve regulated, recombinant, lead calcium.

c. Accessories:

1) Transient voltage suppression.

2) Input-harmonics reduction.

3) Rectifier/charger.

4) Battery disconnect device.
5) Static bypass transfer switch.
6) Internal maintenance bypass/isolation switch.
7) External maintenance bypass/isolation switch.
8) Output isolation transformer.
9) Remote UPS monitoring.
10) Battery monitoring.
11) Remote battery monitoring.

D. ECC Software:

1. Provide for automatic system database save and restore on the ECC's hard disk a copy of the current database of each Controller. This database shall be updated whenever a change is made in any system panel. In the event of a database loss in a building management panel, the ECC shall automatically restore the database for that panel. This capability may be disabled by the operator.
2. Provide for manual database save and restore. An operator with proper clearance shall be able to save the database from any system panel. The operator also shall be able to clear a panel database and manually initiate a download of a specified database to any panel in the system.
3. Provide a method of configuring the system. This shall allow for future system changes or additions by users with proper clearance.
4. Operating System. Furnish a concurrent multi-tasking operating system. The operating system also shall support the use of other common software applications. Acceptable operating systems are Windows Server 2019, Linux, and UNIX.
5. System Graphics. The operator workstation software shall be graphically oriented. The system shall allow display of up to 10 graphic screens at once for comparison and monitoring of system status. Provide a method for the operator to easily move between graphic displays and change the size and location of graphic displays on the screen. The system graphics shall be able to be modified while on-line. An operator with the proper password level shall be able to add, delete, or change dynamic objects on a graphic. Dynamic objects shall include analog and binary values, dynamic text, static text, and animation files. Graphics shall have

the ability to show animation by shifting image files based on the status of the object.

6. Custom Graphics. Custom graphic files shall be created with the use of a graphics generation package furnished with the system. The graphics generation package shall be a graphically based system that uses the mouse to create and modify graphics that are saved in industry standard formats such as PCX, TIFF, and GEM. The graphics generation package also shall provide the capability of capturing or converting graphics from other programs such as Designer or AutoCAD.
7. Graphics Library. Furnish a complete library of standard HVAC equipment graphics such as chillers, boilers, air handlers, terminals, fan coils, and unit ventilators. This library also shall include standard symbols for other equipment including fans, pumps, coils, valves, piping, dampers, and ductwork. The library shall be furnished in a file format compatible with the graphics generation package program.
8. The Controls Systems Operator Interfaces shall be user friendly, readily understood and shall make maximum use of colors, graphics, icons, embedded images, animation, text based information and data visualization techniques to enhance and simplify the use and understanding of the displays by authorized users at the ECC. The operating system shall be Windows 10 latest version, or better, and shall support the third party software.
9. Provide graphical user software, which shall minimize the use of keyboard through the use of the mouse and "point and click" approach to menu selection.
10. The software shall provide a multi-tasking type environment that will allow the user to run several applications simultaneously. The mouse or Alt-Tab keys shall be used to quickly select and switch between multiple applications. The operator shall be able automatically export data to and work in Microsoft Word, Excel, and other Windows based software programs, while concurrently on-line system alarms and monitoring information.
11. On-Line Help. Provide a context-sensitive, on-line help system to assist the operator in operating and editing the system. On-line help shall be available for all applications and shall provide the

relevant data for that particular screen. Additional help information shall be available through the use of hypertext.

12. User access shall be protected by a flexible and Owner re-definable software-based password access protection. Password protection shall be multi-level and partition able to accommodate the varied access requirements of the different user groups to which individual users may be assigned. Provide the means to define unique access privileges for each individual authorized user. Provide the means to on-line manage password access control under the control of a project specific Master Password. Provide an audit trail of all user activity on the Controls Systems including all actions and changes.
13. The system shall be completely field-programmable from the common operator's keyboard thus allowing hard disk storage of all data automatically. All programs for the CUs shall be able to be downloaded from the hard disk. The software shall provide the following functionality as a minimum:
    a. Point database editing, storage and downloading of controller databases.
    b. Scheduling and override of building environmental control systems.
    c. Collection and analysis of historical data.
    d. Alarm reporting, routing, messaging, and acknowledgement.
    e. Definition and construction of dynamic color graphic displays.
    f. Real-time graphical viewing and control of environment.
    g. Scheduling trend reports.
    h. Program editing.
    i. Operating activity log and system security.
    j. Transfer data to third party software.
14. Provide functionality such that using the least number of steps to initiate the desired event may perform any of the following simultaneously:
    a. Dynamic color graphics and graphic control.
    b. Alarm management.
    c. Event scheduling.
    d. Dynamic trend definition and presentation.
    e. Program and database editing.

f. Each operator shall be required to log on to the system with a username and password to view, edit or delete the data. System security shall be selectable for each operator, and the password shall be able to restrict the operator's access for viewing and changing the system programs. Each operator shall automatically be logged off the system if no keyboard or mouse activity is detected for a selected time.

15. Graphic Displays:
    a. The workstation shall allow the operator to access various system schematics and floor plans via a graphical penetration scheme, menu selection, or text-based commands. Graphic software shall permit the importing of AutoCAD or scanned pictures in the industry standard format (such as PCX, BMP, GIF, and JPEG) for use in the system.
    b. System Graphics shall be project specific and schematically correct for each system. (i.e.: coils, fans, dampers located per equipment supplied with project.) Standard system graphics that do not match equipment or system configurations are prohibited. Operator shall have capability to manually operate the entire system from each graphic screen at the ECC. Each system graphic shall include a button/tab to a display of the applicable sequence of operation.
    c. Dynamic temperature values, humidity values, flow rates, and status indication shall be shown in their locations and shall automatically update to represent current conditions without operator intervention and without pre-defined screen refresh values.
    d. Color shall be used to indicate status and change in status of the equipment. The state colors shall be user definable.
    e. A clipart library of HVAC equipment, such as chillers, boilers, air handling units, fans, terminal units, pumps, coils, standard ductwork, piping, valves and laboratory symbols shall be provided in the system. The operator shall have the ability to add custom symbols to the clipart library.
    f. A dynamic display of the site-specific architecture showing status of the controllers, the ECC and network shall be provided.

g. The windowing environment of the workstation shall allow the user to simultaneously view several applications at a time to analyze total building operation or to allow the display of graphic associated with an alarm to be viewed without interrupting work in progress. The graphic system software shall also have the capability to split screen, half portion of the screen with graphical representation and the other half with sequence of operation of the same HVAC system.

16. Trend reports shall be generated on demand or pre-defined schedule and directed to monitor display, printers or disk. As a minimum, the system shall allow the operator to easily obtain the following types of reports:
    a. A general list of all selected points in the network.
    b. List of all points in the alarm.
    c. List of all points in the override status.
    d. List of all disabled points.
    e. List of all points currently locked out.
    f. List of user accounts and password access levels.
    g. List of weekly schedules.
    h. List of holiday programming.
    i. List of limits and dead bands.
    j. Custom reports.
    k. System diagnostic reports, including, list of digital controllers on the network.
    l. List of programs.
17. ASHRAE Standard 147 Report: Provide a daily report that shows the operating condition of each chiller as recommended by ASHRAE Standard 147. At a minimum, this report shall include:
    a. Chilled water (or other secondary coolant) inlet and outlet temperature
    b. Chilled water (or other secondary coolant) flow
    c. Chilled water (or other secondary coolant) inlet and outlet pressures
    d. Evaporator refrigerant pressure and temperature
    e. Condenser refrigerant pressure and liquid temperature
    f. Condenser water inlet and outlet temperatures

g. Condenser water flow
h. Refrigerant levels
i. Oil pressure and temperature
j. Oil level
k. Compressor refrigerant discharge temperature
l. Compressor refrigerant suction temperature
m. Addition of refrigerant
n. Addition of oil
o. Vibration levels or observation that vibration is not excessive
p. Motor amperes per phase
q. Motor volts per phase
r. PPM refrigerant monitor level
s. Purge exhaust time or discharge count
t. Ambient temperature (dry-bulb and wet-bulb)
u. Date and time logged

18. Electrical, Gas, and Weather Reports
    a. Electrical Meter Report: Provide a monthly report showing the daily electrical consumption and peak electrical demand with time and date stamp for each building meter.
    b. Provide an annual (12-month) summary report showing the monthly electrical consumption and peak demand with time and date stamp for each meter.
    c. Gas Meter Report: Provide a monthly report showing the daily natural gas consumption for each meter. Provide an annual (12-month) report that shows the monthly consumption for each meter.
    d. Weather Data Report: Provide a monthly report showing the daily minimum, maximum, and average outdoor air temperature, as well as the number of heating and cooling degree-days for each day. Provide an annual (12-month) report showing the minimum, maximum, and average outdoor air temperature for the month, as well as the number of heating and cooling degree-days for the month.
19. Scheduling and Override:
    a. Provide override access through menu selection from the graphical interface and through a function key.
    b. Provide a calendar type format for time-of-day scheduling and overrides of building control systems. Schedules reside in the

ECC. The digital controllers shall ensure equipment time scheduling when the ECC is off-line. The ECC shall not be required to execute time scheduling. Provide the following spreadsheet graphics as a minimum:

1) Weekly schedules.
2) Zone schedules, minimum of 100 zones.
3) Scheduling up to 365 days in advance.
4) Scheduled reports to print at workstation.

20. Collection and Analysis of Historical Data:
    a. Provide trending capabilities that will allow the operator to monitor and store records of system activity over an extended period. Points may be trended automatically on time-based intervals or change of value, both of which shall be user definable. The trend interval could be five (5) minutes to 120 hours. Trend data may be stored on hard disk for future diagnostic and reporting. Additionally trend data may be archived to network drives or removable disk media for off-site retrieval.
    b. Reports may be customized to include individual points or predefined groups of at least six points. Provide additional functionality to allow pre-defined groups of up to 250 trended points to be easily accessible by other industry standard word processing and spreadsheet packages. The reports shall be time and date stamped and shall contain a report title and the name of the facility.
    c. System shall have the set up to generate spreadsheet reports to track energy usage and cost based on weekly or monthly interval, equipment run times, equipment efficiency, and/or building environmental conditions.
    d. Provide additional functionality that will allow the operator to view real time trend data on trend graph displays. A minimum of 20 points may be graphed regardless of whether they have been predefined for trending. In addition, the user may pause the graph and take snapshots of the screens to be stored on the workstation disk for future reference and trend analysis. Exact point values may be viewed, and the graph may be printed.

Operator shall be able to command points directly on the trend plot by double clicking on the point.

21. Alarm Management:
    a. Alarm routing shall allow the operator to send alarm notification to selected printers or operator workstation based on time of day, alarm severity, or point type.
    b. Alarm notification shall be provided via two alarm icons, to distinguish between routine, maintenance type alarms and critical alarms. The critical alarms shall display on the screen at the time of its occurrence, while others shall display by clicking on their icon.
    c. Alarm display shall list the alarms with highest priority at the top of the display. The alarm display shall provide selector buttons for display of the associated point graphic and message in English language. The operator shall be able to sort out the alarms.
    d. Alarm messages shall be customized for each point to display detailed instructions to the operator regarding actions to take in the event of an alarm.
    e. An operator with proper security level access may acknowledge and clear the alarm. All that have not been cleared shall be archived at workstation disk.
22. Remote Communications: The system shall have the ability to dial out in the event of an alarm. Receivers shall include operator workstations, e-mail addresses, and alpha-numeric pagers. The alarm message shall include the name of the calling location, the device that generated the alarm, and the alarm message itself.
23. System Configuration:
    a. Network control strategies shall not be restricted to a single digital controller but shall be able to include data from all other network devices to allow the development of global control strategies.
    b. Provide automatic backup and restore of all digital controller databases on the workstation hard disk. In addition to all backup data, all databases shall be performed while the workstation is on-line without disturbing other system operations.

2.5 PORTABLE OPERATOR'S TERMINAL (POT)

A. Provide a portable operator's terminal (POT) that shall be capable of accessing all system data. POT may be connected to any point on the system network or may be connected directly to any controller for programming, setup, and troubleshooting. POT shall communicate using BACnet protocol. POT may be connected to any point on the system network or it may be connected directly to controllers using the BACnet PTP (Point-To-Point) Data Link/ Physical layer protocol. The terminal shall use the Read (Initiate) and Write (Execute) BACnet Services. POT shall be an IBM-compatible notebook-style PC including all software and hardware required.

B. Hardware: POT shall conform to the BACnet Advanced Workstation (B-AWS) Profile and shall be BTL-Listed as a B-AWS device.

1. POT shall be commercial standard with supporting 32- or 64-bit hardware (as limited by the direct-digital control system software) and software enterprise server. Internet Explorer v6.0 SP1 or higher, Windows Script Hosting version 5.6 or higher, Windows Message Queuing, Windows Internet Information Services (IIS) v5.0 or higher, minimum 2.8 GHz processor, minimum 500 GB 7200 rpm SATA hard drive with 16 MB cache, minimum 2GB DDR3 SDRAM (minimum 1333 Mhz) memory, 512 MB video card, minimum 16 inch (diagonal) screen, 10-100-1000 Base-TX Ethernet NIC with an RJ45 connector or a 100Base-FX Ethernet NIC with an SC/ST connector, 56,600 bps modem, an ASCII RS-232 interface, and a 16 speed high density DVD-RW+/- optical drive.

C. Software: POT shall include software equal to the software on the ECC.

2.6 BACnet PROTOCOL ANALYZER

A. For ease of troubleshooting and maintenance, provide a BACnet protocol analyzer. Provide its associated fittings, cables and appurtenances, for connection to the communications network. The BACnet protocol analyzer shall be able to, at a minimum: capture and store to a file all data traffic on all network levels; measure bandwidth usage; filter out (ignore) selected traffic.

2.7 NETWORK AND DEVICE NAMING CONVENTION

A. Network Numbers

1. BACnet network numbers shall be based on a "facility code, network" concept. The "facility code" is the VAMC's or VA campus' assigned numeric value assigned to a specific facility or building. The

"network" typically corresponds to a "floor" or other logical configuration within the building. BACnet allows 65535 network numbers per BACnet internet work.

2. The network numbers are thus formed as follows: "Net #" = "FFFNN" where:
   a. FFF = Facility code (see below)
   b. NN = 00-99 This allows up to 100 networks per facility or building

B. Device Instances

1. BACnet allows 4194305 unique device instances per BACnet internet work. Using Agency's unique device instances are formed as follows: "Dev #" = "FFFNNDD" where
   a. FFF and N are as above and
   b. DD = 00-99, this allows up to 100 devices per network.
2. Note Special cases, where the network architecture of limiting device numbering to DD causes excessive subnet works. The device number can be expanded to DDD and the network number N can become a single digit. In NO case shall the network number N and the device number D exceed 4 digits.
3. Facility code assignments:
4. 000-400 Building/facility number
5. Note that some facilities have a facility code with an alphabetic suffix to denote wings, related structures, etc. The suffix will be ignored. Network numbers for facility codes greater than 400 will be assigned in the range 000-399.

C. Device Names

1. Name the control devices based on facility name, location within a facility, the system or systems that the device monitors and/or controls, or the area served. The intent of the device naming is to be easily recognized. Names can be up to 254 characters in length, without embedded spaces. Provide the shortest descriptive, but unambiguous, name. For example, in building #123 prefix the number with a “B” followed by the building number, if there is only one chilled water pump "CHWP-1", a valid name would be "B123.CHWP. 1.STARTSTOP". If there are two pumps designated "CHWP-1", one in a basement mechanical room (Room 0001) and one in a penthouse

mechanical room (Room PH01), the names could be "B123.R0001.CHWP.1. STARTSTOP" or "B123.RPH01.CHWP.1.STARTSTOP". In the case of unitary controllers, for example a VAV box controller, a name might be "B123.R101.VAV". These names should be used for the value of the "Object_Name" property of the BACnet Device objects of the controllers involved so that the BACnet name and the EMCS name are the same.

2.8 BACnet DEVICES

A. All BACnet Devices – controllers, gateways, routers, actuators, Operator Displays, and sensors shall conform to BACnet Device Profiles and shall be BACnet Testing Laboratories (BTL) –Listed as conforming to those Device Profiles. Protocol Implementation Conformance Statements (PICSs), describing the BACnet capabilities of the Devices shall be published and available for the Devices through links in the BTL website.

1. BACnet Building Controllers, shall conform to the BACnet B-BC Device Profile, and shall be BTL-Listed as conforming to the B-BC Device Profile. The Device's PICS shall be submitted.
2. BACnet Advanced Application Controllers shall conform to the BACnet B-AAC Device Profile and shall be BTL-Listed as conforming to the B-AAC Device Profile. The Device's PICS shall be submitted.
3. BACnet Application Specific Controllers shall conform to the BACnet B-ASC Device Profile and shall be BTL-Listed as conforming to the B-ASC Device Profile. The Device's PICS shall be submitted.
4. BACnet Smart Actuators shall conform to the BACnet B-SA Device Profile and shall be BTL-Listed as conforming to the B-SA Device Profile. The Device's PICS shall be submitted.
5. BACnet Smart Sensors shall conform to the BACnet B-SS Device Profile and shall be BTL-Listed as conforming to the B-SS Device Profile. The Device's PICS shall be submitted.
6. BACnet routers and gateways shall conform to the BACnet B-OTH Device Profile, and shall be BTL-Listed as conforming to the B-OTH Device Profile. The Device's PICS shall be submitted.

2.9 CONTROLLERS

A. General. Provide an adequate number of BTL listed B-BC building controllers, BTL listed B-AAC, BTL listed B-ASC, BTL listed B-SA, and BTL listed B-SS's to achieve the performance specified in the Part 1 Article on

"System Performance." Each of these controllers shall meet the following requirements.

1. Communication.
   a. Each B-BC controller shall reside on a BACnet network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications.
   b. Each B-BC controller shall provide a service communication port using BACnet Data Link/Physical layer protocol for connection to a portable operator's terminal. If this port is not available built into the controller, contractor is to install a 4 port unmanaged switch inside the B-BC control cabinet.
2. Keypad. A local keypad and display shall be provided for each controller. The keypad shall be provided for interrogating and editing data. Provide a system security password to prevent unauthorized use of the keypad and display.
3. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
4. Memory. The controller shall maintain all BIOS and programming information in the event of a power loss for at least 72 hours.
5. The controller shall be able to operate at 90 percent to 110 percent of nominal voltage rating and shall perform an orderly shutdown less than 80 percent nominal voltage. Controller operation shall be protected against electrical noise of 5 to 120 Hz and from keyed radios up to 5 watt at 1 meter (3 feet).
6. Transformer. Power supply for the ASC must be rated at a minimum of 125 percent of B-ASC power consumption and shall be of the fused or current limiting type.

B. Provide BTL-Listed B-ASC application specific controllers for each piece of equipment for which they are constructed. Application specific controllers shall communicate with other BACnet devices on the internetwork using the BACnet Read (Execute) Property service.

1. Each B-ASC shall be capable of stand-alone operation and shall continue to provide control functions without being connected to the network.

2. Each B-ASC will contain sufficient I/O capacity to control the target system.
3. Communication.
   a. Each controller shall reside on a BACnet network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications. Each building controller also shall perform BACnet routing if connected to a network of custom application and application specific controllers.
   b. Each controller shall have a BACnet Data Link/Physical layer compatible connection for a laptop computer or a portable operator's tool. This connection shall be extended to a space temperature sensor port where shown.
4. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
5. Memory. The application specific controller shall use nonvolatile memory and maintain all BIOS and programming information in the event of a power loss.
6. Immunity to power and noise. Controllers shall be able to operate at 90 percent to 110 percent of nominal voltage rating and shall perform an orderly shutdown below 80 percent. Operation shall be protected against electrical noise of 5-120 Hz and from keyed radios up to 5 watts at 1 meter (3 feet).

C. Direct Digital Controller Software

1. The software programs specified in this section shall be commercially available, concurrent, multi-tasking operating system and support the use of software application that operates under Linux or Microsoft Windows.
2. All points shall be identified by up to 30-character point name and 16-character point descriptor. The same names shall be used at the ECC.
3. All control functions shall execute within the stand-alone control units. All new controllers installed will also include all software and/or hardware required to program, commission, or alter the sequence of operation of said controller(s). Controllers requiring

software or hardware that is not commercially available will not be allowed. Installation of software and/or hardware for controller configuration will be the responsibility of the DDC contractor. COR will direct to install said hardware and/or software on either the B-AWS or portable operator terminal. The VA shall be able to customize control strategies and sequences of operations defining the appropriate control loop algorithms and choosing the optimum loop parameters without requiring the services of a DDC contractor.

4. All controllers shall be capable of being programmed to utilize stored default values for assured fail-safe operation of critical processes. Default values shall be invoked upon sensor failure or, if the primary value is normally provided by the central or another CU, or by loss of bus communication. Individual application software packages shall be structured to assume a fail-safe condition upon loss of input sensors. Loss of an input sensor shall result in output of a sensor-failed message at the ECC. Each ACU and RCU shall have capability for local readouts of all functions. The UCUs shall be read remotely.
5. All DDC control loops shall be able to utilize any of the following control modes:
   a. Two position (on-off, slow-fast) control.
   b. Proportional control.
   c. Proportional plus integral (PI) control.
   d. Proportional plus integral plus derivative (PID) control. All PID programs shall automatically invoke integral wind up prevention routines whenever the controlled unit is off, under manual control of an automation system or time-initiated program.
   e. Automatic tuning of control loops.
6. System Security: Operator access shall be secured using individual password and operator’s name. Passwords shall restrict the operator to the level of object, applications, and system functions assigned to him. A minimum of three (3)or a maximum of six (6) levels of security for operator access shall be provided.
7. Application Software: The controllers shall provide the following programs as a minimum for the purpose of optimizing energy consumption while maintaining comfortable environment for occupants.

All application software shall reside and run in the system digital controllers. Editing of the application shall occur at the ECC or via a portable operator's terminal, when it is necessary, to access directly the programmable unit.

a. Economizer: An economizer program shall be provided for VAV systems. This program shall control the position of air handler relief, return, and outdoor dampers. If the outdoor air dry bulb temperature and humidity fall below changeover set point the energy control center will modulate the dampers to provide 100 percent outdoor air. The operator shall be able to override the economizer cycle and return to minimum outdoor air operation at any time.
b. Night Setback/Morning Warm up Control: The system shall provide the ability to automatically adjust set points for this mode of operation.
c. Optimum Start/Stop (OSS): Optimum start/stop program shall automatically be coordinated with event scheduling. The OSS program shall start HVAC equipment at the latest possible time that will allow the equipment to achieve the desired zone condition by the time of occupancy, and it shall also shut down HVAC equipment at the earliest possible time before the end of the occupancy period and still maintain desired comfort conditions. The OSS program shall consider both outside weather conditions and inside zone conditions. The program shall automatically assign longer lead times for weekend and holiday shutdowns. The program shall poll all zones served by the associated AHU and shall select the warmest and coolest zones. These shall be used in the start time calculation. It shall be possible to assign occupancy start times on a per air handler unit basis. The program shall meet the local code requirements for minimum outdoor air while the building is occupied. Modification of assigned occupancy start/stop times shall be possible via the ECC.
d. Event Scheduling: Provide a comprehensive menu driven program to automatically start and stop designated points or a group of

points according to a stored time. This program shall provide the capability to individually command a point or group of points. When points are assigned to one common load group it shall be possible to assign variable time advances/delays between each successive start or stop within that group. Scheduling shall be calendar based and advance schedules may be defined up to one year in advance. Advance schedule shall override the day-to-day schedule. The operator shall be able to define the following information:

1) Time, day.
2) Commands such as on, off, auto.
3) Time delays between successive commands.
4) Manual overriding of each schedule.
5) Allow operator intervention.

e. Alarm Reporting: The operator shall be able to determine the action to be taken in the event of an alarm. Alarms shall be routed to the ECC based on time and events. An alarm shall be able to start programs, login the event, print and display the messages. The system shall allow the operator to prioritize the alarms to minimize nuisance reporting and to speed operator's response to critical alarms. A minimum of six (6) priority levels of alarms shall be provided for each point.

f. Remote Communications: The system shall have the ability to dial out in the event of an alarm to the ECC and alpha-numeric pagers. The alarm message shall include the name of the calling location, the device that generated the alarm, and the alarm message itself. The operator shall be able to remotely access and operate the system using dial up communications. Remote access shall allow the operator to function the same as local access.

g. Maintenance Management (PM): The program shall monitor equipment status and generate maintenance messages based upon the operators defined equipment run time, starts, and/or calendar date limits. A preventative maintenance alarm shall be printed indicating maintenance requirements based on pre-defined run time. Each preventive message shall include point description, limit criteria and preventative maintenance instruction assigned to

that limit. A minimum of 480-character PM shall be provided for each component of units such as air handling units.

h. Chilled water Plant Operation: This program shall have the ability to sequence the multiple chillers to minimize energy consumption. The program shall provide sequence of operation as described on the drawings and include the following as a minimum:

1) Automatic start/stop of chillers and auxiliaries in accordance with the sequence of operation shown on the drawings, while incorporating requirements and restraints, such as starting frequency of the equipment imposed by equipment manufacturers.
2) Secondary chilled water pumps and controls.
3) Generate chilled water plant load profiles for different seasons for use in forecasting efficient operating schedule.
4) Cooling Tower Operation Program: The objective of cooling tower control is to optimize chiller/tower energy use within the equipment restraints and minimum condenser water temperature limit recommended by the equipment manufacturer. Maintain chilled water plant performance records and print reports at intervals selected by the operator. It shall be possible for the operator to change the set points and the operating schedule.
5) The chilled water plant program shall display the following as a minimum:
   a) Secondary chilled flow rate.
   b) Secondary chilled water supply and return temperature.
   c) Condenser water supply and return temperature.
   d) Outdoor air dry bulb temperature.
   e) Outdoor air wet bulb temperature.
   f) Ton-hours of chilled water per day/month/year.
   g) On-off status for each chiller.
   h) Chilled water flow rate.
   i) Chilled water supply and return temperature.
   j) Operating set points-temperature and pressure.
   k) Kilowatts and power factor.
   l) Current limit set point.

m) Date and time.

n) Operating or alarm status.

o) Operating hours.

2.10 SPECIAL CONTROLLERS

A. Laboratory rooms and the fume hoods in those rooms shall be controlled to allow for a variable flow of conditioned air into the room, general exhaust from the room, and exhaust through the fume hood while maintaining a safe face velocity at the hood sash opening and proper space pressurization.

B. Fume Hood Exhaust Air Controller: The air flow through the open face of the hood, regardless of sash position, shall be controlled at a face velocity between 30 to 36 meter per minute (100 fpm and 120 fpm). A velocity sensor controller located in a sampling tube in the side wall of the hood shall control a damper in the hood discharge to maintain the face velocity.

C. Room Differential Pressure Controller: The differential pressure in laboratory rooms, operating rooms, in the SPS area, Chemo compounding rooms, and isolation rooms shall be maintained by controlling the quantity of air exhausted from or supplied to the room. A sensor-controller shall measure and control the velocity of air flowing into or out of the room through a sampling tube installed in the wall separating the room from the adjacent space and display the value on its monitor. The sensor-controller shall meet the following as a minimum:

1. Operating range: -0.25 to +0.25 inches of water column
2. Resolution: 5 percent of reading
3. Accuracy: +/- 10 percent of reading +/- 0.005 inches of water column
4. Analog output: 4-20 ma or 0-10 VDC
5. Operating temperature range: 32 degrees F - 120 degrees F

2.11 SENSORS (AIR, WATER AND STEAM)

A. Sensors' measurements shall be read back to the DDC system, and shall be visible by the ECC.

B. Temperature and Humidity Sensors shall be electronic, vibration and corrosion resistant for wall, immersion, and/or duct mounting. Provide all remote sensors as required for the systems.

1. Temperature Sensors: thermistor type for terminal units and Resistance Temperature Device (RTD) with an integral 4-20 mA or 0-10 VDC transmitter type for all other sensors.

a. Duct sensors shall be rigid or averaging type as shown on drawings. Averaging sensor shall be a minimum of 1 linear foot of sensing element for each square feet of cooling/heating coil face area.
b. Immersion sensors shall be provided with a separable well made of stainless steel, bronze or monel material. Pressure rating of well is to be consistent with the system pressure in which it is to be installed. Temperature well shall be filled with a thermal compound compatible with installed sensor.
c. All space sensors shall be equipped with in-space User set-point adjustment, override switch, numerical temperature display on sensor cover, and BACnet communication port. Match room thermostats. Provide a tooled-access cover.
    1) Public space sensor: setpoint adjustment shall be only through the ECC or through the DDC system's diagnostic device/laptop. Do not provide in-space User set-point adjustment. Provide an opaque keyed-entry cover if needed to restrict in-space User set-point adjustment.
    2) Psychiatric patient room sensor: sensor shall be flush with wall or on the return duct, shall not include an override switch, numerical temperature display on sensor cover, shall not include a communication port and shall not allow in-space User set-point adjustment. Setpoint adjustment shall be only through the ECC or through the DDC system's diagnostic device/laptop. Provide a stainless-steel cover plate with an insulated back and security screws.
d. Outdoor air temperature sensors shall have watertight inlet fittings and be shielded from direct sunlight.
e. Room security sensors shall have stainless steel cover plate with insulated back and security screws.
f. Wire: Twisted, shielded-pair cable.
g. Output Signal: 4-20 mA or 0-10 VDC.

2. Humidity Sensors: Bulk polymer sensing element type.
    a. Duct and room sensors shall have a sensing range of 20 to 80 percent with accuracy of ± 2 to ± 5 percent RH, including hysteresis, linearity, and repeatability.

b. Outdoor humidity sensors shall be furnished with element guard and mounting plate and have a sensing range of 0 to 100 percent RH.

c. Continuous Output Signal: 4-20 mA or 0-10 VDC.

C. Static Pressure Sensors: Non-directional, temperature compensated.

1. 4-20 mA or 0-10 VDC output signal.
2. 0 to 5 inches wg for duct static pressure range.
3. 0 to 0.25 inch wg for Building static pressure range.

D. Vortex Water flow sensors:

1. Type: Insertion vortex type with retractable probe assembly and 2 inch full port gate valve.
   a. Pipe size: up to 24 inches.
   b. Retractor: ASME threaded, non-rising stem type with hand wheel.
   c. Mounting connection: 2 inch 150 PSI flange.
   d. Sensor assembly: Design for expected water flow and pipe size.
   e. Seal: Teflon (PTFE).
2. Controller:
   a. Integral to unit.
   b. Locally display flow rate and total.
   c. Output flow signal to BAS/EMS/BES/BMCS: Digital pulse or BACnet type.
3. Performance:
   a. Turndown: 20:1
   b. Response time: Adjustable from 1 to 100 seconds.
   c. Power: 24 volt AC
4. Install flow meters according to manufacturer's recommendations. Where recommended by manufacturer because of mounting conditions, provide flow rectifier.

E. Turbine Water Flow Sensors: shall be insertion turbine type with turbine element, retractor and preamplifier/transmitter mounted on a two-inch full port isolation valve; assembly easily removed or installed as a single unit under line pressure through the isolation valve without interference with process flow; calibrated scale shall allow precise positioning of the flow element to the required insertion depth within plus or minus minute 1 mm (0.05 inch); wetted parts shall be constructed of stainless steel. Operating power shall be nominal 24 VDC. Local instantaneous flow indicator shall be

LED type in NEMA 4 enclosure with 3-1/2 digital display, for wall or panel mounting.

1. Performance characteristics:
   a. Ambient conditions: -40 degrees C to 60 degrees C (-40 degrees F to 140 degrees F), 5 to 100 percent humidity.
   b. Operating conditions: 850 kPa (125 psig), 0 degree C to 120 degrees C (30 degrees F to 250 degrees F), 0.15 to 12 meters per second (0.5 to 40 feet per second) velocity.
   c. Nominal range (turn down ratio): 10 to 1.
   d. Preamplifier mounted on meter shall provide 4-20 mA or 0-10 VDC, a divided pulse output or switch closure signal for units of volume or mass per a time base. Signal transmission distance shall be a minimum of 1,800 meters (6,000 feet). Preamplifier for bi-directional flow measurement shall provide a directional contact closure from a relay mounted in the preamplifier.
   e. Pressure Loss: Maximum 1 percent of the line pressure in line sizes above 100 mm (4 inches).
   f. Ambient temperature effects, less than 0.005 percent calibrated span per degrees C (degrees F) temperature change.
   g. RFI effect - flow meter shall not be affected by RFI.
   h. Power supply effect less than 0.02 percent of span for a variation of plus or minus 10 percent power supply.

F. Steam Flow Sensor/Transmitter:

1. Sensor: Vortex shedder incorporating wing type sensor and amplification technology for high signal-to-noise ratio, carbon steel body with 316 stainless steel working parts, 24 VDC power, NEMA 4 enclosure.
   a. Ambient conditions, -40 degrees C to 80 degrees C (-40 degrees F to 175 degrees F).
   b. Process conditions, 900 kPa (125 psig) saturated steam.
   c. Turn down ratio, 20 to 1.
   d. Output signal, 4-20 ma or 0-10 VDC DC.
   e. Processor/Transmitter, NEMA 4 enclosure with keypad program selector and six digit LCD output display of instantaneous flow rate or totalized flow, solid state switch closure signal shall be provided to the nearest DDC panel for totalization.

1) Ambient conditions, -20 degrees C to 50 degrees C (0 degrees F to 120 degrees F), 0 to 95 percent non-condensing RH.
2) Power supply, 120 VAC, 60 hertz or 24 VDC.
3) Internal battery, provided for 24-month retention of RAM contents when all other power sources are removed.

f. Sensor on all steam lines shall be protected by pigtail siphons installed between the sensor and the line, and shall have an isolation valve installed between the sensor and pressure source.

G. Flow switches:

1. Shall be either paddle or differential pressure type.
   a. Paddle-type switches (liquid service only) shall be UL Listed, SPDT snap-acting, adjustable sensitivity with NEMA 4 enclosure.
   b. Differential pressure type switches (air or water service) shall be UL listed, SPDT snap acting, NEMA 4 enclosure, with scale range and differential suitable for specified application.

H. Current Switches: Current operated switches shall be self powered, solid state with adjustable trip current as well as status, power, and relay command status LED indication. The switches shall be selected to match the current of the application and output requirements of the DDC systems.

I. Water Overflow Indicators:

1. Float Switches: Float switch manufactured to close a normally open electrical contact when water level rises at the bottom of a drain pan or sump. All parts that come in contact with water shall be plastic, brass, or stainless steel. Select switch configuration for reliable operation in the specific location it is to be used (primary drain pan, primary humidifier drain pan, secondary pan, pump sump etc.) Contact rating 4A at 24 VAC maximum and 100 mA at 5 VDC minimum. For installation the switch shall be clamped to the side of the fan or sump. Switches that required drilling through the side of the pan or sump shall be prohibited.
2. Water Sensors: 24 VAC powered solid state single pole – double throw contacts that closes upon the sensor’s detection of water at the bottom of pan, sump, floor etc. Sensor designed to be placed at the bottom of the pan, floor etc. where it will detect moisture. Sensor design shall incorporate water sensor array inside a hydrophilic pad

designed to absorb and alarm with only a small amount of water. Contact rating 4A at 24 VAC maximum and 100 mA at 5 VDC minimum.

2.12 CONTROL CABLES

A. General:

1. Ground cable shields, drain conductors, and equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments. Comply with Sections 27 05 26 and 26 05 26.
2. Cable conductors to provide protection against induction in circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
3. Minimize the radiation of RF noise generated by the System equipment so as not to interfere with any audio, video, data, computer main distribution frame (MDF), telephone customer service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.
4. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs.
5. Label system's cables on each end. Test and certify cables in writing to the VA before conducting proof-of-performance testing. Minimum cable test requirements are for impedance compliance, inductance, capacitance, signal level compliance, opens, shorts, cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges used. Make available all cable installation and test records at demonstration to the VA. All changes (used pair, failed pair, etc.) shall be posted in these records as the change occurs.
6. Power wiring shall not be run in conduit with communications trunk wiring or signal or control wiring operating at 100 volts or less.

B. Analogue control cabling shall be not less than No. 18 AWG solid or stranded, with thermoplastic insulated conductors as specified in Section 26 05 21.

C. Copper digital communication cable between the ECC and the B-BC and B-AAC controllers shall be 100BASE-TX Ethernet, Category 5e or 6, not less than minimum 24 American Wire Gauge (AWG) solid, Shielded Twisted Pair (STP) or

Unshielded Twisted Pair (UTP), with thermoplastic insulated conductors, enclosed in a thermoplastic outer jacket, as specified in Section 27 15 00.

1. Other types of media commonly used within IEEE Std 802.3 LANs (e.g., 10Base-T and 10Base-2) shall be used only in cases to interconnect with existing media.

D. All MS/TP communications cables for devices utilizing the EIA-485 standard must be listed for use on EIA-485 networks by the manufacturer of the cable. This requirement overrides any cable recommendation by the controller manufacturer. The use of EIA-485 communication cables shall not affect the warranty from the installing DDC contractor. Cables shall have the following characteristic:

1. Nominal Impedance: 100-130 Ohms
2. Twisted/shielded construction of 1, 1.5, or 2 pairs depending on controller requirements.
3. Be plenum rated when required
4. Cables designated for use by the cable manufacturer for use in PA or Speaker systems shall not be allowed, regardless of recommendations by the controller manufacturer.

E. Optical digital communication fiber, if used, shall be Multimode or Single mode fiber, 62.5/125 micron for multimode or 10/125 micron for single mode micron with SC or ST connectors as specified in TIA-568-C.1. Terminations, patch panels, and other hardware shall be compatible with the specified fiber and shall be as specified in Section 27 15 00. Fiber-optic cable shall be suitable for use with the 100Base-FX or the 100Base-SX standard (as applicable) as defined in IEEE Std 802.3.

2.13 THERMOSTATS AND HUMIDISTATS

A. Room thermostats controlling unitary standalone heating and cooling devices not connected to the DDC system shall have three modes of operation (heating - null or dead band - cooling). Thermostats for patient bedrooms shall have capability of being adjusted to eliminate null or dead band. Wall mounted thermostats shall have manufacturer's recommendation finish, setpoint range and temperature display and external adjustment:

1. Electronic Thermostats: Solid-state, microprocessor based, BACnet enabled programmable to daily, weekend, and holiday schedules.
   a. Public Space Thermostat: Public space thermostat shall have a thermistor sensor and shall not have a visible means of set point

adjustment. Adjustment shall be via the digital controller to which it is connected.

b. Patient Room Thermostats: thermistor with in-space User set point adjustment and an on-casing room temperature numerical temperature display.

c. Psychiatric Patient Room Sensors: Electronic duct sensor as noted under Article 2.4.

d. Battery replacement without program loss.

B. Strap-on aquastat shall be enclosed in a dirt-and-moisture proof housing with adjustable temperature switching point and minimum single pole, double throw switch. Variable setpoint and variable differential ranges selected for the application. Manual reset.

C. Freezestats shall have a minimum of 300 mm (one linear foot) of sensing element for each 0.093 square meter (one square foot) of coil area. A freezing condition at any increment of 300 mm (one foot) anywhere along the sensing element shall be sufficient to operate the thermostatic element. Freezestats shall be manually-reset.

D. Room Humidistats: Provide fully proportioning humidistat with adjustable throttling range for accuracy of settings and conservation. The humidistat shall have set point scales shown in percent of relative humidity located on the instrument. Systems showing moist/dry or high/low are prohibited.

E. Low Signal Selector High Limit Duct Humidistat: Duct mounted high limit humidistat mounted downstream of the humidifier steam injection grid to protect the ductwork and other components from moisture in the event of humidifier loop problems. Typically set at 70 percent to 80 percent RH the device provides proportional signal back to steam control equipment as duct humidity approaches high limit setpoint thus providing more accurate control. Duct mounted device with polymer sensor:

1. Output 4 to 20 milliamp or 0-10 VDC.
2. Setpoint range 60 percent RH to 95 percent RH.
3. Proportional Band range 5 percent to 30 percent.
4. Auxiliary contacts for alarms.
5. Accuracy 2 percent RH and drift less than 0.5 percent per year.

2.14 FINAL CONTROL ELEMENTS AND OPERATORS

A. Fail Safe Operation: Control valves and dampers shall provide "fail safe" operation in either the normally open or normally closed position as required for freeze, moisture, and smoke or fire protection.

B. Spring Ranges: Range as required for system sequencing and to provide tight shut-off.

C. Power Operated Control Dampers (other than VAV Boxes): Factory fabricated, balanced type dampers. All modulating dampers shall be opposed blade type and gasketed. Blades for two-position, duct-mounted dampers shall be parallel, airfoil (streamlined) type for minimum noise generation and pressure drop.

1. Leakage: maximum leakage in closed position shall not exceed 7 L/S (15 CFMs) differential pressure for outside air and exhaust dampers and 200 L/S/ square meter (40 CFM/square feet) at 50 mm (2 inches) differential pressure for other dampers.
2. Frame shall be galvanized steel channel with seals as required to meet leakage criteria.
3. Blades shall be galvanized steel or aluminum, 200 mm (8 inch) maximum width, with edges sealed as required.
4. Bearing shall be nylon, bronze sleeve or ball type.
5. Hardware shall be zinc-plated steel. Connected rods and linkage shall be non-slip. Working parts of joints shall be brass, bronze, nylon or stainless steel.
6. Maximum air velocity and pressure drop through free area of the dampers:
   a. Smoke damper in air handling unit: 305 meter per minute (1000 fpm).
   b. Duct mounted damper: 600 meter per minute (2000 fpm).
   c. Maximum static pressure loss: 50 Pascal (0.20 inches water gauge).

D. Smoke Dampers and Combination Fire/Smoke Dampers: Dampers and operators are specified in Section 23 31 00, HVAC DUCTS AND CASINGS. Control of these dampers is specified under this Section.

E. Control Valves:

1. Valves shall be rated for a minimum of 150 percent of system operating pressure at the valve location but not less than 900 kPa (125 psig).
2. Valves 50 mm (2 inches) and smaller shall be bronze body with threaded or flare connections.
3. Valves 60 mm (2 1/2 inches) and greater shall be bronze or iron body with flanged connections.
4. Brass or bronze seats except for valves controlling media greater than 100 degrees C (210 degrees F), which shall have stainless steel seats.
5. Flow characteristics:
   a. Three way modulating valves shall be globe pattern. Position versus flow relation shall be linear relation for steam or equal percentage for water flow control.
   b. Two-way modulating valves shall be globe pattern. Position versus flow relation shall be linear for steam and equal percentage for water flow control.
   c. Two-way 2-position valves shall be ball, gate or butterfly type.
6. Maximum pressure drop:
   a. Two position steam control: 20 percent of inlet gauge pressure.
   b. Modulating Steam Control: 80 percent of inlet gauge pressure (acoustic velocity limitation).
   c. Modulating water flow control, greater of 3 meters (10 feet) of water or the pressure drop through the apparatus.
7. Two position water valves shall be line size.

F. Damper and Valve Operators and Relays:

1. Electric operator shall provide full modulating control of dampers and valves. For dampers a linkage and pushrod shall be furnished for mounting the actuator on the damper frame internally in the duct, externally in the duct, externally on the duct wall, or shall be furnished with a direct-coupled design. Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motor(s) shall have sufficient closure torque to allow for complete closure of valve or damper under

pressure. Provide multiple motors as required to achieve sufficient close-off torque.

a. Minimum valve close-off pressure shall be equal to the system pump's dead-head pressure, minimum 50 psig for valves smaller than 4 inches.

2. Electronic damper operators: Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve or damper under pressure. Provide multiple motors as required to achieve sufficient close-off torque.

a. VAV Box actuator shall be mounted on the damper axle or shall be of the air valve design, and shall provide complete modulating control of the damper. The motor shall have a closure torque of 35-inch pounds minimum with full torque applied at close off to attain minimum leakage.

3. See and coordinate drawings for required control operation.

2.15 AIR FLOW CONTROL

A. Airflow and static pressure shall be controlled via digital controllers with inputs from airflow control measuring stations and static pressure inputs as specified. Controller outputs shall be analog or pulse width modulating output signals. The controllers shall include the capability to control via simple proportional (P) control, proportional plus integral (PI), proportional plus integral plus derivative (PID), and on-off. The airflow control programs shall be factory-tested programs that are documented in the literature of the control manufacturer.

B. Air Flow Measuring Station -- Electronic Thermal Type:

1. Air Flow Sensor Probe:

a. Each air flow sensor shall contain two individual thermal sensing elements. One element shall determine the velocity of the air stream while the other element shall compensate for changes in temperature. Each thermal flow sensor and its associated control circuit and signal conditioning circuit shall be factory calibrated and be interchangeable to allow replacement of a sensor without recalibration of the entire flow station. The

sensor in the array shall be located at the center of equal area segment of the duct or fan inlet and the number of sensors shall be adequate to accommodate the expected velocity profile and variation in flow and temperature. The airflow station shall be of the insertion type in which sensor support structures are inserted from the outside of the ducts to make up the complete electronic velocity array.

b. Thermal flow sensor shall be constructed of hermetically sealed thermistors or nickel chromium or reference grade platinum wire, wound over an epoxy, stainless steel or ceramic mandrel and coated with a material suitable for the conditions to be encountered. Each dual sensor shall be mounted in an extruded aluminum alloy strut.

2. Air Flow Sensor Grid Array:

a. Each sensor grid shall consist of a lattice network of temperature sensors and linear integral controllers (ICs) situated inside an aluminum casing suitable for mounting in a duct or fan inlet. Each sensor shall be mounted within a strut facing downstream of the airflow and located so that it is protected on the upstream side. All wiring shall be encased (out of the air stream) to protect against mechanical damage.

b. The casing shall be made of welded aluminum of sufficient strength to prevent structural bending and bowing. Steel or iron composite shall not be acceptable in the casing material.

c. Pressure drop through the flow station shall not exceed 4 Pascal (0.015 inch WG) at 1,000 meter per minute (3,000 FPM).

3. Electronics Panel:

a. Electronics Panel shall consist of a surface mounted enclosure complete with solid-state microprocessor and software.

b. Electronics Panel shall be A/C powered 120 VAC and shall have the capability to transmit signals of 4-20 ma or 0-10 VDC type or PWM type for use in control of the HVAC Systems. The electronic panel shall have the capability to accept user defined scaling parameters for all output signals.

c. Electronics Panel shall have the capability to digitally display airflow in CFM and temperature in degrees F . The displays shall

be provided as an integral part of the electronics panel. The electronic panel shall have the capability to totalize the output flow in CFM for two or more systems, as required. A single output signal shall be provided which will equal the sum of the systems totalized. Output signals shall be provided for temperature and airflow. Provide remote mounted air flow or temperature displays where indicated on the plans.

d. Electronics Panel shall have the following:
   1) Minimum of 12-bit A/D conversion.
   2) Field adjustable digital primary output offset and gain.
   3) Airflow analog output scaling of 100 to 10,000 FPM.
   4) Temperature analog output scaling from -45 degrees C to 70 degrees C (-50 degrees F to 160 degrees F).
   5) Analog output resolution (full scale output) of 0.025 percent.

e. All readings shall be in I.P. units.

4. Thermal flow sensors and its electronics shall be installed as per manufacturer's instructions. The required probe sensor density shall be as follows:

Probe Sensor Density

Area (square feet)	Qty. Sensors
<=1	2
>1 to <4	4
4 to <8	6
8 to <12	8
12 to <16	12
>=16	16

a. Complete installation shall not exhibit more than ± 2.0 percent error in airflow measurement output for variations in the angle of flow of up to 10 percent in any direction from its calibrated orientation. Repeatability of readings shall be within ± 0.25 percent.

C. Static Pressure Measuring Station: shall consist of one or more static pressure sensors and transmitters along with relays or auxiliary devices as required for a complete functional system. The span of the transmitter shall not exceed two times the design static pressure at the point of measurement.

The output of the transmitter shall be true representation of the input pressure with plus or minus 25 Pascal (0.1 inch) W.G. of the design input pressure:

1. Static pressure sensors shall have the same requirements as Airflow Measuring Devices except that total pressure sensors are optional, and only multiple static pressure sensors positioned on an equal area basis connected to a network of headers are required.
2. For systems with multiple major or main trunk supply ducts, furnish a static pressure transmitter for each trunk duct. The transmitter signal representing the lowest static pressure shall be selected and this shall be the input signal to the controller.
3. The controller shall receive the static pressure transmitter signal and Control Unit (CU) shall provide a control output signal to the supply fan capacity control device. The control mode shall be proportional plus integral (PI) (automatic reset) and where required shall also include derivative mode.
4. In systems with multiple static pressure transmitters, provide a switch located near the fan discharge to prevent excessive pressure during abnormal operating conditions. High-limit switches shall be manually reset.

D. Constant Volume Control Systems shall consist of an air flow measuring station along with such relays and auxiliary devices as required to produce a complete functional system. The transmitter shall receive its air flow signal or static pressure signal from the flow measuring station and shall have a span not exceeding three times the design flow rate. The CU shall receive the transmitter signal and shall provide an output to the fan volume control device to maintain a constant flow rate. The CU shall provide proportional plus integral (PI) (automatic reset) control mode and where required also inverse derivative mode. Overall system accuracy shall be plus or minus the equivalent of 2 Pascal (0.008 inch) velocity pressure as measured by the flow station.

E. Airflow Synchronization:

1. Systems shall consist of an air flow measuring station for each main supply and return duct, the CU and such relays, as required to provide a complete functional system that will maintain a constant flow rate difference between supply and return air to an accuracy of

±10 percent. In systems where there is no suitable location for a flow measuring station that will sense total supply or return flow, provide multiple flow stations with a differential pressure transmitter for each station. Signals from the multiple transmitters shall be added through the CU such that the resultant signal is a true representation of total flow.

2. The total flow signals from supply and return air shall be the input signals to the CU. This CU shall track the return air fan capacity in proportion to the supply air flow under all conditions.

2.16 SAFETY

A. Provide hard-wired interlocked connections for such all safety devices, such as freeze stats, smoke detectors, smoke dampers, and refrigerant leak detection devices. All safety devises shall be provided with additional dry contacts and shall be connected to the DDC system for monitoring and sequencing.

PART 3 – EXECUTION

3.1 INSTALLATION

A. General:

1. Examine project plans for control devices and equipment locations; and report any discrepancies, conflicts, or omissions to COR for resolution before proceeding for installation.
2. Install equipment, piping, wiring /conduit parallel to or at right angles to building lines.
3. Install all equipment and piping in readily accessible locations. Do not run tubing and conduit concealed under insulation or inside ducts.
4. Mount control devices, tubing and conduit located on ducts and apparatus with external insulation on standoff support to avoid interference with insulation.
5. Provide sufficient slack and flexible connections to allow for vibration of piping and equipment.
6. Run tubing and wire connecting devices on or in control cabinets parallel with the sides of the cabinet neatly racked to permit tracing.
7. Install equipment level and plumb.

B. Electrical Wiring Installation:

1. All wiring and cabling shall be installed in conduits. Install conduits and wiring in accordance with Specification Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS. Conduits carrying control wiring and cabling shall be dedicated to the control wiring and cabling: these conduits shall not carry power wiring. Provide plastic end sleeves at all conduit terminations to protect wiring from burrs.
2. Install analog signal and communication cables in conduit and in accordance with Specification Division 27 - COMMINICATIONS. Install digital communication cables in conduit and in accordance with Specification Section 27 15 00, COMMINICATIONS STRUCTURED CABLING.
3. Install conduit and wiring between operator workstation(s), digital controllers, electrical panels, indicating devices, instrumentation, miscellaneous alarm points, thermostats, and relays as shown on the drawings or as required under this section.

4. Install all electrical work required for a fully functional system and not shown on electrical plans or required by electrical specifications. Where low voltage (less than 50 volt) power is required, provide suitable Class B transformers.
5. Install all system components in accordance with local Building Code and National Electric Code.
   a. Splices: Splices in shielded and coaxial cables shall consist of terminations and the use of shielded cable couplers. Terminations shall be in accessible locations. Cables shall be harnessed with cable ties.
   b. Equipment: Fit all equipment contained in cabinets or panels with service loops, each loop being at least 300 mm (12 inches) long. Equipment for fiber optics system shall be rack mounted, as applicable, in ventilated, self-supporting, code gauge steel enclosure. Cables shall be supported for minimum sag.
   c. Cable Runs: Keep cable runs as short as possible. Allow extra length for connecting to the terminal board. Do not bend flexible coaxial cables in a radius less than ten times the cable outside diameter.

d. Use vinyl tape, sleeves, or grommets to protect cables from vibration at points where they pass around sharp corners, through walls, panel cabinets, etc.

6. Conceal cables, except in mechanical rooms and areas where other conduits and piping are exposed.
7. Permanently label or code each point of all field terminal strips to show the instrument or item served. Color-coded cable with cable diagrams may be used to accomplish cable identification.
8. Grounding: ground electrical systems per manufacturer's written requirements for proper and safe operation.

C. Install Sensors and Controls:

1. Temperature Sensors:
   a. Install all sensors and instrumentation according to manufacturer's written instructions. Temperature sensor locations shall be readily accessible, permitting quick replacement and servicing of them without special skills and tools.
   b. Calibrate sensors to accuracy specified, if not factory calibrated.
   c. Use of sensors shall be limited to its duty, e.g., duct sensor shall not be used in lieu of room sensor.
   d. Install room sensors permanently supported on wall frame. They shall be mounted at 1.5 meter (5.0 feet) above the finished floor unless otherwise noted on the plans or drawings.
   e. Mount sensors rigidly and adequately for the environment within which the sensor operates. Separate extended-bulb sensors form contact with metal casings and coils using insulated standoffs.
   f. Sensors used in mixing plenum, and hot and cold decks shall be of the averaging of type. Averaging sensors shall be installed in a serpentine manner horizontally across duct. Each bend shall be supported with a capillary clip.
   g. All pipe mounted temperature sensors shall be installed in wells.
   h. All wires attached to sensors shall be air sealed in their conduits or in the wall to stop air transmitted from other areas affecting sensor reading.
   i. Permanently mark terminal blocks for identification. Protect all circuits to avoid interruption of service due to short-circuiting

or other conditions. Line-protect all wiring that comes from external sources to the site from lightning and static electricity.

2. Pressure Sensors:
   a. Install duct static pressure sensor tips facing directly downstream of airflow.
   b. Install high-pressure side of the differential switch between the pump discharge and the check valve.
   c. Install snubbers and isolation valves on steam pressure sensing devices.
3. Actuators:
   a. Mount and link damper and valve actuators according to manufacturer's written instructions.
   b. Check operation of damper/actuator combination to confirm that actuator modulates damper smoothly throughout stroke to both open and closed position.
   c. Check operation of valve/actuator combination to confirm that actuator modulates valve smoothly in both open and closed position.
4. Flow Switches:
   a. Install flow switch according to manufacturer's written instructions.
   b. Mount flow switch a minimum of 5 pipe diameters up stream and 5 pipe diameters downstream or 600 mm (2 feet) whichever is greater, from fittings and other obstructions.
   c. Assure correct flow direction and alignment.
   d. Mount in horizontal piping-flow switch on top of the pipe.

D. Installation of network:

1. Ethernet:
   a. The network shall employ Ethernet LAN architecture, as defined by IEEE 802.3. The Network Interface shall be fully Internet Protocol (IP) compliant allowing connection to currently installed IEEE 802.3, Compliant Ethernet Networks.

   b. The network shall directly support connectivity to a variety of cabling types. As a minimum provide the following connectivity:

100 Base TX (Category 5e cabling) for the communications between the ECC and the B-BC and the B-AAC controllers.

2. Third party interfaces: Contractor shall integrate real-time data from building systems by other trades and databases originating from other manufacturers as specified and required to make the system work as one system.

F. Installation of digital controllers and programming:

1. Provide a separate digital control panel for each major piece of equipment, such as air handling unit, chiller, pumping unit etc. Points used for control loop reset such as outdoor air, outdoor humidity, or space temperature could be located on any of the remote control units.

2. Provide sufficient internal memory for the specified control sequences and trend logging. There shall be a minimum of 25 percent of available memory free for future use.
3. System point names shall be human readable, permitting easy operator interface without the use of a written point index.
4. Provide software programming for the applications intended for the systems specified, and adhere to the strategy algorithms provided.
5. Provide graphics for each piece of equipment and floor plan in the building. This includes each chiller, cooling tower, air handling unit, fan, terminal unit, boiler, pumping unit etc. These graphics shall show all points dynamically as specified in the point list.

3.2 SYSTEM VALIDATION AND DEMONSTRATION

A. As part of final system acceptance, a system demonstration is required (see below). Prior to start of this demonstration, the contractor is to perform a complete validation of all aspects of the controls and instrumentation system. When formal commissioning is included in the project the system validation/test shall be part of the commissioning and shall be witnessed by the CxA.

B. Validation

1. Prepare and submit for approval a validation test plan including test procedures for the performance verification tests. Test Plan shall be submitted for review with the control system submittal as indicated in paragraph 1.7 Submittals. Test Plan address all specified functions of the ECC and all specified sequences of

operation. Explain in detail actions and expected results used to demonstrate compliance with the requirements of this specification. Explain the method for simulating the necessary conditions of operation used to demonstrate performance of the system. Test plan shall include a test check list to be used by the Installer's agent to check and initial that each test has been successfully completed. Deliver test plan documentation for the performance verification tests to the owner's representative 30 days prior to start of performance verification tests. Provide draft copy of operation and maintenance manual with performance verification test.

2. After approval of the validation test plan, installer shall carry out all tests and procedures therein. Installer shall completely check out, calibrate, and test all connected hardware and software to ensure that system performs in accordance with approved specifications and sequences of operation submitted. Installer shall complete and submit Test Check List.

C. Demonstration

1. System operation and calibration to be demonstrated by the installer in the presence of the Architect, CxA or COR on random samples of equipment as dictated by the COR. Should random sampling indicate improper work, the owner reserves the right to subsequently witness complete calibration of the system at no addition cost to the VA.
2. Make accessible, personnel to provide necessary adjustments and corrections to systems as directed by balancing agency.
3. The following witnessed demonstrations of field control equipment shall be included:
   a. Observe HVAC systems in shut down condition. Check dampers and valves for normal position.
   b. Test application software for its ability to communicate with digital controllers, operator workstation, and uploading and downloading of control programs.
   c. Demonstrate the software ability to edit the control program off-line.
   d. Demonstrate reporting of alarm conditions for each alarm and ensure that these alarms are received at the assigned location, including operator workstations.

e. Demonstrate ability of software program to function for the intended applications-trend reports, change in status etc.
f. Demonstrate via graphed trends to show the sequence of operation is executed in correct manner, and that the HVAC systems operate properly through the complete sequence of operation, e.g., seasonal change, occupied/unoccupied mode, and warm-up condition.
g. Demonstrate hardware interlocks and safeties functions, and that the control systems perform the correct sequence of operation after power loss and resumption of power loss.
h. Prepare and deliver to the VA graphed trends of all control loops to demonstrate that each control loop is stable and the set points are maintained.
i. Demonstrate that each control loop responds to set point adjustment and stabilizes within one (1) minute. Control loop trend data shall be instantaneous and the time between data points shall not be greater than one (1) minute.

4. Witnessed demonstration of ECC functions shall consist of:
   a. Running each specified report.
   b. Display and demonstrate each data entry to show site specific customizing capability. Demonstrate parameter changes.
   c. Step through penetration tree, display all graphics, demonstrate dynamic update, and direct access to graphics.
   d. Execute digital and analog commands in graphic mode.
   e. Demonstrate DDC loop precision and stability via trend logs of inputs and outputs (6 loops minimum).
   f. Demonstrate Energy Management System (EMS) performance via trend logs and command trace.
   g. Demonstrate scan, update, and alarm responsiveness.
   h. Demonstrate spreadsheet/curve plot software, and its integration with database.
   i. Demonstrate on-line user guide, and help function and mail facility.
   j. Demonstrate digital system configuration graphics with interactive upline and downline load, and demonstrate specified diagnostics.

k. Demonstrate multitasking by showing dynamic curve plot, and graphic construction operating simultaneously via split screen.

l. Demonstrate class programming with point options of beep duration, beep rate, alarm archiving, and color banding.

3.3 STARTUP AND TESTING

A. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.

B. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

C. The CxA will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the COR and CxA. Provide a minimum notice of 10 working days prior to startup and testing.

3.4 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.5 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer’s technical representative for 4 hourss to instruct each VA personnel responsible in the operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

3.6 CONSTRUCTION WASTE MANAGEMENT

A. General: Comply with Contractor’s Waste Management Plan and Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT.

B. To the greatest extent possible, separate reusable and recyclable products from contaminated waste and debris in accordance with the Contractor’s Waste Management Plan. Place recyclable and reusable products in designated containers and protect from moisture and contamination.

----- END -----

SECTION 23 21 13
HYDRONIC PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

A. Water piping to connect HVAC equipment, including the following:
   1. Chilled water, condenser water, heating hot water and drain piping.
   2. Extension of domestic water make-up piping for HVAC systems.
   3. Glycol-water piping.
B. A complete listing of common acronyms and abbreviations are included in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.
B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.
E. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.
F. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
G. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
H. Section 23 07 11, HVAC AND BOILER PLANT INSULATION.
I. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.
J. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
K. Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING.
L. Section 31 20 00, EARTHWORK: Excavation and backfill.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standard will govern.
B. American Society of Mechanical Engineers (ASME):
   B1.20.1-2013.....Pipe Threads, General Purpose, Inch
   B16.3-2016.....Malleable Iron Threaded Fittings: Classes 150 and 300

B16.4-2016.....Gray Iron Threaded Fittings: (Classes 125 and 250)

B16.5-2020.....Pipe Flanges and Flanged Fittings: NPS 1/2 through NPS 24 Metric/Inch Standard

B16.9-2018.....Factory Made Wrought Buttwelding Fittings

B16.11-2016.....Forged Fittings, Socket-Welding and Threaded

B16.18-2018.....Cast Copper Alloy Solder Joint Pressure Fittings

B16.22-2018.....Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings

B16.24-2016.....Cast Copper Alloy Pipe Flanges, Flanged Fittings, and Valves: Classes 150, 300, 600, 900, 1500, and 2500

B16.39-2019.....Malleable Iron Threaded Pipe Unions: Classes 150, 250, and 300

B16.42-2016.....Ductile Iron Pipe Flanges and Flanged Fittings: Classes 150 and 300

B31.9-2020.....Building Services Piping

B40.100-2013.....Pressure Gauges and Gauge Attachments

ASME Boiler and Pressure Vessel Code (BPVC):

BPVC Section VIII-2021..Rules for Construction of Pressure Vessels, Division 1

C. American Society for Testing and Materials (ASTM):

A47/A47M-1999(R2018)e1..Standard Specification for Ferritic Malleable Iron Castings

A53/A53M-2020.....Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless

A106/A106M-2019a.....Standard Specification for Seamless Carbon Steel Pipe for High-Temperature Service

A126-2004(R2019).....Standard Specification for Gray Iron Castings for Valves, Flanges, and Pipe Fittings

A183-2014(R2020).....Standard Specification for Carbon Steel Track Bolts and Nuts

A216/A216M-2021.....Standard Specification for Steel Castings, Carbon, Suitable for Fusion Welding, for High-Temperature Service

A307-2021.....Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60,000 PSI Tensile Strength

A193/A193M-2024.....Standard Specification for Alloy-Steel and Stainless-Steel Bolting for High Temperature or High-Pressure Service and Other Special Purpose Applications

A536-1984(R2019e1).....Standard Specification for Ductile Iron Castings

B62-2017.....Standard Specification for Composition Bronze or Ounce Metal Castings

B88-2020.....Standard Specification for Seamless Copper Water Tube

F439-2019.....Standard Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80

F441/F441M-2020.....Standard Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe, Schedules 40 and 80

D. American Welding Society (AWS):

B2.1/B2.1M-2014.....Specification for Welding Procedure and Performance Qualification

E. Expansion Joint Manufacturer's Association, Inc. (EJMA):

EJMA 2017.....Standards of the Expansion Joint Manufacturers Association, Tenth Edition

F. Manufacturers Standardization Society (MSS) of the Valve and Fitting Industry, Inc.:

SP-67-2017.....Butterfly Valves

SP-70-2011.....Gray Iron Gate Valves, Flanged and Threaded Ends

SP-71-2018.....Gray Iron Swing Check Valves, Flanged and Threaded Ends

SP-80-2019.....Bronze Gate, Globe, Angle, and Check Valves

SP-85-2011.....Gray Iron Globe and Angle Valves, Flanged and Threaded Ends

SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends

SP-125-2018.....Check Valves: Gray Iron and Ductile Iron, In-line, Spring-Loaded, Center-Guided

G. National Fire Protection Association (NFPA):

70-2023.....National Electrical Code (NEC)

H. Tubular Exchanger Manufacturers Association (TEMA):

TEMA Standards 2019.....10th Edition

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 21 13, HYDRONIC PIPING", with applicable paragraph identification.

C. Manufacturer's Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Pipe and equipment supports. Submit calculations for variable spring and constant support hangers.
2. Pipe and tubing, with specification, class or type, and schedule.
3. Pipe fittings, including miscellaneous adapters and special fittings.
4. Flanges, gaskets and bolting.
5. Couplings and fittings.
6. Valves of all types.
7. Strainers.
8. Flexible connectors for water service.
9. Pipe alignment guides.
10. Expansion joints.
11. Expansion compensators.
12. All specified hydronic system components.
13. Water flow measuring devices.

14. Gauges.
15. Thermometers and test wells.
16. Seismic bracing details for piping.

D. Manufacturer's certified data report, Form No. U-1, for ASME pressure vessels:

E. Submit the welder’s qualifications in the form of a current (less than 1-year old) and formal certificate.

F. Coordination Drawings: Refer to paragraph, SUBMITTALS of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

G. As-Built Piping Diagrams: Provide drawings as follows for chilled water, condenser water, and heating hot water system and other piping systems and equipment.
1. 1 wall-mounted stick file with complete set of prints. Mount stick file in the chiller plant or control room along with control diagram stick file.
2. 1 complete set of reproducible drawings.
3. 1 complete set of drawings in electronic AutoCAD and pdf format.

H. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replacement parts, and troubleshooting guide:
1. Include complete list indicating all components of the systems.
2. Include complete diagrams of the internal wiring for each item of equipment.
3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.

I. Completed System Readiness Checklist provided by the CxA and completed by the contractor, signed by a qualified technician, and dated on the date of completion, in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

J. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

1.5 QUALITY ASSURANCE

A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC, which includes welding qualifications.

B. Submit prior to welding of steel piping a certificate of Welder's certification. The certificate shall be current and not more than 1-year old.

C. All couplings, fittings, valves, and specialties shall be the products of a single manufacturer.

1. All castings used for coupling housings, fittings, valve bodies, etc., shall be date stamped for quality assurance and traceability.

D. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

E. Refer to Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for additional sustainable design requirements.

1.6 AS-BUILT DOCUMENTATION

A. Comply with requirements in paragraph AS-BUILT DOCUMENTATION of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

1.7 SPARE PARTS

A. For mechanical pressed sealed fittings provide tools required for each pipe size used at the facility.

PART 2 - PRODUCTS

2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES

A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

2.2 PIPE AND TUBING

A. Chilled Water, Condenser Water, Heating Hot Water, and Glycol-Water, and Vent Piping:

1. Steel: ASTM A53/A53M Grade B, seamless or ERW, Schedule 40.
2. Copper Water Tube Option: ASTM B88, Type K or L, hard drawn.

B. Extension of Domestic Water Make-up Piping: ASTM B88, Type K or L, hard drawn copper tubing.

C. Cooling Coil Condensate Drain Piping:

1. From Air Handling Units: Copper water tube, ASTM B88, Type M, or Schedule 40 PVC plastic piping. Use of PVC piping is prohibited in exterior applications.

2. From Fan Coil or Other Terminal Units: Copper water tube, ASTM B88, Type M for runouts and Type L for mains.

D. Chemical Feed Piping for Condenser Water Treatment: CPVC, Schedule 80, ASTM F441/F441M.

E. Pipe supports, including insulation shields, for aboveground piping: Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

2.3 FITTINGS FOR STEEL PIPE

A. 50 mm (2 inches) and Smaller: Screwed or welded joints.
   1. Butt Welding: ASME B16.9 with same wall thickness as connecting piping.
   2. Forged Steel, Socket Welding or Threaded: ASME B16.11.
   3. Screwed: 150-pound malleable iron, ASME B16.3. 125-pound cast-iron, ASME B16.4, may be used in lieu of malleable iron. Bushing reduction of a single pipe size, or use of close nipples, is prohibited.
   4. Unions: ASME B16.39.
   5. Water Hose Connection Adapter: Brass, pipe thread to 19 mm (3/4 inch) garden hose thread, with hose cap nut.

B. 63 mm (2-1/2 inches) and Larger: Welded or flanged joints.
   1. Butt Welding Fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.
   2. Welding Flanges and Bolting: ASME B16.5:
      a. Water Service: Weld neck or slip-on, plain face, with 3.2 mm (1/8 inch) thick full-face neoprene gasket suitable for 104 degrees C (220 degrees F).
         1) Contractor's Option: Convoluted, cold formed 150-pound steel flanges, with Teflon gaskets, may be used for water service.
      b. Flange Bolting: Alloy-steel or stainless steel bolts or studs and nuts, ASTM A193.

C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets shall be used for branch connections up to 1 pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 shall be used for drain, vent, and gauge connections.

2.4 FITTINGS FOR COPPER TUBING

A. Joints:

1. Solder Joints: Joints shall be made up in accordance with recommended practices of the materials applied. Apply 95/5 tin and antimony on all copper piping.
2. Mechanically Formed Tee Connection In Water and Drain Piping: Form mechanically extracted collars in a continuous operation by drilling pilot hole and drawing out tube surface to form collar, having a height of not less than 3 times the thickness of tube wall. Adjustable collaring device shall ensure proper tolerance and complete uniformity of the joint. Notch and dimple joining branch tube in a single process to provide free flow where the branch tube penetrates the fitting.

B. Bronze Flanges and Flanged Fittings: ASME B16.24.

C. Fittings: ASME B16.18 cast copper or ASME B16.22 solder wrought copper.

2.5 FITTINGS FOR PLASTIC PIPING

A. Schedule 40, socket type for solvent welding.

B. Schedule 40 PVC Drain Piping: Drainage pattern.

C. Chemical Feed Piping for Condenser Water Treatment: CPVC, Schedule 80, ASTM F439.

2.6 DIELECTRIC FITTINGS

A. Provide where copper tubing and ferrous metal pipe are joined.

B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.

C. 63 mm (2-1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42. Dielectric gasket material shall be compatible with hydronic medium.

D. Temperature Rating: 99 degrees C (210 degrees F).

E. Contractor's Option: On pipe sizes 50 mm (2 inch) and smaller, screwed end brass ball valves may be used in lieu of dielectric unions.

2.7 SCREWED JOINTS

A. Pipe Thread: ASME B1.20.1.

B. Lubricant or Sealant: Oil and graphite or other compound approved for the intended service.

2.8 VALVES

A. Asbestos packing is prohibited.

B. All valves of the same type shall be products of a single manufacturer.

C. Provide chain operators for valves 152 mm (6 inches) and larger when the centerline is located 2.4 m (8 feet) or more above the floor or operating platform.

D. Shut-Off Valves:

1. Ball Valves (Pipe Sizes 50 mm (2 inch) and Smaller): MSS SP-110, screwed or solder connections, brass or bronze body with chrome-plated ball with full port and Teflon seat at 2758 kPa (400 psig) working pressure rating. Provide stem extension to allow operation without interfering with pipe insulation.
2. Butterfly Valves (Pipe Sizes 63 mm (2-1/2 inch) and Larger): Provide stem extension to allow 50 mm (2 inches) of pipe insulation without interfering with valve operation. MSS SP-67, flange lug type rated 1200 kPa (175 psig) working pressure at 93 degrees C (200 degrees F). Valves shall be ANSI Leakage Class VI and rated for bubble tight shut-off to full valve pressure rating. Valve shall be rated for dead end service and bi-directional flow capability to full rated pressure. Butterfly valves are prohibited for direct buried pipe applications.
   a. Body: Cast-iron, ASTM A126, Class B. Malleable iron, ASTM A47/A47M electro-plated, or ductile iron, ASTM A536, Grade 65-45-12 electro-plated.
   b. Trim: Bronze, aluminum bronze, or 300 series stainless-steel disc, bronze bearings, 316 stainless-steel shaft and manufacturer's recommended resilient seat. Resilient seat shall be field replaceable, and fully line the body to completely isolate the body from the product. A phosphate coated steel shaft or stem is acceptable, if the stem is completely isolated from the product.
3. Gate Valves:
   a. 50 mm (2 inches) and Smaller: MSS SP-80, Bronze, 1034 kPa (150 psig), wedge disc, rising stem, union bonnet.
   b. 63 mm (2-1/2 inches) and Larger: Flanged, outside screw and yoke. MSS SP-70, iron body, bronze mounted, 860 kPa (125 psig) wedge disc.
4. Field Interchangeable Actuators: Valves for balancing service shall have adjustable memory stop to limit open position.

a. Valves 152 mm (6 inches) and Smaller: Lever actuator with minimum of seven locking positions, except where chain wheel is required.

b. Valves 203 mm (8 inches) and Larger: Enclosed worm gear with handwheel, and where required, chain-wheel operator.

E. Globe and Angle Valves:

1. Globe Valves:

a. 50 mm (2 inches) and Smaller: MSS SP-80, bronze, 1034 kPa (150 psig) Globe valves shall be union bonnet with metal plug type disc.

b. 63 mm (2-1/2 inches) and Larger: 860 kPa (125 psig), flanged, iron body, bronze trim, MSS SP-85 for globe valves.

2. Angle Valves:

a. 50 mm (2 inches) and Smaller: MSS SP-80, bronze, 1034 kPa (150 psig) Angle valves shall be union bonnet with metal plug type disc.

b. 63 mm (2-1/2 inches) and Larger: 860 kPa (125 psig), flanged, iron body, bronze trim, MSS SP-85 for angle.

F. Check Valves:

1. Swing Check Valves:

a. 50 mm (2 inches) and Smaller: MSS SP-80, bronze, 1034 kPa (150 psig), 45-degree swing disc.

b. 63 mm (2-1/2 inches) and Larger: 860 kPa (125 psig), flanged, iron body, bronze trim, MSS SP-71 for check valves.

2. Non-Slam or Silent Check Valve: Spring loaded double disc swing check or internally guided flat disc lift type check for bubble tight shut-off. Provide where check valves are shown in chilled water and hot water piping. Check valves incorporating a balancing feature may be used.

a. Body: MSS SP-125 cast-iron, ASTM A126, Class B, or steel, ASTM A216/A216M, Class WCB, or ductile iron, ASTM 536, flanged or wafer type.

b. Seat, Disc and Spring: 18-8 stainless-steel, or bronze, ASTM B62. Seats may be elastomer material.

G. Water Flow Balancing Valves: For flow regulation. Provide separate isolation valve. Valves shall be sized to provide the needed pressure drop in the middle of their throttling range.

1. Globe style valve.
2. A dual-purpose flow balancing valve and adjustable flow meter, with bronze or cast-iron body, calibrated position pointer, valved pressure taps or quick disconnects with integral check valves and preformed polyurethane insulating enclosure.
3. Provide a readout kit including flow meter, readout probes, hoses, flow charts or calculator, and carrying case.

H. Automatic Balancing Control Valves: Factory calibrated to maintain constant flow (plus or minus five percent) over system pressure fluctuations of 28 to 393 kPa (4 to 57 psig). Provide standard pressure taps and 4 sets of capacity charts. Valves shall be line size and be one of the following designs:

1. Gray iron ASTM A126 or brass body rated 1200 kPa (175 psig) at 93 degrees C (200 degrees F), with stainless-steel piston and spring.
2. Brass or ferrous body designed for 2070 kPa (300 psig) service at 121 degrees C (250 degrees F), with corrosion resistant, tamper proof, self-cleaning piston/spring assembly that is easily removable for inspection or replacement.
3. Combination assemblies containing ball type shut-off valves, unions, flow regulators, strainers with blowdown valves and pressure temperature ports shall be acceptable.
4. Provide a readout kit including flow meter, probes, hoses, flow charts and carrying case.

I. Manual Radiator/Convector Valves: Brass, packless, with position indicator.

2.9 WATER FLOW MEASURING DEVICES

A. Minimum overall accuracy plus or minus 3 percent over a range of 70 to 110 percent of design flow. Select devices for not less than 110 percent of design flow rate.

B. Venturi Type: Bronze, steel, or cast-iron with bronze throat, with valved pressure sensing taps upstream and at the throat.

C. Wafer Type Circuit Sensor: Cast-iron wafer-type flow meter equipped with readout valves to facilitate the connecting of a differential pressure meter. Each readout valve shall be fitted with an integral

check valve designed to minimize system fluid loss during the monitoring process.

D. Self-Averaging Annular Sensor Type: Brass or stainless-steel metering tube, shutoff valves and quick-coupling pressure connections. Metering tube shall be rotatable so all sensing ports may be pointed down-stream when unit is not in use.

E. Insertion Turbine Type Sensor: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

F. Flow Measuring Device Identification:

1. Metal tag attached by chain to the device.
2. Include meter or equipment number, manufacturer's name, meter model, flow rate factor and design flow rate in gpm.

G. Portable Water Flow Indicating Meters:

1. Minimum 152 mm (6 inch) diameter dial, forged brass body, beryllium-copper bellows designed for 1200 kPa (175 psig) working pressure at 121 degrees C (250 degrees F).
2. Bleed and equalizing valves.
3. Vent and drain hose and two 3 m (10 feet) lengths of hose with quick disconnect connections.
4. Factory-fabricated carrying case with hose compartment and a bound set of capacity curves showing flow rate versus pressure differential.
5. Provide 1 portable meter for each range of differential pressure required for the installed flow devices.

H. Permanently Mounted Water Flow Indicating Meters: Minimum 152 mm (6 inch) diameter, or 457 mm (18 inch) long scale, for 120 percent of design flow rate, direct reading in gpm, with 3 valve manifold and 2 shut-off valves.

2.10 STRAINERS

A. Y Type.

1. Screens: Bronze, Monel metal or 18-8 stainless-steel, free area not less than 2-1/2 times pipe area, with perforations as follows: 1.1 mm (0.045 inch) diameter perforations for 100 mm (4 inches) and larger: 3.2 mm (1/8 inch) diameter perforations.

B. Suction Diffusers: Specified in Section 23 21 23, HYDRONIC PUMPS.

2.11 FLEXIBLE CONNECTORS FOR WATER SERVICE

A. Flanged Spool Connector:

1. Single arch or multiple arch type. Tube and cover shall be constructed of chlorobutyl elastomer with full faced integral flanges to provide a tight seal without gaskets. Connectors shall be internally reinforced with high strength synthetic fibers impregnated with rubber or synthetic compounds as recommended by connector manufacturer, and steel reinforcing rings.
2. Working pressures and temperatures shall be as follows:
   a. Connector sizes 50 mm to 100 mm (2 inches to 4 inches), 1137 kPa (165 psig) at 121 degrees C (250 degrees F).
   b. Connector sizes 127 mm to 305 mm (5 inches to 12 inches), 965 kPa (140 psig) at 121 degrees C (250 degrees F).
3. Provide ductile iron retaining rings and control units.

B. Braided Hose: Corrugated-metal inner hose and braided outer shell.

1. Piping Up To 50 mm (2 inches): Bronze hoses and single-braid bronze sheaths with 3102 kPa at 21 degrees C (450 psig at 70 degrees F) and 2344 kPa at 232 degrees C (340 psig at 450 degrees F) ratings.
2. Piping From 65 mm (2-1/2 inches) To 100 mm (4 inches): Stainless-steel hoses and single-braid, stainless-steel sheaths with 2070 kPa at 21 degrees C (300 psig at 70 degrees F) and 1550 kPa at 232 degrees C (225 psig at 450 degrees F) ratings.
3. Piping From 150 mm (6 inches) and Above: Stainless-steel hoses and single-braid, stainless-steel sheaths with 1380 kPa at 21 degrees C (200 psig at 70 degrees F) and 1000 kPa at 315 degrees C (145 psig at 600 degrees F) ratings.

2.12 EXPANSION JOINTS

A. Factory built devices, inserted in the pipe lines, designed to absorb axial cyclical pipe movement which results from thermal expansion and contraction. This includes factory-built or field-fabricated guides located along the pipe lines to restrain lateral pipe motion and direct the axial pipe movement into the expansion joints.

B. Manufacturing Quality Assurance: Conform to Expansion Joints Manufacturers Association (EJMA) Standards.

C. Bellows - Internally Pressurized Type:

1. Multiple corrugations of Type 304 or Type A240-321 stainless-steel.

2. Internal stainless-steel sleeve entire length of bellows.
3. External cast-iron equalizing rings for services exceeding 345 kPa (50 psig).
4. Welded ends.
5. Design shall conform to standards of EJMA and ASME B31.9.
6. External tie rods designed to withstand pressure thrust force upon anchor failure if one or both anchors for the joint are at change in direction of pipeline.
7. Integral external cover.

D. Bellows – Externally Pressurized Type:
1. Multiple corrugations of Type 304 stainless-steel.
2. Internal and external guide integral with joint.
3. Design for external pressurization of bellows to eliminate squirm.
4. Welded ends.
5. Conform to the standards of EJMA and ASME B31.9.
6. Threaded connection at bottom, 25 mm (1 inch) minimum, for drain or drip point.
7. Integral external cover and internal sleeve.

E. Expansion Compensators:
1. Corrugated bellows, externally pressurized, stainless-steel or bronze.
2. Internal guides and anti-torque devices.
3. Threaded ends.
4. External shroud.
5. Conform to standards of EJMA.

F. Expansion Joint (Contractor’s Option): 2413 kPa (350 psig) maximum working pressure, steel pipe fitting consisting of telescoping body and slip-pipe sections, PTFE modified polyphenylene sulfide coated slide section, with welded or flanged ends, suitable for axial end movement to 75 mm (3 inch).

G. Expansion Joint Identification: Provide stamped brass or stainless-steel nameplate on each expansion joint listing the manufacturer, the allowable movement, flow direction, design pressure and temperature, date of manufacture, and identifying the expansion joint by the identification number in the contract documents.

H. Guides: Provide factory-built guides along the pipe line to permit axial movement only and to restrain lateral and angular movement. Guides shall be designed to withstand a minimum of 15 percent of the axial force which will be imposed on the expansion joints and anchors. Field-built guides shall be used if detailed in the contract documents.

I. Supports: Provide saddle supports and frame or hangers for heat exchanger. Mounting height shall be adjusted to facilitate gravity return of steam condensate. Construct supports from steel, weld joints.

2.13 HYDRONIC SYSTEM COMPONENTS (NOT USED)

2.14 WATER FILTERS AND POT CHEMICAL FEEDERS (NOT USED)

2.15 GAUGES, PRESSURE AND COMPOUND

A. ASME B40.100, Accuracy Grade 1A, (pressure, vacuum, or compound for air, oil or water), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 114 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT bottom connection, white dial with black graduations and pointer, clear glass or acrylic plastic window, suitable for board mounting. Provide red "set hand" to indicate normal working pressure.

B. Provide brass lever handle union cock. Provide brass/bronze pressure snubber for gauges in water service.

C. Range of Gauges: Provide range equal to at least 130 percent of normal operating range.

1. For Condenser Water Suction (Compound): 101 kPa (29.5 inches Hg) to 689 kPa (100 psig).

2.16 PRESSURE/TEMPERATURE TEST PROVISIONS

A. Pete's Plug: 6 mm (1/4 inch) MPT by 75 mm (3 inches) long, brass body and cap, with retained safety cap, Nordel self-closing valve cores, permanently installed in piping where shown, or in lieu of pressure gauge test connections shown in the contract documents.

B. Provide one each of the following test items to the COR:

1. 6 mm (1/4 inch) FPT by 3.2 mm (1/8 inch) diameter stainless-steel pressure gauge adapter probe for extra-long test plug.
2. 89 mm (3-1/2 inch) diameter, one percent accuracy, compound gauge, 101 kPa (29.5 inches Hg) to 689 kPa (100 psig) range.

3. 0 to 104 degrees C (32 to 220 degrees F) pocket thermometer 1/2-degree accuracy, 25 mm (1 inch) dial, 127 mm (5 inch) long stainless-steel stem, plastic case.

2.17 THERMOMETERS

A. Mercury or organic liquid filled type, red or blue column, clear plastic window, with 152 mm (6 inch) brass stem, straight, fixed or adjustable angle as required for each in reading.

B. Case: Chrome plated brass or aluminum with enamel finish.

C. Scale: Not less than 228 mm (9 inches), range as described below, 2-degree graduations.

D. Separable Socket (Well): Brass, extension neck type to clear pipe insulation.

E. Scale Ranges:

1. Chilled Water and Glycol-Water: 0 to 38 degrees C (32 to 100 degrees F).
2. Hot Water and Glycol-Water: 38 to 93 degrees C (100 to 200 degrees F).

2.18 FIRESTOPPING MATERIAL

A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

2.19 ELECTRICAL HEAT TRACING SYSTEMS (NOT USED)

PART 3 - EXECUTION

3.1 INSTALLATION

A. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or time to the Government.

B. The contract documents show the general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to connect pipes to equipment, fan-coils, coils, radiators, etc., and to coordinate with other trades. Provide all necessary fittings, offsets and pipe runs based on field measurements and at no additional cost or time to the Government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be connected on ceiling grid. Pipe location in the contract documents shall be altered by contractor where necessary to avoid interferences and clearance difficulties.

C. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.

D. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Install heat exchangers at height sufficient to provide gravity flow of condensate to the flash tank and condensate pump.

E. Install piping generally parallel to walls and column center lines, unless shown otherwise in the contract documents. Space piping, including insulation, to provide 25 mm (1 inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope drain piping down in the direction of flow not less than 25 mm (1 inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.

F. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally, locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown in the contract documents. Install butterfly valves with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.

G. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where noted in the contract documents.

H. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.

I. Provide manual or automatic air vent at all piping system high points and drain valves at all low points. Install piping to floor drains from all automatic air vents.

J. Connect piping to equipment as shown in the contract documents. Install components furnished by others such as:

   1. Water treatment pot feeders and condenser water treatment systems.
   2. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.

K. Thermometer Wells: In pipes 63 mm (2-1/2 inches) and smaller increase the pipe size to provide free area equal to the upstream pipe area.

L. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC AND BOILER PLANT INSULATION.

M. Where copper piping is connected to steel piping, provide dielectric connections.

3.2 PIPE JOINTS

A. Welded: Beveling, spacing and other details shall conform to ASME B31.9 and AWS B2.1/B2.1M. See Welder's qualification requirements in paragraph QUALITY ASSURANCE of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

B. Screwed: Threads shall conform to ASME B1.20.1; joint compound shall be applied to male threads only and joints made up so no more than 3 threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.

C. 125 Pound Cast-Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast-iron flange.

D. Solvent Welded Joints: As recommended by the manufacturer.

3.3 EXPANSION JOINTS (BELLOWS AND SLIP TYPE)

A. Anchors and Guides: Provide type, quantity and spacing as recommended by manufacturer of expansion joint and as shown. A professional engineer shall verify in writing that anchors and guides are properly designed for forces and moments which will be imposed.

B. Cold Set: Provide setting of joint travel at installation as recommended by the manufacturer for the ambient temperature during the installation.

C. Preparation for Service: Remove all apparatus provided to restrain joint during shipping or installation. Representative of manufacturer shall visit the site and verify that installation is proper.

D. Access: Expansion joints shall be located in readily accessible space. Locate joints to permit access without removing piping or other devices. Allow clear space to permit replacement of joints and to permit access to devices for inspection of all surfaces and for adding.

3.4 SEISMIC BRACING ABOVEGROUND PIPING

A. Provide in accordance with Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

3.5 LEAK TESTING ABOVEGROUND PIPING

A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary, to the satisfaction of the COR. Tests shall be either of those below, or a combination, as approved by the COR.

B. An operating test at design pressure, and for hot systems, design maximum temperature.

C. A hydrostatic test at 1.5 times design pressure. For water systems, the design maximum pressure would usually be the static head, or expansion tank maximum pressure, plus pump head. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Isolate equipment where necessary to avoid excessive pressure on mechanical seals and safety devices.

3.6 FLUSHING AND CLEANING PIPING SYSTEMS

A. Water Piping: Clean systems as recommended by the suppliers of chemicals specified in Section 23 25 00, HVAC WATER TREATMENT.

B. Initial Flushing: Remove loose dirt, mill scale, metal chips, weld beads, rust, and like deleterious substances without damage to any system component. Provide temporary piping or hose to bypass coils, control valves, exchangers and other factory cleaned equipment unless acceptable means of protection are provided and subsequent inspection of hide-out areas takes place. Isolate or protect clean system components, including pumps and pressure vessels, and remove any component which may be damaged. Open all valves, drains, vents and strainers at all system levels. Remove plugs, caps, spool pieces, and components to facilitate early debris discharge from system. Sectionalize system to obtain debris carrying velocity of 1.8 m/s (5.9 f/s), if possible. Connect dead-end supply and return headers as necessary. Flush bottoms of risers. Install temporary strainers where necessary to protect down-stream equipment. Supply and remove flushing water and drainage by various type hose, temporary and permanent piping and Contractor's booster pumps. Flush until clean as approved by the COR.

C. Cleaning: Using products supplied in Section 23 25 00, HVAC WATER TREATMENT, circulate systems at normal temperature to remove adherent organic soil, hydrocarbons, flux, pipe mill varnish, pipe joint compounds, iron oxide, and like deleterious substances not removed by flushing, without chemical or mechanical damage to any system component. Removal of tightly adherent mill scale is not required. Keep isolated equipment which is "clean" and where dead-end debris accumulation cannot occur. Sectionalize system if possible, to circulate at velocities not less than 1.8 m/s (5.9 f/s). Circulate each section for not less than 4 hours. Blow-down all strainers or remove and clean as frequently as necessary. Drain and prepare for final flushing.

D. Final Flushing: Return systems to conditions required by initial flushing after all cleaning solution has been displaced by clean make-up. Flush all dead ends and isolated clean equipment. Gently operate all valves to dislodge any debris in valve body by throttling velocity. Flush for not less than one hour.

3.7 WATER TREATMENT (NOT USED)

3.8 ELECTRIC HEAT TRACING (NOT USED)

3.9 STARTUP AND TESTING

A. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.

B. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

C. The CxA will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with COR and CxA. Provide a minimum notice of 10 working days prior to startup and testing.

D. Adjust red set hand on pressure gauges to normal working pressure.

3.10 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.11 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer's technical representative for 4 hours to instruct each VA personnel responsible in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS

- - - E N D - - -

SECTION 23 22 13
STEAM AND CONDENSATE HEATING PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

A. Steam, condensate, and vent piping inside buildings.

B. Boiler plant and outside steam distribution piping is covered in specification Section 33 63 00, STEAM ENERGY DISTRIBUTION and Section 23 21 11, BOILER PLANT PIPING SYSTEMS.

C. A complete listing of common acronyms and abbreviations are included in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

E. Section 09 91 00, PAINTING.

F. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

G. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

H. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.

I. Section 23 07 11, HVAC AND BOILER PLANT INSULATION.

J. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

K. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standards shall govern.

B. American Society of Mechanical Engineers (ASME):

B1.20.1-2013.....Pipe Threads, General Purpose (Inch)

B16.5-2020.....Pipe Flanges and Flanged Fittings: NPS 1/2 through NPS 24 Metric/Inch Standard

B16.9-2018.....Factory Made Wrought Buttwelding Fittings

B16.11-2016.....Forged Fittings, Socket-Welding and Threaded

B16.42-2016.....Ductile Iron Pipe Flanges and Flanged Fittings: Classes 150 and 300

B31.1-2020.....Power Piping

B31.9-2020.....Building Services Piping

B40.100-2013.....Pressure Gauges and Gauge Attachments

ASME Boiler and Pressure Vessel Code (BPVC) -

BPVC Section II-2021 Materials

BPVC Section VIII-2021 Rules for Construction of Pressure Vessels, Division 1

BPVC Section IX-2021Welding, Brazing, and Fusing Qualifications

C. American Society for Testing and Materials (ASTM):

A53/A53M-2020.....Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless

A106/A106M-2019a.....Standard Specification for Seamless Carbon Steel Pipe for High-Temperature Service

A216/A216M-2018.....Standard Specification for Steel Castings, Carbon, Suitable for Fusion Welding, for High-Temperature Service

A285/A285M-2017.....Standard Specification for Pressure Vessel Plates, Carbon Steel, Low-and Intermediate-Tensile Strength

A307-2014e1.....Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60,000 PSI Tensile Strength

A193/A193M-2024.....Standard Specification for Alloy-Steel and Stainless-Steel Bolting for High Temperature or High-Pressure Service and Other Special Purpose Applications

A516/A516M-2017.....Standard Specification for Pressure Vessel Plates, Carbon Steel, for Moderate- and Lower-Temperature Service

A536-1984(2019)e1.....Standard Specification for Ductile Iron Castings

B62-2017.....Standard Specification for Composition Bronze or Ounce Metal Castings

D. American Welding Society (AWS):

B2.1/B2.1M-2014.....Specification for Welding Procedure and Performance Qualifications

Z49.1-2012.....Safety in Welding and Cutting and Allied Processes

E. Manufacturers Standardization Society (MSS) of the Valve and Fitting Industry, Inc.:

SP-80-2019.....Bronze Gate, Globe, Angle, and Check Valves

F. Military Specifications (Mil. Spec.):

MIL-DTL-901E-2017.....Shock Tests, H.I. (High Impact) Shipboard Machinery, Equipment, and Systems

G. National Board of Boiler and Pressure Vessel Inspectors (NB):

Relieving Capacities of Safety Valves and Relief Valves

H. Tubular Exchanger Manufacturers Association (TEMA):

TEMA Standards-2019.....10th Edition

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 22 13, STEAM AND CONDENSATE HEATING PIPING", with applicable paragraph identification.

C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Pipe and equipment supports. Submit calculations for variable spring and constant support hangers.
2. Pipe and tubing, with specification, class or type, and schedule.
3. Pipe fittings, including miscellaneous adapters and special fittings.
4. Flanges, gaskets and bolting.
5. Valves of all types.
6. Steam traps.
7. Steam trap monitoring system.
8. Strainers.

9. Pipe alignment guides.
10. Expansion joints.
11. Expansion compensators.
12. Flexible ball joints: Catalog sheets, performance charts, schematic drawings, specifications and installation instructions.
13. All specified steam system components.
14. Gauges.
15. Thermometers and test wells.
16. Seismic bracing details for piping.

D. Manufacturer's certified data report, Form No. U-1, for ASME pressure vessels:

1. Flash tanks.

E. Coordination Drawings: Refer to paragraph, SUBMITTALS of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

F. As-Built Piping Diagrams: Provide drawing as follows for steam and steam condensate piping and other central plant equipment.
1. One wall-mounted stick file for prints. Mount stick file in the chiller plant or adjacent control room along with control diagram stick file.
2. One set of reproducible drawings.

G. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replacement parts, and troubleshooting guide:
1. Include complete list indicating all components of the systems.
2. Include complete diagrams of the internal wiring for each item of equipment.
3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.

H. Completed System Readiness Checklist provided by the CxA and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

I. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

1.5 QUALITY ASSURANCE

A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC, which includes welding qualifications.

B. The products and execution of work specified in this section shall conform to the referenced codes and standards as required by the specifications. Local codes and amendments shall be enforced, along with requirements of local utility companies. The most stringent requirements of these specifications, local codes, or utility company requirements shall always apply. Any conflicts shall be brought to the attention of the COR.

C. Welding Qualifications: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:

1. Qualify welding processes and operators for piping according to ASME BPVC Section IX, AWS Z49.1 and AWS B2.1/B2.1M.
2. Comply with provisions in ASME B31.9 and ASME B31.1.
3. Certify that each welder and welding operator has passed AWS qualification tests for welding processes involved and that certification is current and recent. Submit documentation to the COR.
4. All welds shall be stamped according to the provisions of the American Welding Society.

D. ASME Compliance: Comply with ASME B31.9 and ASME B31.1 for materials, products, and installation. Safety valves and pressure vessels shall bear appropriate ASME labels.

1.6 AS-BUILT DOCUMENTATION

A. Submit manufacturer’s literature and data updated to include submittal review comments and any equipment substitutions.

B. Submit operation and maintenance data updated to include submittal review comments, VA approved substitutions and construction revisions shall be in electronic version on CD or DVD inserted into a three-ring binder. All aspects of system operation and maintenance procedures, including applicable piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include

troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement. Provide record drawings as follows:
   1. As-built drawings are to be provided, with a copy of them in three-dimensional Building Information Modeling (BIM) software version 2023 provided on CD or DVD.

D. The as-built drawings shall indicate the location and type of all lockout/tagout points for all energy sources for all equipment and pumps to include breaker location and numbers, valve tag numbers, etc. Coordinate lockout/tagout procedures and practices with local VA requirements.

E. Certification documentation shall be provided to COR 21 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and provide documentation/certification that all results of tests were within limits specified. Test results shall contain written sequence of test procedure with written test results annotated at each step along with the expected outcome or setpoint. The results shall include all readings, including but not limited to data on device (make, model and performance characteristics), normal pressures, switch ranges, trip points, amp readings, and calibration data to include equipment serial numbers or individual identifications, etc.

PART 2 - PRODUCTS

2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES

A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

2.2 PIPE AND TUBING

A. Steam Piping: Steel, ASTM A53/A53M, Grade B, seamless or ERW; ASTM A106/A106M Grade B, seamless; Schedule 40.

B. Steam Condensate and Pumped Condensate Piping: Steel, ASTM A53/A53M, Grade B, seamless or ERW; or ASTM A106/A106M Grade B, seamless, Schedule 80.

C. Vent Piping: Steel, ASTM A53/A53M, Grade B, seamless or ERW; ASTM A106/A106M Grade B, seamless; Schedule 40, galvanized.

2.3 FITTINGS FOR STEEL PIPE

A. 50 mm (2 inches) and Smaller: Screwed or welded.

1. Cast iron fittings or piping is prohibited for steam and steam condensate piping. Bushing reduction or use of close nipples is prohibited.
2. Forged steel, socket welding or threaded: ASME B16.11, 13,790 kPa (2000 psig) class with ASME B1.20.1 threads. Use Schedule 80 pipe and fittings for threaded joints. Lubricant or sealant shall be oil and graphite, or other compound approved for the intended service.
3. Unions: Forged steel, 13,790 kPa (2000 psig) class or 20,685 kPa (3000 psig) class on piping 50 mm (2 inches) and less.
4. Steam line drip station and strainer quick-couple blowdown hose connection: Straight through, plug and socket, screw or cam locking type for 15 mm (1/2 inch) ID hose. No integral shut-off is required.

B. 65 mm (2-1/2 inches) and Larger: Welded or flanged joints.

1. Cast iron fittings or piping is prohibited for steam and steam condensate piping.
2. Butt welding fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.
3. Welding flanges and bolting: ASME B16.5:
   a. Steam service: Weld neck or slip-on, raised face, with non-asbestos gasket. Non-asbestos gasket shall either be stainless steel spiral wound strip with flexible graphite filler or

compressed inorganic fiber with nitrile binder rated for saturated and superheated steam service 400 degrees C (750 degrees F) and 10,342 kPa (1500 psig).

b. Flange bolting: Alloy-steel or stainless steel bolts or studs and nuts, ASTM A193.

C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets may be used for branch connections up to one pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 may be used for drain, vent and gauge connections.

2.4 DIELECTRIC FITTINGS

A. Provide where dissimilar metal pipe are joined.

B. 50 mm (2 inches) and Smaller: Threaded dielectric union.

C. 65 mm (2-1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42.

D. Temperature Rating, 121 degrees C (250 degrees F) for steam condensate and as required for steam service.

E. Contractor's option: On pipe sizes 50 mm (2 inches) and smaller, screwed end steel gate valves may be used in lieu of dielectric unions.

2.5 VALVES

A. Asbestos packing is prohibited.

B. All valves of the same type shall be products of a single manufacturer.

C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2.1 meter (7 feet) or greater above the floor or operating platform.

D. Shut-Off Valves:

1. Ball Valves:

a. 50 mm (2 inches) and smaller: Forged steel body, rated for 1380 kPa (200 psig) saturated steam, 2758 kPa (400 psig) WOG, bronze wedges and Monel or stainless-steel seats, threaded ends, rising stem, and union bonnet.

b. 65 mm (2-1/2 inches) and larger: Flanged, outside screw and yoke.

1) High pressure steam 110 kPa (16 psig) and above system: Cast steel body, ASTM A216/A216M grade WCB, 1035 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel solid disc and seats. Provide 25 mm (1 inch)

factory installed bypass with globe valve on valves 100 mm (4 inches) and larger.

2) All other services: Forged steel body, Class B, rated for 850 kPa (123 psig) saturated steam, 1380 kPa (200 psig) WOG, bronze or bronze face wedge and seats, 850 kPa (123 psig) ASME flanged ends, OS&Y, rising stem, bolted bonnet, and renewable seat rings.

E. Ball Valves: Reduced port permitted for bypass (throttling) service; full port required for all other services, one-fourth turn to open.

1. Type 501: Type 316 stainless steel body, ball and stem, rated for 1034 kPa at 185 degrees C (150 psig at 365 degrees F), 4137 kPa at 93 degrees C (600 psig at 200 degrees F); reinforced TFE seat, stem seal and thrust washer; end entry, threaded ends.
2. Type 502: Steel body, rated for 1034 kPa at 185 degrees C (150 psig at 365 degrees F), 1724 kPa at 121 degrees C (250 psig at 250 degrees F), reinforced TFE seat, stem seal and thrust washer; end entry, threaded ends, UL-listed for natural or LP gas shut off service when used on those services.
3. Type 503: Carbon steel body, steam service, rated for 1380 kPa at 200 degrees C (200 psig at 392 degrees F), stainless steel ball and stem, Polyfil seat, live-loaded or adjustable stem seal, threaded ends.

F. Globe and Angle Valves:

1. Globe Valves:
   a. 50 mm (2 inches) and smaller: Forged steel body, rated for 1380 kPa (200 psig) saturated steam, 2758 kPa (400 psig) WOG, hardened stainless steel disc and seat, threaded ends, rising stem, union bonnet, and renewable seat rings.
   b. 65 mm (2-1/2 inches) and larger:
      1) Globe valves for high pressure steam 110 kPa (16 psig): Cast steel body, ASTM A216/A216M grade WCB, flanged, OS&Y, 1035 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
      2) All other services: Steel body, rated for 850 kPa (123 psig) saturated steam, 1380 kPa (200 psig) WOG, bronze or bronze-faced disc (Teflon or composition facing permitted) and seat,

850 kPa (123 psig) ASME flanged ends, OS&Y, rising stem, bolted bonnet, and renewable seat rings.

2. Angle Valves:
   a. 50 mm (2 inches) and smaller: Cast steel 1035 kPa (150 psig), union bonnet with metal plug type disc.
   b. 65 mm (2-1/2 inches) and larger:
      1) Angle valves for high pressure steam 110 kPa (16 psig): Cast steel body, ASTM A216/A216M grade WCB, flanged, OS&Y, 1035 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
      2) All other services: 861 kPa (125 psig), flanged, cast steel body, and bronze trim.

G. Swing Check Valves:
   1. 50 mm (2 inches) and smaller: Cast steel, 1035 kPa (150 psig), 45-degree swing disc.
   2. 65 mm (2-1/2 inches) and Larger:
      a. Check valves for high pressure steam 110 kPa (16 psig) and above system: Cast steel body, ASTM A216/A216M grade WCB, flanged, OS&Y, 1035 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
      b. All other services: 861 kPa (125 psig), flanged, cast steel body, and bronze trim.

H. Manual Radiator/Convector Valves: Brass, packless, with position indicator.

2.6 STRAINERS

A. Basket or Y Type. Tee type is acceptable for gravity flow and pumped steam condensate service.

B. High Pressure Steam: Rated 1035 kPa (150 psig) saturated steam.
   1. 50 mm (2 inches) and smaller: Cast steel, rated for saturated steam at 1034 kPa (150 psig) threaded ends.
   2. 65 mm (2-1/2 inches) and larger: Cast steel rated for 1034 kPa (150 psig) saturated steam with 1034 kPa (150 psig) ASME flanged ends or forged steel with 1724 kPa (250 psig) ASME flanged ends.

C. All Other Services: Rated 861 kPa (125 psig) saturated steam.
   1. 50 mm (2 inches) and smaller: Cast steel body.

2. 65 mm (2-1/2 inches) and larger: Flanged, cast steel body.

D. Screens: Bronze, Monel metal or 18-8 stainless steel, free area not less than 2-1/2 times pipe area, with perforations as follows:
   1. 75 mm (3 inches) and smaller: 20 mesh for steam and 1.1 mm (0.045 inch) diameter perforations for liquids.
   2. 100 mm (4 inches) and larger: 1.1 mm (0.045) inch diameter perforations for steam and 3.2 mm (1/8 inch) diameter perforations for liquids.

2.7 PIPE ALIGNMENT

A. Guides: Provide factory-built guides along the pipe line to permit axial movement only and to restrain lateral and angular movement. Guides shall be designed to withstand a minimum of 15 percent of the axial force which will be imposed on the expansion joints and anchors. Field-built guides may be used if detailed in the contract documents.

2.8 EXPANSION JOINTS

A. Factory built devices, inserted in the pipe lines, designed to absorb axial cyclical pipe movement which results from thermal expansion and contraction. This includes factory-built or field-fabricated guides located along the pipe lines to restrain lateral pipe motion and direct the axial pipe movement into the expansion joints.

B. Minimum Service Requirements:
   1. Pressure Containment:
      a. Steam Service 35-200 kPa (5-29 psig): Rated 345 kPa (50 psig) at 148 degrees C (298 degrees F).
      b. Steam Service 214-850 kPa (31-123 psig): Rated 1035 kPa (150 psig) at 186 degrees C (366 degrees F).
      c. Steam Service 869-1035 kPa (126-150 psig): Rated 1380 kPa (200 psig) at 194 degrees C (381 degrees F).
      d. Condensate Service: Rated 690 kPa (100 psig) at 154 degrees C (309 degrees F).
   2. Number of Full Reverse Cycles without failure: Minimum 1000.
   3. Movement: As shown on contract documents plus recommended safety factor of manufacturer.

C. Manufacturing Quality Assurance: Conform to Expansion Joints Manufacturers Association Standards.

D. Bellows - Internally Pressurized Type:
   1. Multiple corrugations of Type 304 or Type A240-321 stainless steel.
   2. Internal stainless-steel sleeve entire length of bellows.
   3. External cast iron equalizing rings for services exceeding 345 kPa (50 psig).
   4. Welded ends.
   5. Design shall conform to standards of EJMA and ASME B31.1.
   6. External tie rods designed to withstand pressure thrust force upon anchor failure if one or both anchors for the joint are at change in direction of pipeline.
   7. Integral external cover.

E. Bellows - Externally Pressurized Type:
   1. Multiple corrugations of Type 304 stainless steel.
   2. Internal and external guide integral with joint.
   3. Design for external pressurization of bellows to eliminate squirm.
   4. Welded ends.
   5. Conform to the standards of EJMA and ASME B31.1.
   6. Threaded connection at bottom, 25 mm (1 inch) minimum, for drain or drip point.
   7. Integral external cover and internal sleeve.

F. Expansion Joint Identification: Provide stamped brass or stainless-steel nameplate on each expansion joint listing the manufacturer, the allowable movement, flow direction, design pressure and temperature, date of manufacture, and identifying the expansion joint by the identification number in the contract documents.

2.9 FLEXIBLE BALL JOINTS

A. Design and Fabrication: One-piece component construction, fabricated from steel with welded ends, designed for a working steam pressure of 1725 kPa (250 psig) and a temperature of 232 degrees C (450 degrees F). Each joint shall provide for 360 degrees rotation in addition to a minimum angular flexible movement of 30 degrees for sizes 6 mm (1/4 inch) to 150 mm (6 inch) inclusive, and 15 degrees for sizes 65 mm (2-1/2 inches) to 762 mm (30 inches). Joints through 355 mm (14 inches) shall have forged pressure retaining members, while size 406 mm (16 inches) through 762 mm (30 inches) shall be of one-piece construction.

B. Material:

1. Cast or forged steel pressure containing parts and bolting in accordance with ASME BPVC Section II or ASME B31.1. Retainer may be ductile iron ASTM A536, Grade 65-45-12, or ASME BPVC Section II SA 515, Grade 70.
2. Gaskets: Steam pressure molded composition design for a temperature range of from minus 10 degrees C (50 degrees F) to plus 274 degrees C (525 degrees F).

C. Certificates: Submit qualifications of ball joints in accordance with the following test data:

1. Low pressure leakage test: 41 kPa (6 psig) saturated steam for 60 days.
2. Flex cycling: 800 Flex cycles at 3447 kPa (500 psig) saturated steam.
3. Thermal cycling: 100 saturated steam pressure cycles from atmospheric pressure to operating pressure and back to atmospheric pressure.
4. Environmental shock tests: Forward certificate from a recognized test laboratory, that ball joints of the type submitted has passed shock testing in accordance with Mil. Spec MIL-S-901.
5. Vibration: 170 hours on each of three mutually perpendicular axes at 25 to 125 Hz; 1.3 mm to 2.5 mm (0.05 inch to 0.10 inch) double amplitude on a single ball joint and 3 ball joint off set.

2.10 STEAM SYSTEM COMPONENTS

A. Heat Exchanger (Steam to Hot Water): Shell and tube type, U-bend removable tube bundle, steam in shell, water in tubes, equipped with support cradles.

1. Maximum tube velocity: 2.3 meter/second (7.5 feet/second).
2. Tube fouling factor: TEMA Standards, but not less than 0.00018 square meters K/W (0.001 square foot/hour degrees F/Btu).
3. Materials:
   a. Shell: Steel.
   b. Tube sheet and tube supports: Steel or brass.
   c. Tubes: 20 mm (3/4 inch) OD copper.
   d. Head or bonnet: Steel.

4. Construction: In accordance with ASME Pressure Vessel Code for 861 kPa (125 psig) working pressure for shell and tubes. Provide manufacturer's certified data report, Form No. U-1.

B. Optional Heat Transfer Package: In lieu of field erected individual components, the Contractor may provide a factory or shop assembled package of heat exchangers, pumps, and other components, pre-piped and pre-wired and supported on a welded steel frame or skid.

C. Steam Pressure Reducing Valves in PRV Stations:

1. Type: Single-seated, diaphragm operated, spring-loaded, external or internal steam pilot-controlled, normally closed, adjustable set pressure. Pilot shall sense controlled pressure downstream of main valve.
2. Service: Provide controlled reduced pressure to steam piping systems.
3. Pressure control shall be smooth and continuous with maximum drop of 10 percent deviation from set pressure. Maximum flow capacity of each valve shall not exceed capacity of downstream safety valve(s).
4. Main valve and pilot valve shall have replaceable valve plug and seat of stainless steel, Monel, or similar durable material.
   a. Pressure rating for high pressure steam: Not less than 1035 kPa (150 psig) saturated steam.
   b. Connections: Flanged for valves 65 mm (2-1/2 inches) and larger; flanged or threaded ends for smaller valves.
5. Select pressure reducing valves to develop less than 85 dBA at 1.5-meter (5 feet) elevation above adjacent floor, and 1.5 meter (5 feet) distance in any direction. Inlet and outlet piping for steam pressure reducing valves shall be Schedule 80 minimum for required distance to achieve required levels or sound attenuators shall be applied.

D. Safety Valves and Accessories: Comply with ASME BPVC Section VIII. Capacities shall be certified by National Board of Boiler and Pressure Vessel Inspectors, maximum accumulation 10 percent. Provide lifting lever. Provide drip pan elbow where shown. Valve shall have stainless steel seats and trim.

E. Steam PRV for Individual Equipment: Cast steel body, screwed or flanged ends, rated 861 kPa (125 psig), or 20 percent above the working

pressure, whichever is greater. Single-seated, diaphragm operated, spring loaded, adjustable range, all parts renewable.

F. Moisture Separator: Shall be of the high efficiency internal baffle type, with a pressure drop that does not exceed an equivalent length of straight pipe. Body shall be iron, steel or cast steel with screwed, socket weld or flanged connections as detailed on drawing schedule. Steel construction shall be in accordance with Section VIII, Division 1 of the ASME Boiler and Pressure Vessel Code with ASME Class 150, 300 or 600 RF flange connections. A bottom drain connection shall be provided for the installation of a trap to discharge any accumulated liquid. Separators shall be installed before steam PRV and Control Valves.

G. Flash Tanks: Horizontal or vertical vortex type, constructed of copper bearing steel, ASTM A516/A516M or ASTM A285/A285M, for a steam working pressure of 861 kPa (125 psig) to comply with ASME Code for Unfired Pressure Vessels and stamped with "U" symbol. Perforated pipe inside tank shall be ASTM A53/A53M Grade B, seamless or ERW, or ASTM A106/A106M Grade B seamless, Schedule 80. Corrosion allowance of 1.6 mm (1/16 inch) may be provided in lieu of the copper bearing requirement. Provide data Form No. U-1.

H. Steam Trap: Each type of trap shall be the product of a single manufacturer. Provide trap sets at all low points and at 61 meter (200 feet) intervals on the horizontal main lines.

1. Floats and linkages shall provide sufficient force to open trap valve over full operating pressure range available to the system. Unless otherwise indicated in the contract documents, traps shall be sized for capacities indicated at minimum pressure drop as follows:
   a. For equipment with modulating control valve: 1.7 kPa (1/4 psig), based on a condensate leg of 300 mm (12 inches) at the trap inlet and gravity flow to the receiver.
   b. For main line drip trap sets and other trap sets at steam pressure: Up to 70 percent of design differential pressure. Condensate may be lifted to the return line.
2. Trap bodies: Steel and stainless-steel, constructed to permit ease of removal and servicing working parts without disturbing connecting piping. The use of raised face flange is required on pipe sizes 1-1/2 inch and greater. The use of unions is acceptable for pipe sizes

less than 1—1/2 inches. For systems without relief valve traps shall be rated for the pressure upstream of the steam supplying the system.

3. Balanced pressure thermostatic elements: Phosphor bronze, stainless steel or Monel metal.
4. Valves and seats: Suitable hardened corrosion resistant alloy.
5. Mechanism: Brass, stainless steel or corrosion resistant alloy.
6. Floats: Stainless steel.
7. Inverted bucket traps: Provide bi-metallic thermostatic element for rapid release of non-condensables.
8. Thermodynamic steam traps: Shall have tight shut-off with no steam loss allowed either by bleed or "controlled leak" and shall have an integral seat design with hardened disc and seating surfaces. Thermodynamic traps for steam pressures below 600 psi shall be all stainless-steel construction with threaded, socket weld or flanged connections on a common centerline, and shall be capable of operating in any position. Traps shall be capable of operating with up to 80% back pressure and shall be standard with insulating cover to reduce heat loss. Thermodynamic traps for steam pressures 600 psi or higher shall be of alloy steel construction with threaded, socket weld or flanged connections on a common centerline, and will operate in any position. Steam trap shall be capable of operating with up to 80% back pressure with operating pressure up to 900 psi. Thermodynamic trap shall have three equidistant discharge ports between seat land surfaces to minimize disc and seat wear.

I. Factory-Packaged Trap Station: As an option for drip points requiring isolation valves, strainer, trap, check-valve, valved test ports, and monitoring provide factory packaged trap station including all these features:

1. Shall consist of compact stainless steel design comprising upstream and downstream isolation valves, a quick- fit universal trap connector, strainer, and check valve. The trap station shall be single-piece construction. Once installed, the station remains permanently in the line. Steam traps shall be installed and removed from the station by two bolts, facilitating simple and rapid installation and replacement.

2. Isolation valves, check valve, and strainer shall be maintainable.
3. Steam trap station shall be suitable for use with and shall include thermodynamic, inverted bucket, float & thermostatic, or thermostatic steam traps fitted with universal connectors. The selected steam trap shall be attached to the connector by bolts.
4. Steam Trap Station shall be designed for maximum operating pressure (PMO) with saturated steam of 1751 kPa (254 psig). For ANSI 150 connections PMO shall be 1379 kPa (200 psig).
5. All components of the packaged trap station shall meet specified requirements for individual components specified in this section.

J. Wireless Trap Performance Monitoring System: The steam traps in this facility are monitored by Armstrong AIM ST5700 Series and WirelessHART system, manufactured by Armstrong. Provide additional trap monitors and required receiver, transmitters, and programing compatible with the existing system.

K. Thermostatic Air Vent (Steam): Steel body, balanced pressure bellows, stainless steel (renewable) valve and seat, rated 861 kPa (125 psig) working pressure, 20 mm (3/4 inch) screwed connections. Air vents shall be balanced pressure type that responds to steam pressure-temperature curve and vents air at any pressure.

L. Clean Steam Generator for HVAC Humidification: Factory fabricated; UL listed heat exchanger for the generation of low-pressure clean steam to be used in HVAC humidification. Compatible with softened DI/RO water.
1. Steam to steam humidifier: Steam to steam humidifier, 304 stainless steel tank with removable 304 stainless steel cover with gasketed flanges, steam outlet connection on top of tank for hose or pipe.

    a. Tank: Stainless steel.
    b. Enclosed cabinet, coated steel construction and air gap between cabinet and insulated tank
    c. Steam control valve, steam inlet strainer and steam trap furnished and installed at factory.
    d. Steam outlet on top of tank configured to connect to hose, pipe, or flange connection.

e. Stainless steel evaporator tank with flat surfaces.

f. Mounting: Humidifier shall be mounted on painted legs.

2. Electric immersion heated humidifier: 304 stainless steel tank with removable 304 stainless steel cover with gasketed flanges, heater / cover interlock safety switch, power and control wiring terminal strip, steam outlet at top for hose or pipe connection. Factory insulated.

   a. Immersion heater(s): Heater(s) shall be Incoloy alloy-sheathed resistance type designed for no more than 86 watts per square inch. Two threaded ends of each heater element shall pass through the top of the evaporating chamber and be secured and sealed with washer and threaded nuts to evaporating chamber

   b. Temperature sensor: A factory mounted sensor, with a temperature range of -40 to 248 °F (-40 to 120 °C) shall be mounted on the humidifier to maintain evaporating chamber water temperature above freezing.

   c. Over-temperature switch: A factory-mounted and -wired UL-listed limit control sensor with manual reset shall sense an over-temperature condition and de-energize heater circuit controls.

   d. Indoor Mounting: Humidifier shall be mounted on factory furnished, field installed legs.

   e. Drain Positive drainage/blow-down using a drain pump, drawing water from the bottom of the tank, maximizing mineral evacuation.

   f. Steam trap and strainer: Humidifier shall include a float/thermostatic steam trap and steam supply line strainer.

   g. Water requirements: The humidifier shall be capable of generating steam from softened, or DI/RO water

3. Humidifier shall have a stainless-steel float operated fill valve with an electric solenoid to prevent tank from filling when the tank is not in service Humidifier shall have a field-wired low water float switch to provide water level indication for building management systems.

   a. Factory assembled and tested with the humidifier installed to provide complete weather protection and to operate within the

following temperature limits: -40 to 120 degree F (-40 to 50 degrees C).

b. Frame construction: 5 degree (127 mm), 12-gauge, G-90 galvanized steel formed frame, suitably reinforced and braced to permit loading, shipping, unloading and rigging to the unit destination without damage to external or internal components. The base frame shall be corrosion resistant without painting or further coating.

c. Housing construction: 16-gauge, G-90 galvanized steel panels fabricated into self-framing, double standing seam-type construction. All joints shall be caulked weather-tight with a silicone sealant. All interior surfaces shall be insulated with 1 inch (25 mm), 2.2 pounds/square feet (10.8 kilogram/square meter) rigid, noncombustible glass fiber insulation. No exposed insulation shall be permitted on the top-wearing surface of the floor of the unit. The floor shall be insulated from underneath. The floor shall have a drain connection.

d. Access door construction: Access door shall provide access to all internal components, be constructed of 16-gauge, G-90 galvanized steel with a gasket around the full perimeter of the doorframe, with heavy-duty stainless-steel hinges, and latches.

4. Integral water tempering device: A factory-installed thermostatically controlled water valve shall meter an amount of cold water into a stainless-steel mixing chamber to temper 212 degrees F (100 degrees C) water with a 6 gpm (0.38 liter/second) in-flow rate to a 140 degrees F (60 degrees C) discharge temperature to sanitary system.

5. Units for DI / RO water shall be specifically designed for that purpose and shall have a stainless steel manually operated drain valve and a stainless-steel float operated fill valve.

6. Controls: Control subpanel shall be factory-attached to humidifier with all wiring between subpanel and humidifier completed at factory. A wiring diagram shall be included. The controller shall be microprocessor based and shall have the following features or functions:

a. Web interface shall have same functionality as the unit keypad/display and shall allow multiple remotely located users to

simultaneously view system operation and/or change system parameters. Web interface shall have password-protected secure access and shall be compatible with standard Internet browsers. Web interface shall connect directly to a personal computer or through a system network via Ethernet cable and shall be interoperable with any communication network.

b. Redundant low water safety control.

c. Fully modulating (0 to 100 percent) control of humidifier outputs.

d. Water level control: Automatic refill, low water cut-off, field adjustable skimmer bleed-off functions, and automatic drain-down of humidifier.

e. Temperature sensor: A factory mounted sensor, with a temperature range of -40 to 121 degrees C (-40 to 250 degrees F) mounted on the humidifier to enable the following functions:
   1) Maintain the evaporating chamber water temperature above freezing.
   2) Maintain a user-defined preset evaporating chamber water temperature.
   3) Allow rapid warm-up of water in evaporating chamber after a call for humidity, providing 100% operation until steam production occurs.

f. USB port on the control board for software updates, data backups, and data restoration.

g. Up-time optimizer function to keep humidifier(s) operating through conditions such as fill, drain, or run-time faults, as long as safety conditions are met, minimizing production down-time.

h. Real-time clock to allow time-stamped alarm/message tracking, and scheduled events.

i. Factory commissioning of humidifier and control board, including system configuration as-ordered, factory unit testing, and operation with water before shipping.

j. Unit-mounted keypad/display operable within a temperature range of 0 to 70 degrees C (32 to 158 degrees F) and provides backlighting for viewing in low light.

k. Alarms, unit configuration, and usage timer values shall remain in nonvolatile memory indefinitely during a power outage.

l. The controls shall monitor, control, and/or adjust the following parameters:
   1) Relative humidity (RH) set point, actual conditions in the space (from humidity transmitter), RH offset.
   2) Dew point set point, actual conditions in the space (from dew point transmitter), dew point offset.
   3) Relative humidity (RH) duct high limit set point (switch) and actual conditions.
   4) Relative humidity (RH) duct high limit set point, actual conditions (from transmitter), high limit span, and high limit offset.
   5) Total system demand in % of humidifier capacity.
   6) Total system output in kg/hr (lb/hr).
   7) Drain/flush duration, allowed days, and frequency based on usage.
   8) End-of-season drain status (on standard water systems and if ordered as a DI water option) and hours humidifier is idle before end of season draining occurs.
   9) Window glass surface temperature with programmable offset.
   10) Air temperature or other auxiliary temperature monitoring with programmable offset.
   11) System alarms and system messages, current and previous.
   12) Adjustable water skim duration.

m. Programmable outputs for remote signaling of alarms and/or messages, device activation (such as a fan), or for signaling tank heating and/or steam production.

n. System diagnostics that include:
   1) Test outputs function to verify component operation.
   2) Test humidifier function by simulating demand to validate performance.
   3) Data collection of RH, air temperature, water use, energy use, alarms, and service messages for viewing from the keypad/display or Web interface.
   4) Service notification scheduling.

5) Password-protected system parameters.

6) Keypad/display or Web interface displays in English.

7) Numerical units displayed in inch-pound or SI units.

7. Other humidifier control features:

a. Interoperability using BACnet MS/TP.

1)

b. Water level control for DI/RO water: System shall provide for continuous control of water level and shall accommodate the use of deionized or reverse osmosis water with resistance up to 18 M-ohm/cm. System shall include:

1) Water level sensing unit comprised of a float operated stainless steel valve for water makeup.

2) Low water cut-off float switch.

3) Operation within inlet water supply pressure range of 170 to 550 kPa (25 to 80 psig).

c. Access panel interlock switch: The control subpanel shall have an interlock control switch with manual override to remove control voltage when access panel is opened.

d. Control input accessory:

1) Airflow proving switch, pressure type: Airflow proving switch shall be diaphragm-operated with pitot tube for field installation. Switch shall have an adjustable control point range of 12.5 to 2988 Pa (0.05 to 12 inch WG) Operating temperature range -40 to 82 degrees C (-40 to 180 degrees F). Compatible with 24, 120, and 240 VAC.

8. Distribution Manifold: Stainless steel, composed of dispersion pipe and surrounding steam jacket, manifold shall span the width of duct or air handler, and shall be multiple manifold type under any of the following conditions:

9. Duct section height exceeds 900 mm (36 inches).

10. Duct air velocity exceeds 5.1 m/s (1000 feet per minute).

11. If within 900 mm (3 feet) upstream of fan, damper or pre-filter.

12. If within 3 m (10 feet) upstream of after-filter.

M. Unfired, Clean, Steam to Steam Generator (for sterilization purposes):

1. Provide a packaged factory assembled, pre-piped unfired steam generator consisting of stainless steel shell, stainless steel tube coil, stainless steel steam piping, valves and controls All stainless-steel piping shall be type 304 factory-fabricated and provided as a part of the complete package. Any make-up water to these units shall be less than 1 ppm hardness. A dual tower water softener with brine tank and automatic regeneration shall be provided, if necessary.
2. Shell: Stainless steel ASME code construction with flanged piping connections, 1035 kPa (150 psig) maximum working steam pressure.
3. Tubes: Stainless Steel tubes suitable for 1035 kPa (150 psig) working pressure.
4. Design: Heated fluid in shell and heating fluid (higher pressure steam) in tubes.
5. Each steam generator shall be furnished with the following accessories:
   a. Resilient insulation.
   b. Pilot operated modulating control valve with pressure controller.
   c. Control pilot to maintain constant steam output.
   d. Pressure relief valve.
   e. Vessel and tube side pressure gauges.
   f. Liquid level controller with brass feed water solenoid valve, in check valve and strainer.
   g. Over-pressure limit system with auto-reset.
   h. Factory packaging.
   i. Dual F&T condensate traps.
   j. Manual blow down valve.
   k. TDS based automatic blow down of cooled water 38 degrees C (100 degrees F) or less.
   l. Low water cut-off and high-pressure cut-off.
   m. Fully wired control box.
   n. Automatic drain solenoid valve.
6. Provide solid state control module with LED backlit LCD display and LED pilot lights to indicate on-off, high pressure, low pressure, low water and water feed. Control module shall allow the local

adjustment of pressure limits on display screen. Control module shall have alarm light and alarm horn with built in alarm silence relay. Control module shall be supplied with dry contact closure outputs to indicate to building automation controls (BAC) the occurrence of power on, high pressure, low pressure, low water and water feed. The control module shall allow the BAC to turn the unfired steam generator on or off through a remote relay suitable for 24 VAC, 1 amp. The control module shall allow the BAC to remotely monitor the operating pressure. Control module shall be supplied with an on-off switch and shall be mounted in a NEMA 4 panel. All solenoids and limits shall be 24 VAC.

N. Steam Gun Set: Furnish for ready coupling to building steam and cold water and designed for rinsing equipment (such as carts and racks) with hot or cold water, cleaning such articles with detergent-laden hot water or steam, or alternately sanitizing the articles with only live steam.
   1. Gun: Fit gun for finger-tip release of steam. Design so siphoning action will automatically mix detergent with gun effluent. Equip gun with hardwood front and rear handgrips. Include a 24 mm (15/16 inch) diameter, double tube butyl hose reinforced with braid and designed for 1035 kPa (150 psig) pressure. Hose shall be 3.6 meter (12 feet) long.
   2. Detergent Tank: Furnish 9.5 L (2-1/2 gallon) polyethylene or fiberglass storage tank and fit for wall mounting. Also provide 15 mm (1/2 inch) diameter neoprene double wall detergent hose of the same length as steam hose. Fit hose-to-tank connection with strainer. Fit other end of hose with valve to regulate amount of detergent to be mixed with steam.
   3. Steam/Water Selector: Furnish manifold for wall mounting; design manifold to deliver only steam or water, or steam and water mix to gun. Construct mounting panel of stainless steel. Valves and piping located in panel shall be brass.
   4. Accessories: Provide one pair of protective gloves and three 50 mm (2 inch) diameter brushes, one nylon and two stainless-steel.

O. Steam Hose and Accessories: Hose shall be sufficiently flexible to be placed in a 1.2 meter (4 feet) diameter coil.
   1. Furnish and install in the mechanical room housing each PRV station a 7.6 meter (25 feet) length of 15 mm (1/2 inch) ID steam hose, rated 861 kPa (125 psig) and a hose rack. In one end of the hose install a quick-couple device, suitable for steam service, to match corresponding devices in the PRV blowdown connections.
   2. Hose storage rack: Wall-mounted, steel, iron or aluminum, semi-circular shape, with capacity to store 7.6 meter (25 feet) of 15 mm (1/2 inch) ID steam hose.

P. Steam Flow Meter/Recorder: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

Q. Steam Exhaust Head: Cast iron, fitted with baffle plates, to trap and drain condensed water.

2.11 GAUGES, PRESSURE AND COMPOUND

A. ASME B40.100, Accuracy Grade 1A, (pressure, vacuum, or compound), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 115 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT bottom connection, white dial with black graduations and pointer, clear glass or acrylic plastic window, suitable for board mounting. Provide red "set hand" to indicate normal working pressure.

B. Provide steel, lever handle union cock. Provide steel or stainless-steel pressure snubber for gauges in water service. Provide steel pigtail syphon for steam gauges.

C. Pressure gauge ranges shall be selected such that the normal operating pressure for each gauge is displayed near the midpoint of each gauge's range. Gauges with ranges selected such that the normal pressure is displayed at less than 30 percent or greater than 70 percent of the gauge's range are prohibited. The units of pressure shall be psig.

2.12 PRESSURE/TEMPERATURE TEST PROVISIONS

A. Provide one each of the following test items to the COR:
   1. 6 mm (1/4 inch) FPT by 3.2 mm (1/8 inch) diameter stainless steel pressure gauge adapter probe for extra-long test plug. Pressure/temperature plug is an example.

2. 90 mm (3-1/2 inch) diameter, one percent accuracy, compound gauge, 762 mm (30 inches) Hg to 690 kPa (100 psig) range.
3. 0 to 104 degrees C (32 to 220 degrees F) pocket thermometer one-half degree accuracy, 25 mm (1 inch) dial, 125 mm (5 inch) long stainless-steel stem, plastic case.

2.13 FIRESTOPPING MATERIAL

A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

2.14 ELECTRICAL HEAT TRACING SYSTEMS (NOT USED)

PART 3 - EXECUTION

3.1 GENERAL

A. If in the substantiated evaluation of the COR, the installation fails to meet the requirements of the construction documents with respect to function and maintainability, an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or time to the Government.

B. The contract documents show the general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to connect pipes to equipment, fan-coils, coils, radiators, etc., and to coordinate with other trades. Provide all necessary fittings, offsets and pipe runs based on field measurements and at no additional cost or time to the Government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be connected on ceiling grid. Pipe location in the contract documents shall be altered by contractor where necessary to avoid interferences and clearance difficulties.

C. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.

D. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Install convertors and other heat exchangers at height sufficient to provide gravity flow of condensate to the flash tank and condensate pump.

E. Install piping generally parallel to walls and column center lines, unless shown otherwise in the contract documents. Space piping, including insulation, to provide 25 mm (1 inch) minimum clearance

between adjacent piping and another surface. Unless shown otherwise, slope steam, condensate and drain piping down in the direction of flow not less than 25 mm (1 inch) in 12 meter (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.

F. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally, locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown in the contract documents.

G. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where noted in the contract documents.

H. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.

I. Connect piping to equipment as shown in the contract documents. Install components furnished by others such as flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.

J. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC AND BOILER PLANT INSULATION.

K. Pipe vents to the exterior. Where a combined vent is provided, the cross-sectional area of the combined vent shall be equal to sum of individual vent areas. Slope vent piping 25 mm (1 inch) in 12 meter (40 feet) 0.25 percent in direction of flow. Provide a drip pan elbow on relief valve outlets if the vent rises to prevent backpressure. Terminate vent minimum 300 mm (12 inches) above the roof or through the wall minimum 2.4 meter (8 feet) above grade with down turned elbow.

L. Contract documents do not identify all locations where steam trap sets are required. Contractor shall provide at no additional cost as many trap-sets as are necessary for the proper, reliable operation of the system. Provide trap-sets at all low points and at 61 meter (200 feet) intervals on all horizontal main lines.

3.2 WELDING

A. The contractor is entirely responsible for the quality of the welding and shall:
   1. Conduct tests of the welding procedures used on the project, verify the suitability of the procedures used, verify that the welds made will meet the required tests, and also verify that the welding operators have the ability to make sound welds under standard conditions.
   2. Perform all welding operations required for construction and installation of the piping systems.

B. Qualification of Welders: Rules of procedure for qualification of all welders and general requirements for fusion welding shall conform with the applicable portions of ASME B31.1, AWS B2.1/B2.1M, AWS Z49.1, and also as outlined below.

C. Examining Welder: Examine each welder at job site, in the presence of the COR, to determine the ability of the welder to meet the qualifications required. Test welders for piping for all positions, including welds with the axis horizontal (not rolled) and with the axis vertical. Each welder shall be allowed to weld only in the position in which he has qualified and shall be required to identify his welds with his specific code marking signifying his name and number assigned.

D. Examination Results: Provide the COR with a list of names and corresponding code markings. Retest welders who fail to meet the prescribed welding qualifications. Disqualify welders, who fail the second test, for work on the project.

E. Beveling: Field bevels and shop bevels shall be done by mechanical means or by flame cutting. Where beveling is done by flame cutting, surfaces shall be thoroughly cleaned of scale and oxidation just prior to welding. Conform to specified standards.

F. Alignment: Provide approved welding method for joints on all pipes greater than 50 mm (2 inches) to assure proper alignment, complete weld penetration, and prevention of weld spatter reaching the interior of the pipe.

G. Erection: Piping shall not be split, bent, flattened, or otherwise damaged before, during, or after installation. If the pipe temperature falls to 0 degrees C (32 degrees F) or lower, the pipe shall be heated

to approximately 38 degrees C (100 degrees F) for a distance of 300 mm (1 foot) on each side of the weld before welding, and the weld shall be finished before the pipe cools to 0 degrees C (32 degrees F).

H. Non-Destructive Examination of Piping Welds:

1. Perform radiographic examination of 50 percent of the first 10 welds made and 10 percent of all additional welds made. The COR reserves the right to identify individual welds for which the radiographic examination shall be performed. All welds shall be visually inspected by the COR. The VA reserves the right to require testing on additional welds up to 100 percent if greater than 25 percent of the examined welds fail the inspection.
2. An approved independent testing firm regularly engaged in radiographic testing shall perform the radiographic examination of pipe joint welds. All radiographs shall be reviewed and interpreted by an ASNT Certified Level III radiographer, employed by the testing firm, who shall sign the reading report.
3. Comply with ASME B31.1. Furnish a set of films showing each weld inspected, a reading report evaluating the quality of each weld, and a location plan showing the physical location where each weld is to be found in the completed project. The COR and the CxA shall be given a copy of all reports to be maintained as part of the project records and shall review all inspection records.

I. Defective Welds: Replace and reinspect defective welds. Repairing defective welds by adding weld material over the defect or by peening are prohibited. Welders responsible for defective welds shall be requalified prior to resuming work on the project.

J. Electrodes: Electrodes shall be stored in a dry heated area and be kept free of moisture and dampness during the fabrication operations. Discard electrodes that have lost part of their coating.

3.3 PIPE JOINTS

A. Welded: Beveling, spacing and other details shall conform to ASME B31.1 and AWS B2.1/B2.1M. See Welder’s qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

B. Screwed: Threads shall conform to ASME B1.20.1; joint compound shall be applied to male threads only and joints made up so no more than three

threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.

C. 125 Pound Cast Steel Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast steel flange.

3.4 EXPANSION JOINTS (BELLOWS AND SLIP TYPE)

A. Anchors and Guides: Provide type, quantity and spacing as recommended by manufacturer of expansion joint and as shown. A professional engineer shall verify in writing that anchors and guides are properly designed for forces and moments which will be imposed.

B. Cold Set: Provide setting of joint travel at installation as recommended by the manufacturer for the ambient temperature during the installation.

C. Preparation for Service: Remove all apparatus provided to restrain joint during shipping or installation. Representative of manufacturer shall visit the site and verify that installation is proper.

D. Access: Expansion joints shall be located in readily accessible space. Locate joints to permit access without removing piping or other devices. Allow clear space to permit replacement of joints and to permit access to devices for inspection of all surfaces and for adding packing.

3.5 STEAM TRAP PIPING

A. Install to permit gravity flow to the trap. Provide gravity flow (avoid lifting condensate) from the trap where modulating control valves are used. Support traps weighing over 11 kg (24 pounds) independently of connecting piping.

1. On pipe size 1-1/2 inch and greater a raised face flange is required to allow for removal of the steam trap without disturbing surrounding piping.
2. On pipe size less than 1-1/2inch raised face flanges or unions may be used to allow for removal of the traps.

3.6 SEISMIC BRACING

A. Provide in accordance with Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

3.7 LEAK TESTING

A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary to the satisfaction of the COR in accordance with the specified requirements. Testing shall be performed in accordance with the specification requirements.

B. An operating test at design pressure, and for hot systems, design maximum temperature.

C. A hydrostatic test at 1.5 times design pressure. For water systems, the design maximum pressure would usually be the static head, or expansion tank maximum pressure, plus pump head. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Avoid excessive pressure on mechanical seals and safety devices.

D. Prepare and submit test and inspection reports to the COR within 5 working days of test completion and prior to covering the pipe.

E. All tests shall be witnessed by the COR, their representative, or the CxA and be documented by each section tested, date tested, and list or personnel present.

3.8 FLUSHING AND CLEANING PIPING SYSTEMS

A. Steam, Condensate and Vent Piping: The piping system shall be flushed clean prior to equipment connection. Cleaning includes pulling all strainer screens and cleaning all scale/dirt legs during startup operation. Contractor shall be responsible for damage caused by inadequately cleaned/flushed systems.

3.9 ELECTRIC HEAT TRACING (NOT USED)

3.10 STARTUP AND TESTING

A. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.

B. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

C. The CxA shall observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with COR and CxA. Provide a minimum notice of 10 working days prior to startup and testing.

D. Adjust red set hand on pressure gauges to normal working pressure.

3.11 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

B. Components provided under this section of the specification shall be tested as part of a larger system.

3.12 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer's technical representative for 4 hours to instruct each VA personnel responsible in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

- - - E N D - - -

SECTION 23 31 00
HVAC DUCTS AND CASINGS

PART 1 - GENERAL

1.1 DESCRIPTION

A. A complete listing of common acronyms and abbreviations are included in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

B. Ductwork and accessories for HVAC including the following:

1. Supply air, return air, outside air, exhaust, make-up air, and relief systems.

C. Definitions:

1. Seal or Sealing: Use of liquid or mastic sealant, with or without compatible tape overlay, or gasketing of flanged joints, to keep air leakage at duct joints, seams and connections to an acceptable minimum.
2. Duct Pressure Classification: SMACNA HVAC Duct Construction Standards, Metal and Flexible.
3. Exposed Duct: Exposed to view in a finished room, exposed to weather.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 07 84 00, FIRESTOPPING.

E. Section 08 90 00, LOUVERS and VENTS.

F. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

G. Section 22 11 00, FACILITY WATER DISTRIBUTION.

H. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

I. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

J. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

K. Section 23 07 11, HVAC and BOILER PLANT INSULATION.

L. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

M. Section 23 34 00, HVAC FANS.

N. Section 23 36 00, AIR TERMINAL UNITS.

O.

P. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.

Q. Section 23 82 16, AIR COILS.

R. Section 28 31 00, FIRE DETECTION and ALARM.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.Where conflicts occur these specifications and the VHA standards will govern.

B. American Society of Civil Engineers (ASCE):

7-2016.....Minimum Design Loads for Associated Criteria for Buildings and Other Structures

C. American Society for Testing and Materials (ASTM):

A653/A653M-2020.....Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process

A1011/A1011-2018a.....Standard Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High Strength Low-Alloy with Improved Formability, and Ultra-High Strength

B209-2021.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate

C1071-2019.....Standard Specification for Fibrous Glass Duct Lining Insulation (Thermal and Sound Absorbing Material)

E1-2014(R2020).....Standard Specification for ASTM Liquid-in-Glass Thermometers

E77-2014(R2021).....Standard Test Method for Inspection and Verification of Thermometers

E84-2021a.....Standard Test Method for Surface Burning Characteristics of Building Materials

D. National Fire Protection Association (NFPA):

90A-2024.....Standard for the Installation of Air-Conditioning and Ventilating Systems

96-2024.....Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations

E. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):

006-2020.....HVAC Duct Construction Standards, Metal and Flexible, 4th Edition

016-2012.....HVAC Air Duct Leakage Test Manual, 2nd Edition

2016.....Fibrous Glass Duct Construction Standards, 7th Edition

F. Underwriters Laboratories, Inc. (UL):

181-2013(R2017).....Standard for Factory-Made Air Ducts and Air Connectors

555-2006(R2020) .....Standard for Fire Dampers

555S-2014(R2020).....Standard for Smoke Dampers

G. Department of Veterans Affairs (VA):

PG-18-10-2015.....Physical Security Design Manual for VA Mission Critical Facilities

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 XX XX, SECTION TITLE", with applicable paragraph identification.

C. Manufacturer's Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Rectangular Ducts:
   a. Schedules of duct systems, materials and selected SMACNA construction alternatives for joints, sealing, gauge and reinforcement.
   b. Duct liner.
   c. Sealants and gaskets.
   d. Access doors.
2. Round and Flat Oval DuctS:

a. Manufacturer's details for duct fittings.

b. Sealants and gaskets.

c. Access sections.

d. Installation instructions.

3. Volume dampers, back draft dampers.
4. Upper hanger attachments.
5. Fire dampers, fire doors, and smoke dampers with installation instructions.
6. Sound attenuators, including pressure drop and acoustic performance.
7. Flexible ducts and clamps, with manufacturer's installation instructions.
8. Flexible connections.
9. Instrument test fittings.
10. Details and design analysis of alternate or optional duct systems.

D. Coordination Drawings: Refer to paragraph SUBMITTALS in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

E. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replaceable parts, and troubleshooting guide:

1. Include complete list indicating all components of the systems.
2. Include complete diagrams of the internal wiring for each item of equipment.
3. Diagrams shall have their terminals identified to facilitate installation, operation, and maintenance.

1.5 QUALITY ASSURANCE

A. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

B. Refer to Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for additional sustainable design requirements.

C. Fire Safety Code: Comply with NFPA 90A.

D. Duct System Construction and Installation: Referenced SMACNA Standards are the minimum acceptable quality.

E. Duct Sealing, Air Leakage Criteria, and Air Leakage Tests: Ducts shall be sealed as per duct sealing requirements of SMACNA HVAC Air Duct Leakage Test Manual for duct pressure classes shown in the contract documents.

F. Duct accessories exposed to the air stream, such as dampers of all types (except smoke dampers) and access openings, shall be of the same material as he duct or provide at least the same level of corrosion resistance.

1.6 AS-BUILT DOCUMENTATION

A. Comply with requirements in paragraph AS-BUILT DOCUMENTATION of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

PART 2 - PRODUCTS

2.1 DUCT MATERIALS AND SEALANTS

A. General: Except for systems specified otherwise, construct ducts, casings, and accessories of galvanized sheet steel, ASTM A653/A653M, coating G90; or, aluminum sheet, ASTM B209, alloy 1100, 3003 or 5052.

B. Specified Corrosion Resistant Systems: Stainless-steel sheet, Class 302 or 304, Condition A (annealed) Finish No. 4 for exposed ducts and Finish No. 2B for concealed duct or ducts located in mechanical rooms.

C. Joint Sealing: Refer to SMACNA HVAC Duct Construction Standards, Metal and Flexible.

1. Sealant: Elastomeric compound, gun or brush grade, maximum 25 flame spread, and 50 smoke developed (dry state) compounded specifically for sealing ductwork as recommended by the manufacturer. Generally, provide liquid sealant, with or without compatible tape, for low clearance slip joints and heavy, permanently elastic, mastic type where clearances are larger. Oil base caulking and glazing compounds are prohibited because they do not retain elasticity and bond.
2. Tape: Use only tape specifically designated by the sealant manufacturer and apply only over wet sealant. Pressure sensitive tape shall not be used on bare metal or on dry sealant.
3. Gaskets in Flanged Joints: Soft neoprene.

D. Approved factory-made joints may be used.

2.2 DUCT CONSTRUCTION AND INSTALLATION

A. Regardless of the pressure classifications outlined in the SMACNA Standards, fabricate and seal the ductwork in accordance with the following pressure classifications:

B. Duct Pressure Classification:

1. 0 to 13 mm (0 to 1/2 inch)
2. 13 mm to 25 mm (1/2 inch to 1 inch)
3. 25 mm to 50 mm (1 inch to 2 inch)
4. 50 mm to 75 mm (2 inch to 3 inch)
5. 75 mm to 100 mm (3 inch to 4 inch)

C. Seal Class: All ductwork shall receive Class A Seal.

D. Provide a welded stainless-steel duct section for housing the duct-mounted terminal humidifiers. Ductwork shall be at least 914 mm (3 feet) long on the upstream side and 1829 mm (6 feet) long on the downstream side. Slope the ductwork against the direction of airflow and provide drain connections.

E. Round and Flat Oval Ducts: Furnish duct and fittings made by the same manufacturer to ensure good fit of slip joints. When submitted and approved in advance, round and flat oval duct, with size converted on the basis of equal pressure drop, may be furnished in lieu of rectangular duct design shown in the contract documents.

1. Elbows: Diameters 75 through 203 mm (3 through 8 inches) shall be two sections die stamped, all others shall be gored construction, maximum 18 degree angle, with all seams continuously welded or standing seam. Coat galvanized areas of fittings damaged by welding with corrosion resistant aluminum paint or galvanized repair compound.
2. Provide bell mouth, conical tees or taps, laterals, reducers, and other low loss fittings as shown in SMACNA HVAC Duct Construction Standards, Metal and Flexible.
3. Ribbed Duct Option: Lighter gauge round/oval duct and fittings may be furnished provided certified tests indicating that the rigidity and performance is equivalent to SMACNA standard gauge ducts are submitted.
   a. Ducts: Manufacturer's published standard gauge, G90 coating, spiral lock seam construction with an intermediate standing rib.

b. Fittings: May be manufacturer's standard as shown in published catalogs, fabricated by spot welding and bonding with neoprene base cement or machine formed seam in lieu of continuous welded seams.

4. Provide flat side reinforcement of oval ducts as recommended by the manufacturer and SMACNA HVAC Duct Construction Standards, Metal and Flexble. Because of high pressure loss, do not use internal tie-rod reinforcement unless approved by the COR.

F. Casings and Plenums: Construct in accordance with SMACNA HVAC Duct Construction Standards, Metal and Flexible, including curbs, access doors, pipe penetrations, eliminators and drain pans. Access doors shall be hollow metal, insulated, with latches and door pulls, 508 mm (20 inches) wide by 1219 to 1372 mm (48 to 54 inches) high. Provide view port in the doors where shown. Provide drain for outside air louver plenum. Outside air plenum shall have exterior insulation. Drain piping shall be routed to the nearest floor drain.

G. Volume Dampers: Single blade or opposed blade, multi-louver type as detailed in SMACNA Standards. Refer to SMACNA for Single Blade and Multi-blade Volume Dampers.

H. Duct Hangers and Supports: Refer to SMACNA Standards. Avoid use of trapeze hangers for round duct.

I. Ductwork in excess of 620 cm^2 (96 square inches) shall be protected unless the duct has one dimension less than 152 mm (6 inches) if it passes through the areas listed below. Refer to the Physical Security Design Manual for VA Mission Critical Facilities. This applies to the following:

1. Agent cashier spaces
2. Perimeter partitions of caches
3. Perimeter partitions of computer rooms
4. Perimeter of a COOP sites
5. Perimeter partitions of Entrances
6. Security control centers (SCC)

2.3 DUCT LINER (WHERE INDICATED IN THE CONTRACT DOCUMENTS) (NOT USED)

2.4 DUCT ACCESS DOORS, PANELS AND SECTIONS

A. Provide access doors, sized and located for maintenance work, upstream, in the following locations:
   1. Each duct mounted coil and humidifier.
   2. Each fire damper (for link service), smoke damper and automatic control damper.
   3. Each duct mounted smoke detector.

B. Openings shall be as large as feasible in small ducts, 305 mm by 305 mm (12 inch by 12 inch) minimum where possible. Access sections in insulated ducts shall be double-wall, insulated. Transparent shatterproof covers are preferred for uninsulated ducts.
   1. For Rectangular Ducts: Refer to SMACNA HVAC Duct Construction Standards, Metal and Flexible.
   2. For Round and Flat Oval Ducts: Refer to SMACNA HVAC Duct Construction Standards, Metal and Flexible.

2.5 FIRE DAMPERS

A. Galvanized steel, interlocking blade type, UL listing and label, 1-1/2-hour rating, 70 degrees C (158 degrees F) fusible line, 100 percent free opening with no part of the blade stack or damper frame in the air stream.

B. Fire dampers in wet air exhaust shall be of stainless-steel construction, all others may be galvanized steel.

C. Minimum Requirements for Fire Dampers:
   1. The damper frame may be of design and length as to function as the mounting sleeve, thus eliminating the need for a separate sleeve, as allowed by UL 555. Otherwise provide sleeves and mounting angles, minimum 1.9 mm (14 gauge), required to provide installation equivalent to the damper manufacturer's UL test installation.
   2. Submit manufacturer's installation instructions conforming to UL rating test.

2.6 SMOKE DAMPERS (NOT USED)

2.7 FIRE DOORS (NOT USED)

2.8 FLEXIBLE AIR DUCT

A. General: Factory-fabricated, complying with NFPA 90A for connectors not passing through floors of buildings. Flexible ducts shall not penetrate

any fire or smoke barrier which is required to have a fire resistance rating of one hour or more. Flexible duct length shall not exceed 1.5 m (5 feet). Provide insulated acoustical air duct connectors in supply air duct systems and elsewhere as shown.

B. Flexible ducts shall be listed by Underwriters Laboratories, Inc., complying with UL 181. Ducts greater than 203 mm (8 inches) in diameter shall be Class 1. Ducts less than 203 mm (8 inches) in diameter shall be Class 1 or Class 2.

C. Insulated Flexible Air Duct: Factory-fabricated including mineral fiber insulation with maximum C factor of 0.25 at 24 degrees C (75 degrees F) mean temperature, encased with a low permeability moisture barrier outer jacket, having a puncture resistance of not less than 50 Beach Units. Acoustic insertion loss shall not be less than 3 dB per 300 mm (foot) of straight duct, at 500 Hz, based on 152 mm (6 inch) duct, of 762 m/min (2500 fpm).

D. Application Criteria:

1. Temperature Range: -18 to 93 degrees C (0 to 200 degrees F) internal.
2. Maximum Working Velocity: 1219 m/min (4000 fpm).
3. Minimum Working Pressure, Inches of Water Gauge: 2500 Pa (10 inches WG) positive, 500 Pa (2 inches WG) negative.

E. Duct Clamps: 100 percent nylon strap, 80 kg (176 pounds) minimum loop tensile strength manufactured for this purpose or stainless-steel strap with cadmium plated worm gear tightening device. Apply clamps with sealant and as approved for UL 181, Class 1 installation.

F. Flexible air duct is prohibited in operating room suites, SPS processing spaces, Pharmacy compounding spaces, Protective Environment spaces, Isolation Rooms, Clean Rooms, Bio-containment Laboratories, Research Laboratories, and Clinical Laboratories.

2.9 FLEXIBLE DUCT CONNECTIONS

A. Where duct connections are made to fans, air terminal units, and air handling units, install a non-combustible flexible connection of 822 g (29 ounces) neoprene coated fiberglass fabric approximately 152 mm (6 inches) wide. For connections exposed to sun and weather provide hypalon coating in lieu of neoprene. Burning characteristics shall conform to NFPA 90A. Securely fasten flexible connections to round

ducts with stainless-steel or zinc-coated iron draw bands with worm gear fastener. For rectangular connections, crimp fabric to sheet metal and fasten sheet metal to ducts by screws 50 mm (2 inches) on center. Fabric shall not be stressed other than by air pressure. Allow at least 25 mm (one inch) slack to ensure that no vibration is transmitted.

2.10 SOUND ATTENUATING UNITS (NOT USED)

2.11 PREFABRICATED ROOF CURBS (NOT USED)

2.12 FIRESTOPPING MATERIAL

A. Refer to Section 07 84 00, FIRESTOPPING.

2.13 SEISMIC RESTRAINT FOR DUCTWORK

A. Refer to Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

2.14 DUCT MOUNTED THERMOMETER (AIR)

A. Stem Type Thermometers: ASTM E1, 7 inch scale, red appearing mercury, lens front tube, cast aluminum case with enamel finish and clear glass or polycarbonate window, brass stem, 2 percent of scale accuracy to ASTM E77 scale calibrated in degrees Fahrenheit.

B. Thermometer Supports:

1. Socket: Brass separable sockets for thermometer stems with or without extensions as required, and with cap and chain.
2. Flange: 75 mm (3 inch) outside diameter reversible flange, designed to fasten to sheet metal air ducts, with brass perforated stem.

2.15 DUCT MOUNTED TEMPERATURE SENSOR (AIR)

A. Refer to Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

2.16 INSTRUMENT TEST FITTINGS

A. Manufactured type with a minimum 50 mm (2 inch) length for insulated duct, and a minimum 25 mm (1 inch) length for duct not insulated. Test hole shall have a flat gasket for rectangular ducts and a concave gasket for round ducts at the base, and a screw cap to prevent air leakage.

B. Provide instrument test holes at each duct or casing mounted temperature sensor or transmitter, and at entering and leaving side of each heating coil, and cooling coil.

2.17 AIR FLOW CONTROL VALVES (AFCV)

A. Refer to Section 23 36 00, AIR TERMINAL UNITS and Section 23 82 00, CONVECTION HEATING and COOLING UNITS.

2.18 LEAD COVERED DUCT (NOT USED)

2.19 ELECTROSTATIC SHIELDING (NOT USED)

PART 3 - EXECUTION

3.1 INSTALLATION

A. If an installation is unsatisfactory to the COR, the contractor shall correct the installation at no additional cost or time to the Government.

B. Comply with provisions of Section 23 05 11, COMMON WORK RESULTS FOR HVAC, particularly regarding coordination with other trades and work in existing buildings.

C. Fabricate and install ductwork and accessories in accordance with referenced SMACNA Standards:

1. Contract documents show the general layout of ductwork and accessories but do not show all required fittings and offsets that may be necessary to connect ducts to equipment, boxes, diffusers, grilles, etc., and to coordinate with other trades. Fabricate ductwork based on field measurements. Provide all necessary fittings and offsets at no additional cost to the Government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories on ceiling grid. Duct sizes in the contract documents are inside dimensions which shall be altered by Contractor to other dimensions with the same air handling characteristics where necessary to avoid interferences and clearance difficulties.
2. Provide duct transitions, offsets and connections to dampers, coils, and other equipment in accordance with SMACNA Standards. Provide streamliner, when an obstruction cannot be avoided and must be taken in by a duct. Repair galvanized areas with galvanizing repair compound.
3. Provide bolted construction and tie-rod reinforcement in accordance with SMACNA Standards.
4. Construct casings, eliminators, and pipe penetrations in accordance with SMACNA Standards. Design casing access doors to swing against air pressure so that pressure helps to maintain a tight seal.

D. Install duct hangers and supports in accordance with SMACNA Standards.

E. Install fire dampers and smoke dampers in accordance with the manufacturer's instructions to conform to the installation used for the rating test. Install fire dampers and smoke dampers at locations indicated and where ducts penetrate fire rated and/or smoke rated walls, shafts and where required by the COR. Install with required perimeter mounting angles, sleeves, breakaway duct connections, corrosion resistant springs, bearings, bushings and hinges per UL and NFPA. Demonstrate resetting of fire dampers and operation of smoke dampers to the COR.

F. Seal openings around duct penetrations of floors and fire rated partitions with fire stop material as required by NFPA 90A.

G. Flexible Duct Installation: Refer to SMACNA Standards. Ducts shall be continuous, single pieces not over 1.5 m (5 feet) long per NFPA 90A, as straight and short as feasible, adequately supported. Centerline radius of bends shall be not less than two duct diameters. Make connections with clamps as recommended by SMACNA. Clamp per SMACNA with one clamp on the core duct and one on the insulation jacket. Flexible ducts shall not penetrate floors, or any chase or partition designated as a fire or smoke barrier, including corridor partitions fire rated one hour or two hours. Support ducts SMACNA Standards.

H. Where diffusers, registers and grilles cannot be installed to avoid seeing inside the duct, paint the inside of the duct with flat black paint to reduce visibility.

I. Control Damper Installation:

1. Provide necessary blank-off plates required to install dampers that are smaller than duct size. Provide necessary transitions required to install dampers larger than duct size.
2. Assemble multiple sections dampers with required interconnecting linkage and extend required number of shafts through duct for external mounting of damper motors.
3. Provide necessary sheet metal baffle plates to eliminate stratification and provide air volumes specified. Locate baffles by experimentation, and affix and seal permanently in place, only after stratification problem has been eliminated.
4. Install all damper control/adjustment devices on stand-offs to allow complete coverage of insulation.

J. Air Flow Measuring Devices: Install units with minimum straight run distances, upstream and downstream as recommended by the manufacturer.

K. Low Pressure Duct Liner: Install in accordance with SMACNA Standards.

L. Protection and Cleaning: Adequately protect equipment and materials against physical damage. Place equipment in first class operating condition or return to source of supply for repair or replacement, as determined by COR. Protect equipment and ducts during construction against entry of foreign matter to the inside and clean both inside and outside before operation and painting. When new ducts are connected to existing ductwork, clean both new and existing ductwork by mopping and vacuum cleaning inside and outside before operation.

3.2 DUCT LEAKAGE TESTS AND REPAIR

A. Ductwork leakage testing shall be performed by the Testing and Balancing Contractor directly contracted by the General Contractor and independent of the Sheet Metal Contractor.

B. Ductwork leakage testing shall be performed for the entire air distribution system (including all supply, return, exhaust and relief ductwork), section by section, including fans, coils and filter sections. Based upon satisfactory initial duct leakage test results, the scope of the testing may be reduced by the COR on ductwork constructed to the 500 Pa (2 inches WG) duct pressure classification. In no case shall the leakage testing of ductwork constructed above the 500 Pa (2 inches WG) duct pressure classification or ductwork located in shafts or other inaccessible areas be eliminated.

C. Test procedure, apparatus and report shall conform to SMACNA HVAC Air Duck Leakage Test Manual. The maximum leakage rate allowed is 4 percent of the design air flow rate.

D. All ductwork shall be leak tested first before enclosed in a shaft or covered in other inaccessible areas.

E. All tests shall be performed in the presence of the COR and the Test and Balance agency. The Test and Balance agency shall measure and record duct leakage and report to the COR and identify leakage source with excessive leakage.

F. If any portion of the duct system tested fails to meet the permissible leakage level, the Contractor shall rectify sealing of ductwork to

bring it into compliance and shall retest it until acceptable leakage is demonstrated to the COR.

G. All tests and necessary repairs shall be completed prior to insulation or concealment of ductwork.

H. Make sure all openings used for testing flow and temperatures by TAB Contractor are sealed properly.

3.3 DUCTWORK EXPOSED TO WIND VELOCITY

A. Provide additional support and bracing to all exposed ductwork installed on the roof or outside the building to withstand wind velocity of 145 km/h (90mph).

3.4 TESTING, ADJUSTING, AND BALANCING (TAB)

A. Refer to Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

3.5 OPERATING AND PERFORMANCE TESTS

A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

- - - E N D - - -

SECTION 23 34 00
HVAC FANS

PART 1 - GENERAL

1.1 DESCRIPTION

A. A complete listing of common acronyms and abbreviations are included in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

B. Fans for heating, ventilating and air conditioning.

C. Product Definitions: AMCA 99.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

E. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

F. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

G. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.

H. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

I. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

J. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

K. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

L. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.

M. Section 23 82 16, AIR COILS.

N. Section 26 29 11, MOTOR CONTROLLERS.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standards will govern.

B. Air Movement and Control Association International, Inc. (AMCA):
99-2016.....Standards Handbook
210-2016.....Laboratory Methods of Testing Fans for Aerodynamic Performance Rating

300-2014.....Reverberant Room Method for Sound Testing of Fans

C. American Society for Testing and Materials (ASTM):

B117-2019.....Standard Practice for Operating Salt Spray (Fog) Apparatus

D1735-2014.....Standard Practice for Testing Water Resistance of Coatings Using Water Fog Apparatus

D3359-2017.....Standard Test Methods for Rating Adhesion by Tape Test

G152-2013(R2021).....Standard Practice for Operating Open Flame Carbon Arc Light Apparatus for Exposure of NonMetallic Materials

G153-2013(R2021).....Standard Practice for Operating Enclosed Carbon Arc Light Apparatus for Exposure of NonMetallic Materials

D. National Fire Protection Association (NFPA):

NFPA 96-2024.....Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations

E. National Sanitation Foundation (NSF):

37-2020 .....Air Curtains for Entranceways in Food and Food Service Establishments

F. Underwriters Laboratories, Inc. (UL):

181-2013.....Standard for Factory-Made Air Ducts and Air Connectors

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 XX XX, SECTION TITLE", with applicable paragraph identification.

C. Manufacturers Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Plenum fan, motors, and drives.

2. Centrifugal fans, motors, drives, accessories, and coatings.
   a. Inline centrifugal fans.
   e. Utility fans and vent sets.

D. Certified sound power levels for each fan.

E. Motor ratings, types, electrical characteristics, and accessories.

F. Certified fan performance curves for each fan showing cubic feet per minute (CFM) versus static pressure, efficiency, and horsepower for design point of operation.

G. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replaceable parts, and troubleshooting guide:
   1. Include complete list indicating all components of the systems.
   2. Include complete diagrams of the internal wiring for each item of equipment.
   3. Diagrams shall have their terminals identified to facilitate installation, operation, and maintenance.

H. Completed System Readiness Checklist provided by the CxA and completed by the contractor, signed by a qualified technician, and dated on the date of completion, in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

I. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

1.5 QUALITY ASSURANCE

A. Fans and power ventilators shall bear the AMCA performance seal.

B. Operating Limits for Centrifugal Fans: AMCA 99 (Class I, II, and III).

C. Fans and power ventilators shall comply with the following standards:
   1. Testing and Rating: AMCA 210.
   2. Sound Rating: AMCA 300.

D. Vibration Tolerance for Fans and Power Ventilators: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

E. Performance Criteria:
   1. The fan schedule shall show the design air volume and static pressure. Select the fan motor hp by increasing the fan bhp by 10 percent to account for the drive losses and field conditions.
   2. Select the fan operating point as follows:

a. Forward Curve and Axial Flow Fans: Right hand side of peak pressure point.

b. Air Foil, Backward Inclined, or Tubular: At or near the peak static efficiency.

F. Safety Criteria: Provide manufacturer's standard screen on fan inlet and discharge where exposed to operating and maintenance personnel.

G. Corrosion Protection:

1. Except for fans in fume hood exhaust service, all steel shall be mill-galvanized, or phosphatized and coated with minimum two coats, corrosion resistant enamel paint. Manufacturer’s paint and paint system shall meet the minimum requirements of ASTM D1735 water fog, ASTM B117 salt spray, ASTM D3359 adhesion, and ASTM G152 and ASTM G153 for carbon arc light apparatus for exposure of non-metallic material.

I. Bio-Based Materials: For products designated by the USDA’s Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

J. Refer to Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for additional sustainable design requirements.

1.6 AS-BUILT DOCUMENTATION

A. Comply with requirements in paragraph AS-BUILT DOCUMENTATION of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

1.7 EXTRA MATERIALS

A. Provide one additional set of belts for all belt-driven fans.

PART 2 - PRODUCTS

2.1 PLENUM FAN

A. Plenum Fans - Single and/or Multiple Fans in an Array:

1. General: Fans shall be Class II (minimum) construction with single inlet, aluminum wheel and stamped air-foil aluminum bladed. The fan wheel shall be mounted on the directly-driven motor shaft in AMCA Arrangement 4. Fans shall be dynamically balanced and internally isolated to minimize the vibrations. Provide a steel inlet cone for

each wheel to match with the fan inlet. Locate fan in the air stream to assure proper flow. The fan performance shall be rated in accordance with AMCA 210 or ASHRAE 51.

2. Allowable vibration tolerances for fan shall not exceed a self-excited vibration maximum velocity of 0.005 m/s (0.20 inch per second) RMS, filter in, when measured with a vibration meter on bearing caps of machine in vertical, horizontal and axial directions or measured at equipment mounting feet if bearings are concealed. After field installation, compliance to this requirement shall be demonstrated with field test in accordance with Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT and Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC. Following fan assembly, the complete fan assembly balance shall be tested using an electronic balance analyzer with a tunable filter and stroboscope. Vibration measurements shall be taken on each motor bearing housing in the vertical, horizontal, and axial planes (5 total measurements, 2 each motor bearing and 1 axial).
3. The plenum fans shall be driven by variable speed drives with at least one back-up drive as shown in the design documents. Use of a drive with bypass is not permitted.
4. Multiple fans shall be installed in a pre-engineered structural frame to facilitate fan stacking. All fans shall modulate in unison, above or below the synchronous speed within the limits specified by the manufacturer, by a common control sequence. Staging of the fans is not permitted. Redundancy requirement shall be met by all operating fans in an array and without the provision of an idle standby fan.
5. Fan Accessories
   a. Fan Isolation: Provide an actuator-controlled damperto isolate the fan not in operation due to failure.
   b. Fan Airflow Measurement: Provide an airflow measuring device integral to the fan to measure air volume within +/- 5 percent accuracy. The probing device shall not be placed in the airflow path to stay clear of turbulence and avoid loss of performance.

2.2 CENTRIFUGAL FANS

A. Record factory vibration test results on the fan or furnish to the Contractor.

B. Fan arrangement, unless noted or approved otherwise:

1. DWDl fans: Arrangement 3.
2. SWSl fans: Arrangement 1, 3, 9 or 10.

C. Construction: Wheel diameters and outlet areas shall be in accordance with AMCA standards.

1. Housing: Low carbon steel, arc welded throughout, braced and supported by structural channel or angle iron to prevent vibration or pulsation, flanged outlet, inlet fully streamlined. Provide lifting clips, and casing drain. Provide manufacturer's standard access door. Provide 13 mm (1/2 inches) wire mesh screens for fan inlets without duct connections.
2. Wheel: Steel plate with die formed blades welded or riveted in place, factory balanced statically and dynamically.
3. Shaft: Designed to operate at no more than 70 percent of the first critical speed at the top of the speed range of the fans class.
4. Bearings: Heavy duty ball or roller type sized to produce a B10 life of not less than 50,000 hours, and an average fatigue life of 200,000 hours. Extend filled lubrication tubes for interior bearings or ducted units to outside of housing.
5. Belts: Oil resistant, non-sparking and non-static.
6. Belt Drives: Factory installed with final alignment belt adjustment made after installation.
7. Motors and Fan Wheel Pulleys: Adjustable pitch for use with motors through 15 hp, fixed pitch for use with motors greater than 15 hp. Select pulleys so that pitch adjustment is at the middle of the adjustment range at fan design conditions.
8. Motor, adjustable motor base, drive and guard: Furnish from factory with fan. Provide protective sheet metal enclosure for fans located outdoors. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC for specifications.
9. Furnish variable speed fan motor controllers where shown in the contract documents. Refer to Section 26 29 11, MOTOR CONTROLLERS.

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC for controller/motor combination requirements.

D. Inline Centrifugal Fans: Provide minimum 18 Gauge galvanized steel housing with inlet and outlet flanges, backward inclined aluminum centrifugal fan wheel, bolted access door and supports as required. Motors shall be factory pre-wired to an external junction box. Provide factory wired disconnect switch.

E. Utility Fans, Vent Sets and Small Capacity Fans: Class l design, arc welded housing, spun intake cone. Requirement for AMCA seal is waived for wheel diameters less than 300 mm (l2 inches) and housings may be cast-iron.

2.3 POWER ROOF VENTILATOR (NOT USED)

2.4 POWER WALL VENTILATOR (NOT USED)

2.5 PACKAGED HOOD MAKE-UP AIR UNITS (NOT USED)

2.6 CENTRIFUGAL CEILING FANS (NOT USED)

2.7 PROPELLER FANS (NOT USED)

2.8 VANE AXIAL FANS (NOT USED)

2.9 AIR CURTAIN UNITS (NOT USED)

PART 3 - EXECUTION

3.1 INSTALLATION

A. If an installation is unsatisfactory to the COR, the contractor shall correct the installation at no additional cost or time to the Government.

B. Install fan, motor and drive in accordance with manufacturer's instructions.

C. Align fan and motor sheaves to allow belts to run true and straight.

D. Bolt equipment to curbs with galvanized lag bolts.

E. Install vibration control devices as shown in the contract documents and specified in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

3.2 PRE-OPERATION MAINTENANCE

A. Lubricate bearings, pulleys, belts and other moving parts with manufacturer recommended lubricants.

B. Rotate impeller by hand and check for shifting during shipment and check all bolts, collars, and other parts for tightness.

C. Clean fan interiors to remove foreign material and construction dirt and dust.

3.3 STARTUP AND TESTING

A. Verify operation of motor, drive system and fan wheel according to the contract documents.

B. Check vibration and correct as necessary for air balance work.

C. After air balancing is complete and permanent sheaves are in place perform necessary field mechanical balancing to meet vibration tolerance in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

D. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.

E. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

F. The CxA will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the COR and CxA. Provide a minimum notice of 10 working days prior to startup and testing.

3.3 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.4 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer’s technical representative for 4 hours to instruct each VA personnel responsible in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

- - - E N D - - -

SECTION 23 36 00
AIR TERMINAL UNITS

PART 1 - GENERAL

1.1 DESCRIPTION

A. A complete listing of common acronyms and abbreviations are included in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

B. Air terminal units and air flow control valves.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

E. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

F. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

G. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

H. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

I. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

J. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

K. Section 23 31 00, HVAC DUCTS and CASINGS.

L. Section 23 34 00, HVAC FANS

M. Section 23 82 16, AIR COILS.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standards will govern.

B. Air Conditioning, Heating, and Refrigeration Institute (AHRI):
880-2017.....Performance Rating of Air Terminals

C. American Society for Testing and Materials (ASTM):
C665-2017.....Standard Specification for Mineral-Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing

D. National Fire Protection Association (NFPA):

90A-2024.....Standard for the Installation of Air-Conditioning and Ventilating Systems

E. Underwriters Laboratories, Inc. (UL):

181-2013(R2017).....Standard for Factory-Made Air Ducts and Air Connectors

F. Department of Veterans Affairs (VA):

PG-18-10-2024.....HVAC Design Manual

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 XX XX, SECTION TITLE", with applicable paragraph identification.

C. Manufacturer's Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Air flow control valves.

D. Samples: Provide one typical air terminal unit for approval by the COR. This unit will be returned to the Contractor after all similar units have been shipped and deemed acceptable at the job site.

E. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replaceable parts, and troubleshooting guide:

1. Include complete list indicating all components of the systems.
2. Include complete diagrams of the internal wiring for each item of equipment.
3. Diagrams shall have their terminals identified to facilitate installation, operation, and maintenance.

F. Completed System Readiness Checklist provided by the CxA and completed by the contractor, signed by a qualified technician, and dated on the date of completion, in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

G. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

1.5 QUALITY ASSURANCE

A. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

B. Refer to Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for additional sustainable design requirements.

1.6 AS-BUILT DOCUMENTATION

A. Comply with requirements in paragraph AS-BUILT DOCUMENTATION of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

PART 2 - PRODUCTS

2.1 GENERAL

A. Coils:

1. All Air Terminal Units: Provide aluminum fins and copper coils for all hot water reheat coils.
2. Water Heating Coils:
   a. AHRI certified, continuous plate or spiral fin type, leak tested at 2070 kPa (300 psig).
   b. Capacity: As indicated, based on scheduled entering water temperature.
   c. Headers: Copper or Brass.
   d. Fins: Aluminum, maximum 315 fins per meter (8 fins per inch).
   e. Tubes: Copper, arrange for counter-flow of heating water.
   f. Water Flow Rate: Minimum 0.032 Liters/second (0.5 gpm).
   g. Provide vent and drain connection at high and low point, respectively of each coil.
   h. Coils shall be guaranteed to drain.

B. Labeling: Control box shall be clearly marked with an identification label that lists such information as nominal CFM, maximum and minimum factory-set airflow limits, coil type and coil connection orientation, where applicable.

C. Factory-calibrate air terminal units to air flow rate indicated. All settings including maximum and minimum air flow shall be field adjustable.

D. Dampers with internal air volume control, see Section 23 31 00, HVAC DUCTS and CASINGS.

E. Terminal sound attenuators, see Section 23 31 00, HVAC DUCTS and CASINGS.

F. Air terminal performance shall be in compliance with AHRI 880.

2.2 AIR TERMINAL UNITS (BOXES)

A. General: Factory-built, pressure independent units, factory set-field adjustable air flow rate, suitable for single duct applications. Use of dual-duct air terminal units is prohibited. Clearly show on each unit the unit number and factory set air volumes corresponding to the contract drawings. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC work assumes factory set air volumes. Coordinate flow controller sequence and damper operation details with the contract drawings and Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. All air terminal units shall be brand new products of the same manufacturer.

B. Capacity and Performance: The maximum capacity of a single terminal unit shall not exceed 566 Liters/second (1,200 cfm) with the exception of operating rooms and Cystoscopy rooms, which shall be served by a single air terminal unit at a maximum of 1,250 Liters/second (2,649 CFM).

C. Sound Power Levels: Acoustic performance of the air terminal units shall be based on the design noise levels for the spaces stipulated in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT. Equipment schedule shall show the sound power levels in all octave bands. Terminal sound attenuators shall be provided, as required, to meet the intent of the design.

D. Casing: Unit casing shall be constructed of galvanized steel no lighter than 0.85 mm (22 Gauge). Air terminal units serving the operating rooms and Cystoscopy rooms shall be fabricated without lining. Provide hanger brackets for attachment of supports.

1. Lining Material: Suitable to provide required acoustic performance, thermal insulation and prevent sweating. Meet the requirements of

NFPA 90A and comply with UL 181 for erosion as well as ASTM C665 antimicrobial requirements. Insulation shall consist of 13 mm (1/2 inch) thick non-porous foil faced rigid fiberglass insulation of 4-lb/cu.ft, secured by full length galvanized steel z-strips which enclose and seal all edges. Tape and adhesives shall not be used. Materials shall be non-friable and with surfaces, including all edges, fully encapsulated and faced with perforated metal or coated so that the air stream will not detach material. No lining material is permitted in the boxes serving operating rooms and Cystoscopy rooms.

2. Access Panels (or doors): Provide panels large enough for inspection, adjustment and maintenance without disconnecting ducts, and for cleaning heating coils attached to unit, even if there are no moving parts. Panels shall be insulated to same standards as the rest of the casing and shall be secured and gasketed airtight. It shall require no tool other than a screwdriver to remove.
3. Total leakage from casing, not to exceed 2 percent of the nominal capacity of the unit when subjected to a static pressure of 750 Pa (3 inches WG), with all outlets sealed shut and inlets fully open.
4. Octopus Connector: Factory installed, lined air distribution terminal. Provide where flexible duct connections are shown on the contract drawings connected directly to terminals. Provide butterfly-balancing damper, with locking means in connectors with more than one outlet. Octopus connectors and flexible connectors are prohibited in the Surgical Suite.

E. Construct dampers and other internal devices of corrosion resisting materials which do not require lubrication or other periodic maintenance.
   1. Damper Leakage: Not greater than 2 percent of maximum rated capacity, when closed against inlet static pressure of 1 kPa (4 inches WG).
F. Provide multi-point velocity pressure sensors with external pressure taps. Provide direct reading air flow rate table pasted to box.
G. Provide static pressure tubes.
H. Externally powered DDC variable air volume controller and damper actuator to be furnished under Section 23 09 23, DIRECT-DIGITAL CONTROL

SYSTEM FOR HVAC for factory mounting on air terminal units. The DDC controller shall be electrically actuated.

2.3 AIR FLOW CONTROL VALVE (AFCV) (NOT USED)

PART 3 - EXECUTION

3.1 INSTALLATION

A. If an installation is unsatisfactory to the COR, the contractor shall correct the installation at no additional cost or time to the Government.

B. Work shall be installed as shown and according to the manufacturer's diagrams and recommendations.

C. Handle and install units in accordance with manufacturer's written instructions.

D. Support units rigidly so they always remain stationary. Cross-bracing or other means of stiffening shall be provided as necessary. Method of support shall be such that distortion and malfunction of units cannot occur.

E. Locate air terminal units to provide a straight section of inlet duct for proper functioning of volume controls.

3.2 STARTUP AND TESTING

A. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.

B. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

C. The CxA will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the COR and CxA. Provide a minimum notice of 10 working days prior to startup and testing.

3.3 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.4 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer's technical representative for 4 hours to instruct each VA personnel responsible in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

- - - E N D - - -

SECTION 23 37 00
AIR OUTLETS AND INLETS

PART 1 - GENERAL

1.1 DESCRIPTION

A. A complete listing of common acronyms and abbreviations are included in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

B. Air Outlets and Inlets: Diffusers, registers, and grilles.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 08 90 00, LOUVERS and VENTS.

E. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

F. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

G. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

H. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standards will govern.

B. Air Duct Council:

Flexible Duct Performance & Installation Standards (Manual), 5th Edition Green Book

C. American Society of Civil Engineers (ASCE):

7-2016.....Minimum Design Loads and Associated Criteria for Buildings and Other Structures

D. American Society for Testing and Materials (ASTM):

B209/B209M-2021.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate

E. National Fire Protection Association (NFPA):

90A-2024.....Standard for the Installation of Air-Conditioning and Ventilating Systems

F. Underwriters Laboratories, Inc. (UL):

181-2013(R2017).....Standard for Factory-Made Air Ducts and Air Connectors

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 XX XX, SECTION TITLE", with applicable paragraph identification.

C. Manufacturer's Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Air intake/exhaust hoods.
2. Diffusers, registers, grilles, and accessories.

D. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replaceable parts, and troubleshooting guide:

1. Include complete list indicating all components of the systems.
2. Include complete diagrams of the internal wiring for each item of equipment.
3. Diagrams shall have their terminals identified to facilitate installation, operation, and maintenance.

1.5 QUALITY ASSURANCE

A. Fire Safety Code: Comply with NFPA 90A.

B. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

C. Refer to Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for additional sustainable design requirements.

1.6 AS-BUILT DOCUMENTATION

A. Comply with requirements in paragraph AS-BUILT DOCUMENTATION of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

PART 2 - PRODUCTS

2.1 GRAVITY INTAKE/EXHAUST VENTILATORS (ROOF MOUNTED) (NOT USED)

2.2 EQUIPMENT SUPPORTS

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

2.3 AIR OUTLETS AND INLETS

A. Materials:
   1. Steel or aluminum. Provide manufacturer's standard gasket.
   2. Exposed Fastenings: The same material as the respective inlet or outlet. Fasteners for aluminum may be stainless-steel.
   3. Contractor shall review all ceiling drawings and details and provide all ceiling mounted devices with appropriate dimensions and trim for the specific locations.

B. Performance Test Data: In accordance with Air Duct Council "Flexible Duct Performance & Installation Standards (Manual), Green Book". Refer to Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT for NC criteria.

C. Air Supply Outlets:
   1. Ceiling Diffusers: Suitable for surface mounting, exposed T-bar or special tile ceilings, off-white finish, square or round neck connection as shown on the contract drawings. Provide plaster frame for units in plaster ceilings.
      a. Square, Louver, Fully Adjustable Pattern: Round neck, surface mounting unless shown otherwise on the contract drawings. Provide equalizing or control grid and volume control damper.
      b. Louver Face Type: Square or rectangular, removable core for 1, 2, 3, or 4 way directional pattern. Provide equalizing or control grid and opposed blade damper.
      c. Perforated Face Type: Manual adjustment for one-, two-, three-, or four-way horizontal air distribution pattern without change of air volume or pressure. Provide equalizing or control grid and opposed blade over overlapping blade damper. Perforated face diffusers for VAV systems shall have the pattern controller on

the inner face, rather than in the neck and designed to discharge air horizontally at the ceiling maintaining a Coanda effect.

2. Supply Registers: Double deflection type with horizontal face bars and opposed blade damper with removable key operator.
   a. Margin: Flat, 32 mm (1-1/4 inches) wide.
   b. Bar Spacing: 19 mm (3/4 inch) maximum.
   c. Finish: Off white baked enamel for ceiling mounted units. Wall units shall have a prime coat for field painting or shall be extruded with manufacturer's standard finish.
3. Supply Grilles: Same as registers but without the opposed blade damper.

D. Return and Exhaust Registers and Grilles: Provide opposed blade damper without removable key operator for registers.

1. Finish: Off-white baked enamel for ceiling mounted units. Wall units shall have a prime coat for field painting or shall be extruded aluminum with manufacturer's standard aluminum finish.
2. Standard Type: Fixed horizontal face bars set at 30 to 45 degrees, approximately 32 mm (1-1/4 inch) margin.
3. Perforated Face Type: To match supply units.
4. Grid Core Type: 13 mm by 13 mm (1/2 inch by 1/2 inch) core with 32 mm (1-1/4 inch) margin.
5. Door Grilles: Are furnished with the doors.
6. Egg Crate Grilles: Aluminum or Painted Steel 13 mm by 13 mm by 13 mm (1/2 inch by 1/2 inch by 1/2) inch grid providing 90 percent free area.
   a. Heavy extruded aluminum frame shall have countersunk screw mounting. Unless otherwise indicated, register blades and frame shall have factory applied white finish.
   b. Grille shall be suitable for duct or surface mounting as indicated on the contract drawings. All necessary appurtenances shall be provided to allow for mounting.

2.4 WIRE MESH GRILLE

A. Fabricate grille with 2 by 2 inch mesh 13 mm (1/2 inch) galvanized steel or aluminum hardware cloth in a spot welded galvanized steel frame with approximately 38 mm (1-1/2 inch) margin.

B. Use grilles where shown in unfinished areas such as mechanical rooms.

2.5 FILTER RETURN/EXHAUST GRILLE (NOT USED)

PART 3 - EXECUTION

3.1 INSTALLATION

A. If an installation is unsatisfactory to the COR, the contractor shall correct the installation at no additional cost or time to the Government.

B. Comply with provisions of Section 23 05 11, COMMON WORK RESULTS FOR HVAC, particularly regarding coordination with other trades and work in existing buildings.

C. Protection and Cleaning: Protect equipment and materials against physical damage. Place equipment in first class operating condition or return to source of supply for repair or replacement, as determined by COR. Protect equipment during construction against entry of foreign matter to the inside and clean both inside and outside before operation and painting.

3.2 INTAKE/EXHAUST HOODS EXPOSED TO WIND VELOCITY

A. Provide additional support and bracing to all exposed ductwork installed on the roof or outside the building to withstand wind velocity of 145 km/h (90 mph).

3.3 TESTING, ADJUSTING, AND BALANCING (TAB)

A. Refer to Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

3.4 STARTUP AND TESTING

A. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.

B. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

- - - E N D - - -

SECTION 23 40 00
HVAC AIR CLEANING DEVICES

PART 1 - GENERAL

1.1 DESCRIPTION

A. A complete listing of common acronyms and abbreviations are included in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

B. Air filters for heating, ventilating and air conditioning.

C. Definitions: Refer to ASHRAE 52.2 for definitions of face velocity, net effective filtering area, media velocity, initial resistance (pressure drop), MERV (Minimum Efficiency Reporting Value), PSE (Particle Size Efficiency), particle size ranges for each MERV number, dust holding capacity and explanation of electrostatic media based filtration products versus mechanical filtration products. Refer to ASHRAE 52.2 for definition of MERV-A.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

E. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

F. Section 23 37 00, AIR OUTLETS AND INLETS.

G. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only. Where conflicts occur these specifications and the VHA standards will govern.

B. Air-Conditioning, Heating, and Refrigeration Institute (AHRI):
850-2013.....Performance Rating of Commercial and Industrial Air Filter Equipment

C. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. (ASHRAE):
52.2-2017.....Method of Testing General Ventilation Air Cleaning Devices for Removal Efficiency by Particle Size

170-2021.....Ventilation of Health Care Facilities

D. American Society of Mechanical Engineers (ASME):

ASME Boiler and Pressure Vessel Code -

BPVC Section IX-2021....Welding, Brazing, and Fusing Qualifications

E. American Welding Society (AWS):

D9.1/D9.1M-2018.....Sheet Metal Welding Code

F. International Organization for Standardization (ISO):

9001-2015(R2021).....Quality Management Systems - Requirements

G. Underwriters Laboratories, Inc. (UL):

586-2009(R2017).....Standard for High-Efficiency, Particulate, Air Filter Units

900-2015.....Standard for Air Filter Units

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 XX XX, SECTION TITLE", with applicable paragraph identification.

C. Manufacturer's Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Extended surface filters.
2. Holding frames. Identify locations.
3. Side access housings. Identify locations, verify insulated doors.
4. Magnehelic gauges.

D. Air Filter performance reports.

E. Suppliers warranty.

F. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replaceable parts, and troubleshooting guide:

1. Include complete list indicating all components of the systems.
2. Include complete diagrams of the internal wiring for each item of equipment.

3. Diagrams shall have their terminals identified to facilitate installation, operation, and maintenance.

1.5 QUALITY ASSURANCE

A. Air Filter Performance Report for Extended Surface Filters:

1. Submit a test report for each Grade of filter being offered. The report shall not be more than three (3) years old and prepared by using test equipment, method and duct section as specified by ASHRAE 52.2 for type filter under test and acceptable to COR, indicating that filters comply with the requirements of this specification. Filters utilizing partial or complete synthetic media will be tested in compliance with pre-conditioning steps as stated in ASHRAE 52.2. All testing is to be conducted on filters with a nominal 610 mm by 610 mm (24 inch by 24 inch) face dimension. Test for 150 m/min (500 fpm) will be accepted for lower velocity rated filters provided the test report of an independent testing laboratory complies with all the requirements of this specification.

2. Government Option: The Government at its option may take one of the filters for each different type submitted and run an independent test to determine if the filter meets the requirements of this specification. When the filter meets the requirements, the Government will pay for the test. When the filter does not meet the specification requirements, the manufacturer will be required to pay for the test and replace the filters with filters that will perform as required by the specifications.
3. Guarantee Performance: The manufacturer shall supply ASHRAE 52.2 test reports on each filter type submitted. Any filter supplied will be required to maintain the minimum efficiency shown on the ASHRAE 52.2 report throughout the time the filter is in service. Within the first 6 to 12 weeks of service a filter may be pulled out of service and sent to an independent laboratory for ASHRAE 52.2 testing for initial efficiency only. If this filter fails to meet the minimum level of efficiency shown in the previously submitted reports, the filter manufacturer/distributor shall take back all filters and refund the owner all monies paid for the filters, cost of installation, cost of freight and cost of testing.

B. Filter Warranty for Extended Surface Filters: Guarantee the filters against leakage, blow-outs, and other deficiencies during their normal useful life, up to the time that the filter reaches the final pressure drop. Defective filters shall be replaced at no additional cost or time to the Government.

C. Comply with UL 900 for flame test.

D. Nameplates: Each filter shall bear a label or name plate indicating manufacturer's name, filter size, rated efficiency, UL classification, and file number.

E. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

F. Refer to Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for additional sustainable design requirements.

1.6 AS-BUILT DOCUMENTATION

A. Comply with requirements in paragraph AS-BUILT DOCUMENTATION of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

PART 2 - PRODUCTS

2.1 REPLACEMENT FILTER ELEMENTS TO BE FURNISHED

A. To allow temporary use of HVAC systems for testing and in accordance with Paragraph, TEMPORARY USE OF MECHANICAL AND ELECTRICAL SYSTEMS in Section 01 00 00, GENERAL REQUIREMENTS. Provide one complete set of additional filters to the COR.

B. The COR will direct whether these additional filters will either be installed as replacements for dirty units or turned over to VA for future use as replacements.

2.2 EXTENDED SURFACE AIR FILTERS

A. Use factory assembled air filters of the extended surface type with supported or non-supported cartridges for removal of particulate matter in air conditioning, heating and ventilating systems. Filter units shall be of the extended surface type fabricated for disposal when the contaminant load limit is reached as indicated by maximum (final) pressure drop.

B. Filter Classification: UL listed and approved conforming to UL 900.

C. HVAC Filter Types:

HVAC Filter Types				
MERV Value ASHRAE 52.2		Application	Particle Size	Thickness /Type
8		Pre-Filter	3 to 10 Microns	50 mm (2 inch) Throwaway
11		After-Filter	1 to 3 Microns	152 mm (6 inch) or 305 mm (12 inch) Rigid Cartridge
13		(Alternate) After-Filter	0.3 to 1 Microns	152 mm (6 inch) or 305 mm (12 inch) Rigid Cartridge
14		After-Filter	0.3 to 1 Microns	152 mm (6 inch) or 305 mm (12 inch) Rigid Cartridge

D. HEPA Filters:

HEPA Filters				
Efficiency at 0.3 Micron	Application	Initial Resistance (inches WG)	Rated cfm	Construction
99.97	Final Filter	1.35	1100	Galvanized Frame X-Body
99.97	Final Filter	1.00	2000	Aluminum Frame V-Bank

2.3 MEDIUM EFFICIENCY PLEATED PANEL PRE-FILTERS (50 MM (2 INCH); MERV 8; UL 900 CLASS 2)

A. Construction: Air filters shall be medium efficiency ASHRAE pleated panels consisting of cotton and synthetic or 100 percent virgin synthetic media, self-supporting media with required media stabilizers, and beverage board enclosing frame. Filter media shall be lofted to a uniform depth and formed into a uniform radial pleat. The media stabilizers shall be bonded to the downstream side of the media to maintain radial pleats and prevent media oscillation. An enclosing frame of no less than 28-point high wet-strength beverage board shall provide a rigid and durable enclosure. The frame shall be bonded to the media on all sides to prevent air bypass. Integral diagonal support members on the air entering and air exiting side shall be bonded to the

apex of each pleat to maintain uniform pleat spacing in varying airflows.

B. Performance: The filter shall have a Minimum Efficiency Reporting Value of MERV 8 when evaluated under the guidelines of ASHRAE 52.2. The media shall maintain or increase in efficiency over the life of the filter. All testing is to be conducted on filters with a nominal 610 mm by 610 mm (24 inch by 24 inch) face dimension.

Minimum Efficiency Reporting (MERV)	8
Dust Holding Capacity (Grams)	105
Nominal Size (Inches Width x Height x Depth)	24x24x2
Rated Air Flow Capacity (cfm)	2,000
Rated Air Flow Rate (fpm)	500
Final Resistance (Inches WG) Maximum Recommended Change-Out Resistance (Inches WG)	1.0 0.66
Rated Initial Resistance (Inches WG)	0.33

C. The filters shall be approved and listed by Underwriters Laboratories, Inc. as Class 2 when tested according to UL 900.

2.4 HIGH EFFICIENCY EXTENDED SURFACE (INTERMEDIATE/AFTER (FINAL)) CARTRIDGE FILTERS (305 MM (12 INCH); MERV 14/13/11; UL 900 CLASS 2)

A. Construction: Air filters shall consist of 8 pleated media packs assembled into 4 V-banks within a totally plastic frame. The filters shall be capable of operating at temperatures up to 80 degrees C (176 degrees F). The filters shall either fit without modification or be adaptable to the existing holding frames. The molded end panels are to be made of high impact polystyrene plastic. The center support members shall be made of ABS plastic. No metal components are to be used.

B. Media: The media shall be made of micro glass fibers with a water repellent binder. The media shall be a dual density construction, with coarser fibers on the air entering side and finer fibers on the air leaving side. The media shall be pleated using separators made of continuous beads of low profile thermoplastic material. The media packs shall be bonded to the structural support members at all points of contact, this improves the rigidity as well as eliminates potential air bypass in the filter.

C. Performance: Filters of the size, air flow capacity and nominal efficiency (MERV) shall meet the following rated performance specifications based on the ASHRAE 52.2 test method. All testing is to be conducted on filters with a nominal 610 mm by 610 mm (24 inch by 24 inch) header dimension.

Minimum Efficiency Reporting Value (MERV)	14	13	11
Gross Media Area (sf)	197	197	197
Dust Holding Capacity (Grams)	486	430	465
Nominal Size (Inches Width x Height x Depth)	24x24x12	24x24x12	24x24x12
Rated Air Flow Capacity (cfm)	2,000	2,000	2,000
Rated Air Flow Rate (fpm)	500	500	500
Final Resistance (Inches WG)	2.0	2.0	2.0
Maximum Recommended Change-Out Resistance (Inches WG)	0.74	0.68	0.54
Rated Initial Resistance (Inches WG)	0.37	0.34	0.27

2.5 HIGH EFFICIENCY PARTICULATE AIR (HEPA) FILTERS STANDARD CAPACITY (FINAL FILTER APPLICATION)

A. Air filters shall be HEPA grade standard capacity air filters with waterproof micro glass fiber media, corrugated aluminum separators, urethane sealant, 1.6 mm (16 gauge) steel enclosing frame and fluid sealing gasket. Sizes shall be as noted on enclosed drawings or other supporting materials.

B. Construction: Filter media shall be one continuous pleating of microfine glass fiber media. Pleats shall be uniformly separated by corrugated aluminum separators incorporating a hemmed edge to prevent damage to the media. The media pack shall be potted into the enclosing frame with a fire-retardant urethane sealant. The enclosing frame shall be of 1.6 mm (16 gauge) steel, with a zinc aluminum alloy finish, and shall be bonded to the media pack to form a rugged and durable enclosure. The filter shall be assembled without the use of fasteners to ensure no frame penetrations. Overall dimensional tolerance shall be correct within -3.2 mm (-1/8 inch), +0 mm (+0 inch), and square within 3.2 mm (1/8 inch). A poured-in-place seamless sealing gasket shall be

included on the downstream side of the enclosing frame to form a positive seal upon installation.

C. Performance: The filter shall have a tested efficiency of 99.97 percent when evaluated according to IEST Recommended Practice. Initial resistance to airflow shall not exceed 250 Pa (1 inch WG) at rated capacity. Filter shall be listed by Underwriters Laboratories as UL 900. The filter shall be capable of withstanding 2500 Pa (10 inches WG) without failure of the media pack. Manufacturer shall provide evidence of facility certification to ISO 9001.

HEPA Performance (Standard Capacity)		
Nominal Size (Inches Height x Width x Depth)	Airflow Capacity (cfm)	Media Area (sf)
24x24x12	1080 at 1 Inch WG	153
24x12x12	500 at 1 Inch WG	33
Follow manufacturer's recommendation for change out resistance, typically double the initial.		

D. Supporting Data: The filter shall be labeled as to tested efficiency, rated/tested cfm, pressure drop and shall be serialized for identification. The manufacturer shall supply a Certificate of Conformance for each HEPA filter supplied to the facility.

2.6 HEPA FILTERS HIGH CAPACITY V-BANK HIGH CAPACITY FILTERS (FINAL FILTER APPLICATION) (NOT USED)

2.7 FILTER HOUSINGS/SUPPORT FRAMES (NOT USED)

2.8 ACTIVATED CARBON PLEATED PANEL FILTERS (NOT USED)

2.9 ACTIVATED CARBON EXTENDED SURFACE, HIGH EFFICIENCY GAS PHASE FILTERS (NOT USED)

2.10 CHEMICAL MEDIA GAS-PHASE AIR CLEANING CASSETTES - HEAVY DUTY (HD) CASSETTE, MEDIUM DUTY (MD) CASSETTE, CLEANROOM GRADE (CG) CASSETTE (NOT USED)

2.11 INSTRUMENTATION

A. Magnehelic Differential Pressure Filter Gauges: Nominal 100 mm (4 inch) diameter, 0 to 500 Pa (0 to 2 inches WG), 3 inch for HEPA range. Gauges shall be flush-mounted in aluminum panel board, complete with static tips, copper or aluminum tubing, and accessory items to provide zero adjustment.

B. DDC Static (Differential) Air Pressure Measuring Station: Refer to Section 23 09 23, DIRECT DIGITAL CONTROL SYSTEM FOR HVAC.

C. Provide one DDC sensor across each extended surface filter. Provide Petcocks for each gauge or sensor.

D. Provide one common filter gauge for two-stage filter banks with isolation valves to allow differential pressure measurement.

2.12 HVAC EQUIPMENT FACTORY FILTERS

A. Manufacturer standard filters within fabricated packaged equipment should be specified with the equipment and should adhere to industry standard.

B. Cleanable filters are prohibited.

C. Automatic roll type filters are prohibited.

2.13 FILTER RETURN GRILLES (NOT USED)

PART 3 - EXECUTION

3.1 INSTALLATION

A. If an installation is unsatisfactory to the COR, the contractor shall correct the installation at no additional cost or time to the Government.

B. Install supports, filters, and gauges in accordance with manufacturer's instructions.

C. Label clearly with words "Contaminated Air" on exhaust ducts leading to the HEPA filter housing.

3.2 STARTUP AND TESTING

A. Clean and vacuum air handling units and plenums prior to starting air handling systems.

B. Replace pre-filters and install clean filter units prior to final inspection as directed by the COR.

C. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.

D. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

E. The CxA will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with

the COR and CxA. Provide a minimum notice of 10 working days prior to startup and testing.

- - E N D - - -

SECTION 23 73 00
INDOOR CENTRAL-STATION AIR-HANDLING UNITS

PART 1 - GENERAL

1.1 DESCRIPTION

A. A complete listing of common acronyms and abbreviations are included in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

B. Air handling units including integral components specified herein.

C. Definition of Air Handling Unit (AHU): A factory-fabricated and tested assembly of modular sections consisting of single or multiple plenum fans with direct-drive, coils, filters, and other necessary equipment to perform one or more of the following functions of circulating, cleaning, heating, cooling, humidifying, dehumidifying, and mixing of air. Design capacities of units shall be as scheduled in the contract documents.

1.2 RELATED WORK

A. Section 01 00 00, GENERAL REQUIREMENTS.

B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

E. Section 09 91 00, PAINTING.

F. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

G. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

H. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT.

I. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

J. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.

K. Section 23 07 11, HVAC AND BOILER PLANT INSULATION.

L. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

M. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

N. Section 23 21 13, HYDRONIC PIPING.

O. Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING.

P. Section 23 31 00, HVAC DUCTS and CASINGS.

Q. Section 23 34 00, HVAC FANS.

R. Section 23 40 00, HVAC AIR CLEANING DEVICES.

S. Section 23 82 16, AIR COILS.

T. Section 26 29 11, MOTOR CONTROLLERS.

1.3 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Where conflicts occur these specifications and the VHA standards will govern.

B. Air-Conditioning, Heating, and Refrigeration Institute (AHRI):

260-2017.....Sound Rating of Ducted Air Moving and Conditioning Equipment

410-2001.....Forced-Circulation Air-Cooling and Air-Heating Coils with Addenda 1, 2 and 3

430-2020.....Performance Rating of Central Station Air-Handling Unit Supply Fans

C. Air Movement and Control Association International, Inc. (AMCA):

99-2016.....Standards Handbook

210-2016.....Laboratory Methods of Testing Fans for Certified Aerodynamic Performance Rating

D. American Bearing Manufacturers Association (ABMA):

9-2015(R2020).....Load Ratings and Fatigue Life for Ball Bearings

E. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. (ASHRAE):

51-2016.....Laboratory Methods of Testing Fans for Certified Aerodynamic Performance Rating

170-2021.....Ventilation of Health Care Facilities

F. American Society for Testing and Materials (ASTM):

A653/A653M-2020.....Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process

B117-2019.....Standard Practice for Operating Salt Spray (Fog) Apparatus

D1654-2008(R2016)e1.....Standard Test Method for Evaluation of Painted or Coated Specimens Subjected to Corrosive Environments

D1735-2014.....Standard Practice for Testing Water Resistance of Coatings Using Water Fog Apparatus

D3359-2017.....Standard Test Methods for Rating Adhesion by Tape Test

G152-2013(R2021).....Standard Practice for Operating Open Flame Carbon Arc Light Apparatus for Exposure of Nonmetallic Materials

G. Energy Policy Act of 2005 (P.L.109-58)

H. Military Specifications (Mil. Spec.):

P-21035B-2021.....Paint, High Zinc Dust Content, Galvanizing Repair (Metric)

I. National Fire Protection Association (NFPA):

70-2023.....National Electrical Code

90A-2024.....Standard for Installation of Air-Conditioning and Ventilating Systems

J. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):

016-2012.....HVAC Air Duct Leakage Test Manual, 2nd Edition

1.4 SUBMITTALS

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 23 XX XX, SECTION TITLE", with applicable paragraph identification.

C. Manufacturer's Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Submittals for AHUs shall include fans, drives, motors, coils, humidifiers, mixing box with outside/return air dampers, filter housings, and all other related accessories. The contractor shall provide custom drawings showing total air handling unit assembly including dimensions, operating weight, access sections, flexible connections, door swings, controls penetrations, electrical disconnect, lights, duplex receptacles, switches, wiring, utility

connection points, unit support system, vibration isolators, drain pan, pressure drops through each component (filter, coil etc).

2. Submittal drawings of section or component only will not be acceptable. Contractor shall also submit performance data including performance test results, charts, curves, or certified computer selection data; data sheets; fabrication and insulation details. If the unit cannot be shipped in one piece, the contractor shall indicate the number of pieces that each unit will have to be broken into to meet shipping and job site rigging requirements.
3. Submit sound power levels in each octave band for the inlet and discharge of the fan and at entrance and discharge of AHUs at scheduled conditions. In absence of sound power ratings refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
4. Provide fan curves showing Liters/Second (cubic feet per minute), static pressure, efficiency, and horsepower for design point of operation and at maximum design Liters/Second (cubic feet per minute).
5. Submit total fan static pressure, external static pressure, for AHU including total, inlet and discharge pressures, and itemized specified internal losses and unspecified internal losses. Refer to air handling unit schedule in the contract documents.

D. Submit written test procedures two weeks prior to factory testing. Submit written results of factory tests for approval prior to shipping.
E. Submit shipping information that clearly indicates how the units will be shipped in compliance with the descriptions below.
   1. Units shall be shipped in one (1) piece where possible and in shrink wrapping to protect the unit from dirt, moisture and/or road salt.
   2. If not shipped in one (1) piece, provide manufacturer approved shipping splits where required for installation or to meet shipping and/or job site rigging requirements in modular sections. Indicate clearly that the shipping splits shown in the submittals have been verified to accommodate the construction constraints for rigging as required to complete installation and removal of any section for replacement through available access without adversely affecting other sections.

3. If shipping splits are provided, each component shall be individually shrink wrapped to protect the unit and all necessary hardware (e.g., bolts, gaskets etc.) will be included to assemble unit onsite.
4. Lifting lugs will be provided to facilitate rigging on shipping splits and joining of segments. If the unit cannot be shipped in one piece, the contractor shall indicate the number of pieces that each unit will have to be broken into to meet shipping and job site rigging requirements.

F. Complete operating and maintenance manuals including wiring diagrams, technical data sheets, information for ordering replaceable parts, and troubleshooting guide:
1. Include complete list indicating all components of the systems.
2. Include instructions for lubrication, filter replacement, motor and drive replacement, and spare parts list.
3. Include complete diagrams of the internal wiring for each item of equipment.
4. Diagrams shall have their terminals identified to facilitate installation, operation, and maintenance.

G. Completed System Readiness Checklist provided by the CxA and completed by the contractor, signed by a qualified technician, and dated on the date of completion, in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

H. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

1.5 QUALITY ASSURANCE

A. Comply with requirements in paragraph QUALITY ASSURANCE of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

B. Air Handling Units Certification:
1. Air Handling Units with Housed Centrifugal Fans: The air handling units shall be certified in accordance with AHRI 430 and tested/rated in accordance with AHRI 260.
2. Air Handling Units with Plenum Fans:
a. Air Handling Units with a single Plenum Fan shall be certified in accordance with AHRI 430 and tested/rated in accordance with AHRI 260.

b. Air handling Units with Multiple Fans in an Array shall be tested and rated in accordance with AHRI 430 and AHRI 260.

C. Heating, Cooling, and Air Handling Capacity and Performance Standards: AHRI 430, AHRI 410, ASHRAE 51, and AMCA 210.

D. Performance Criteria:

1. The fan BHP shall include all system effects for all fans and v-belt drive losses for housed centrifugal fans.
2. The fan motor shall be selected within the rated nameplate capacity, without relying upon NEMA Standard Service Factor.
3. Select the fan operating point as follows:
   a. Forward Curve and Axial Flow Fans: Right hand side of peak pressure point.
   b. Air Foil, Backward Inclined, or Tubular Fans Including Plenum Fans: At or near the peak static efficiency but at an appropriate distance from the stall line.
4. Operating Limits: AMCA 99 and manufacturer's recommendations.

E. Units shall be factory-fabricated, assembled, and tested by a manufacturer, in business of manufacturing similar air-handling units for at least five (5) years.

F. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit http://www.biopreferred.gov.

G. Refer to Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for additional sustainable design requirements.

1.6 AS-BUILT DOCUMENTATION

A. Comply with requirements in paragraph AS-BUILT DOCUMENTATION of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

PART 2 - PRODUCTS

2.1 AIR HANDLING UNITS

A. General:

1. AHUs shall be fabricated from insulated, solid double-wall galvanized steel without any perforations in draw-through

configuration. Galvanizing shall be hot dipped conforming to ASTM A653/A653M and shall provide a minimum of 0.275 kg of zinc per square meter (0.97 oz. of zinc per square foot) (G90). Aluminum constructed units, subject to VA approval, may be used in place of galvanized steel. The unit manufacturer shall provide published documentation confirming that the structural rigidity of aluminum air-handling units is equal or greater than the specified galvanized steel.

2. The contractor and the AHU manufacturer shall be responsible for ensuring that the unit will not exceed the allocated space shown in the contract documents, including required clearances for service and future overhaul or removal of unit components. All structural, piping, wiring, and ductwork alterations of units, which are dimensionally different than those specified, shall be the responsibility of the contractor at no additional cost or time to the Government.
3. AHUs shall be fully assembled by the manufacturer in the factory in accordance with the arrangement shown in the contract documents. The unit shall be assembled into the largest sections possible subject to shipping and rigging restrictions. The correct fit of all components and casing sections shall be verified in the factory for all units prior to shipment. All units shall be fully assembled, tested, and then split to accommodate shipment and job site rigging. On units not shipped fully assembled, the manufacturer shall tag each section and include air flow direction to facilitate assembly at the job site. Lifting lugs or shipping skids shall be provided for each section to allow for field rigging and final placement of unit.
4. The AHU manufacturer shall provide the necessary gasketing, caulking, and all screws, nuts, and bolts required for assembly. The manufacturer shall provide a factory-trained and qualified local representative at the job site to supervise the assembly and to assure that the units are assembled to meet manufacturer's recommendations and requirements noted in the contract documents. Provide documentation to the Contracting Officer that the local representative has provided services of similar magnitude and

complexity on jobs of comparable size. If a local representative cannot be provided, the manufacturer shall provide a factory representative.

5. Gaskets: All door and casing and panel gaskets and gaskets between air handling unit components, if joined in the field, shall be high quality which seal airtight and retain their structural integrity and sealing capability after repeated assembly and disassembly of bolted panels and opening and closing of hinged components. Bolted sections may use a more permanent gasketing method provided they are not disassembled.
6. Structural Rigidity: Provide structural reinforcement when required by span or loading so that the deflection of the assembled structure shall not exceed 1/200 of the span based on a differential static pressure of 2000 Pa (8 inch WG) or higher.

B. Base:

1. Provide a heavy duty steel base for supporting all major AHU components. Bases shall be constructed of wide-flange steel I-beams, channels, or minimum 127 mm (5 inch) high 3.5 mm (10 Gauge) steel base rails. Welded or bolted cross members shall be provided as required for lateral stability. Contractor shall provide supplemental steel supports as required to obtain proper operation heights for cooling coil condensate drain trap and steam coil condensate return trap as shown in the contract documents.
2. AHUs shall be completely self-supporting for installation on concrete housekeeping pad, steel support pedestals, or suspended as shown in the contract documents.
3. The AHU bases not constructed of galvanized steel shall be cleaned, primed with a rust inhibiting primer, and finished with rust inhibiting exterior enamel.

C. Casing (Including Wall, Floor, and Roof):

1. General: AHU casing shall be constructed as solid double wall, galvanized steel insulated panels without any perforations, integral of or attached to a structural frame. The thickness of insulation, mode of application and thermal breaks shall be such that there is no visible condensation on the exterior panels of the AHU located in the non-conditioned spaces.

2. Casing Construction:

Outer Panel	0.8 mm (22 Gauge) Minimum
Inner Panel	0.8 mm (22 Gauge) Minimum
Insulation Thickness Density	Foam 50 mm (2 inch) Minimum 48 kg/m^3 (3.0 lb/ft^3) Minimum
Total R Value	2.3 m^2.K/W (13.0 ft^2.^{O}F.hr/Btu) Minimum

3. Casing Construction (Contractor's Option):

Outer Panel	1.3 mm (18 Gauge) Minimum
Inner Panel	1.0 mm (20 Gauge) Minimum
Insulation Thickness Density	Fiberglass 50 mm (2 inch) Minimum 24 kg/m^3 (1.5 lb/ft^3) Minimum
Total R Value	1.4 m^2.K/W (8.0 ft^2.^{O}F.hr/Btu) Minimum

4. Blank-Off: Provide blank-offs as required to prevent air bypass between the AHU sections, around coils, and filters.
5. Casing panels shall be secured to the support structure with stainless-steel or zinc-chromate plated screws and gaskets installed around the panel perimeter. Panels shall be completely removable to allow removal of fan, coils, and other internal components for future maintenance, repair, or modifications. Welded exterior panels are prohibited.
6. Access Doors: Provide in each access section and where shown in the contract documents. Show single-sided and double-sided access doors with door swings on the floor plans. Doors shall be a minimum of 50 mm (2 inch) thick with same double wall construction as the unit casing. Doors shall be a minimum of 610 mm (24 inches) wide, unless shown of different size in the contract documents, and shall be the full casing height up to a maximum of 1829 mm (6 feet). Doors shall be gasketed, hinged, and latched to provide an airtight seal. The access doors for fan section, mixing box, humidifiercoil section shall include a minimum 152 mm x 152 mm (6 inch x 6 inch) double

thickness, with air space between the glass panes tightly sealed, reinforced glass or Plexiglas window in a gasketed frame.

a. Hinges: Manufacturer's standard, designed for door size, weight and pressure classifications. Hinges shall hold door completely rigid with minimum 45 kg (100 lb) weight hung on latch side of door.

b. Latches: Non-corrosive alloy construction, with operating levers for positive cam action, operable from either inside or outside. Doors that do not open against unit operating pressure shall allow the door to ajar and then require approximately 0.785 radian (45 degrees) further movement of the handle for complete opening. Latch shall be capable of restraining explosive opening of door with a force not less than 2000 Pa (8 inch WG).

c. Gaskets: Neoprene, continuous around door, positioned for direct compression with no sliding action between the door and gasket. Secure with high quality mastic to eliminate possibility of gasket slipping or coming loose.

7. Provide sealed sleeves, metal or plastic escutcheons or grommets for penetrations through casing for power and temperature control wiring and pneumatic tubing. Coordinate with electrical and temperature control subcontractors for number and location of penetrations. Coordinate lights, switches, and duplex receptacles and disconnect switch location and mounting. All penetrations and equipment mounting may be provided in the factory or in the field. All field penetrations shall be performed neatly by drilling or saw cutting. No cutting by torches will be allowed. Neatly seal all openings airtight.

D. Floor:

1. Unit floor shall be level without offset space or gap and designed to support a minimum of 488 kg/square meter (91 lbs per square foot) distributed load without permanent deformation or crushing of internal insulation. Provide adequate structural base members beneath floor in service access sections to support typical service foot traffic and to prevent damage to unit floor or internal insulation. Unit floors in casing sections, which may contain water or condensate, shall be watertight with drain pan.

2. Where indicated, furnish and install floor drains flush with the floor, with nonferrous grate cover and stub through floor for external connection.

F. Condensate Drain Pan: Drain pan shall be designed to extend entire length of cooling coils including headers and return bends. Depth of drain pan shall be at least 43 mm (1.7 inches) and shall handle all condensate without overflowing. Drain pan shall be double-wall, double sloping type, and fabricated from stainless-steel (304) with at least 50 mm (2 inch) thick insulation sandwiched between the inner and outer surfaces. Drain pan shall be continuous metal or welded watertight. No mastic sealing of joints exposed to water will be permitted. Drain pan shall be placed on top of casing floor or integrated into casing floor assembly. Drain pan shall be pitched in all directions to drain line.

1. An intermediate, stainless-steel (304) condensate drip pan with copper downspouts shall be provided on stacked cooling coils. Use of intermediate condensate drain channel on upper casing of lower coil is permissible provided it is readily cleanable. Design of intermediate condensate drain shall prevent upper coil condensate from flowing across face of lower coil.
2. Drain pan shall be piped to the exterior of the unit. Drain pan shall be readily cleanable.
3. Installation, including frame, shall be designed and sealed to prevent blow-by.

G. Housed Centrifugal Fan Sections:

1. Fans shall be minimum Class II construction, double width, double inlet centrifugal, air foil or backward inclined type as indicated in the contract documents, factory balanced and rated in accordance with AMCA 210 or ASHRAE 51. Provide self-aligning, pillow block, regreasable ball-type bearings selected for a B (10) life of not less than 50,000 hours and an L (50) average fatigue life of 200,000 hours per ABMA 9. Extend bearing grease lines to motor and drive side of fan section. Fan shall be located in airstream to assure proper air flow.
2. Provide internally vibration isolated fan, motor and drive, mounted on a common integral bolted or welded structural steel base with adjustable motor slide rail with locking device. Provide vibration

isolators and flexible duct connections at fan discharge to completely isolate fan assembly. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT, for additional requirements.

3. Allowable vibration tolerances for fan shall not exceed a self-excited vibration maximum velocity of 0.005 m/s (0.20 inch per second) RMS, filter in, when measured with a vibration meter on bearing caps of machine in vertical, horizontal, and axial directions or measured at equipment mounting feet if bearings are concealed. After field installation, compliance to this requirement shall be demonstrated with field test in accordance with Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT and Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC. Following fan assembly, the complete fan assembly balance shall be tested using an electronic balance analyzer with a tunable filter and stroboscope. Vibration measurements shall be taken on each motor bearing housing in the vertical, horizontal, and axial planes (5 total measurements, 2 each motor bearing and 1 axial).

H. Fan Motor, Drive, and Mounting Assembly (Housed Centrifugal Fans):

1. Fan Motor and Drive: Motors shall be premium energy efficient type, as mandated by the Energy Policy Act of 2005, with efficiencies as shown in Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION, in the contract documents and suitable for use in variable frequency drive applications on AHUs where this type of drive is indicated. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC, for additional motor and drive specifications. Refer to Section 26 29 11, MOTOR CONTROLLERS.
2. Fan drive and belts shall be factory mounted with final alignment and belt adjustment to be made by the Contractor after installation. Drive and belts shall be as specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Provide additional drive(s) if required during balancing, to achieve desired airflow.

I. Plenum Fans - Single and/or Multiple Fans in an Array:

1. General: Fans shall be Class II (minimum) construction with single inlet, aluminum wheel and stamped air-foil aluminum bladed. The fan wheel shall be mounted on the directly-driven motor shaft in AMCA

Arrangement 4. Fans shall be dynamically balanced and internally isolated to minimize the vibrations. Provide a steel inlet cone for each wheel to match with the fan inlet. Locate fan in the air stream to assure proper flow. The fan performance shall be rated in accordance with AMCA 210 or ASHRAE 51.

2. Allowable vibration tolerances for fan shall not exceed a self-excited vibration maximum velocity of 0.005 m/s (0.20 inch per second) RMS, filter in, when measured with a vibration meter on bearing caps of machine in vertical, horizontal, and axial directions or measured at equipment mounting feet if bearings are concealed. After field installation, compliance to this requirement shall be demonstrated with field test in accordance with Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT and Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC. Following fan assembly, the complete fan assembly balance shall be tested using an electronic balance analyzer with a tunable filter and stroboscope. Vibration measurements shall be taken on each motor bearing housing in the vertical, horizontal, and axial planes (5 total measurements, 2 each motor bearing and 1 axial).
3. The plenum fans shall be driven by variable speed drives with at least one back-up drive as shown in the design documents. Use of a drive with bypass is prohibited.
4. Multiple fans shall be installed in a pre-engineered structural frame to facilitate fan stacking. All fans shall modulate in unison, above or below the synchronous speed within the limits specified by the manufacturer, by a common control sequence. Staging of the fans is prohibited. Redundancy requirement shall be met by all operating fans in an array and without the provision of an idle standby fan.
5. Fan Accessories:
   a. Fan Isolation: Provide an actuator-controlled damper to isolate the fan not in operation due to failure.
   b. Fan Airflow Measurement: Provide an airflow measuring device integral to the fan to measure air volume within +/- 5 percent accuracy. The probing device shall not be placed in the airflow path to stay clear of turbulence and avoid loss of performance.

J. Fan Motor and Drive (Plenum Fans): Motors shall be premium energy efficient type, as mandated by the Energy Policy Act of 2005, with efficiencies as shown in Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT, in the contract documents and suitable for use in variable frequency drive applications. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC, for additional motor and drive specifications. Refer to Section 26 29 11, MOTOR CONTROLLERS.

L. Filter Section: Refer to Section 23 40 00, HVAC AIR CLEANING DEVICES, for filter requirements.

1. Filters including one complete set for temporary use at site shall be provided independent of the AHU. The AHU manufacturer shall install filter housings and racks in filter section compatible with filters furnished. The AHU manufacturer shall be responsible for furnishing temporary filters (pre-filters and after-filters, as shown in the contract documents) required for AHU testing.
2. Factory-fabricated filter section shall be of the same construction and finish as the AHU casing including filter racks and hinged double wall access doors. Filter housings shall be constructed in accordance with side service or holding frame housing requirements in Section 23 40 00, HVAC AIR CLEANING DEVICES.

M. Coils: Coils shall be mounted on hot dipped galvanized steel supports to assure proper anchoring of coil and future maintenance. Coils shall be face or side removable for future replacement thru the access doors or removable panels. Each coil shall be removable without disturbing adjacent coil. Cooling coils shall be designed and installed to ensure no condensate carry over. Provide factory-installed extended supply, return, drain, and vent piping connections. Refer to the contract documents and Section 23 82 16, AIR COILS for additional coil requirements.

Q. Humidifier: When included in design, coordinate the humidification requirements with Section 23 22 13 STEAM AND CONDENSATE HEATING PIPING. Provide air-handling unit-mounted humidification section with stainless-steel drain pan of adequate length to allow complete absorption of water vapor. Provide stainless-steel dispersion panel or distributors as indicated, with stainless-steel supports and hardware.

R. Sound Attenuators: (NOT USED)

S. Discharge Section: Provide aerodynamically designed framed discharge openings or spun bellmouth fittings to minimize pressure loss.

T. Electrical and Lighting: Wiring and equipment specifications shall conform to Division 26, ELECTRICAL.

1. Vapor-proof lights using cast aluminum base style with glass globe and cast aluminum guard shall be installed in access sections for fan, mixing box, humidifier, and any section over 305 mm (12 inch) wide. A switch shall control the lights in each compartment with pilot light mounted outside the respective compartment access door. Wiring between switches and lights shall be factory-installed. All wiring shall run in neatly installed electrical conduits and terminate in a junction box for field connection to the building system. Provide single point 115 volt - one phase connection at junction box.
2. Install compatible LED bulb in each light fixture.
3. Provide a convenience duplex receptacle next to the light switch.
4. Disconnect switch and power wiring: Provide factory or field mounted disconnect switch. Coordinate with Division 26, ELECTRICAL.
5. Provide single point power connection. Coordinate with Division 26, ELECTRICAL.

PART 3 - EXECUTION

3.1 INSTALLATION

A. If an installation is unsatisfactory to the COR, the contractor shall correct the installation at no additional cost or time to the Government.

B. Install air handling unit in conformance with AHRI 430.

C. Assemble air handling unit components following manufacturer's instructions for handling, testing and operation. Repair damaged galvanized areas with paint in accordance with Mil. Spec. P-21035B. Repair painted units by touch up of all scratches with finish paint material. Vacuum the interior of air handling units clean prior to operation.

D. Install seismic restraints for roof top units. Refer to Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

E. Leakage and test requirements for air handling units shall be the same as specified for ductwork in Section 23 31 00, HVAC DUCTS AND CASINGS except leakage shall not exceed Leakage Class (C_L) 12 listed in SMACNA HVAC Air Duct Leakage Test Manual when tested at 1.5 times the design static pressure. Repair casing air leaks that can be heard or felt during normal operation and to meet test requirements.

F. Perform field mechanical (vibration) balancing in accordance with Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

G. Seal and/or fill all openings between the casing and AHU components and utility connections to prevent air leakage or bypass.

3.2 STARTUP AND TESTING

A. The air handling unit shall not be operated for any purpose, temporary or permanent, until ductwork is clean, filters are in place, bearings are lubricated, and the fan has been test run under observation.

B. After the air handling unit is installed and tested, provide startup and operating instructions to VA personnel.

C. An authorized factory representative should startup, test, and certify the final installation and application specific calibration of control components. Items to be verified include fan performance over entire operating range, noise and vibration testing, verification of proper alignment, overall inspection of the installation, Owner/Operator training, etc.

D. Perform tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.

E. When any defects are detected, correct defects and repeat test at no additional cost or time to the Government.

F. The CxA will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the COR and CxA. Provide a minimum notice of 10 working days prior to startup and testing.

3.3 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

B. Components provided under this section of the specification will be tested as part of a larger system.

3.4 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer's technical representative for 4 hours to instruct each VA personnel responsible in operation and maintenance of the system.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

- - - E N D - - -

SECTION 23 82 16
AIR COILS

PART 1 - GENERAL

1.1 DESCRIPTION

Heating and cooling coils for air handling unit and duct applications

1.2 RELATED WORK

A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES
B. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS
C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC
D. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS
E. Section 23 09 23, DDC SYSTEMS for HVAC
F. Section 23 31 00, HVAC DUCTS AND CASINGS
G. Section 23 36 00, AIR TERMINAL UNITS: Reheat coils for VAV/CV terminals.
H. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.

1.3 QUALITY ASSURANCE

A. Refer to paragraph, QUALITY ASSURANCE, Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
B. Unless specifically exempted by these specifications, heating and cooling coils shall be tested, rated, and certified in accordance with AHRI Standard 4l0 and shall bear the AHRI certification label.

1.4 SUBMITTALS

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
B. Manufacturer's Literature and Data for Heating and Cooling Coils: Submit type, size, arrangements and performance details. Present application ratings in the form of tables, charts or curves.
C. Provide installation, operating and maintenance instructions.
D. Certification Compliance: Evidence of listing in current ARI Directory of Certified Applied Air Conditioning Products.
E. Coils may be submitted with Section 23 36 00, AIR TERMINAL UNITS, Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS, Section 23 74 13, PACKAGED, OUTDOOR, CENTRAL-STATION AIR-HANDLING UNITS, or Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.
F. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician

and dated on the date of completion, in accordance with the requirements of Section 23 08 00 COMMISSIONING OF HVAC SYSTEMS.

1.5 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. Air Conditioning and Refrigeration Institute (AHRI):
Directory of Certified Applied Air Conditioning Products
AHRI 410-2001.....Forced-Circulation Air-Cooling and Air-Heating Coils

C. American Society for Testing and Materials (ASTM):
B75/75M-2019.....Standard Specifications for Seamless Copper Tube

D. National Fire Protection Association (NFPA):
70-2023.....National Electric Code

E. National Electric Manufacturers Association (NEMA):
250-2014.....Enclosures for Electrical Equipment (1,000 Volts Maximum)

F. Underwriters Laboratories, Inc. (UL):
1996-2014.....Electric Duct Heaters

PART 2 - PRODUCTS

2.1 HEATING AND COOLING COILS

A. Conform to ASTM B75 and AHRI 410.

B. Tubes: Minimum 16 mm (0.625 inch) tube diameter; Seamless copper tubing.

C. Fins: 0.1397 mm (0.0055 inch) aluminum or 0.1143 mm (0.0045 inch) copper mechanically bonded or soldered or helically wound around tubing.

D. Headers: Copper, welded steel or cast iron. Provide seamless copper tubing or resistance welded steel tube for volatile refrigerant coils.

E. "U" Bends, Where Used: Machine die-formed, silver brazed to tube ends.

F. Coil Casing: 1.6 mm (16 gage) galvanized steel with tube supports at 1200 mm (48 inch) maximum spacing. Construct casing to eliminate air bypass and moisture carry-over. Provide duct connection flanges.

G. Pressures kPa (PSIG):

Pressure	Water Coil	Steam Coil	Refrigerant Coil
Test	2070 (300)	1725 (250)	2070 (300)
Working	1380 (200)	520 (75)	1725 (250)

H. Protection: Unless protected by the coil casing, provide cardboard, plywood, or plastic material at the factory to protect tube and finned surfaces during shipping and construction activities.

I. Vents and Drain: Coils that are not vented or drainable by the piping system shall have capped vent/drain connections extended through coil casing.

J. Cooling Coil Condensate Drain Pan: Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS or Section 23 74 13, PACKAGED, OUTDOOR, CENTRAL-STATION AIR-HANDLING UNITS.

K. Steam Distributing Coils: Conform to ASTM B75 and ARI 410. Minimum 9.5 mm (3/8-inch) steam distributing tubing installed concentrically in 25 mm (one-inch) OD condensing coil tubes.

L. Dampers: Interlocking opposed blades to completely isolate coil from air flow when unit is in bypass position; 1.6 mm (l6 gage) steel, coated with factory applied corrosion resistant baked enamel finish. Provide damper linkage and electric operators. Damper operators shall be of same manufacturer as controls furnished under Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

2.2 REHEAT COILS, DUCT MOUNTED (NOT USED)

2.3 WATER COILS, INCLUDING GLYCOL-WATER

A. Use the same coil material as listed in Paragraphs 2.1.

B. Drainable Type (Self Draining, Self Venting); Manufacturer standard:

1. Cooling, all types.

2. Heating or preheat.

C. Cleanable Tube Type; manufacturer standard:

1. Well water applications.

2. Waste water applications.

2.4 VOLATILE REFRIGERANT COILS (NOT USED)

2.5 ELECTRIC HEATING COILS (NOT USED)

PART 3 - EXECUTION

3.1 INSTALLATION

A. Follow coil manufacturer's instructions for handling, cleaning, installation and piping connections.

B. Comb fins, if damaged. Eliminate air bypass or leakage at coil sections.

3.2 STARTUP AND TESTING

A. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the COR and Commissioning Agent. Provide a minimum of 7 days prior notice.

3.3 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and as required by Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.

B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.4 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer’s technical representative for four hours to instruct VA personnel in operation and maintenance of units.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS.

- - - E N D - - -

DIVISION 26

ELECTRICAL

SECTION 26 05 11
REQUIREMENTS FOR ELECTRICAL INSTALLATIONS

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section applies to all sections of Division 26.

B. Furnish and install electrical systems, materials, equipment, and accessories in accordance with the specifications and drawings. Capacities and ratings of motors, transformers, conductors and cable, switchboards, panelboards, , and other items and arrangements for the specified items are shown on the drawings.

C.

D. Conductor ampacities specified or shown on the drawings are based on copper conductors, with the conduit and raceways sized per NEC. Aluminum conductors are prohibited.

1.2 MINIMUM REQUIREMENTS

A. The latest International Building Code (IBC), Underwriters Laboratories, Inc. (UL), Institute of Electrical and Electronics Engineers (IEEE), and National Fire Protection Association (NFPA) codes and standards are the minimum requirements for materials and installation.

B. The drawings and specifications shall govern in those instances where requirements are greater than those stated in the above codes and standards.

1.3 TEST STANDARDS

A. All materials and equipment shall be listed, labeled, or certified by a Nationally Recognized Testing Laboratory (NRTL) to meet Underwriters Laboratories, Inc. (UL), standards where test standards have been established. Materials and equipment which are not covered by UL standards will be accepted, providing that materials and equipment are listed, labeled, certified or otherwise determined to meet the safety requirements of a NRTL. Materials and equipment which no NRTL accepts, certifies, lists, labels, or determines to be safe, will be considered if inspected or tested in accordance with national industrial

standards, such as ANSI, NEMA, and NETA. Evidence of compliance shall include certified test reports and definitive shop drawings.

B. Definitions:

1. Listed: Materials and equipment included in a list published by an organization that is acceptable to the Authority Having Jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production or listed materials and equipment or periodic evaluation of services, and whose listing states that the materials and equipment either meets appropriate designated standards or has been tested and found suitable for a specified purpose.
2. Labeled: Materials and equipment to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the Authority Having Jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled materials and equipment, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.
3. Certified: Materials and equipment which:
   a. Have been tested and found by a NRTL to meet nationally recognized standards or to be safe for use in a specified manner.
   b. Are periodically inspected by a NRTL.
   c. Bear a label, tag, or other record of certification.
4. Nationally Recognized Testing Laboratory: Testing laboratory which is recognized and approved by the Secretary of Labor in accordance with OSHA regulations.

1.4 QUALIFICATIONS (PRODUCTS AND SERVICES)

A. Manufacturer’s Qualifications: The manufacturer shall regularly and currently produce, as one of the manufacturer's principal products, the materials and equipment specified for this project, and shall have manufactured the materials and equipment for at least three years.

B. Product Qualification:

1. Manufacturer's materials and equipment shall have been in satisfactory operation, on three installations of similar size and type as this project, for at least three years.

2. The Government reserves the right to require the Contractor to submit a list of installations where the materials and equipment have been in operation before approval.

C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

1.5 APPLICABLE PUBLICATIONS

A. Applicable publications listed in all Sections of Division 26 shall be the latest issue, unless otherwise noted.

B. Products specified in all sections of Division 26 shall comply with the applicable publications listed in each section.

1.6 MANUFACTURED PRODUCTS

A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, and for which replacement parts shall be available. Materials and equipment furnished shall be new, and shall have superior quality and freshness.

B. When more than one unit of the same class or type of materials and equipment is required, such units shall be the product of a single manufacturer.

C. Equipment Assemblies and Components:

1. Components of an assembled unit need not be products of the same manufacturer.
2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
3. Components shall be compatible with each other and with the total assembly for the intended service.
4. Constituent parts which are similar shall be the product of a single manufacturer.

D. Factory wiring and terminals shall be identified on the equipment being furnished and on all wiring diagrams.

E. When Factory Tests are specified, Factory Tests shall be performed in the factory by the equipment manufacturer, and witnessed by the contractor. In addition, the following requirements shall be complied with:
   1. The Government shall have the option of witnessing factory tests. The Contractor shall notify the Government through the COR a minimum of thirty (30) days prior to the manufacturer's performing of the factory tests.
   2. When factory tests are successful, contractor shall furnish four (4) copies of the equipment manufacturer's certified test reports to the COR fourteen (14) days prior to shipment of the equipment, and not more than ninety (90) days after completion of the factory tests.
   3. When factory tests are not successful, factory tests shall be repeated in the factory by the equipment manufacturer, and witnessed by the Contractor. The Contractor shall be liable for all additional expenses for the Government to witness factory re-testing.

1.7 VARIATIONS FROM CONTRACT REQUIREMENTS

A. Where the Government or the Contractor requests variations from the contract requirements, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

1.8 MATERIALS AND EQUIPMENT PROTECTION

A. Materials and equipment shall be protected during shipment and storage against physical damage, vermin, dirt, corrosive substances, fumes, moisture, cold, freeze and rain.
   1. Store materials and equipment indoors in clean dry space with uniform temperature to prevent condensation.
   2. During installation, equipment shall be protected against entry of foreign matter, and be vacuum-cleaned both inside and outside before testing and operating. Compressed air shall not be used to clean equipment. Remove loose packing and flammable materials from inside equipment.

3. Damaged equipment shall be repaired or replaced, as determined by the COR.
4. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
5. Damaged paint on equipment shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

1.9 WORK PERFORMANCE

A. All electrical work shall comply with requirements of the latest NFPA 70 (NEC), NFPA 70B, NFPA 70E, NFPA 99, NFPA 110, NFPA 780, OSHA Part 1910 subpart J – General Environmental Controls, OSHA Part 1910 subpart K – Medical and First Aid, and OSHA Part 1910 subpart S – Electrical, in addition to other references required by contract.

B. Job site safety and worker safety is the responsibility of the Contractor.

C. Electrical work shall be accomplished with all affected circuits or equipment de-energized. However, energized electrical work may be performed only for the non-destructive and non-invasive diagnostic testing(s), or when scheduled outage poses an imminent hazard to patient care, safety, or physical security. In such case, all aspects of energized electrical work, such as the availability of appropriate/correct personal protective equipment (PPE) and the use of PPE, shall comply with the latest NFPA 70E, as well as the following requirements:

1. Only Qualified Person(s) shall perform energized electrical work. Supervisor of Qualified Person(s) shall witness the work of its entirety to ensure compliance with safety requirements and approved work plan.
2. At least two weeks before initiating any energized electrical work, the Contractor and the Qualified Person(s) who is designated to perform the work shall visually inspect, verify and confirm that the work area and electrical equipment can safely accommodate the work involved.
3. At least two weeks before initiating any energized electrical work, the Contractor shall develop and submit a job specific work plan,

and energized electrical work request to the COR, and Medical Center's Chief Engineer or his/her designee. At the minimum, the work plan must include relevant information such as proposed work schedule, area of work, description of work, name(s) of Supervisor and Qualified Person(s) performing the work, equipment to be used, procedures to be used on and near the live electrical equipment, barriers to be installed, safety equipment to be used, and exit pathways.

4. Energized electrical work shall begin only after the Contractor has obtained written approval of the work plan, and the energized electrical work request from the COR, and Medical Center's Chief Engineer or his/her designee. The Contractor shall make these approved documents present and available at the time and place of energized electrical work.
5. Energized electrical work shall begin only after the Contractor has invited and received acknowledgment from the COR, and Medical Center's Chief Engineer or his/her designee to witness the work.

D. For work that affects existing electrical systems, arrange, phase and perform work to assure minimal interference with normal functioning of the facility. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.

E. New work shall be installed and connected to existing work neatly, safely and professionally. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.

F. Coordinate location of equipment and conduit with other trades to minimize interference.

1.10 EQUIPMENT INSTALLATION AND REQUIREMENTS

A. Equipment location shall be as close as practical to locations shown on the drawings.

B. Working spaces or working clearances shall comply with NEC's requirements, at a minimum.

C. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not readily accessible for operation and maintenance, the

equipment shall be removed and reinstalled as directed at no additional cost to the Government.

2. "Readily accessible" is defined as being capable of being reached quickly for operation, maintenance, or inspections without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

1.11 EQUIPMENT IDENTIFICATION

A. In addition to the requirements of the NEC, install an identification sign which clearly indicates information required for use and maintenance of items such as switchboards and switchgear, panelboards, cabinets, motor controllers, fused and non-fused safety switches, generators, automatic transfer switches, separately enclosed circuit breakers, individual breakers and controllers in switchboards, switchgear and motor control assemblies, control devices and other significant equipment.

B. Identification signs for Normal Power System equipment shall be laminated black phenolic resin with a white core with engraved lettering. Identification signs for Essential Electrical System (EES) equipment, as defined in the NEC, shall be laminated red phenolic resin with a white core with engraved lettering. Lettering shall be a minimum of 12 mm (1/2 inch) high. Identification signs shall indicate equipment designation, rated bus amperage, voltage, number of phases, number of wires, and type of EES power branch as applicable. Secure nameplates with screws.

C. Install adhesive arc flash warning labels on all equipment as required by the latest NFPA 70E. Label shall show specific and correct information for specific equipment based on its arc flash calculations. Label shall show the followings:

1. Nominal system voltage.
2. Equipment/bus name, date prepared, and manufacturer name and address.
3. Arc flash boundary.
4. Available arc flash incident energy and the corresponding working distance.

5. Minimum arc rating of clothing.
6. Site-specific level of PPE.

1.12 SUBMITTALS

A. Submit to the COR in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. The Government's approval shall be obtained for all materials and equipment before delivery to the job site. Delivery, storage or installation of materials and equipment which has not had prior approval will not be permitted.

C. All submittals shall include six copies of adequate descriptive literature, catalog cuts, shop drawings, test reports, certifications, samples, and other data necessary for the Government to ascertain that the proposed materials and equipment comply with drawing and specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify specific materials and equipment being submitted.

D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.

1. Mark the submittals, "SUBMITTED UNDER SECTION_____".
2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
3. Submit each section separately.

E. The submittals shall include the following:

1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, manuals, pictures, nameplate data, and test reports as required.

3. Elementary and interconnection wiring diagrams for communication and signal systems, control systems, and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.
4. Parts list which shall include information for replacement parts and ordering instructions, as recommended by the equipment manufacturer.

F. Maintenance and Operation Manuals:

1. Submit as required for systems and equipment specified in the technical sections. Furnish in hardcover binders or an approved equivalent.
2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, material, equipment, building, name of Contractor, and contract name and number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the material or equipment.
3. Provide a table of contents and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
4. The manuals shall include:
   a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
   b. A control sequence describing start-up, operation, and shutdown.
   c. Description of the function of each principal item of equipment.
   d. Installation instructions.
   e. Safety precautions for operation and maintenance.
   f. Diagrams and illustrations.
   g. Periodic maintenance and testing procedures and frequencies, including replacement parts numbers.
   h. Performance data.
   i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare and replacement parts, and name of servicing organization.
   j. List of factory approved or qualified permanent servicing organizations for equipment repair and periodic testing and maintenance, including addresses and factory certification qualifications.

G. Approvals will be based on complete submission of shop drawings, manuals, test reports, certifications, and samples as applicable.

H. After approval and prior to installation, furnish the COR with one sample of each of the following:

1. A minimum 300 mm (12 inches) length of each type and size of wire and cable along with the tag from the coils or reels from which the sample was taken. The length of the sample shall be sufficient to show all markings provided by the manufacturer.
2. Each type of conduit coupling, bushing, and termination fitting.
3. Conduit hangers, clamps, and supports.
4. Duct sealing compound.
5. Each type of receptacle, toggle switch, lighting control sensor, outlet box, manual motor starter, device wall plate, engraved nameplate, wire and cable splicing and terminating material, and branch circuit single pole molded case circuit breaker.

1.13 SINGULAR NUMBER

A. Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

1.15 ACCEPTANCE CHECKS AND TESTS

A. The Contractor shall furnish the instruments, materials, and labor for tests.

B. Where systems are comprised of components specified in more than one section of Division 26, the Contractor shall coordinate the installation, testing, and adjustment of all components between various manufacturer’s representatives and technicians so that a complete, functional, and operational system is delivered to the Government.

C. When test results indicate any defects, the Contractor shall repair or replace the defective materials or equipment, and repeat the tests for the equipment. Repair, replacement, and re-testing shall be accomplished at no additional cost to the Government.

1.16 WARRANTY

A. All work performed and all equipment and material furnished under this Division shall be free from defects and shall remain so for a period of one year from the date of acceptance of the entire installation by the Contracting Officer for the Government.

1.17 INSTRUCTION

A. Instruction to designated Government personnel shall be provided for the particular equipment or system as required in each associated technical specification section.

B. Furnish the services of competent and factory-trained instructors to give full instruction in the adjustment, operation, and maintenance of the specified equipment and system, including pertinent safety requirements. Instructors shall be thoroughly familiar with all aspects of the installation, and shall be factory-trained in operating theory as well as practical operation and maintenance procedures.

C. A training schedule shall be developed and submitted by the Contractor and approved by the COR at least 30 days prior to the planned training.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION (NOT USED)

---END---

11-01-22

SECTION 26 05 19
LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the furnishing, installation, connection, and testing of the electrical conductors and cables for use in electrical systems rated 600 V and below, indicated as cable(s), conductor(s), wire, or wiring in this section.

1.2 RELATED WORK

A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire-resistant rated construction.

B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.

C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for conductors and cables.

1.3 QUALITY ASSURANCE

A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:

1. Shop Drawings:
   a. Submit sufficient information to demonstrate compliance with drawings and specifications.
   b. Submit the following data for approval:
      1) Electrical ratings and insulation type for each conductor and cable.
      2) Splicing materials and pulling lubricant.
2. Certifications: Two weeks prior to final inspection, submit the following.

a. Certification by the manufacturer that the conductors and cables conform to the requirements of the drawings and specifications.

b. Certification by the Contractor that the conductors and cables have been properly installed, adjusted, and tested.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by designation only.

B. American Society of Testing Material (ASTM):

D2301-10.....Standard Specification for Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape

D2304-18.....Test Method for Thermal Endurance of Rigid Electrical Insulating Materials

D3005-17.....Low-Temperature Resistant Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape

C. National Electrical Manufacturers Association (NEMA):

WC 70-21.....Power Cables Rated 2000 Volts or Less for the Distribution of Electrical Energy

D. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

E. Underwriters Laboratories, Inc. (UL):

44-18.....Thermoset-Insulated Wires and Cables

83-17.....Thermoplastic-Insulated Wires and Cables

467-13.....Grounding and Bonding Equipment

486A-486B-18.....Wire Connectors

486C-18.....Splicing Wire Connectors

486D-15.....Sealed Wire Connector Systems

486E-15.....Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors

493-18.....Thermoplastic-Insulated Underground Feeder and Branch Circuit Cables

514B-12.....Conduit, Tubing, and Cable Fittings

PART 2 - PRODUCTS

2.1 CONDUCTORS AND CABLES

A. Conductors and cables shall be in accordance with ASTM, NEMA, NFPA, UL, as specified herein, and as shown on the drawings.

B. Conductors shall be copper.

C. Single Conductor:

1. No. 12 AWG: Minimum size, except where smaller sizes are specified herein or shown on the drawings.
2. No. 8 AWG and larger: Stranded.
3. No. 10 AWG and smaller: Solid; except shall be stranded for final connection to motors, transformers, and vibrating equipment.
4. Insulation: THHN-THWN and XHHW-2. XHHW-2 shall be used for isolated power systems.

E. Conductor Color Code:

1. No. 10 AWG and smaller: Solid color insulation or solid color coating.
2. No. 8 AWG and larger: Color-coded using one of the following methods:
   a. Solid color insulation or solid color coating.
   b. Stripes, bands, or hash marks of color specified.
   c. Color using 19 mm (0.75 inches) wide tape.
4. For modifications and additions to existing wiring systems, color coding shall conform to the existing wiring system.
5. Conductors shall be color-coded as follows:

208/120 V	Phase	480/277 V
Black	A	Brown
Red	B	Orange
Blue	C	Yellow
White	Neutral	Gray *
* or white with colored (other than green) tracer.		

6. Lighting circuit “switch legs”,SHALL BE COLOR OF VOLTAGE and 3-way and 4-way switch “traveling wires,” shall have color coding that is unique and distinct (e.g., pink and purple) from the color coding indicated above. The unique color codes shall be solid and in

accordance with the NEC. Coordinate color coding in the field with the COR.

7. Color code for isolated power system wiring shall be in accordance with the NEC.

2.2 SPLICES

A. Splices shall be in accordance with NEC and UL.

B. Above Ground Splices for No. 10 AWG and Smaller:

1. Solderless, screw-on, reusable pressure cable type, with integral insulation, approved for copper and aluminum conductors.
2. The integral insulator shall have a skirt to completely cover the stripped conductors.
3. The number, size, and combination of conductors used with the connector, as listed on the manufacturer's packaging, shall be strictly followed.

C. Above Ground Splices for No. 8 AWG to No. 4/0 AWG:

1. Compression, hex screw, or bolt clamp-type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
3. Splice and insulation shall be product of the same manufacturer.
4. All bolts, nuts, and washers used with splices shall be zinc-plated steel.

D. Above Ground Splices for 250 kcmil and Larger:

1. Long barrel “butt-splice” or “sleeve” type compression connectors, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.
2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
3. Splice and insulation shall be product of the same manufacturer.

2.3 CONNECTORS AND TERMINATIONS

A. Mechanical type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.

B. Long barrel compression type of high conductivity and corrosion-resistant material, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.

C. All bolts, nuts, and washers used to connect connections and terminations to bus bars or other termination points shall be zinc-plated steel.

2.4 CONTROL WIRING

A. Unless otherwise specified elsewhere in these specifications, control wiring shall be as specified herein, except that the minimum size shall be not less than No. 14 AWG, or as required by the control wiring equipment manufacturer.

B. Control wiring shall be sized such that the voltage drop under in-rush conditions does not adversely affect operation of the controls.

2.5 WIRE LUBRICATING COMPOUND

A. Lubricating compound shall be suitable for the wire insulation and conduit, and shall not harden or become adhesive.

PART 3 - EXECUTION

3.1 GENERAL

A. Installation shall be in accordance with the NEC, as shown on the drawings, and manufacturer’s instructions.

B. Install conductors in raceway systems.

C. Splice conductors only in outlet boxes, junction boxes, pullboxes,.

D. Conductors of different systems (e.g., 120 V and 277 V) shall not be installed in the same raceway.

E. For conductors installed in vertical raceways, provide conductor support (also known as cable support), to counter gravity pull on conductor weight. Conductor support shall be split-wedge conductor support type. Prior to installing the conductor support plug, remove all pulling compound from conductors where they pass through the conductor support body. After installing the conductor support plug, tap the conductor support plug firmly in the conductor support body.

F. In panelboards, cabinets, wireways, switches, enclosures, and equipment assemblies, neatly form, train, and tie the conductors with non-metallic “zip” ties.

G. For connections to motors, transformers, and vibrating equipment, stranded conductors shall be used only from the last fixed point of connection to the motors, transformers, or vibrating equipment.

H. Use expanding foam or non-hardening duct-seal to seal conduits entering a building, after installation of conductors.

I. Conductor Pulling:

1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling. Use lubricants approved for the cable.
2. Use nonmetallic pull ropes.
3. Attach pull ropes by means of either woven basket grips or pulling eyes attached directly to the conductors.
4. All conductors in a single conduit shall be pulled simultaneously.
5. Do not exceed manufacturer’s recommended maximum pulling tensions and sidewall pressure values.

J. Number of conductors for branch circuits shall not exceed more than three branch circuits in any one conduit.

K. When stripping stranded conductors, use a tool that does not damage the conductor or remove conductor strands.

3.3 SPLICE AND TERMINATION INSTALLATION

A. Splices and terminations shall be mechanically and electrically secure, and tightened to manufacturer’s published torque values using a torque screwdriver or wrench.

B. Where the Government determines that unsatisfactory splices or terminations have been installed, replace the splices or terminations at no additional cost to the Government.

3.4 CONDUCTOR IDENTIFICATION

A. When using colored tape to identify phase, neutral, and ground conductors larger than No. 8 AWG, apply tape in half-overlapping turns for a minimum of 75 mm (3 inches) from terminal points, and in junction boxes, pullboxes, and manholes. Apply the last two laps of tape with no tension to prevent possible unwinding. Where markings are covered by tape, apply tags to conductors, stating size and insulation type.

3.6 EXISTING CONDUCTORS

A. Unless specifically indicated on the plans, existing conductors shall not be reused.

3.7 CONTROL WIRING INSTALLATION

A. Unless otherwise specified in other sections, install control wiring and connect to equipment to perform the required functions as specified or as shown on the drawings.

B. Install a separate power supply circuit for each system, except where otherwise shown on the drawings.

3.8 CONTROL WIRING IDENTIFICATION

A. Install a permanent wire marker on each wire at each termination.

B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.

C. Wire markers shall retain their markings after cleaning.

3.10 ACCEPTANCE CHECKS AND TESTS

A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:

1. Visual Inspection and Tests: Inspect physical condition.
2. Electrical tests:
   a. After installation but before connection to utilization devices, such as fixtures, motors, or appliances, test conductors phase-to-phase and phase-to-ground resistance with an insulation resistance tester. Existing conductors to be reused shall also be tested.
   b. Applied voltage shall be 500 V DC for 300 V rated cable, and 1000 V DC for 600 V rated cable. Apply test for one minute or until reading is constant for 15 seconds, whichever is longer. Minimum insulation resistance values shall not be less than 25 megohms for 300 V rated cable and 100 megohms for 600 V rated cable.
   c. Perform phase rotation test on all three-phase circuits.

---END---

11-01-22

SECTION 26 05 26
GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the furnishing, installation, connection, and testing of grounding and bonding equipment, indicated as grounding equipment in this section.

B. "Grounding electrode system" refers to grounding electrode conductors and all electrodes required or allowed by NEC, as well as made, supplementary, and lightning protection system grounding electrodes.

C. The terms "connect" and "bond" are used interchangeably in this section and have the same meaning.

1.2 RELATED WORK

A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.

B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.

C. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and boxes.

H. Section 26 22 00, LOW-VOLTAGE TRANSFORMERS: Low-voltage transformers.

J. Section 26 24 13, DISTRIBUTION SWITCHBOARDS: Low-voltage distribution switchboards.

K. Section 26 24 16, PANELBOARDS: Low-voltage panelboards.

36 23, AUTOMATIC TRANSFER SWITCHES: Automatic transfer switches.

O. Section 26 41 00, FACILITY LIGHTNING PROTECTION: Lightning protection.

1.3 QUALITY ASSURANCE

A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:

1. Shop Drawings:

a. Submit sufficient information to demonstrate compliance with drawings and specifications.

b. Submit plans showing the location of system grounding electrodes and connections, and the routing of aboveground and underground grounding electrode conductors.

2. Test Reports:

a. Two weeks prior to the final inspection, submit ground resistance field test reports to the COR.

3. Certifications:

a. Certification by the Contractor that the grounding equipment has been properly installed and tested.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. American Society for Testing and Materials (ASTM):

B1-13.....Standard Specification for Hard-Drawn Copper Wire

B3-13(R2018).....Standard Specification for Soft or Annealed Copper Wire

B8-11(R2017).....Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft

C. Institute of Electrical and Electronics Engineers, Inc. (IEEE):

81-12.....IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System Part 1: Normal Measurements

D. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

70E-24.....National Electrical Safety Code

99-24.....Health Care Facilities

E. Underwriters Laboratories, Inc. (UL):

44-18 .....Thermoset-Insulated Wires and Cables

83-17 .....Thermoplastic-Insulated Wires and Cables

467-13 .....Grounding and Bonding Equipment

PART 2 - PRODUCTS

2.1 GROUNDING AND BONDING CONDUCTORS

A. Equipment grounding conductors shall be insulated stranded copper, except that sizes No. 10 AWG and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes No. 4 AWG and larger shall be identified per NEC.

B. Bonding conductors shall be bare stranded copper, except that sizes No. 10 AWG and smaller shall be bare solid copper. Bonding conductors shall be stranded for final connection to motors, transformers, and vibrating equipment.

C. Conductor sizes shall not be less than shown on the drawings, or not less than required by the NEC, whichever is greater.

D. Insulation: THHN-THWN and XHHW-2.

2.2 GROUND RODS

A. copper clad steel, 19 mm (0.75 inch) diameter by 3 M (10 feet) long.

B. Quantity of rods shall be as shown on the drawings, and as required to obtain the specified ground resistance.

2.4 GROUND CONNECTIONS

B. Above Grade:

1. Bonding Jumpers: Listed for use with aluminum and copper conductors. For wire sizes No. 8 AWG and larger, use compression-type connectors. For wire sizes smaller than No. 8 AWG, use mechanical type lugs. Connectors or lugs shall use zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.
2. Connection to Building Steel: Exothermic-welded type connectors.
3. Connection to Grounding Bus Bars: Listed for use with aluminum and copper conductors. Use mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.
4. Connection to Equipment Rack and Cabinet Ground Bars: Listed for use with aluminum and copper conductors. Use mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.

2.5 EQUIPMENT RACK AND CABINET GROUND BARS

A. Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks. Ground bars shall have minimum dimensions of 6.3 mm (0.25 inch) thick x 19 mm (0.75 inch) wide, with length as required or as shown on the drawings. Provide insulators and mounting brackets.

2.6 GROUND TERMINAL BLOCKS

A. At any equipment mounting location (e.g., backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.

2.7 GROUNDING BUS BAR

A. Pre-drilled rectangular copper bar with stand-off insulators, minimum 6.3 mm (0.25 inch) thick x 100 mm (4 inches) high in cross-section, length as shown on the drawings, with hole size, quantity, and spacing per detail shown on the drawings. Provide insulators and mounting brackets.

PART 3 - EXECUTION

3.1 GENERAL

A. Installation shall be in accordance with the NEC, as shown on the drawings, and manufacturer’s instructions.

B. System Grounding:

1. Secondary service neutrals: Ground at the supply side of the secondary disconnecting means and at the related transformer.
2. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.

C. Equipment Grounding: Metallic piping, building structural steel, electrical enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits, shall be bonded and grounded.

D. For patient care area electrical power system grounding, conform to the latest NFPA 70 and 99.

3.2 INACCESSIBLE GROUNDING CONNECTIONS

A. Make grounding connections, which are normally buried or otherwise inaccessible, by exothermic weld.

3.4 SECONDARY VOLTAGE EQUIPMENT AND CIRCUITS

A. Main Bonding Jumper: Bond the secondary service neutral to the ground bus in the service equipment.

B. Metallic Piping, Building Structural Steel, and Supplemental Electrode(s):

1. Provide a grounding electrode conductor sized per NEC between the service equipment ground bus and all metallic water pipe systems, building structural steel, and supplemental or made electrodes. Provide jumpers across insulating joints in the metallic piping.
2. Provide a supplemental ground electrode as shown on the drawings and bond to the grounding electrode system.

C. Switchboards, Panelboards, , and other electrical equipment:

1. Connect the equipment grounding conductors to the ground bus.
2. Connect metallic conduits by grounding bushings and equipment grounding conductor to the equipment ground bus.

D. Transformers:

2. Separately derived systems (transformers downstream from service equipment): Ground the secondary neutral at the transformer. Provide a grounding electrode conductor from the transformer to the nearest component of the grounding electrode system

3.5 RACEWAY

A. Conduit Systems:

1. Ground all metallic conduit systems. All metallic conduit systems shall contain an equipment grounding conductor.
2. Non-metallic conduit systems, except non-metallic feeder conduits that carry a grounded conductor from exterior transformers to interior or building-mounted service entrance equipment, shall contain an equipment grounding conductor.
3. Metallic conduit that only contains a grounding conductor, and is provided for its mechanical protection, shall be bonded to that conductor at the entrance and exit from the conduit.
4. Metallic conduits which terminate without mechanical connection to an electrical equipment housing by means of locknut and bushings or adapters, shall be provided with grounding bushings. Connect bushings with a equipment grounding conductor to the equipment ground bus.

B. Feeders and Branch Circuits: Install equipment grounding conductors with all feeders, and all branch circuits.

C. Boxes, Cabinets, Enclosures, and Panelboards:
   1. Bond the equipment grounding conductor to each pullbox, junction box, outlet box, device box, cabinets, and other enclosures through which the conductor passes (except for special grounding systems for intensive care units and other critical units shown).
   2. Provide lugs in each box and enclosure for equipment grounding conductor termination.

D. Wireway Systems:
   1. Bond the metallic structures of wireway to provide electrical continuity throughout the wireway system, by connecting a No. 6 AWG bonding jumper at all intermediate metallic enclosures and across all section junctions.
   2. Install insulated No. 6 AWG bonding jumpers between the wireway system, bonded as required above, and the closest building ground at each end and approximately every 16 M (50 feet).
   3. Use insulated No. 6 AWG bonding jumpers to ground or bond metallic wireway at each end for all intermediate metallic enclosures and across all section junctions.
   4. Use insulated No. 6 AWG bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 15 M (49 feet).

E. Receptacles shall not be grounded through their mounting screws. Ground receptacles with a jumper from the receptacle green ground terminal to the device box ground screw and a jumper to the branch circuit equipment grounding conductor.

F. Ground lighting fixtures to the equipment grounding conductor of the wiring system. Fixtures connected with flexible conduit shall have a green ground wire included with the power wires from the fixture through the flexible conduit to the first outlet box.

G. Fixed electrical appliances and equipment shall be provided with a ground lug for termination of the equipment grounding conductor.

I. Panelboard Bonding in Patient Care Areas: The equipment grounding terminal buses of the normal and essential branch circuit panel boards serving the same individual patient vicinity shall be bonded together

with an insulated continuous copper conductor not less than No. 10 AWG, installed in rigid metal conduit.

3.6 OUTDOOR METALLIC FENCES AROUND ELECTRICAL EQUIPMENT

B. Drive ground rods until the top is 300 mm (12 inches) below grade. Attach a No. 4 AWG copper conductor by exothermic weld to the ground rods, and extend underground to the immediate vicinity of fence post. Lace the conductor vertically into 300 mm (12 inches) of fence mesh and fasten by two approved bronze compression fittings, one to bond the wire to post and the other to bond the wire to fence. Each gate section shall be bonded to its gatepost by a 3 mm x 25 mm (0.375 inch x 1 inch) flexible, braided copper strap and ground post clamps. Clamps shall be of the anti-electrolysis type.

3.7 CORROSION INHIBITORS

A. When making grounding and bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

3.9 LIGHTNING PROTECTION SYSTEM

A. Bond the lightning protection system to the electrical grounding electrode system.

3.10 MAIN ELECTRICAL ROOM GROUNDING

3.12 GROUND RESISTANCE

A. Grounding system resistance to ground shall not exceed 5 ohms. Make any modifications or additions to the grounding electrode system necessary for compliance without additional cost to the Government. Final tests shall ensure that this requirement is met.

3.13 GROUND ROD INSTALLATION

A. For outdoor installations, drive each rod vertically in the earth, until top of rod is 610 mm (24 inches) below final grade.

B. For indoor installations, leave 100 mm (4 inches) of each rod exposed.

C. Where buried or permanently concealed ground connections are required, make the connections by the exothermic process, to form solid metal joints. Make accessible ground connections with mechanical pressure-type ground connectors.

D. Where rock or impenetrable soil prevents the driving of vertical ground rods, install angled ground rods or grounding electrodes in horizontal trenches to achieve the specified ground resistance.

3.14 ACCEPTANCE CHECKS AND TESTS

A. Resistance of the grounding electrode system shall be measured using a four-terminal fall-of-potential method as defined in IEEE 81. Ground resistance measurements shall be made before the electrical distribution system is energized or connected to the electric utility company ground system, and shall be made in normally dry conditions not fewer than 48 hours after the last rainfall.

B. Resistance measurements of separate grounding electrode systems shall be made before the systems are bonded together. The combined resistance of separate systems may be used to meet the required resistance, but the specified number of electrodes must still be provided.

C. Below-grade connections shall be visually inspected by the COR prior to backfilling. The Contractor shall notify the COR 24 hours before the connections are ready for inspection.

---END---

11-01-22

SECTION 26 05 33
RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes, to form complete, coordinated, grounded raceway systems. Raceways are required for all wiring unless shown or specified otherwise.

B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

1.2 RELATED WORK

A. Section 06 10 00, ROUGH CARPENTRY: Mounting board for telephone closets.

B. Section 07 60 00, FLASHING AND SHEET METAL: Fabrications for the deflection of water away from the building envelope at penetrations.

C. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire rated construction.

D. Section 07 92 00, JOINT SEALANTS: Sealing around conduit penetrations through the building envelope to prevent moisture migration into the building.

E. Section 09 91 00, PAINTING: Identification and painting of conduit and other devices.

F. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS: Conduits bracing.

G. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.

H. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

1.3 QUALITY ASSURANCE

A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:

1. Shop Drawings:
   a. Size and location of main feeders.
   b. Size and location of panels and pull-boxes.
   c. Layout of required conduit penetrations through structural elements.
   d. Submit the following data for approval:
      1) Raceway types and sizes.
      2) Conduit bodies, connectors and fittings.
      3) Junction and pull boxes, types and sizes.
2. Certifications: Two weeks prior to final inspection, submit the following:
   a. Certification by the manufacturer that raceways, conduits, conduit bodies, connectors, fittings, junction and pull boxes, and all related equipment conform to the requirements of the drawings and specifications.
   b. Certification by the Contractor that raceways, conduits, conduit bodies, connectors, fittings, junction and pull boxes, and all related equipment have been properly installed.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. American Iron and Steel Institute (AISI):

S100-16.....North American Specification for the Design of Cold-Formed Steel Structural Members

C. National Electrical Manufacturers Association (NEMA):

C80.1-20.....Electrical Rigid Steel Conduit

C80.3-20.....Steel Electrical Metal Tubing

C80.6-18.....Electrical Intermediate Metal Conduit

FB1-14.....Fittings, Cast Metal Boxes and Conduit Bodies for Conduit, Electrical Metallic Tubing and Cable

FB2.10-21.....Selection and Installation Guidelines for Fittings for use with Non-Flexible Conduit or Tubing (Rigid Metal Conduit, Intermediate Metallic Conduit, and Electrical Metallic Tubing)

FB2.20-21.....Selection and Installation Guidelines for Fittings for use with Flexible Electrical Conduit and Cable

TC-2-20.....Electrical Polyvinyl Chloride (PVC) Tubing and Conduit

TC-3-21.....PVC Fittings for Use with Rigid PVC Conduit and Tubing

D. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

E. Underwriters Laboratories, Inc. (UL):

1-05.....Flexible Metal Conduit

5-16.....Surface Metal Raceway and Fittings

6-07.....Electrical Rigid Metal Conduit - Steel

50-15.....Enclosures for Electrical Equipment

360-13.....Liquid-Tight Flexible Steel Conduit

467-13.....Grounding and Bonding Equipment

514A-13.....Metallic Outlet Boxes

514B-12.....Conduit, Tubing, and Cable Fittings

514C-14.....Nonmetallic Outlet Boxes, Flush-Device Boxes and Covers

651-11.....Schedule 40 and 80 Rigid PVC Conduit and Fittings

651A-11.....Type EB and A Rigid PVC Conduit and HDPE Conduit

797-07.....Electrical Metallic Tubing

1242-06.....Electrical Intermediate Metal Conduit - Steel

PART 2 - PRODUCTS

2.1 MATERIAL

A. Conduit Size: In accordance with the NEC, but not less than 19 mm (0.75-inch) unless otherwise shown. Where permitted by the NEC, 13 mm (0.5-inch) flexible conduit may be used for tap connections to recessed lighting fixtures.

B. Conduit:

1. Size: In accordance with the NEC, but not less than 13 mm (0.5-inch).
2. Rigid Steel Conduit (RMC): Shall conform to UL 6 and NEMA C80.1.

4. Rigid Intermediate Steel Conduit (IMC): Shall conform to UL 1242 and NEMA C80.6.
5. Electrical Metallic Tubing (EMT): Shall conform to UL 797 and NEMA C80.3. Maximum size not to exceed 105 mm (4 inches) and shall be permitted only with cable rated 600 V or less.
6. Flexible Metal Conduit: Shall conform to UL 1.
7. Liquid-tight Flexible Metal Conduit: Shall conform to UL 360.
9. Surface Metal Raceway: Shall conform to UL 5.

C. Conduit Fittings:

1. Rigid Steel and Intermediate Metallic Conduit Fittings:
   a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
   b. Standard threaded couplings, locknuts, bushings, conduit bodies, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
   c. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
   d. Bushings: Metallic insulating type, consisting of an insulating insert, molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
   e. Erickson (Union-Type) and Set Screw Type Couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case-hardened steel with hex head and cup point to firmly seat in

conduit wall for positive ground. Tightening of set screws with pliers is prohibited.

f. Sealing Fittings: Threaded cast iron type. Use continuous drain-type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.

3. Electrical Metallic Tubing Fittings:
   a. Fittings and conduit bodies shall meet the requirements of UL 514B, NEMA C80.3, and NEMA FB1.
   b. Only steel or malleable iron materials are acceptable.
   c. Compression Couplings and Connectors: Concrete-tight and rain-tight, with connectors having insulated throats.
   d. Indent-type connectors or couplings are prohibited.
   e. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.
4. Flexible Metal Conduit Fittings:
   a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
   b. Clamp-type, with insulated throat.
5. Liquid-tight Flexible Metal Conduit Fittings:
   a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
   b. Only steel or malleable iron materials are acceptable.
   c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
7. Surface Metal Raceway Fittings: As recommended by the raceway manufacturer. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, conduit entry fittings, accessories, and other fittings as required for complete system.
8. Expansion and Deflection Couplings:
   a. Conform to UL 467 and UL 514B.
   b. Accommodate a 19 mm (0.75-inch) deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.

c. Include internal flexible metal braid, sized to guarantee conduit ground continuity and a low-impedance path for fault currents, in accordance with UL 467 and the NEC tables for equipment grounding conductors.

d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat-resistant molded rubber material with stainless steel jacket clamps.

D. Conduit Supports:

1. Parts and Hardware: Zinc-coat or provide equivalent corrosion protection.
2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
3. Multiple Conduit (Trapeze) Hangers: Not less than 38 mm x 38 mm (1.5 x 1.5 inches), 12-gauge steel, cold-formed, lipped channels; with not less than 9 mm (0.375-inch) diameter steel hanger rods.
4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.

E. Outlet, Junction, and Pull Boxes:

1. Comply with UL-50 and UL-514A.
2. Rustproof cast metal where required by the NEC or shown on drawings.
3. Sheet Metal Boxes: Galvanized steel, except where shown on drawings.

F. Metal Wireways: Equip with hinged covers, except as shown on drawings. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for a complete system.

PART 3 - EXECUTION

3.1 PENETRATIONS

A. Cutting or Holes:

1. Cut holes in advance where they should be placed in the structural elements, such as ribs or beams. Obtain the approval of the COR prior to drilling through structural elements.
2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic

hammers, impact electric, hand, or manual hammer-type drills are not allowed, except when permitted by the COR where working space is limited.

B. Firestop: Where conduits, wireways, and other electrical raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.

C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal the gap around conduit to render it watertight, as specified in Section 07 92 00, JOINT SEALANTS.

3.2 INSTALLATION, GENERAL

A. In accordance with NEC, NEMA, UL, as shown on drawings, and as specified herein.

B. Raceway systems used for Essential Electrical Systems (EES) shall be entirely independent of other raceway systems.

C. Install conduit as follows:

1. In complete mechanically and electrically continuous runs before pulling in cables or wires.
2. Unless otherwise indicated on the drawings or specified herein, installation of all conduits shall be concealed within finished walls, floors, and ceilings.
3. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new conduits.
4. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
5. Cut conduits square, ream, remove burrs, and draw up tight.
6. Independently support conduit at 2.4 M (8 feet) on centers with specified materials and as shown on drawings.
7. Do not use suspended ceilings, suspended ceiling supporting members, lighting fixtures, other conduits, cable tray, boxes, piping, or ducts to support conduits and conduit runs.
8. Support within 300 mm (12 inches) of changes of direction, and within 300 mm (12 inches) of each enclosure to which connected.
9. Close ends of empty conduits with plugs or caps at the rough-in stage until wires are pulled in, to prevent entry of debris.

10. Conduit installations under fume and vent hoods are prohibited.
11. Secure conduits to cabinets, junction boxes, pull-boxes, and outlet boxes with bonding type locknuts. For rigid steel and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
12. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, FLASHING AND SHEET METAL.
13. Conduit bodies shall only be used for changes in direction, and shall not contain splices.
14. Label conduit at panel and each junction box indicating circuit and panel designation(s) clearly marked with inedible marker.

D. Conduit Bends:
   1. Make bends with standard conduit bending machines.
   2. Conduit hickey may be used for slight offsets and for straightening stubbed out conduits.
   3. Bending of conduits with a pipe tee or vise is prohibited.

E. Layout and Homeruns:
   1. Install conduit with wiring, including homeruns, as shown on drawings.
   2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted and approved by the COR.

3.3 CONCEALED WORK INSTALLATION

A. In Concrete:
   1. Conduit: Rigid steel, IMC, or EMT. Do not install EMT in concrete slabs that are in contact with soil, gravel, or vapor barriers.
   2. Align and run conduit in direct lines.
   3. Install conduit through concrete beams only:
      a. Where shown on the structural drawings.
      b. As approved by the COR prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
   4. Installation of conduit in concrete that is less than 75 mm (3 inches) thick is prohibited.

a. Conduit outside diameter larger than one-third of the slab thickness is prohibited.
b. Space between conduits in slabs: Approximately six conduit diameters apart, and one conduit diameter at conduit crossings.
c. Install conduits approximately in the center of the slab so that there will be a minimum of 19 mm (0.75-inch) of concrete around the conduits.

5. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to ensure low resistance ground continuity through the conduits. Tightening setscrews with pliers is prohibited.

B. Above Furred or Suspended Ceilings and in Walls:

2. Conduit for Conductors 600 V and Below: Rigid steel, IMC, or EMT. Mixing different types of conduits in the same system is prohibited.
3. Align and run conduit parallel or perpendicular to the building lines.
4. Connect recessed lighting fixtures to conduit runs with maximum 1.8 M (6 feet) of flexible metal conduit extending from a junction box to the fixture.
5. Tightening set screws with pliers is prohibited.
6. For conduits running through metal studs, limit field cut holes to no more than 70% of web depth. Spacing between holes shall be at least 457 mm (18 inches). Cuts or notches in flanges or return lips shall not be permitted.

3.4 EXPOSED WORK INSTALLATION

A. Unless otherwise indicated on drawings, exposed conduit is only permitted in mechanical and electrical rooms.

B. Conduit for Conductors Above 600 V: Rigid steel . Mixing different types of conduits in the system is prohibited.
C. Conduit for Conductors 600 V and Below: Rigid steel, IMC, or EMT. Mixing different types of conduits in the system is prohibited.
D. Align and run conduit parallel or perpendicular to the building lines.
E. Install horizontal runs close to the ceiling or beams and secure with conduit straps.

F. Support horizontal or vertical runs at not over 2.4 M (8 feet) intervals.

G. Surface Metal Raceways: Use only where shown on drawings.

H. Painting:

1. Paint exposed conduit as specified in Section 09 91 00, PAINTING.
2. Paint all conduits containing cables rated over 600 V safety orange. Refer to Section 09 91 00, PAINTING for preparation, paint type, and exact color. In addition, paint legends, using 50 mm (2 inch) high black numerals and letters, showing the cable voltage rating. Provide legends where conduits pass through walls and floors and at maximum 6 M (20 feet) intervals in between.

3.7 WET OR DAMP LOCATIONS

A. Use rigid steel or IMC conduits unless as shown on drawings.

B. Provide sealing fittings to prevent passage of water vapor where conduits pass from warm to cold locations, i.e., refrigerated spaces, constant-temperature rooms, air-conditioned spaces, building exterior walls, roofs, or similar spaces.

C. Use rigid steel or IMC conduit within 1.5 M (5 feet) of the exterior and below concrete building slabs in contact with soil, gravel, or vapor barriers, unless as shown on drawings. Conduit shall be half-lapped with 10 mil PVC tape before installation. After installation, completely recoat or retape any damaged areas of coating.

D. Conduits run on roof shall be supported with integral galvanized lipped steel channel, attached to UV-inhibited polycarbonate or polypropylene blocks every 2.4 M (8 feet) with 9 mm (3/8-inch) galvanized threaded rods, square washer and locknut. Conduits shall be attached to steel channel with conduit clamps.

3.8 MOTORS AND VIBRATING EQUIPMENT

A. Use flexible metal conduit for connections to motors and other electrical equipment subject to movement, vibration, misalignment, cramped quarters, or noise transmission.

B. Use liquid-tight flexible metal conduit for installation in exterior locations, moisture or humidity laden atmosphere, corrosive atmosphere, water or spray wash-down operations, inside airstream of HVAC units, and locations subject to seepage or dripping of oil, grease, or water.

C. Provide a green equipment grounding conductor with flexible and liquid-tight flexible metal conduit.

3.9 EXPANSION JOINTS

A. Conduits 75 mm (3 inch) and larger that are secured to the building structure on opposite sides of a building expansion joint require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.

B. Provide conduits smaller than 75 mm (3 inch) with junction boxes on both sides of the expansion joint. Connect flexible metal conduits to junction boxes with sufficient slack to produce a 125 mm (5 inch) vertical drop midway between the ends of the flexible metal conduit. Flexible metal conduit shall have a green insulated copper bonding jumper installed. In lieu of this flexible metal conduit, expansion and deflection couplings as specified above are acceptable.

C. Install expansion and deflection couplings where shown.

3.10 CONDUIT SUPPORTS

A. Safe working load shall not exceed one-quarter of proof test load of fastening devices.

B. Use pipe straps or individual conduit hangers for supporting individual conduits.

C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and an additional 90 kg (200 lbs). Attach each conduit with U-bolts or other approved fasteners.

D. Support conduit independently of junction boxes, pull-boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.

E. Fasteners and Supports in Solid Masonry and Concrete:

1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
2. Existing Construction:
   a. Steel expansion anchors not less than 6 mm (0.25-inch) bolt size and not less than 28 mm (1.125 inch) in embedment.
   b. Power set fasteners not less than 6 mm (0.25-inch) diameter with depth of penetration not less than 75 mm (3 inch).

c. Use vibration and shock-resistant anchors and fasteners for attaching to concrete ceilings.

F. Hollow Masonry: Toggle bolts.

G. Bolts supported only by plaster or gypsum wallboard are not acceptable.

H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.

I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.

J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.

K. Spring steel type supports or fasteners are prohibited for all uses except horizontal and vertical supports/fasteners within walls.

L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

3.11 BOX INSTALLATION

A. Boxes for Concealed Conduits:

1. Flush-mounted.
2. Provide raised covers for boxes to suit the wall or ceiling, construction, and finish.

B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling-in operations or where more than the equivalent of 4-90 degree bends are necessary.

C. Locate pullboxes so that covers are accessible and easily removed. Coordinate locations with piping and ductwork where installed above ceilings.

D. Remove only knockouts as required. Plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.

E. Outlet boxes mounted back-to-back in the same wall are prohibited. A minimum 600 mm (24 inch) center-to-center lateral spacing shall be maintained between boxes.

F. Flush-mounted wall or ceiling boxes shall be installed with raised covers so that the front face of raised cover is flush with the wall.

Surface-mounted wall or ceiling boxes shall be installed with surface-style flat or raised covers.

G. Minimum size of outlet boxes for ground fault circuit interrupter (GFCI) receptacles is 100 mm (4 inches) square x 55 mm (2.125 inches) deep, with device covers for the wall material and thickness involved.

H. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "ELECTRICAL PB No. 1."

I. On all branch circuit junction box covers, identify the circuits with black marker.

- - - E N D - - -

SECTION 26 05 73
OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the overcurrent protective device coordination study, related calculations and analysis, indicated as the study in this section.

B. A short-circuit and selective coordination study, and arc flash calculations and analysis shall be prepared for the electrical overcurrent devices to be installed under this project.

C. The study shall present a well-coordinated time-current analysis of each overcurrent protective device from the individual new device up to the one level upstream.

1.2 RELATED WORK

A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.

D. Section 26 23 00, LOW-VOLTAGE SWITCHGEAR: Low-voltage switchgear.

E. Section 26 24 13, DISTRIBUTION SWITCHBOARDS: Low-voltage distribution switchboards.

F. Section 26 24 16, PANELBOARDS: Low-voltage panelboards.

1.3 QUALITY ASSURANCE

A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

B. The study shall be prepared by the equipment manufacturer, and performed by the equipment manufacturer’s licensed electrical engineer.

1.4 SUBMITTALS

A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:

1. Product data on the software program to be used for the study. Software shall be in mainstream use in the industry, shall provide

device settings and ratings, and shall show selective coordination by time-current drawings.

2. Complete study as described in paragraph 1.6. Submittal of the study shall be well-coordinated with submittals of the shop drawings for equipment in related specification sections.
3. Certifications: Two weeks prior to final inspection, submit the following.
   a. Certification by the Contractor that the overcurrent protective devices have been set in accordance with the approved study.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. Institute of Electrical and Electronics Engineers (IEEE):

241-90.....Recommended Practice Electrical Systems in Commercial Buildings

242-01.....Recommended Practice for Protection and Coordination of Industrial and Commercial Power Systems

399-97.....Recommended Practice for Industrial and Commercial Power Systems Analysis

1584-18.....Performing Arc-Flash Hazards Calculations

C. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

70E-24.....Standard for Electrical Safety in the Workplace

99-24.....Health Care Facilities Code

1.6 STUDY REQUIREMENTS

A. The study shall be in accordance with IEEE and NFPA standards.

B. The study shall include one line diagram, short-circuit and ground fault analysis, protective coordination plots for all overcurrent protective devices, and arc flash calculations and analysis.

C. One Line Diagram:
   1. Show all electrical equipment and wiring to be protected by the overcurrent devices.
   2. Show the following specific information:

a. Calculated fault impedance, X/R ratios, and short-circuit values at each feeder and branch circuit bus.
b. Relay, circuit breaker, and fuse ratings.
c. Generator kW/kVA and transformer kVA and voltage ratings, percent impedance, X/R ratios, and wiring connections.
d. Voltage at each bus.
e. Identification of each bus, matching the identification on the drawings.
f. Conduit, conductor, and busway material, size, length, and X/R ratios.

D. Short-Circuit Study:
1. The study shall be performed using computer software designed for this purpose. Pertinent data and the rationale employed in developing the calculations shall be described in the introductory remarks of the study.
2. Calculate the fault impedance to determine the available short-circuit and ground fault currents at each bus. Incorporate applicable motor and/or generator contribution in determining the momentary and interrupting ratings of the overcurrent protective devices.
3. Present the results of the short-circuit study in a table. Include the following:
a. Device identification.
b. Operating voltage.
c. Overcurrent protective device type and rating.
d. Calculated short-circuit current.

E. Coordination Study:
1. Prepare the coordination curves to determine the required settings of overcurrent protective devices to demonstrate selective coordination. Graphically illustrate on log-log paper that adequate time separation exists between devices, including the utility company upstream device if applicable. Plot the specific time-current characteristics of each overcurrent protective device in such a manner that all devices are clearly depicted.
2. The following specific information shall also be shown on the coordination curves:

a. Device identification.
b. Potential transformer and current transformer ratios.
c. Three-phase and single-phase ANSI damage points or curves for each cable, transformer, or generator.
d. Applicable circuit breaker or protective relay characteristic curves.
e. No-damage, melting, and clearing curves for fuses.
f. Transformer in-rush points.

3. Develop a table to summarize the settings selected for the overcurrent protective devices. Include the following in the table:
a. Device identification.
b. Protective relay or circuit breaker potential and current transformer ratios, sensor rating, and available and suggested pickup and delay settings for each available trip characteristic.
c. Fuse rating and type.

F. Arc Flash Calculations and Analysis:
1. Arc flash warning labels shall comply with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
2. Arc flash calculations shall be based on actual over-current protective device clearing time. Maximum clearing time shall be in accordance with IEEE 1584.
3. Arc flash analysis shall be based on the lowest clearing time setting of the over-current protective device to minimize the incident energy level without compromising selective coordination.
4. Arc flash boundary and available arc flash incident energy at the corresponding working distance shall be calculated for all electrical power distribution equipment specified in the project, and as shown on the drawings.
5. Required arc-rated clothing and other PPE shall be selected and specified in accordance with NFPA 70E.

1.7 ANALYSIS

A. Analyze the short-circuit calculations, and highlight any equipment determined to be underrated as specified. Propose solutions to effectively protect the underrated equipment.

1.8 ADJUSTMENTS, SETTINGS, AND MODIFICATIONS

A. Final field settings and minor modifications of the overcurrent protective devices shall be made to conform with the study, without additional cost to the Government.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION (NOT USED)

---END---

SECTION 26 08 00

COMMISSIONING OF ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

A. The requirements of this Section apply to all sections of Division 26.

B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned is specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIRMENTS. A Commissioning Agent (CxA) appointed by the VA will manage the commissioning process.

1.2 RELATED WORK

A. Section 01 00 00 GENERAL REQUIREMENTS.

B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.3 SUMMARY

A. This Section includes requirements for commissioning the Facility electrical systems, related subsystems and related equipment. This Section supplements the general requirements specified in Section 01 91 00 General Commissioning Requirements.

B. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more details regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

1.4 DEFINITIONS

A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

1.5 COMMISSIONED SYSTEMS

A. Commissioning of a system or systems specified in Division 26 is part of the construction process. Documentation and testing of these systems, as well as training of the VA’s Operation and Maintenance personnel in accordance with the requirements of Section 01 91 00 and

of Division 26, is required in cooperation with the VA and the Commissioning Agent.

B. The Facility electrical systems commissioning will include the systems listed in Section 01 91 00 General Commissioning Requirements:

1.6 SUBMITTALS

A. The commissioning process requires review of selected Submittals that pertain to the systems to be commissioned. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.

B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 CONSTRUCTION INSPECTIONS

A. Commissioning of Electrical systems will require inspection of individual elements of the electrical systems construction throughout the construction period. The Contractor shall coordinate with the Commissioning Agent in accordance with Section 01 91 00 and the Commissioning plan to schedule electrical systems inspections as required to support the Commissioning Process.

3.2 PRE-FUNCTIONAL CHECKLISTS

A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist

to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

3.3 CONTRACTORS TESTS

A. Contractor tests as required by other sections of Division 26 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. All testing shall be incorporated into the project schedule. Contractor shall provide no less than 7 calendar days' notice of testing. The Commissioning Agent will witness selected Contractor tests at the sole discretion of the Commissioning Agent. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

3.4 SYSTEMS FUNCTIONAL PERFORMANCE TESTING

A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the Contracting Officer's Representative. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

3.5 TRAINING OF VA PERSONNEL

A. Training of the VA operation and maintenance personnel is required in cooperation with the Contracting Officer's Representative and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. Contractor shall submit training agendas and trainer resumes in accordance with the requirements of Section 01 91 00. The instruction shall be scheduled in coordination with the VA Contracting Officer's Representative after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 26 Sections for additional Contractor training requirements.

----- END -----

SECTION 26 09 23
LIGHTING CONTROLS

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation and connection of the lighting controls.

1.2 RELATED WORK

A. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Interface of lighting controls with HVAC control systems.

B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General requirements that are common to more than one section of Division 26.

C. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.

D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.

E. Section 26 24 16, PANELBOARDS: Panelboard enclosure and interior bussing used for lighting control panels.

F. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.

G. Section 26 51 00, INTERIOR LIGHTING: Luminaire drivers used in control of lighting systems.

1.3 QUALITY ASSURANCE

A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:

1. Shop Drawings:
   a. Submit the following information for each type of lighting controls.
   b. Material and construction details.

c. Physical dimensions and description.

d. Wiring schematic and connection diagram.

e. Installation details.

2. Manuals:

a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.

b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.

3. Certifications: Two weeks prior to final inspection, submit the following.

a. Certification by the Contractor that the lighting control systems have been properly installed and tested.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. National Electrical Manufacturer's Association (NEMA):

C136.10-17.....American National Standard for Roadway and Area Lighting Equipment—Locking-Type Photocontrol Devices and Mating Receptacles—Physical and Electrical Interchangeability and Testing

ICS-1-00(R2015).....Standard for Industrial Control and Systems General Requirements

ICS-2-00(R2020).....Standard for Industrial Control and Systems Controllers, Contractors, and Overload Relays Rated 600 Volts

ICS-6-93(R2016).....Standard for Industrial Controls and Systems Enclosures

C. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

D. Underwriters Laboratories, Inc. (UL):

20-18.....Standard for General-Use Snap Switches

98-16.....Enclosed and Dead-Front Switches

773-16.....Standard for Plug-In Locking Type Photocontrols for Use with Area Lighting

773A-16.....Nonindustrial Photoelectric Switches for Lighting Control

916-15.....Standard for Energy Management Equipment

917-06.....Clock Operated Switches

924-16.....Emergency Lighting and Power Equipment

PART 2 - PRODUCTS

2.1 ELECTRONIC TIME SWITCHES (NOT USED)

2.7 INDOOR OCCUPANCY SENSORS

A. Wall- or ceiling-mounting, solid-state units with a power supply and relay unit, suitable for the environmental conditions in which installed.

1. Operation: Unless otherwise indicated, turn lights on when covered area is occupied and off when unoccupied; with a 1 to 15 minute adjustable time delay for turning lights off.
2. Sensor Output: Contacts rated to operate the connected relay. Sensor shall be powered from the relay unit or networked power pack as indicated on plans and diagrams.

.

3. Relay Unit: Dry contacts rated for 20A ballast/driver load at 120 volt and 277 volt, for 13A tungsten at 120 volt, and for 1 hp at 120 volt.
4. Mounting:
   a. Sensor: Suitable for mounting in any position on a standard outlet box.
   b. Time-Delay and Sensitivity Adjustments: Programmable by digital head-end unit or mobile application.
5. Indicator: LED, to show when motion is being detected during testing and normal operation of the sensor.
6. Bypass Switch: Override the on function in case of sensor failure.
7. Manual/automatic sensor operation programmable by digital head-end unit or mobile application..

8. Automatic Light-Level Sensor: Adjustable from 21.5 to 2152 lx (2 to 200 fc); keep lighting off when selected lighting level is present.
9. Faceplate for Wall-Switch Replacement Type: Refer to wall plate material and color requirements for toggle switches, as specified in Section 26 27 26, WIRING DEVICES.

B. Dual-technology Type: Ceiling mounting; combination PIR and microphonic detection methods, field-selectable.
1. Sensitivity Adjustment: Separate for each sensing technology and programmable by digital head-end unit or mobile application..
2. Detector Sensitivity: Meets NEMA WD 7-2011 for Small Motion, Large Motion and High Mount applications as needed on the plans and diagrams.

C. Detection Coverage: Shall be sufficient to provide coverage as required by sensor locations shown on drawing and indicated for review on shop drawings..

2.12 LIGHTING CONTROL SYSTEM – DISTIBUTIVE RELAY TYPE

A. System Description:
1. The lighting control system shall be a network of remote relay modules connected to a digital network via network hubs and controlled through a system server / central station. Lighting control devices connect to the relay modules and communicate via the digital network with the system server. System includes all associated network interfaces and wiring, hubs, relay modules, relays, photocells, network interfaces, switches, dimmers, time clock, and occupancy sensors. System shall utilize distributed relays modules, allowing these relay modules to be located above accessible ceilings in or adjacent to rooms they are controlling. Wireless distributed lighting controls are allowed for exterior wall mounted lighting or site lighting on poles or remote locations.
2. System shall include server / central station with operating software, data network, and BACnet IP communication with other systems as described. System communication protocol shall be

compatible with the building automation system specified in Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

3. System server / central station shall provide programmable operation of lights connected via system relays and controlled with system devices. System software shall provide control of relays and control devices, time and sequence scheduling, timed out and blink light operation and monitoring and reporting of system events and components. Initial programming shall be as shown on plans and schedules.

B. Server / Central Control Station: Lighting control system manufacturer shall be responsible to assure coordination between relay modules, network hubs and control system server/ central station such that system performs as described. The astronomical timeclock and global programming settings shall live in the system controller and shall be scalable to additional system controller locations, as required. System controller shall have non-volatile memory and programmable by connecting a PC as needed. The power to the System controller shall be plugged in or hardwired to an equipment emergency circuit

D. Relay Modules: Mounted in NEMA enclosure with physically separate 120/277 volt wiring compartment from low voltage control wiring. Provide low voltage digital communication to control devices as shown on drawings and schedules. Supplemental power packs shall be provided as required for multiple control devices. This equipment shall be identified in shop drawing submission. Dimmable relay modules shall be provided where indicated. Relay modules shall be labeled with room number that relays control lighting within.

F. Control Devices: All occupancy sensors (Microphonic, Ultrasonic, IR and Dual Technology type), photocells, switches and timers shall be provided with system and designed to operate on system network. Supplemental power packs and interface shall be provided as required for multiple control devices. This equipment shall be identified in shop drawing submission.

B

PART 3 - EXECUTION

3.1 INSTALLATION

A. Installation shall be in accordance with the NEC, manufacturer's instructions, as shown on the drawings, and as specified.

B. Aim outdoor photoelectric sensor according to manufacturer's recommendations. Set adjustable window slide for 1 footcandle turn-on.

C. Aiming for wall-mounted and ceiling-mounted motion sensor switches shall be per manufacturer’s recommendations.

D. Set occupancy sensor "on" duration to 15 minutes.

E. Locate photoelectric sensors as indicated and in accordance with the manufacturer's recommendations. Adjust sensor for the available light level at the typical work plane for that area.

F. Label overrise and time-programmed switches with a unique designation.

G. Program lighting control zoning and rooms per schedule on drawings.

3.2 ACCEPTANCE CHECKS AND TESTS

A. Perform in accordance with the manufacturer's recommendations.

B. Upon completion of installation, conduct an operating test to show that equipment operates in accordance with requirements of this section.

C. Test for full range of dimming ballast and dimming controls capability. Observe for visually detectable flicker over full dimming range.

D. Test occupancy sensors for proper operation. Observe for light control over entire area being covered.

E. Upon completion of the installation, the system shall be commissioned by the manufacturer’s factory-authorized technician who will verify all adjustments and sensor placements.

3.3 FOLLOW-UP VERIFICATION

Upon completion of acceptance checks and tests, the Contractor shall show by demonstration in service that the lighting control devices are in good operating condition and properly performing the intended function in the presence of COR.

3.4 INSTRUCTION


A. Furnish the services of a factory-trained technician for a minimum of one 8-hour training period for instructing personnel in the maintenance

and operation of the lighting control system on the dates requested by the COR.

B. Contractor shall submit written instructions on training and maintenance as reviewed in training session.


- - - E N D - - -


Lighting Control Riser

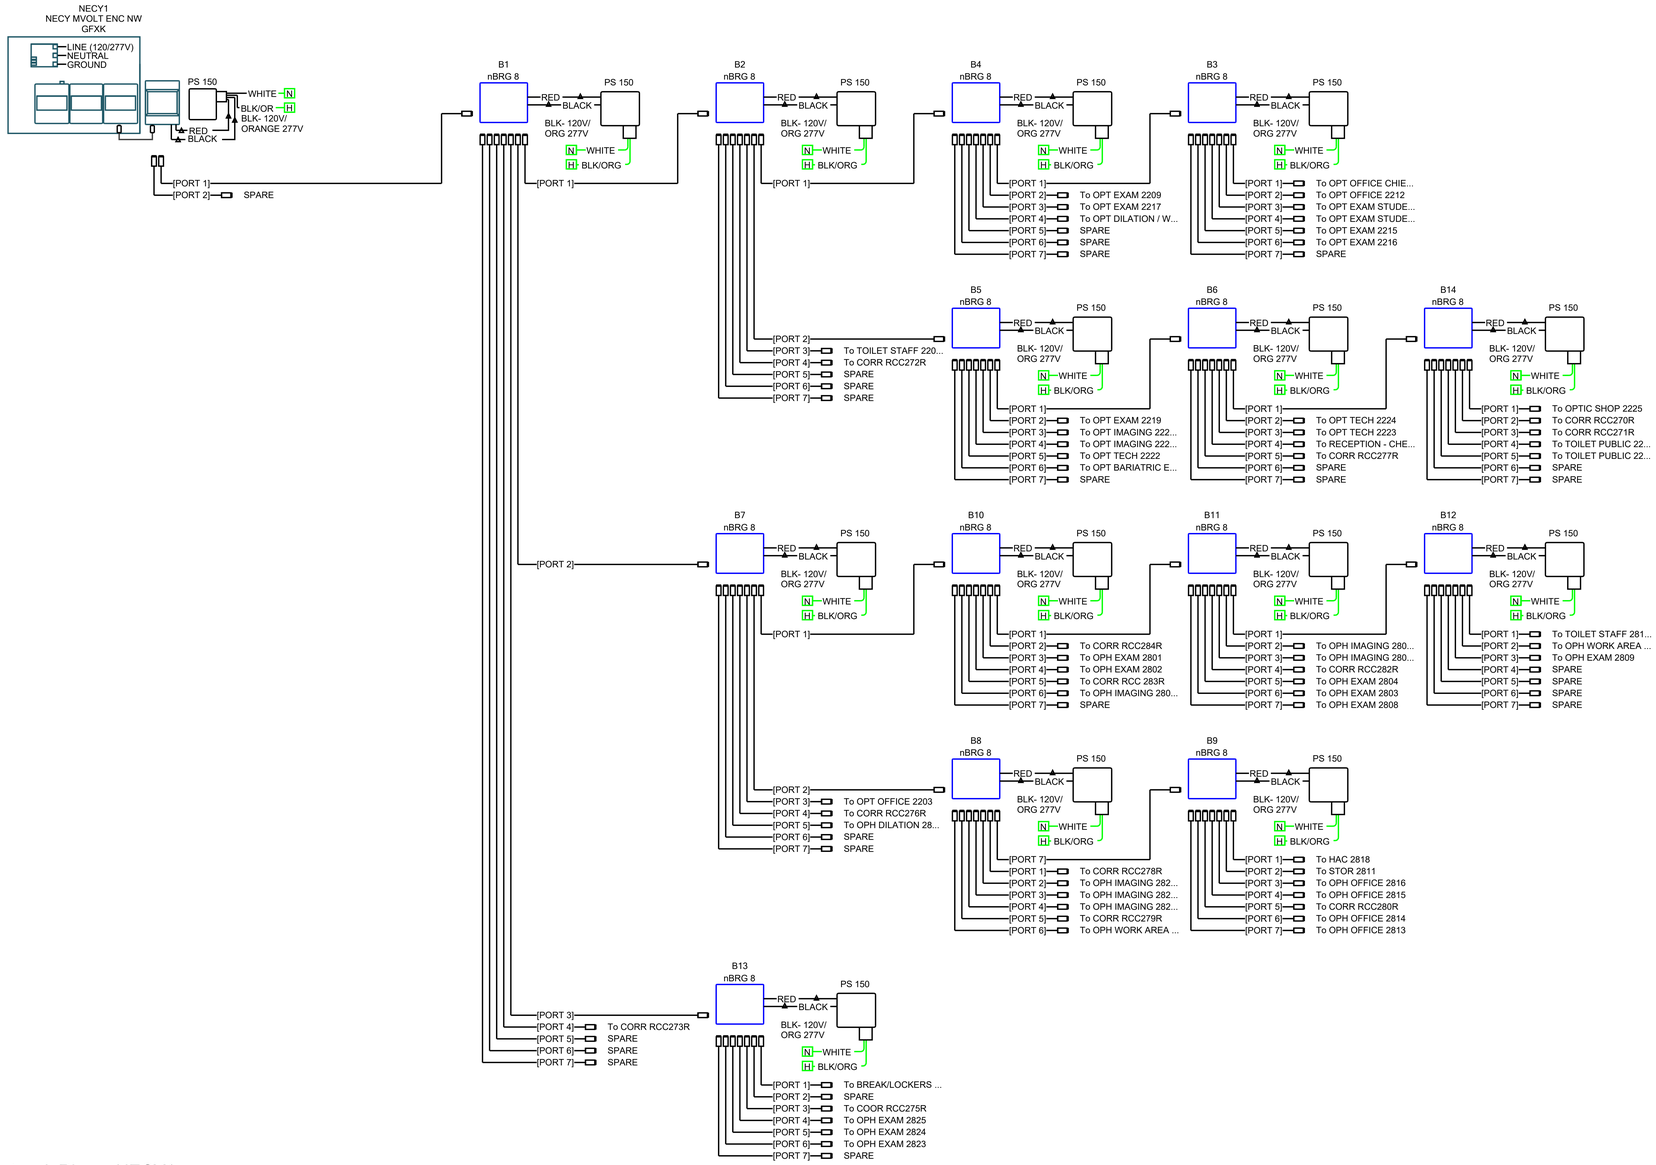

1 Network Riser - NECY1


LC1.0

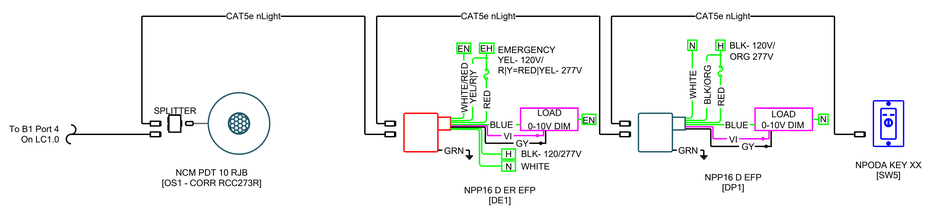

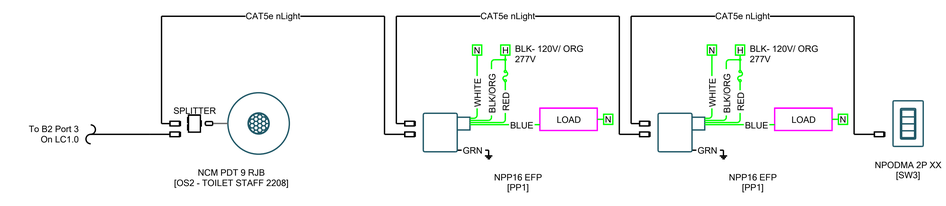


2 B1 Port 4 - CORR RCC273R

LC1.0

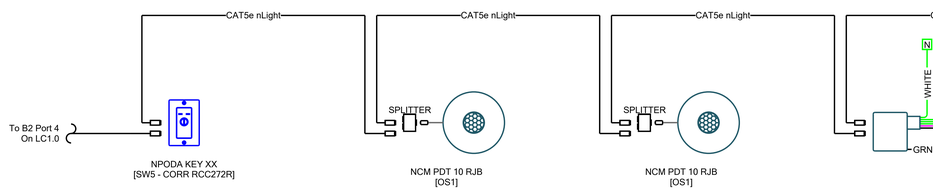

3 B2 Port 3 - TOILET STAFF 2208

LC1.0

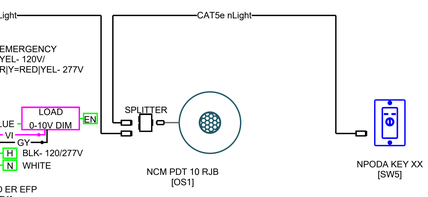

4 B2 Port 4 - CORR RCC272R

LC1.0

Created in Visual Controls


KSA LIGHTING & CONTROLS


EYE CLINIC BIRMINGHAM
BIRMINGHAM, AL

Drawing Type: Riser
Prepared For: BANCROFT

Date: 9/10/2025
Scale: NOT TO SCALE
Drawn By: LF
Project #: KSA CHICAGO
DWG Ref:


Sheet: Riser 1

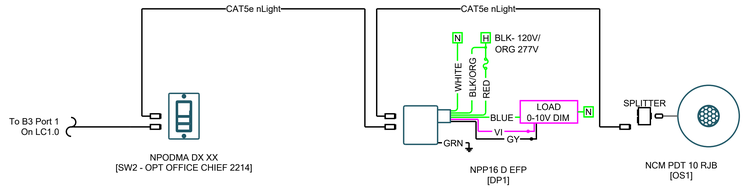

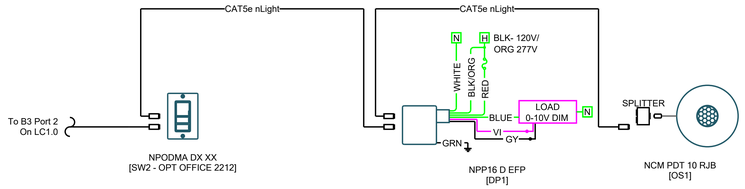

5 B3 Port 1 - OPT OFFICE CHIEF 2214

LC1.0

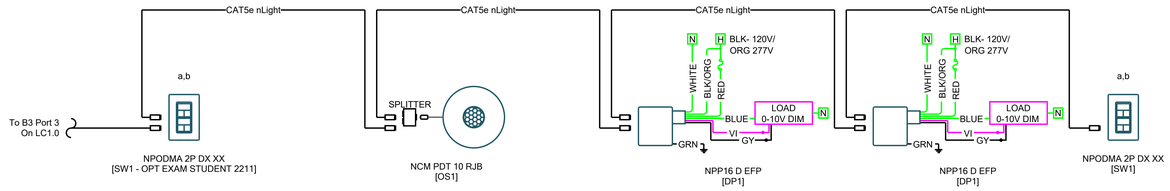


6 B3 Port 2 - OPT OFFICE 2212

LC1.0


7 B3 Port 3 - OPT EXAM STUDENT 2211

LC1.0

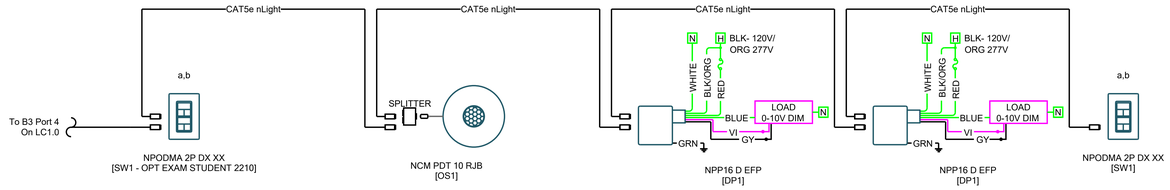


8 B3 Port 4 - OPT EXAM 2210

LC1.0

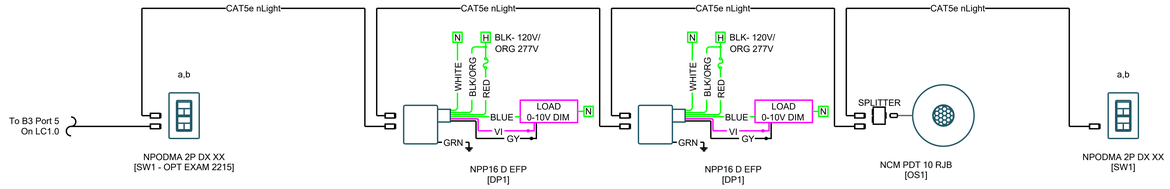


9 B3 Port 5 - OPT EXAM 2215

LC1.0

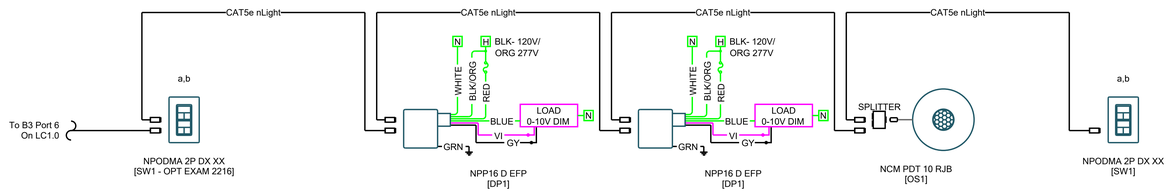

10 B3 Port 6 - OPT EXAM 2216

LC1.0

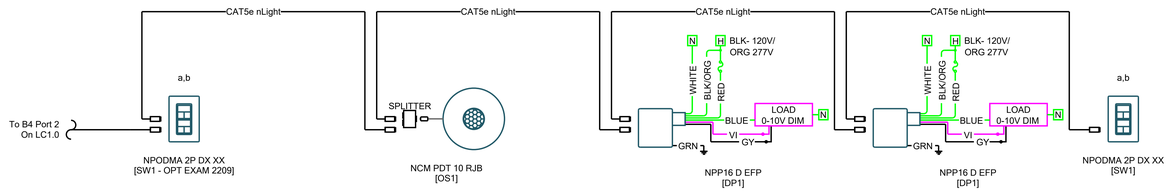

11 B4 Port 2 - OPT EXAM 2209

LC1.0

LIGHTING & CONTROLS

KSA

EYE CLINIC BIRMINGHAM

BIRMINGHAM, AL

Drawing Type: Riser

Prepared For: BANCROFT

Date: 9/10/2025

Scale: NOT TO SCALE


Drawn By: LF

Project #: KSA CHICAGO


DWG Ref:

Sheet: Riser 2


Created in Visual Controls

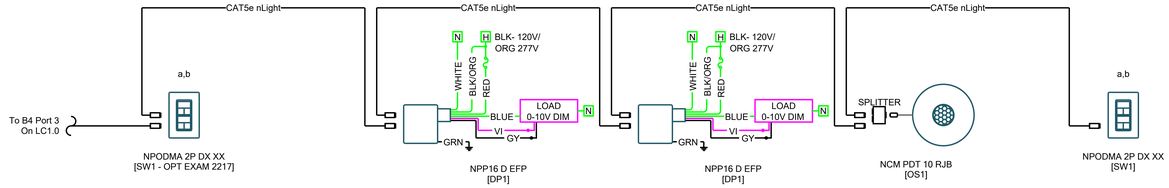


12 B4 Port 3 - OPT EXAM 2217
LC1.0

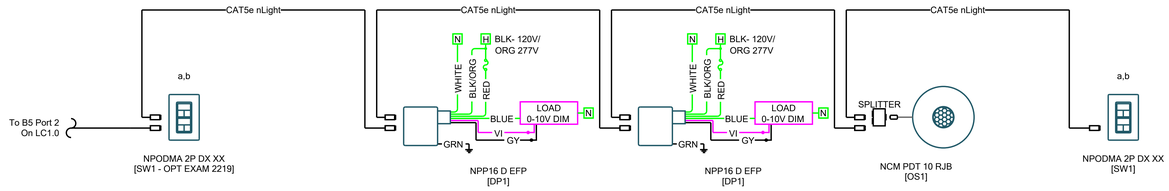


14 B5 Port 2 - OPT EXAM 2219
LC1.0

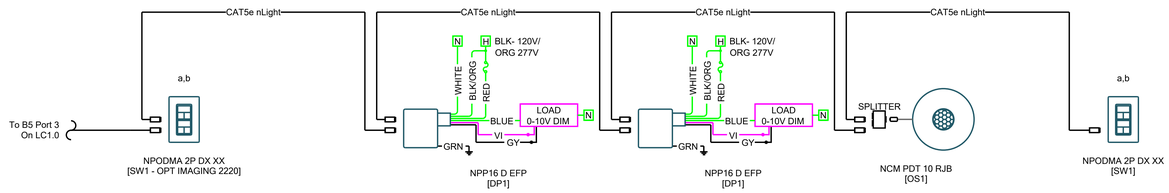


15 B5 Port 3 - OPT IMAGING 2220
LC1.0

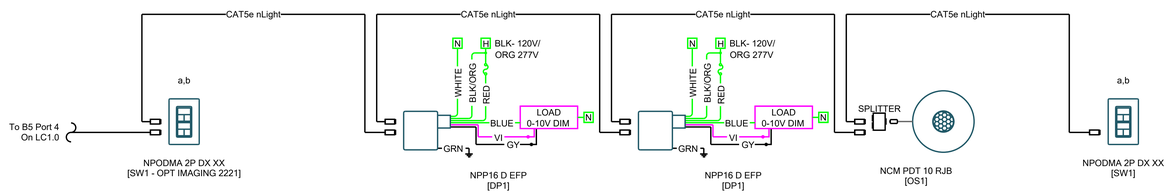


16 B5 Port 4 - OPT IMAGING 2221
LC1.0

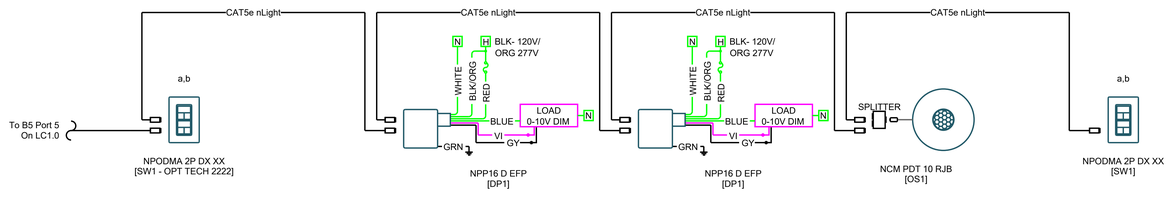

17 B5 Port 5 - OPT TECH 2222
LC1.0

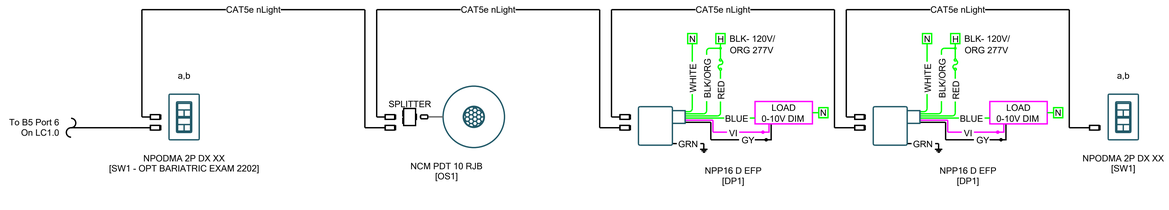

18 B5 Port 6 - OPT BARIATRIC EXAM 2202
LC1.0

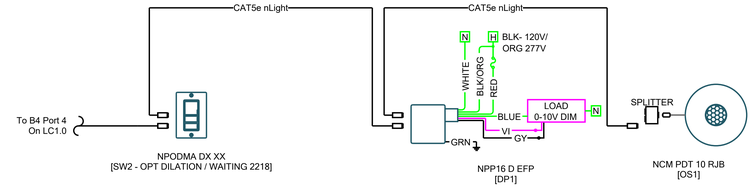

13 B4 Port 4 - OPT DILATION / WAITING 2218
LC1.0

LIGHTING & CONTROLS

KSA

EYE CLINIC BIRMINGHAM
BIRMINGHAM, AL


Drawing Type: Riser

Prepared For: BANCROFT

Date: 9/10/2025
Scale: NOT TO SCALE
Drawn By: LF
Project #: KSA CHICAGO
DWG Ref:


Sheet: Riser 3

Created in Visual Controls

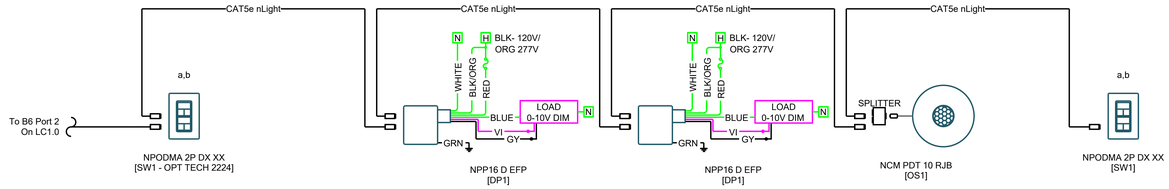


19 B6 Port 2 - OPT TECH 2224

LC1.0

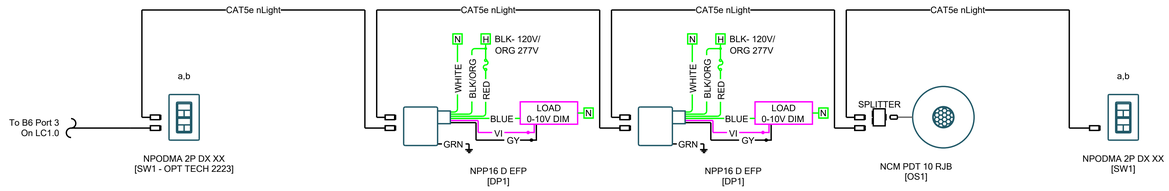


20 B6 Port 3 - OPT TECH 2223

LC1.0

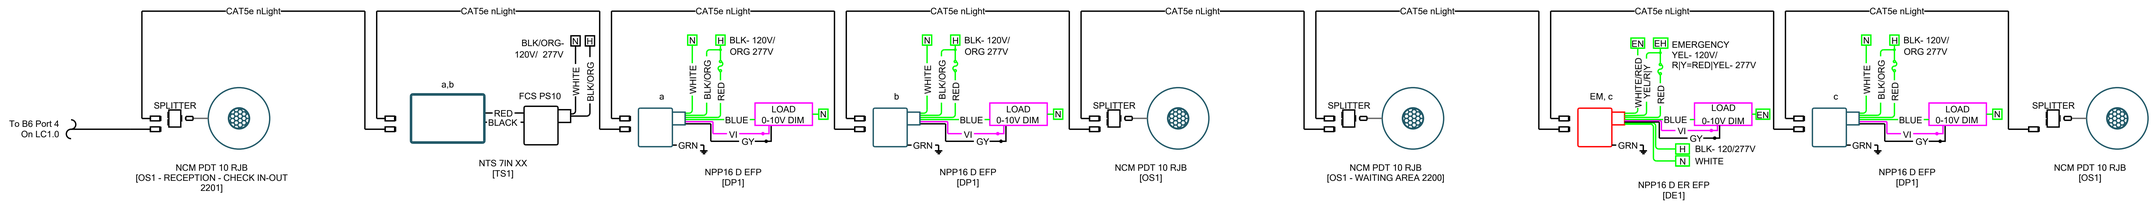

21 B6 Port 4 - RECEPTION - CHECK IN-OUT 2201

LC1.0

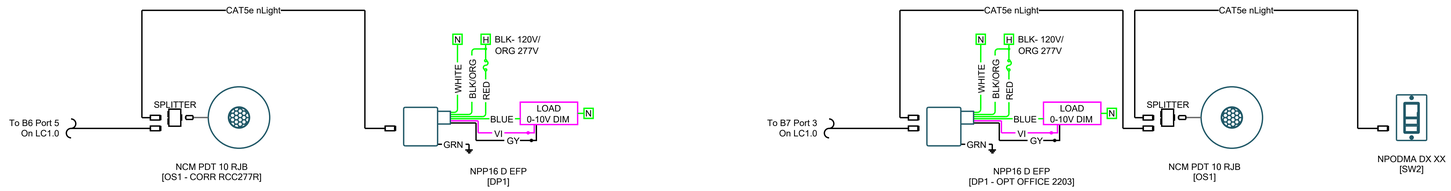


22 B6 Port 5 - CORR RCC277R

LC1.0


23 B7 Port 3 - OPT OFFICE 2203

LC1.0

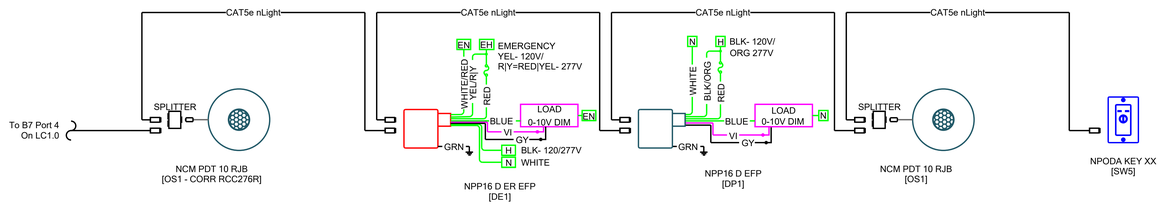

24 B7 Port 4 - CORR RCC276R

LC1.0

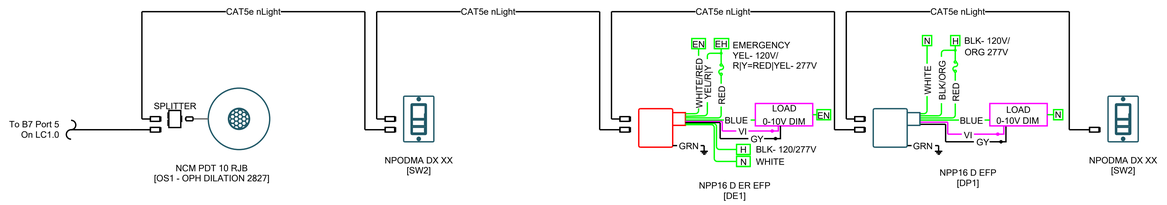

25 B7 Port 5 - OPH DILATION 2827

LC1.0

Created in Visual Controls

LIGHTING & CONTROLS

KSA

EYE CLINIC BIRMINGHAM

BIRMINGHAM, AL

Drawing Type: Riser

Prepared For: BANCROFT

Date: 9/10/2025


Scale: NOT TO SCALE

Drawn By: LF

Project #: KSA CHICAGO


DWG Ref:

Sheet: Riser 4

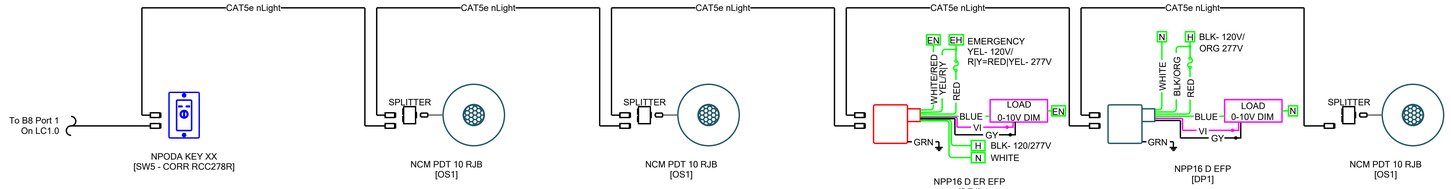


26 B8 Port 1 - CORR RCC278R

LC1.0

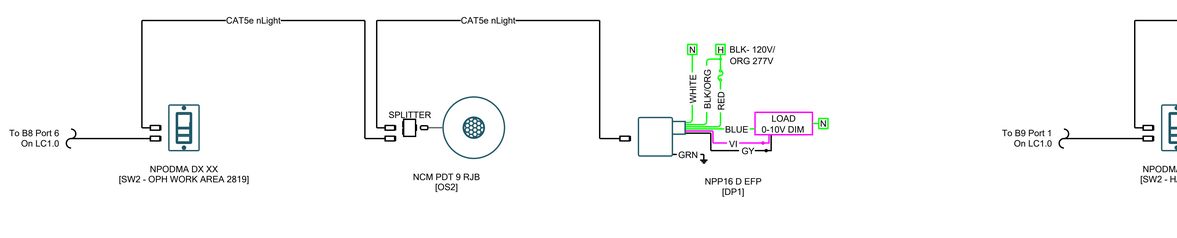


27 B8 Port 2 - OPH IMAGING 2822

LC1.0

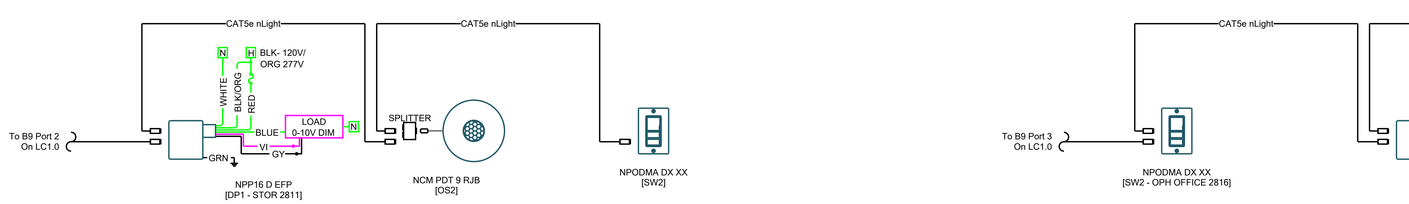


28 B8 Port 3 - OPH IMAGING 2821

LC1.0

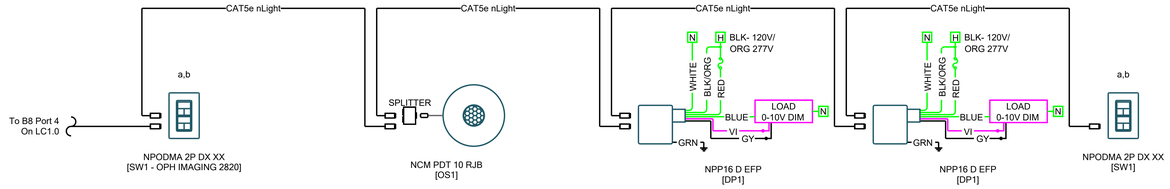

29 B8 Port 4 - OPH IMAGING 2820

LC1.0

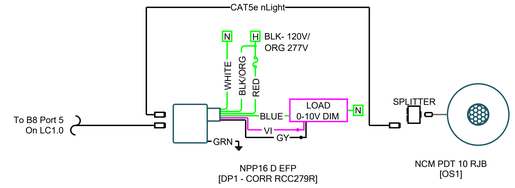


30 B8 Port 5 - CORR RCC279R

LC1.0

31 B8 Port 6 - OPH WORK AREA 2819

LC1.0

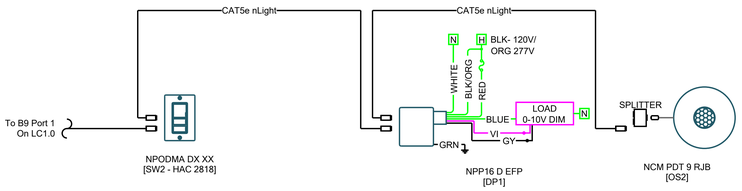


32 B9 Port 1 - HAC 2818

LC1.0

33 B9 Port 2 - STOR 2811

LC1.0

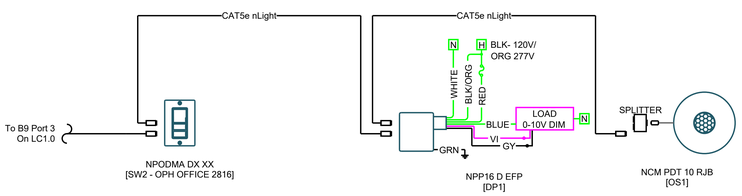

34 B9 Port 3 - OPH OFFICE 2816

LC1.0

LIGHTING & CONTROLS

KSA

EYE CLINIC BIRMINGHAM

BIRMINGHAM, AL

Drawing Type: Riser

Prepared For: BANCROFT

Date: 9/10/2025

Scale: NOT TO SCALE


Drawn By: LF

Project #: KSA CHICAGO

DWG Ref:


Sheet: Riser 5

Created in Visual Controls

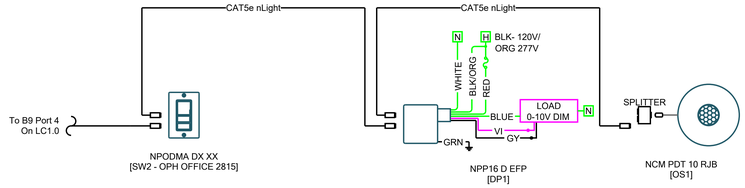


35 B9 Port 4 - OPH OFFICE 2815

LC1.0

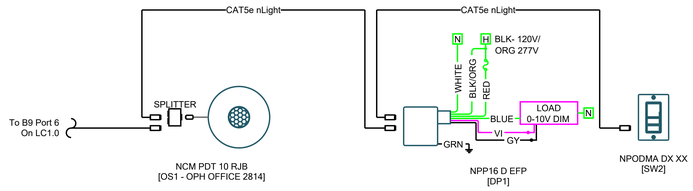


37 B9 Port 6 - OPH OFFICE 2814

LC1.0

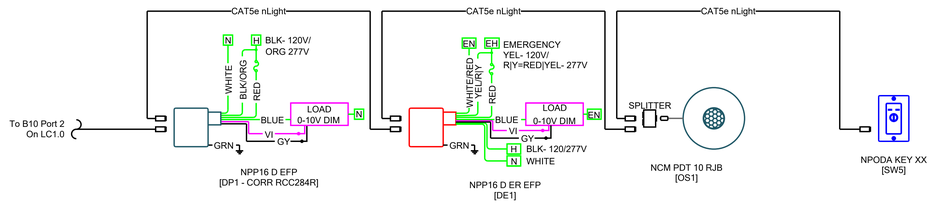


39 B10 Port 2 - CORR RCC284R

LC1.0

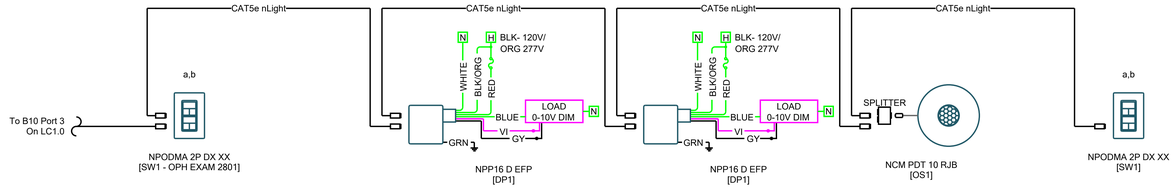


40 B10 Port 3 - OPH EXAM 2801

LC1.0

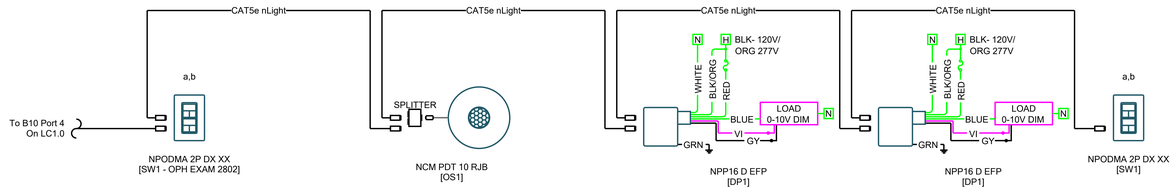


41 B10 Port 4 - OPH EXAM 2802

LC1.0

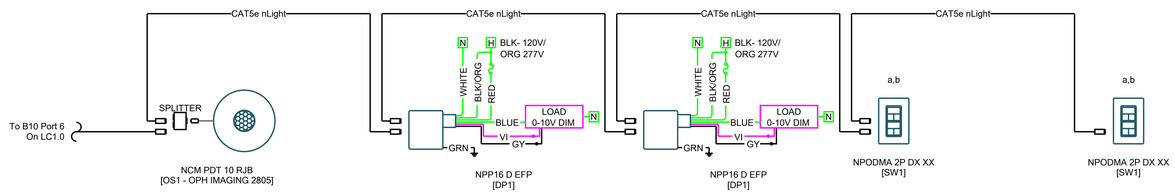


43 B10 Port 6 - OPH IMAGING 2805

LC1.0

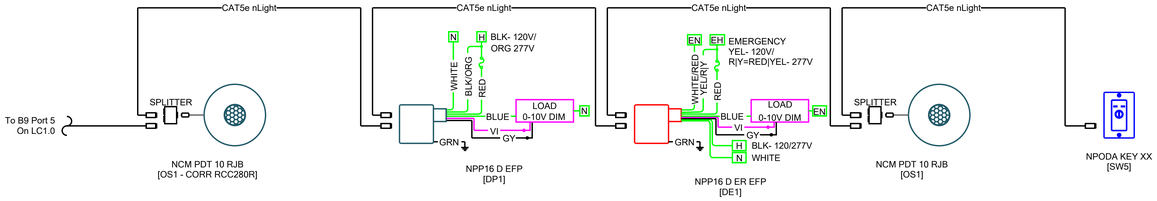


36 B9 Port 5 - CORR RCC280R

LC1.0

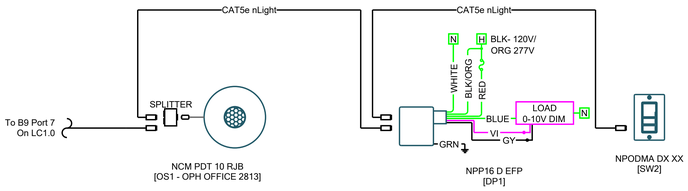

38 B9 Port 7 - OPH OFFICE 2813

LC1.0

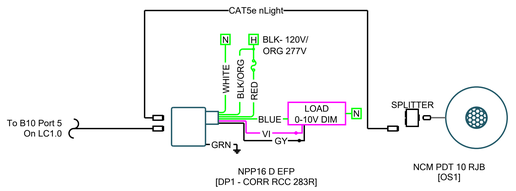

42 B10 Port 5 - CORR RCC 283R

LC1.0

LIGHTING & CONTROLS

KSA

EYE CLINIC BIRMINGHAM

BIRMINGHAM, AL

Drawing Type: Riser

Prepared For: BANCROFT

Date: 9/10/2025

Scale: NOT TO SCALE


Drawn By: LF

Project #: KSA CHICAGO

DWG Ref:


Sheet: Riser 6

Created in Visual Controls

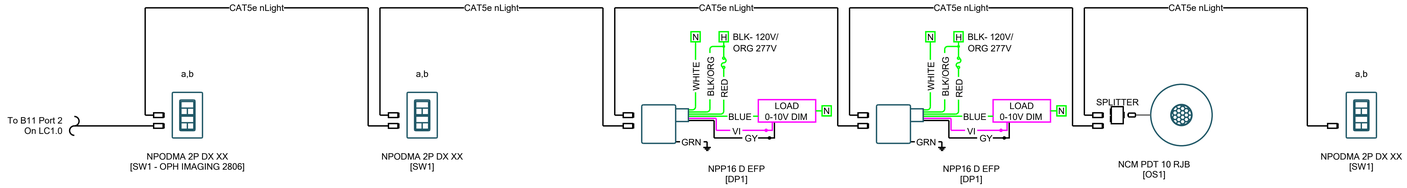


44 B11 Port 2 - OPH IMAGING 2806

LC1.0

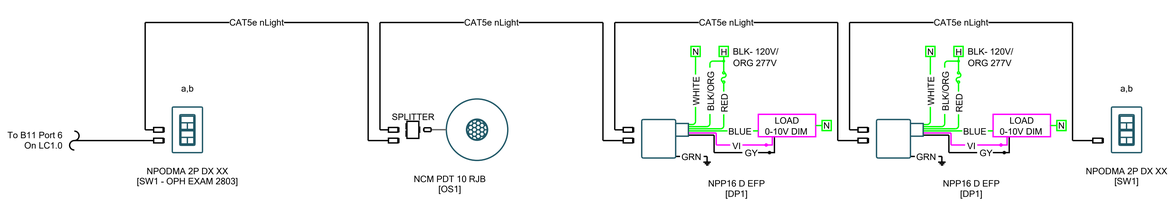

45 B11 Port 3 - OPH IMAGING 2807

LC1.0

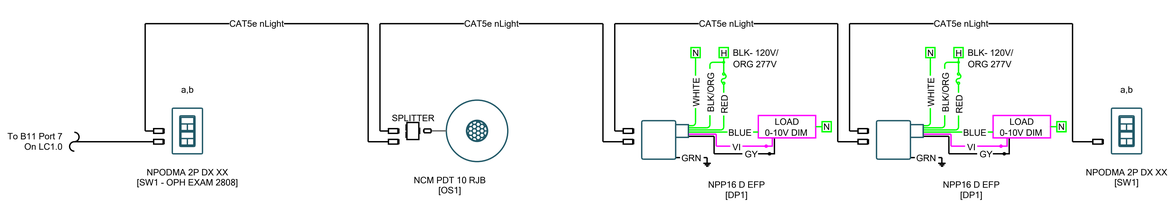

46 B11 Port 4 - CORR RCC282R

LC1.0

47 B11 Port 5 - OPH EXAM 2804

LC1.0

48 B11 Port 6 - OPH EXAM 2803

LC1.0

49 B11 Port 7 - OPH EXAM 2808

LC1.0

LIGHTING & CONTROLS

KSA

EYE CLINIC BIRMINGHAM

BIRMINGHAM, AL

Drawing Type: Riser

Prepared For: BANCROFT

Date: 9/10/2025

Scale: NOT TO SCALE


Drawn By: LF

Project #: KSA CHICAGO


DWG Ref:

Sheet: Riser 7


Created in Visual Controls

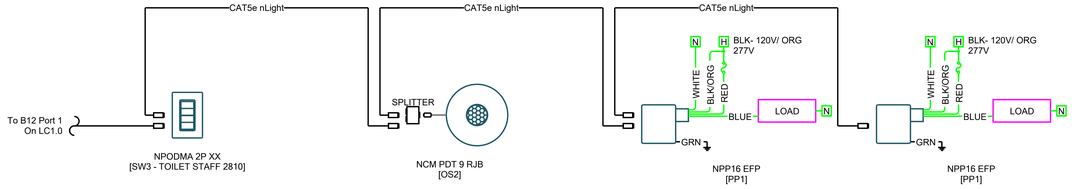


50 B12 Port 1 - TOILET STAFF 2810
LC1.0

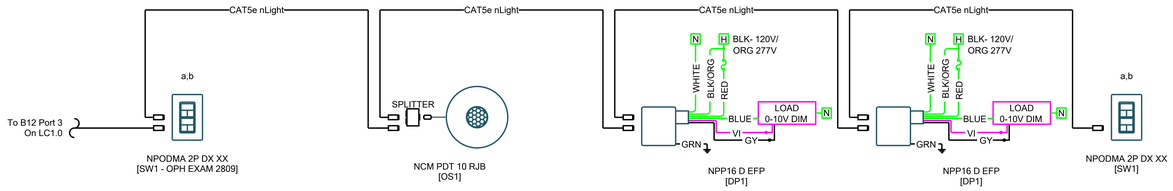


52 B12 Port 3 - OPH EXAM 2809
LC1.0

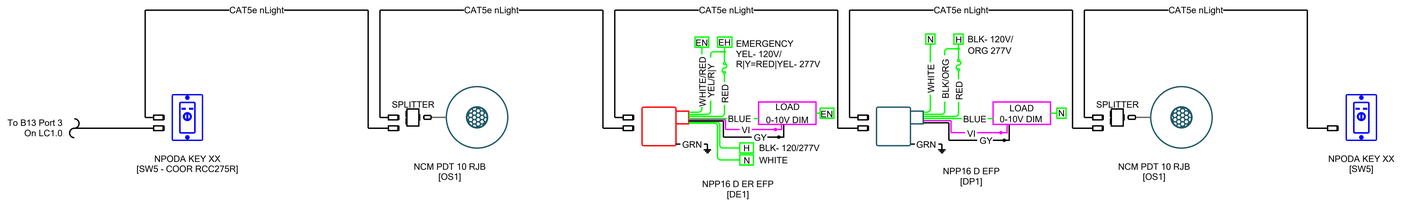


54 B13 Port 3 - COOR RCC275R
LC1.0

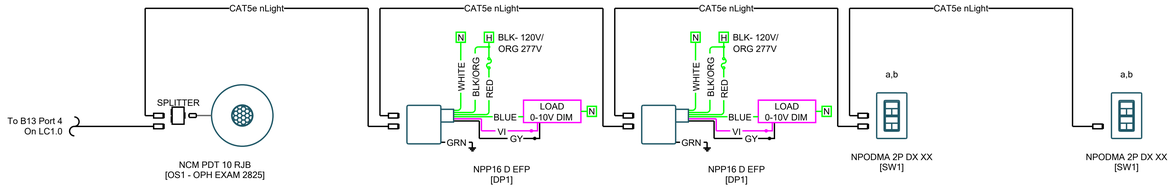


55 B13 Port 4 - OPH EXAM 2825
LC1.0

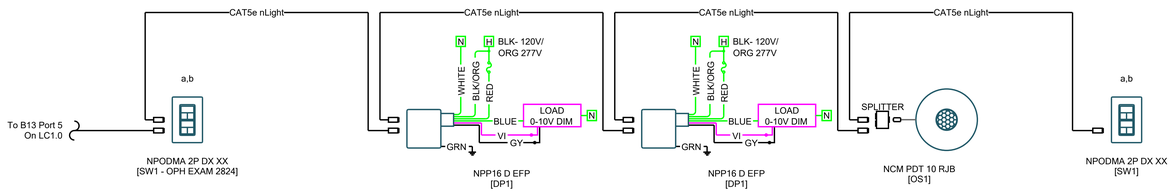


56 B13 Port 5 - OPH EXAM 2824
LC1.0

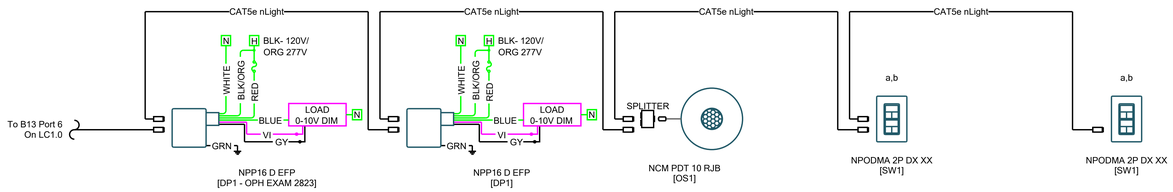


57 B13 Port 6 - OPH EXAM 2823
LC1.0

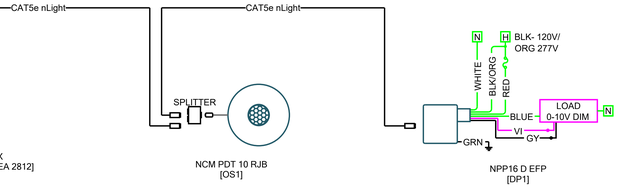

51 B12 Port 2 - OPH WORK AREA 2812
LC1.0

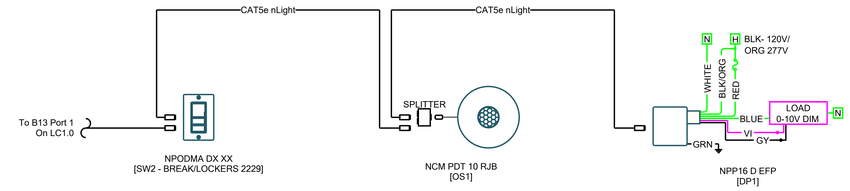

53 B13 Port 1 - BREAK/LOCKERS 2229
LC1.0

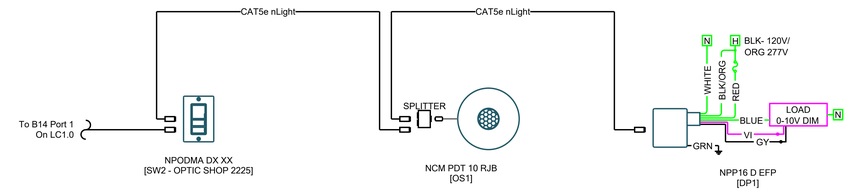

58 B14 Port 1 - OPTIC SHOP 2225
LC1.0

LIGHTING & CONTROLS

KSA

EYE CLINIC BIRMINGHAM
BIRMINGHAM, AL


Drawing Type: Riser

Prepared For: BANCROFT


Date: 9/10/2025
Scale: NOT TO SCALE
Drawn By: LF
Project #: KSA CHICAGO
DWG Ref:

Sheet: Riser 8

Created in Visual Controls

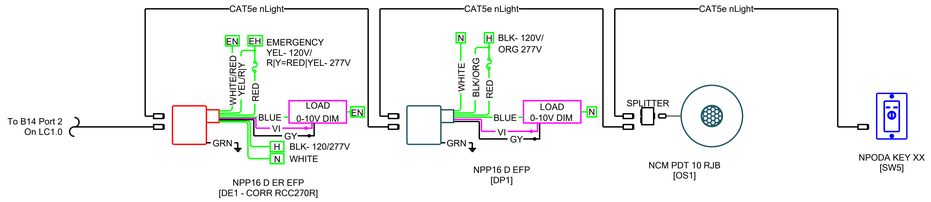


59 B14 Port 2 - CORR RCC270R
LC1.0

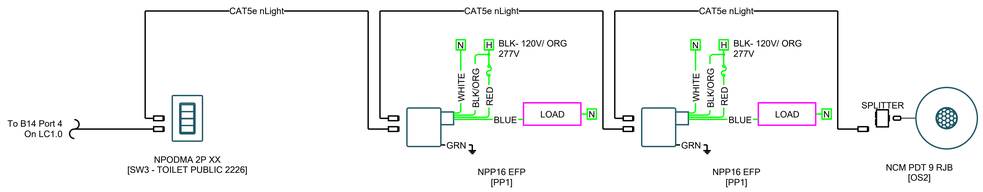


61 B14 Port 4 - TOILET PUBLIC 2226
LC1.0

63 nLight - MECHANICAL ROOM 2228
LC1.0

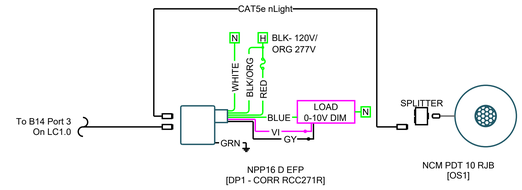

60 B14 Port 3 - CORR RCC271R
LC1.0

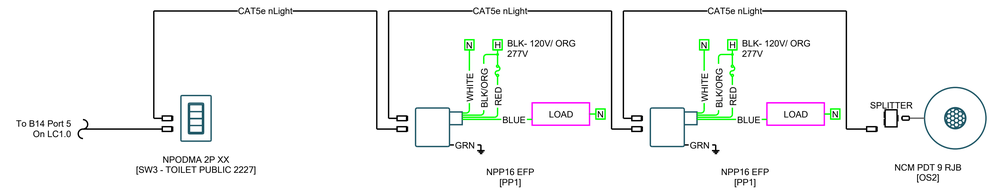

62 B14 Port 5 - TOILET PUBLIC 2227
LC1.0

LIGHTING & CONTROLS

KSA

EYE CLINIC BIRMINGHAM
BIRMINGHAM, AL

Drawing Type: Riser

Prepared For: BANCROFT

Date: 9/10/2025
Scale: NOT TO SCALE
Drawn By: LF
Project #: KSA CHICAGO
DWG Ref:

Sheet: Riser 9

Created in Visual Controls

SECTION 26 24 16
PANELBOARDS

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the furnishing, installation, and connection of panelboards.

1.2 RELATED WORK

A. Section 09 91 00, PAINTING: Painting of panelboards.

B. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS: Requirements for seismic restraint of non-structural components.

D. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.

E. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.

F. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

G. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.

H. Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY: Short circuit and coordination study, and requirements for a coordinated electrical system.

J. Section 26 43 13, SURGE PROTECTIVE DEVICES: Surge protective devices integral to panelboards.

1.3 QUALITY ASSURANCE

A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:

1. Shop Drawings:

a. Submit sufficient information to demonstrate compliance with drawings and specifications.

b. Include electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, circuit breakers, wiring and connection diagrams, accessories, and nameplate data.

c. Certification from the manufacturer that a representative panelboard has been seismically tested to International Building Code requirements. Certification shall be based upon simulated seismic forces on a shake table or by analytical methods, but not by experience data or other methods.

2. Manuals:

a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering circuit breakers and replacement parts.

2) Include information for testing, repair, troubleshooting, assembly, and disassembly.

b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. International Code Council (ICC):

IBC-21.....International Building Code

C. National Electrical Manufacturers Association (NEMA):

PB 1-11.....Panelboards

250-20.....Enclosures for Electrical Equipment (1,000V Maximum)

D. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

70E-24.....Standard for Electrical Safety in the Workplace

E. Underwriters Laboratories, Inc. (UL):

50-15.....Enclosures for Electrical Equipment

67-09.....Panelboards

489-16.....Molded Case Circuit Breakers and Circuit Breaker Enclosures

PART 2 - PRODUCTS

2.1 GENERAL REQUIREMENTS

A. Panelboards shall be in accordance with NEC, NEMA, UL, as specified, and as shown on the drawings.

B. Panelboards shall have main breaker or main lugs, bus size, voltage, phases, number of circuit breaker mounting spaces, top or bottom feed, flush or surface mounting, branch circuit breakers, and accessories as shown on the drawings.

C. Panelboards shall be completely factory-assembled with molded case circuit breakers and integral accessories as shown on the drawings or specified herein.

D. Non-reduced size copper bus bars, rigidly supported on molded insulators, and fabricated for bolt-on type circuit breakers.

E. Bus bar connections to the branch circuit breakers shall be the “distributed phase” or “phase sequence” type.

F. Mechanical lugs furnished with panelboards shall be cast, stamped, or machined metal alloys listed for use with the conductors to which they will be connected.

G. Neutral bus shall be 200%rated, mounted on insulated supports.

H. Grounding bus bar shall be equipped with screws or lugs for the connection of equipment grounding conductors.

I. Bus bars shall be braced for the available short-circuit current as shown on the drawings, but not be less than 10,000 A symmetrical for 120/208 V and 120/240 V panelboards, and 14,000 A symmetrical for 277/480 V panelboards.

J. In two-section panelboards, the main bus in each section shall be full size. The first section shall be furnished with subfeed lugs on the line side of main lugs only, or through-feed lugs for main breaker type panelboards, and have field-installed cable connections to the second

section as shown on the drawings. Panelboard sections with tapped bus or crossover bus are not acceptable.

K. Series-rated panelboards are not permitted.

2.2 ENCLOSURES AND TRIMS

A. Enclosures:

1. Provide galvanized steel enclosures, with NEMA rating as shown on the drawings or as required for the environmental conditions in which installed.
2. Enclosures shall not have ventilating openings.
3. Enclosures may be of one-piece formed steel or of formed sheet steel with end and side panels welded, riveted, or bolted as required.
4. Provide manufacturer’s standard option for prepunched knockouts on top and bottom endwalls.
5. Include removable inner dead front cover, independent of the panelboard cover.

B. Trims:

1. Hinged “door-in-door” type.
2. Interior hinged door with hand-operated latch or latches, as required to provide access only to circuit breaker operating handles, not to energized parts.
3. Outer hinged door shall be securely mounted to the panelboard enclosure with factory bolts, screws, clips, or other fasteners, requiring a key or tool for entry. Hand-operated latches are not acceptable.
4. Inner and outer doors shall open left to right.
5. Trims shall be flush or surface type as shown on the drawings.

2.3 MOLDED CASE CIRCUIT BREAKERS

A. Circuit breakers shall be per UL, NEC, as shown on the drawings, and as specified.

B. Circuit breakers shall be bolt-on type.

C. Circuit breakers shall have minimum interrupting rating as required to withstand the available fault current, but not less than:

1. 120/208 V Panelboard: 10,000 A symmetrical.
2. 120/240 V Panelboard: 10,000 A symmetrical.
3. 277/480 V Panelboard: 14,000 A symmetrical.

D. Circuit breakers shall have automatic, trip free, non-adjustable, inverse time, and instantaneous magnetic trips for less than 400 A frame. Circuit breakers with 400 A frames and above shall have magnetic trip, adjustable from 5x to 10x.

E. Circuit breaker features shall be as follows:

1. A rugged, integral housing of molded insulating material.
2. Silver alloy contacts.
3. Arc quenchers and phase barriers for each pole.
4. Quick-make, quick-break, operating mechanisms.
5. A trip element for each pole, thermal magnetic type with long time delay and instantaneous characteristics, a common trip bar for all poles and a single operator.
6. Electrically and mechanically trip free.
7. An operating handle which indicates closed, tripped, and open positions.
8. An overload on one pole of a multi-pole breaker shall automatically cause all the poles of the breaker to open.
9. Ground fault current interrupting breakers, shunt trip breakers, lighting control breakers (including accessories to switch line currents), or other accessory devices or functions shall be provided where shown on the drawings.
10. For circuit breakers being added to existing panelboards, coordinate the breaker type with existing panelboards. Modify the panel directory accordingly.

2.4 SURGE PROTECTIVE DEVICES

A. Where shown on the drawings, furnish panelboards with integral surge protective devices. Refer to Section 26 43 13, SURGE PROTECTIVE DEVICES.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Installation shall be in accordance with the manufacturer’s instructions, the NEC, as shown on the drawings, and as specified.

B. Locate panelboards so that the present and future conduits can be conveniently connected.

C. In seismic areas, panelboards shall be adequately anchored and braced per details on structural contract drawings to withstand the seismic forces at the location where installed.

D. Update and Install a printed schedule of circuits in each panelboard after approval by the COR. Schedules shall reflect final load descriptions, room numbers, and room names connected to each circuit breaker. Schedules shall be printed on the panelboard directory cards and be installed in the appropriate panelboards

E. Mount panelboards such that the maximum height of the top circuit breaker above the finished floor shall not exceed 1980 mm (78 inches).

F. Provide blank cover for each unused circuit breaker mounting space.

H. Rust and scale shall be removed from the inside of existing enclosures where new interior components are to be installed. Paint inside of enclosures with rust-preventive paint before the new interior components are installed. Provide new trim. Trim shall fit tight to the enclosure.

I. Panelboard enclosures shall not be used for conductors feeding through, spliced, or tapping off to other enclosures or devices.

3.2 ACCEPTANCE CHECKS AND TESTS

A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:

1. Visual Inspection and Tests:

a. Compare equipment nameplate data with specifications and approved shop drawings.

b. Inspect physical, electrical, and mechanical condition.

c. Verify appropriate anchorage and required area clearances.

d. Verify that circuit breaker sizes and types correspond to approved shop drawings.

e. To verify tightness of accessible bolted electrical connections, use the calibrated torque-wrench method or perform thermographic survey after energization.

f. Vacuum-clean enclosure interior. Clean enclosure exterior.

3.3 FOLLOW-UP VERIFICATION

A. Upon completion of acceptance checks, settings, and tests, the Contractor shall demonstrate that the panelboards are in good operating condition and properly performing the intended function.

---END---

SECTION 26 27 26
WIRING DEVICES

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the furnishing, installation, connection, and testing of wiring devices.

1.2 RELATED WORK

A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.

B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Cables and wiring.

C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.

D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and boxes.

E. Section 26 51 00, INTERIOR LIGHTING: LED drivers for use with manual dimming controls.

1.3 QUALITY ASSURANCE

A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:

1. Shop Drawings:
   a. Submit sufficient information to demonstrate compliance with drawings and specifications.
   b. Include electrical ratings, dimensions, mounting details, construction materials, grade, and termination information.
2. Manuals:

a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets and information for ordering replacement parts.

b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.

3. Certifications: Two weeks prior to final inspection, submit the following.

a. Certification by the manufacturer that the wiring devices conform to the requirements of the drawings and specifications.

b. Certification by the Contractor that the wiring devices have been properly installed and adjusted.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.

B. National Electrical Manufacturers Association (NEMA):

WD 1-99(R2020).....General Color Requirements for Wiring Devices

WD 6-16 .....Wiring Devices – Dimensional Specifications

C. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

99-24.....Health Care Facilities

D. Underwriter’s Laboratories, Inc. (UL):

5-16.....Surface Metal Raceways and Fittings

20-18.....General-Use Snap Switches

231-16.....Power Outlets

467-13.....Grounding and Bonding Equipment

498-17.....Attachment Plugs and Receptacles

943-16.....Ground-Fault Circuit-Interrupters

1449-21.....Surge Protective Devices

1472-15.....Solid State Dimming Controls

PART 2 - PRODUCTS

2.1 RECEPTACLES

A. General: All receptacles shall comply with NEMA, NFPA, UL, and as shown on the drawings.
   1. Mounting straps shall be nickel plated brass, brass, nickel plated steel or galvanize steel with break-off plaster ears, and shall include a self-grounding feature. Terminal screws shall be brass, brass plated or a copper alloy metal.
   2. Receptacles shall have provisions for back wiring with separate metal clamp type terminals (four minimum) and side wiring from four captively held binding screws.

B. Duplex Receptacles - Hospital-grade: shall be listed for hospital grade, single phase, 20 ampere, 120 volts, 2-pole, 3-wire, NEMA 5-20R, with break-off feature for two-circuit operation.
   1. Bodies shall be white/ in color.
   2. Switched duplex receptacles shall be wired so that only the top receptacle is switched. The lower receptacle shall be unswitched.
   3. Duplex Receptacles on Emergency Circuit:
      a. In rooms without emergency powered general lighting, the emergency receptacles shall be of the self-illuminated type.
   4. Ground Fault Current Interrupter (GFCI) Duplex Receptacles: Shall be an integral unit, hospital-grade, suitable for mounting in a standard outlet box, with end-of-life indication and provisions to isolate the face due to improper wiring. GFCI receptacles shall be self-test receptacles in accordance with UL 943.
      a. Ground fault interrupter shall consist of a differential current transformer, self-test, solid state sensing circuitry and a circuit interrupter switch. Device shall have nominal sensitivity to ground leakage current of 4-6 milliamperes and shall function to interrupt the current supply for any value of ground leakage current above five milliamperes (+ or – 1 milliampere) on the load side of the device. Device shall have a minimum nominal tripping time of 0.025 second.
      b. Self-test function shall be automatically initiated within 5 seconds after power is activated to the receptacles. Self-test

function shall be periodically and automatically performed every 3 hours or less.

c. End-of-life indicator light shall be a persistent flashing or blinking light to indicate that the GFCI receptacle is no longer in service.

C. Duplex Receptacles – Non-hospital Grade: shall be the same as duplex receptacles – hospital grade in accordance with sections 2.1A and 2.1B of this specification, except for the hospital grade listing.

1. Bodies shall be white nylon.

D. Receptacles - 20, 30, and 50 ampere, 250 Volts: Shall be complete with appropriate cord grip plug.

E. Weatherproof Receptacles: Shall consist of a duplex receptacle, mounted in box with a gasketed, weatherproof, cast metal cover plate and cap over each receptacle opening. The cap shall be permanently attached to the cover plate by a spring-hinged flap. The weatherproof integrity shall not be affected when heavy duty specification or hospital grade attachment plug caps are inserted. Cover plates on outlet boxes mounted flush in the wall shall be gasketed to the wall in a watertight manner.

F. Surge Protective Receptacles shall have integral surge suppression in line to ground, line to neutral, and neutral to ground modes.

1. Surge Protective Components: Multiple metal-oxide varistors; with a nominal clamp-level rating of 400 Volts, and minimum single transient pulse energy dissipation of 210 Joules.
2. Active Surge Protective Indication: LED, visible in face of device to indicate device is active or no longer in service.

2.2 TOGGLE SWITCHES

A. Toggle switches shall be totally enclosed tumbler type with nylon bodies. Handles shall be white/ in color unless otherwise specified or shown on the drawings.

1. Switches installed in hazardous areas shall be explosion-proof type in accordance with the NEC and as shown on the drawings.
2. Shall be single unit toggle, butt contact, quiet AC type, heavy-duty general-purpose use with an integral self grounding mounting strap with break-off plasters ears and provisions for back wiring with

separate metal wiring clamps and side wiring with captively held binding screws.

3. Switches shall be rated 20 amperes at 120-277 Volts AC.

2.3 MANUAL DIMMING CONTROL

A. Electronic full-wave manual slide dimmer with on/off switch and audible frequency and EMI/RFI suppression filters.

B. Manual dimming controls shall be fully compatible with LED dimming driver and be approved by the driver manufacturer, shall operate over full specified dimming range, and shall not degrade the performance or rated life of the electronic dimming ballast and lamp.

C. Provide single-pole, three-way or four-way, as shown on the drawings.

D. Manual dimming control and faceplates shall be white in color unless otherwise specified.

2.4 WALL PLATES

A. Wall plates for switches and receptacles shall be type 302 stainless steel . Oversize plates are not acceptable.

C. For receptacles or switches mounted adjacent to each other, wall plates shall be common for each group of receptacles or switches.

D. In areas requiring tamperproof wiring devices, wall plates shall be type 302 stainless steel, and shall have tamperproof screws and beveled edges.

E. Duplex Receptacles on Emergency Circuit: Wall plates shall be type 302 stainless steel, with the word “EMERGENCY” engraved in 6 mm (1/4 inch) red letters.

2.5 SURFACE MULTIPLE-OUTLET ASSEMBLIES

A. Shall have the following features:

1. Enclosures:

a. Thickness of steel shall be not less than 1 mm (0.040 inch) for base and cover. Nominal dimensions shall be 40 mm x 70 mm (1-1/2 inches by 2-3/4 inches) with inside cross sectional area not less than 2250 square mm (3-1/2 square inches). The enclosures shall be thoroughly cleaned, phosphatized, and painted at the factory with primer and the manufacturer's standard baked enamel finish.

2. Receptacles shall be duplex, hospital grade. See paragraph 'RECEPTACLES' in this Section. Device cover plates shall be the

manufacturer's standard corrosion resistant finish and shall not exceed the dimensions of the enclosure.

3. Unless otherwise shown on drawings, receptacle spacing shall be 600 mm (24 inches) on centers.
4. Conductors shall be as specified in Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLE.
5. Installation fittings shall be the manufacturer’s standard bends, offsets, device brackets, inside couplings, wire clips, elbows, and other components as required for a complete system.
6. Bond the assemblies to the branch circuit conduit system.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Installation shall be in accordance with the NEC and as shown as on the drawings.

B. Install wiring devices after wall construction and painting is complete.

C. The ground terminal of each wiring device shall be bonded to the outlet box with an approved green bonding jumper, and also connected to the branch circuit equipment grounding conductor.

D. Outlet boxes for toggle switches and manual dimming controls shall be mounted on the strike side of doors.

E. Provide barriers in multi-gang outlet boxes to comply with the NEC.

F. Coordinate the electrical work with the work of other trades to ensure that wiring device flush outlets are positioned with box openings aligned with the face of the surrounding finish material. Pay special attention to installations in cabinet work, and in connection with laboratory equipment.

G. Exact field locations of floors, walls, partitions, doors, windows, and equipment may vary from locations shown on the drawings. Prior to locating sleeves, boxes and chases for roughing-in of conduit and equipment, the Contractor shall coordinate exact field location of the above items with other trades.

H. Install wall switches 1.2 M (48 inches) above floor, with the toggle OFF position down.

I. Install wall dimmers 1.2 M (48 inches) above floor.

J. Install receptacles 450 mm (18 inches) above floor, and 152 mm (6 inches) above counter backsplash or workbenches. Install specific-use receptacles at heights shown on the drawings.

K. Install horizontally mounted receptacles with the ground pin to the right.

L. When required or recommended by the manufacturer, use a torque screwdriver. Tighten unused terminal screws.

M. Label device plates with a permanent adhesive label listing panel and circuit feeding the wiring device.

3.2 ACCEPTANCE CHECKS AND TESTS

A. Perform manufacturer’s required field checks in accordance with the manufacturer's recommendations, and the latest NFPA 99. In addition, include the following:

1. Visual Inspection and Tests:
   a. Inspect physical and electrical conditions.
   b. Vacuum-clean surface metal raceway interior. Clean metal raceway exterior.
   c. Test wiring devices for damaged conductors, high circuit resistance, poor connections, inadequate fault current path, defective devices, or similar problems using a portable receptacle tester. Correct circuit conditions, remove malfunctioning units and replace with new, and retest as specified above.
   d. Test GFCI receptacles.

---END---

SECTION 26 29 11
MOTOR CONTROLLERS

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the furnishing, installation, connection, and testing of motor controllers, including all low- and medium-voltage motor controllers and manual motor controllers, indicated as motor controllers in this section, and low-voltage variable speed motor controllers.

B. Motor controllers, whether furnished with the equipment specified in other sections or otherwise (with the exception of elevator motor controllers specified in Division 14 and fire pump controllers specified in Division 21), shall meet this specification and all related specifications.

1.2 RELATED WORK

A. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS: Requirements for seismic restraint for nonstructural components.

C. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.

E. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.

F. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

G. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.

1.3 QUALITY ASSURANCE

A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:

1. Shop Drawings:
   a. Submit sufficient information to demonstrate compliance with drawings and specifications.
   b. Include electrical ratings, dimensions, weights, mounting details, materials, overcurrent protection devices, overload relays, sizes of enclosures, wiring diagrams, starting characteristics, interlocking, and accessories.

   c. Certification from the manufacturer that representative motor controllers have been seismically tested to International Building Code requirements. Certification shall be based upon simulated seismic forces on a shake table or by analytical methods, but not by experience data or other methods.
2. Manuals:
   a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
      1) Wiring diagrams shall have their terminals identified to facilitate installation, maintenance, and operation.
      2) Wiring diagrams shall indicate internal wiring for each item of equipment and interconnections between the items of equipment.
      3) Elementary schematic diagrams shall be provided for clarity of operation.
      4) Include the catalog numbers for the correct sizes of overload relays for the motor controllers.
   b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
3. Certifications: Two weeks prior to final inspection, submit the following.
   a. Certification by the manufacturer that the motor controllers conform to the requirements of the drawings and specifications.
   b. Certification by the Contractor that the motor controllers have been properly installed, adjusted, and tested.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.

B. Institute of Electrical and Electronic Engineers (IEEE):

519-14.....Recommended Practices and Requirements for Harmonic Control in Electrical Power Systems

C37.90.1-12.....Standard Surge Withstand Capability (SWC) Tests for Relays and Relay Systems Associated with Electric Power Apparatus

C. International Code Council (ICC):

IBC-21.....International Building Code

D. National Electrical Manufacturers Association (NEMA):

ICS 1-00(R2015).....Industrial Control and Systems: General Requirements

ICS 1.1-84(R2020).....Safety Guidelines for the Application, Installation and Maintenance of Solid State Control

ICS 2-00(R2020).....Industrial Control and Systems Controllers, Contactors, and Overload Relays Rated 600 Volts

ICS 4-15.....Industrial Control and Systems: Terminal Blocks

ICS 6-93(R2016).....Industrial Control and Systems: Enclosures

ICS 7-20.....Industrial Control and Systems: Adjustable-Speed Drives

ICS 7.1-14.....Safety Standards for Construction and Guide for Selection, Installation, and Operation of Adjustable-Speed Drive Systems

E. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

F. Underwriters Laboratories Inc. (UL):

508A-18.....Industrial Control Panels

1449-14.....Surge Protective Devices

61800-5-1-12.....Adjustable Speed Electrical Power Drive Systems

PART 2 - PRODUCTS

2.1 MOTOR CONTROLLERS

A. Motor controllers shall comply with IEEE, NEMA, NFPA, UL, and as shown on the drawings.

B. Motor controllers shall be separately enclosed, unless part of another assembly. For installation in motor control centers, provide plug-in, draw-out type motor controllers up through NEMA size 4. NEMA size 5 and above require bolted connections.

C. Motor controllers shall be combination type, with magnetic controller per Paragraph 2.3 below and with circuit breaker disconnecting means, with external operating handle with lock-open padlocking positions and ON-OFF position indicator.

1. Circuit Breakers:
   a. Bolt-on thermal-magnetic type with a minimum interrupting rating as indicated on the drawings.
   b. Equipped with automatic, trip free, non-adjustable, inverse-time, and instantaneous magnetic trips for less than 400A. The magnetic trip shall be adjustable from 5x to 10x for breakers 400A and greater.
   c. Additional features shall be as follows:
      1) A rugged, integral housing of molded insulating material.
      2) Silver alloy contacts.
      3) Arc quenchers and phase barriers for each pole.
      4) Quick-make, quick-break, operating mechanisms.
      5) A trip element for each pole, a common trip bar for all poles, and one operator for all poles.

D. Enclosures:
   1. Enclosures shall be NEMA-type rated 1, 3R, or 12 as indicated on the drawings or as required per the installed environment.
   2. Enclosure doors shall be interlocked to prevent opening unless the disconnecting means is open. A "defeater" mechanism shall allow for inspection by qualified personnel with the disconnect means closed. Provide padlocking provisions.
   3. All metal surfaces shall be thoroughly cleaned, phosphatized, and factory primed prior to applying light gray baked enamel finish.

E. Motor control circuits:
   1. Shall operate at not more than 120 Volts.
   2. Shall be grounded, except where the equipment manufacturer recommends that the control circuits be isolated.
   3. For each motor operating over 120 Volts, incorporate a separate, heavy duty, control transformer within each motor controller enclosure.
   4. Incorporate primary and secondary overcurrent protection for the control power transformers.

F. Overload relays:
   1. Thermal and type. Devices shall be NEMA type.
   2. One for each pole.
   3. External overload relay reset pushbutton on the door of each motor controller enclosure.
   4. Overload relays shall be matched to nameplate full-load current of actual protected motor and with appropriate adjustment for duty cycle.
   5. Thermal overload relays shall be tamperproof, not affected by vibration, manual reset, sensitive to single-phasing, and shall have selectable trip classes of 10, 20 and 30.
   8. Electronic overload relays shall utilize internal current transformers and electro-mechanical components. The relays shall have ambient temperature compensation, single-phase protection, manual or automatic reset, and trip classes of 10, 15, 20 and 30. The relay shall provide fault cause indication, including jam/stall, ground fault, phase loss, and overload.

G. Hand-Off-Automatic (H-O-A) switch is required unless specifically stated on the drawings as not required for a particular controller. H-O-A switch shall be operable without opening enclosure door. H-O-A switch is not required for manual motor controllers.

H. Incorporate into each control circuit a 120 Volt, electronic time-delay relay (ON delay), minimum adjustable range from 0.3 to 10 minutes, with transient protection. Time-delay relay is not required where H-O-A switch is not required.

I. Unless noted otherwise, equip each motor controller with not less than two normally open (N.O.) and two normally closed (N.C.) auxiliary contacts.

J. Provide green (RUN) and red (STOP) pilot lights.

K. Motor controllers incorporated within equipment assemblies shall also be designed for the specific requirements of the assemblies.

L. Additional requirements for specific motor controllers, as indicated in other specification sections, shall also apply.

2.2 MANUAL MOTOR CONTROLLERS

A. Shall be in accordance with applicable requirements of 2.1 above.

B. Manual motor controllers shall have the following features:

1. Controllers shall be general-purpose Class A, manually operated type with full voltage controller for induction motors, rated in horsepower.
2. Units shall include thermal overload relays, on-off operator, red orgreen pilot light, normally open normally closed auxiliary contacts.

C. Fractional horsepower manual motor controllers shall have the following features:

1. Controllers shall be general-purpose Class A, manually operated type with full voltage controller for fractional horsepower induction motors.
2. Units shall include thermal overload relays, red pilot light, and toggle operator.

2.3 MAGNETIC MOTOR CONTROLLERS

A. Shall be in accordance with applicable requirements of 2.1 above.

B. Controllers shall be general-purpose, Class A magnetic controllers for induction motors rated in horsepower. Minimum NEMA size 0.

C. Where combination motor controllers are used, combine controller with protective or disconnect device in a common enclosure.

D. Provide phase loss protection for each controller, with contacts to de-energize the controller upon loss of any phase.

E. Unless otherwise indicated, provide full voltage non-reversing across-the-line mechanisms for motors less than 75 HP, closed by coil action and opened by gravity. For motors 75 HP and larger, provide reduced-voltage

or variable speed controllers as shown on the drawings. Equip controllers with 120 VAC coils and individual control transformer unless otherwise noted.

2.6 LOW-VOLTAGE VARIABLE SPEED MOTOR CONTROLLERS (VSMC)

A. VSMC shall be in accordance with applicable portions of 2.1 above.

B. VSMC shall be electronic, with adjustable frequency and voltage, three phase output, capable of driving standard NEMA B three-phase induction motors at full rated speed. The control technique shall be pulse width modulation (PWM), where the VSMC utilizes a full wave bridge design incorporating diode rectifier circuitry. Silicon controlled rectifiers or other control techniques are not acceptable.

C. VSMC shall be suitable for variable torque loads, and shall be capable of providing sufficient torque to allow the motor to break away from rest upon first application of power.

D. VSMC shall be capable of operating within voltage parameters of plus 10 to minus 15 percent of line voltage, and be suitably rated for the full load amps of the maximum watts (HP) within its class.

E. Minimum efficiency shall be 95 percent at 100 percent speed and 85 percent at 50 percent speed.

F. The displacement power factor of the VSMC shall not be less than 95 percent under any speed or load condition.

G. VSMC current and voltage harmonic distortion shall not exceed the values allowed by IEEE 519.

H. Operating and Design Conditions:

1. Elevation: 460/feet Above Mean Sea Level (AMSL)
2. Temperatures: Maximum +90°F Minimum -10°F
3. Relative Humidity:95%
4. VSMC Location: Air conditioned space

I. VSMC shall have the following features:

1. Isolated power for control circuits.
2. Manually resettable overload protection for each phase.

3. Adjustable current limiting circuitry to provide soft motor starting. Maximum starting current shall not exceed 200 percent of motor full load current.
4. Independent acceleration and deceleration time adjustment, manually adjustable from 2 to 2000 seconds. Set timers to the equipment manufacturer's recommended time in the above range.
5. Control input circuitry that will accept 4 to 20 mA current or 0-10 VDC voltage control signals from an external source.
6. Automatic frequency adjustment from 1 Hz to 300 Hz.
7. Circuitry to initiate an orderly shutdown when any of the conditions listed below occur. The VSMC shall not be damaged by any of these electrical disturbances and shall automatically restart when the conditions are corrected. The VSMC shall be able to restart into a rotating motor operating in either the forward or reverse direction and matching that frequency.
   a. Incorrect phase sequence.
   b. Single phasing.
   c. Overvoltage in excess of 10 percent.
   d. Undervoltage in excess of 15 percent.
   e. Running overcurrent above 110 percent (VSMC shall not automatically reset for this condition.)
   f. Instantaneous overcurrent above 150 percent (VSMC shall not automatically reset for this condition).
   g. Short duration power outages of 12 cycles or less (i.e., distribution line switching, generator testing, and automatic transfer switch operations.)

9. Automatic Reset/Restart: Attempt three restarts after VSMC fault or on return of power after an interruption and before shutting down for manual reset or fault correction, with adjustable delay time between restart attempts.
11. Bidirectional Autospeed Search: Capable of starting VSMC into rotating loads spinning in either direction and returning motor to set speed in proper direction, without causing damage to VSMC, motor, or load.

J. VSMC shall include an input circuit breaker which will disconnect all input power, interlocked with the door so that the door cannot be opened with the circuit breaker in the closed position.

K. VSMC shall include a 5% line reactor and a RFI/EMI filter.

L. Surge Suppression: Provide three-phase protection against damage from supply voltage surges in accordance with UL 1449.

M. VSMC shall include front-accessible operator station, with sealed keypad and digital display, which allows complete programming, operating, monitoring, and diagnostic capabilities.

1. Typical control functions shall include but not be limited to:
   a. HAND-OFF-AUTOMATIC-RESET, with manual speed control in HAND mode.
   b. NORMAL-BYPASS.
   c. NORMAL-TEST, which allows testing and adjusting of the VSMC while in bypass mode.
2. Typical monitoring functions shall include but not be limited to:
   a. Output frequency (Hz).
   b. Motor speed and status (run, stop, fault).
   c. Output voltage and current.
3. Typical fault and alarm functions shall include but not be limited to:
   a. Loss of input signal, under- and over-voltage, inverter overcurrent, motor overload, critical frequency rejection with selectable and adjustable deadbands, instantaneous line-to-line and line-to-ground overcurrent, loss-of-phase, reverse-phase, and short circuit.
   b. System protection indicators indicating that the system has shutdown and will not automatically restart.

N. VSMC shall include two N.O. and two N.C. dry contacts rated 120 Volts, 10 amperes, 60 Hz.

O. Hardware, software, network interfaces, gateways, and programming to control and monitor the VSMC by control systems specified in other specification sections, including but not limited to Divisions 22 and 23.

P. Network communications ports: As required for connectivity to control systems specified in other specification sections, including but not limited to Divisions 22 and 23.

Q. Communications protocols: As required for communications with control systems specified in other specification sections, including but not limited to Divisions 22 and 23.

R. Bypass controller: Provide contactor-style bypass, arranged to bypass the inverter.

1. Inverter Output Contactor and Bypass Contactor: Load-break NEMA-rated contactor.
2. Motor overload relays.
3. HAND-OFF-AUTOMATIC bypass control.

S. Bypass operation: Transfers motor between inverter output and bypass circuit, manually, automatically, or both. VSMC shall be capable of stable operation (starting, stopping, and running), and control by fire alarm and detection systems, with motor completely disconnected from the inverter output. Transfer between inverter and bypass contactor and retransfer shall only be allowed with the motor at zero speed.

T. Inverter Isolating Switch: Provide non-load-break switch arranged to isolate inverter and permit safe troubleshooting and testing of the inverter, both energized and de-energized, while motor is operating in bypass mode. Include padlockable, door-mounted handle mechanism.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install motor controllers in accordance with the NEC, as shown on the drawings, and as recommended by the manufacturer.

B. In seismic areas, motor controllers shall be adequately anchored and braced per details on structural contract drawings to withstand the seismic forces at the location where installed.

C. Install manual motor controllers in flush enclosures in finished areas.

D. Set field-adjustable switches, auxiliary relays, time-delay relays, timers, and electronic overload relay pickup and trip ranges.

E. Program variable speed motor controllers per the manufacturer’s instructions and in coordination with other trades so that a complete and functional system is delivered.

F. Adjust trip settings of circuit breakers and motor circuit protectors with adjustable instantaneous trip elements. Initially adjust at six times the motor nameplate full-load ampere ratings and attempt to start motors several times, allowing for motor cooldown between starts. If tripping occurs on motor inrush, adjust settings in increments until motors start without tripping. Do not exceed eight times the motor full-load amperes (or 11 times for NEMA Premium Efficiency motors if required). Where these maximum settings do not allow starting of a motor, notify COTR before increasing settings.

G. Set the taps on reduced-voltage autotransformer controllers at /80 percent of line voltage.

3.2 ACCEPTANCE CHECKS AND TESTS

A. Perform manufacturer’s required field tests in accordance with the manufacturer's recommendations. In addition, include the following:

1. Visual Inspection and Tests:
   a. Compare equipment nameplate data with specifications and approved shop drawings.
   b. Inspect physical, electrical, and mechanical condition.
   c. Verify appropriate anchorage, required area clearances, and correct alignment.
   d. Verify that circuit breaker, motor circuit protector, and fuse sizes and types correspond to approved shop drawings.
   e. Verify overload relay ratings are correct.
   f. Vacuum-clean enclosure interior. Clean enclosure exterior.
   g. Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method in accordance with manufacturer’s published data.
   h. Test all control and safety features of the motor controllers.
   i. For low-voltage variable speed motor controllers, final programming and connections shall be by a factory-trained technician. Set all programmable functions of the variable speed motor controllers to meet the requirements and conditions of use.

3.3 FOLLOW-UP VERIFICATION

A. Upon completion of acceptance checks, settings, and tests, the Contractor shall show by demonstration in service that the motor

controllers are in good operating condition and properly performing the intended functions.

3.4 SPARE PARTS

A. Two weeks prior to the final inspection, provide one complete set of spare fuses for each motor controller.

3.5 INSTRUCTION

A. Furnish the services of a factory-trained technician for two 4-hour training periods for instructing personnel in the maintenance and operation of the motor controllers, on the dates requested by the COTR.

---END---

SECTION 26 29 21
ENCLOSED SWITCHES AND CIRCUIT BREAKERS

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the furnishing, installation, and connection of fused and unfused disconnect switches (indicated as switches in this section), and separately-enclosed circuit breakers for use in electrical systems rated 600 V and below.

1.2 RELATED WORK

A. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS: Requirements for seismic restraint of non-structural components.

B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.

C. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.

D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground faults.

E. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.

F. Section 26 24 16, PANELBOARDS: Molded-case circuit breakers.

1.3 QUALITY ASSURANCE

A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:

1. Shop Drawings:
   a. Submit sufficient information to demonstrate compliance with drawings and specifications.
   b. Submit the following data for approval:

1) Electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, fuses, circuit breakers, wiring and connection diagrams, accessories, and device nameplate data.

c. Certification from the manufacturer that representative enclosed switches and circuit breakers have been seismically tested to International Building Code requirements. Certification shall be based upon simulated seismic forces on a shake table or by analytical methods, but not by experience data or other methods.

2. Manuals:

a. Submit complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering fuses, circuit breakers, and replacement parts.

1) Include schematic diagrams, with all terminals identified, matching terminal identification in the enclosed switches and circuit breakers.

2) Include information for testing, repair, troubleshooting, assembly, and disassembly.

b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.

3. Certifications: Two weeks prior to final inspection, submit the following.

a. Certification by the manufacturer that the enclosed switches and circuit breakers conform to the requirements of the drawings and specifications.

b. Certification by the Contractor that the enclosed switches and circuit breakers have been properly installed, adjusted, and tested.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. International Code Council (ICC):

IBC-21.....International Building Code

C. National Electrical Manufacturers Association (NEMA):

FU l-12.....Low Voltage Cartridge Fuses

KS l-13.....Heavy Duty Enclosed and Dead-Front Switches (600 Volts Maximum)

D. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

E. Underwriters Laboratories, Inc. (UL):

98-16.....Enclosed and Dead-Front Switches

248 1-11.....Low Voltage Fuses

489-16.....Molded Case Circuit Breakers and Circuit Breaker Enclosures

PART 2 - PRODUCTS

2.1 FUSED SWITCHES RATED 600 AMPERES AND LESS

A. Switches shall be in accordance with NEMA, NEC, UL, as specified, and as shown on the drawings.

B. Shall be NEMA classified General Duty (GD) for 240 V switches, and NEMA classified Heavy Duty (HD) for 480 V switches.

C. Shall be horsepower (HP) rated.

D. Shall have the following features:

1. Switch mechanism shall be the quick-make, quick-break type.
2. Copper blades, visible in the open position.
3. An arc chute for each pole.
4. External operating handle shall indicate open and closed positions, and have lock-open padlocking provisions.
5. Mechanical interlock shall permit opening of the door only when the switch is in the open position, defeatable to permit inspection.
6. Fuse holders for the sizes and types of fuses specified.
7. Solid neutral for each switch being installed in a circuit which includes a neutral conductor.
8. Ground lugs for each ground conductor.
9. Enclosures:

a. Shall be the NEMA types shown on the drawings.

b. Where the types of switch enclosures are not shown, they shall be the NEMA types most suitable for the ambient environmental conditions.

c. Shall be finished with manufacturer's standard gray baked enamel paint over pretreated steel.

.2 UNFUSED SWITCHES RATED 600 AMPERES AND LESS

A. Shall be the same as fused switches, but without provisions for fuses.

2.4 MOTOR RATED TOGGLE SWITCHES

A. Type 1, general purpose for single-phase motors rated up to 1 horsepower.

B. Quick-make, quick-break toggle switch with external reset button and thermal overload protection matched to nameplate full-load current of actual protected motor.

2.5 CARTRIDGE FUSES

A. Shall be in accordance with NEMA FU 1.

D. Motor Branch Circuits: shall be per mechanical equipment manufacturer recommendation

F. Control Circuits: shall be per mechanical equipment manufacturer recommendation

2.6 SEPARATELY-ENCLOSED CIRCUIT BREAKERS

A. Provide circuit breakers in accordance with the applicable requirements in Section 26 24 16, PANELBOARDS.

B. Enclosures shall be the NEMA types shown on the drawings. Where the types are not shown, they shall be the NEMA type most suitable for the ambient environmental conditions.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Installation shall be in accordance with the NEC, as shown on the drawings, and manufacturer's instructions.

B. In seismic areas, enclosed switches and circuit breakers shall be adequately anchored and braced per details on structural contract drawings to withstand the seismic forces at the location where installed.

C. Fused switches shall be furnished complete with fuses. Arrange fuses such that rating information is readable without removing the fuses.

3.2 ACCEPTANCE CHECKS AND TESTS

A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:

1. Visual Inspection and Tests:

a. Compare equipment nameplate data with specifications and approved shop drawings.

b. Inspect physical, electrical, and mechanical condition.

c. Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method.

d. Vacuum-clean enclosure interior. Clean enclosure exterior.

3.3 SPARE PARTS

A. Two weeks prior to the final inspection, furnish one complete set of spare fuses for each fused disconnect switch installed on the project. Deliver the spare fuses to the COR.

---END---

SECTION 26 43 13
SURGE PROTECTIVE DEVICES

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the furnishing, installation, and connection of Type 2 Surge Protective Devices, as defined in NFPA 70, and indicated as SPD in this section.

1.2 RELATED WORK

A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.

B. Section 26 23 00, LOW-VOLTAGE SWITCHGEAR: For factory-installed or external SPD.

C. Section 26 24 13, DISTRIBUTION SWITCHBOARDS: For factory-installed or external SPD.

D. Section 26 24 16, PANELBOARDS: For factory-installed or external SPD.

1.3 QUALITY ASSURANCE

A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:

1. Shop Drawings:
   a. Submit sufficient information to demonstrate compliance with drawings and specifications.
   b. Include electrical ratings and device nameplate data.
2. Manuals:
   a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering replacement parts.
   b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.

3. Certifications: Two weeks prior to final inspection, submit the following.
   a. Certification by the manufacturer that the SPD conforms to the requirements of the drawings and specifications.
   b. Certification by the Contractor that the SPD has been properly installed.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplement and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.

B. Institute of Engineering and Electronic Engineers (IEEE):

IEEE C62.41.2-02.....Characterization of Surges in Low-Voltage (1000 V and Less) AC Power Circuits

IEEE C62.45-08.....Surge Testing for Equipment Connected to Low-Voltage (1000 V and Less) AC Power Circuits

C. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

D. Underwriters Laboratories, Inc. (UL):

UL 1283-17.....Electromagnetic Interference Filters

UL 1449-21.....Surge Protective Devices

PART 2 - PRODUCTS

2.1 SWITCHGEAR/SWITCHBOARD SPD

A. General Requirements:

1. Comply with IEEE and UL.
2. Modular design with field-replaceable modules, or non-modular design.
3. Fuses, rated at 200 kA interrupting capacity.
4. Bolted compression lugs for internal wiring.
5. Integral disconnect switch.
6. Redundant suppression circuits.
7. LED indicator lights for power and protection status.
8. Audible alarm, with silencing switch, to indicate when protection has failed.

9. Form-C contacts rated at 5 A and 250-V ac, one normally open and one normally closed, for remote monitoring of protection status. Contacts shall reverse on failure of any surge diversion module or on opening of any current-limiting device.
10. Four-digit transient-event counter.

B. Surge Current per Phase: Minimum 240kA per phase.

2.2 PANELBOARD SPD

A. General Requirements:

1. Comply with UL 1449 and IEEE C62.41.2.
2. Modular design with field-replaceable modules, or non-modular design.
3. Fuses, rated at 200 kA interrupting capacity.
4. Bolted compression lugs for internal wiring.
5. Integral disconnect switch.
6. Redundant suppression circuits.
7. LED indicator lights for power and protection status.
8. Audible alarm, with silencing switch, to indicate when protection has failed.
9. Form-C contacts rated at 5 A and 250-V ac, one normally open and one normally closed, for remote monitoring of protection status. Contacts shall reverse on failure of any surge diversion module or on opening of any current-limiting device.
10. Four-digit transient-event counter.

B. Surge Current per Phase: Minimum 120kA per phase.

2.3 ENCLOSURES

A. Enclosures: NEMA 1.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Installation shall be in accordance with the NEC, as shown on the drawings, and manufacturer’s instructions.

B. Factory-installed SPD: Switchgear, switchboard, or panelboard manufacturer shall install SPD at the factory.

C. Field-installed SPD: Contractor shall install SPD with conductors or buses between SPD and points of attachment as short and straight as

possible. Do not exceed manufacturer's recommended lead length. Do not bond neutral and ground.

1. Provide a circuit breaker as a dedicated disconnecting means for TVSS as shown on drawings.

D. Do not perform insulation resistance tests on switchgear, switchboards, panelboards, or feeders with the SPD connected. Disconnect SPD before conducting insulation resistance tests, and reconnect SPD immediately after insulation resistance tests are complete.

3.2 ACCEPTANCE CHECKS AND TESTS

A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:

1. Visual Inspection and Tests:
   a. Compare equipment nameplate data with specifications and approved shop drawings.
   b. Inspect physical, electrical, and mechanical condition.
   c. Verify that disconnecting means and feeder size and maximum length to SPD corresponds to approved shop drawings.
   d. Verifying tightness of accessible bolted electrical connections by calibrated torque-wrench method.
   e. Vacuum-clean enclosure interior. Clean enclosure exterior.
   f. Verify the correct operation of all sensing devices, alarms, and indicating devices.

3.3 FOLLOW-UP VERIFICATION

A. After completion of acceptance checks and tests, the Contractor shall show by demonstration in service that SPD are in good operating condition and properly performing the intended function.

3.4 INSTRUCTION

A. Provide the services of a factory-trained technician for one 2-hour training period for instructing personnel in the maintenance and operation of the SPD, on the date requested by the COR.

`---END---

NFPA
SECTION 26 51 00
INTERIOR LIGHTING

PART 1 - GENERAL

1.1 DESCRIPTION:

A. This section specifies the furnishing, installation, and connection of the interior lighting systems. The terms "lighting fixture," "fixture," and "luminaire" are used interchangeably.

1.2 RELATED WORK

A. Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT: Disposal of lamps.

B. Section 02 41 00, DEMOLITION: Removal and disposal of lamps and ballasts.

D. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS: Requirement for seismic restraint for nonstructural components.

E. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.

F. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.

G. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.

H. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.

1.3 QUALITY ASSURANCE

A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:

1. Shop Drawings:
   a. Submit the following information for each type of lighting fixture designated on the LIGHTING FIXTURE SCHEDULE, arranged in order of lighting fixture designation.
   b. Material and construction details, include information on housing and optics system.
   c. Physical dimensions and description.
   d. Wiring schematic and connection diagram.
   e. Installation details.
   f. Energy efficiency data.
   g. Photometric data based on laboratory tests complying with IES Lighting Measurements testing and calculation guides.
   h. Lamp data including lumen output (initial and mean), color rendition index (CRI), rated life (hours), and color temperature (degrees Kelvin).
   i. Ballast data including ballast type, starting method, ambient temperature, ballast factor, sound rating, system watts, and total harmonic distortion (THD).
   j. For LED lighting fixtures, submit US DOE LED Lighting Facts label, and IES L70 rated life.
2. Manuals:
   a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
   b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
3. Certifications: Two weeks prior to final inspection, submit the following.
   a. Certification by the Contractor that the interior lighting systems have been properly installed and tested.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the

extent referenced. Publications are referenced in the text by designation only.

B. American Society for Testing and Materials (ASTM):

C635/C635M-22.....Manufacture, Performance, and Testing of Metal Suspension Systems for Acoustical Tile and Lay-in Panel Ceilings

C. Environmental Protection Agency (EPA):

40 CFR 261-21.....Identification and Listing of Hazardous Waste

D. Federal Communications Commission (FCC):

CFR Title 47, Part 15...Radio Frequency Devices

CFR Title 47, Part 18...Industrial, Scientific, and Medical Equipment

E. Illuminating Engineering Society of North America (IESNA):

LM-79-19.....Electrical and Photometric Measurements of Solid-State Lighting Products

LM-80-21.....Measuring Lumen Maintenance of LED Light Sources

LM-82-19.....Characterization of LED Light Engines and LED Lamps for Electrical and Photometric Properties as a Function of Temperature

F. Institute of Electrical and Electronic Engineers (IEEE):

C62.41-91(R1995).....Surge Voltages in Low Voltage AC Power Circuits

G. International Code Council (ICC):

IBC-21.....International Building Code

H. National Electrical Manufacturer's Association (NEMA):

C78.376-14 (R2021).....Chromaticity of Fluorescent Lamps

C82.1-04(S2021).....Lamp Ballasts – Line Frequency Fluorescent Lamp Ballasts

C82.2-02(S2021).....Method of Measurement of Fluorescent Lamp Ballasts

C82.4-17.....Lamp Ballasts - Ballasts for High-Intensity Discharge and Low-Pressure Sodium (LPS) Lamps (Multiple-Supply Type)

C82.11-17.....Lamp Ballasts - High Frequency Fluorescent Lamp Ballasts

LL 9-11.....Dimming of T8 Fluorescent Lighting Systems

SSL 1-16.....Electronic Drivers for LED Devices, Arrays, or Systems

I. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

101-24.....Life Safety Code

J. Underwriters Laboratories, Inc. (UL):

496-17.....Lampholders

542-05.....Fluorescent Lamp Starters

844-12.....Luminaires for Use in Hazardous (Classified) Locations

924-16.....Emergency Lighting and Power Equipment

935-01.....Fluorescent-Lamp Ballasts

1029-94.....High-Intensity-Discharge Lamp Ballasts

1029A-06.....Outline of Investigation for Ignitors and Related Auxiliaries for HID Lamp Ballasts

1574-04.....Standard for Safety Track Lighting Systems

1598-21.....Standard for Safety Luminaires

2108-15.....Standard for Safety Low-Voltage Lighting Systems

8750-15.....Standard for Safety Light Emitting Diode (LED) Light Sources for Use in Lighting Products

PART 2 - PRODUCTS

2.1 LIGHTING FIXTURES

A. Shall be in accordance with NFPA, UL, as shown on drawings, and as specified.

B. Sheet Metal:

1. Shall be formed to prevent warping and sagging. Housing, trim and lens frame shall be true, straight (unless intentionally curved), and parallel to each other as designed.
2. Wireways and fittings shall be free of burrs and sharp edges, and shall accommodate internal and branch circuit wiring without damage to the wiring.
3. When installed, any exposed fixture housing surface, trim frame, door frame, and lens frame shall be free of light leaks.

4. Hinged door frames shall operate smoothly without binding. Latches shall function easily by finger action without the use of tools.

C. Ballasts and lamps Driver and LED shall be serviceable while the fixture is in its normally installed position. Ballasts shall not be mounted to removable reflectors or wireway covers unless so specified.

D. Lamp Sockets:

F. Mechanical Safety: Lighting fixture closures (lens doors, trim frame, hinged housings, etc.) shall be retained in a secure manner by captive screws, chains, aircraft cable, captive hinges, or fasteners such that they cannot be accidentally dislodged during normal operation or routine maintenance.

G. Metal Finishes:

1. The manufacturer shall apply standard finish (unless otherwise specified) over a corrosion-resistant primer, after cleaning to free the metal surfaces of rust, grease, dirt and other deposits. Edges of pre-finished sheet metal exposed during forming, stamping or shearing processes shall be finished in a similar corrosion resistant manner to match the adjacent surface(s). Fixture finish shall be free of stains or evidence of rusting, blistering, or flaking, and shall be applied after fabrication.
2. Interior light reflecting finishes shall be white with not less than 85 percent reflectances, except where otherwise shown on the drawing.
3. Exterior finishes shall be as shown on the drawings.

H. Lighting fixtures shall have a specific means for grounding metallic wireways and housings to an equipment grounding conductor.

.

2.9 LED EXIT LIGHT FIXTURES

A. Exit light fixtures shall meet applicable requirements of NFPA and UL.

B. Housing and door shall be die-cast aluminum.

C. For general purpose exit light fixtures, door frame shall be hinged, with latch. For vandal-resistant exit light fixtures, door frame shall be secured with tamper-resistant screws.

D. Finish shall be satin or fine-grain brushed aluminum.

E. There shall be no radioactive material used in the fixtures.

F. Fixtures:

1. Inscription panels shall be cast or stamped aluminum a minimum of 2.25 mm (0.090 inch) thick, stenciled with 150 mm (6 inch) high letters, baked with red color stable plastic or fiberglass. Lamps shall be luminous Light Emitting Diodes (LED) mounted in center of letters on red color stable plastic or fiberglass.
2. Double-Faced Fixtures: Provide double-faced fixtures where required or as shown on drawings.
3. Directional Arrows: Provide directional arrows as part of the inscription panel where required or as shown on drawings. Directional arrows shall be the "chevron-type" of similar size and width as the letters and meet the requirements of NFPA 101.

G. Voltage: Multi-voltage (120 – 277V).

2.10 LED LIGHT FIXTURES

A. General:

1. LED light fixtures shall be in accordance with IES, NFPA, UL, as shown on the drawings, and as specified.
2. LED light fixtures shall be Reduction of Hazardous Substances (RoHS)-compliant.
3. LED drivers shall include the following features unless otherwise indicated:
   a. Minimum efficiency: 85% at full load.
   b. Minimum Operating Ambient Temperature: -20˚ C. (-4˚ F.)
   c. Input Voltage: 120 - 277V (±10%) at 60 Hz.
   d. Integral short circuit, open circuit, and overload protection.
   e. Power Factor: ≥ 0.95.
   f. Total Harmonic Distortion: ≤ 20%.
   g. Comply with FCC 47 CFR Part 15.

4. LED modules shall include the following features unless otherwise indicated:
   a. Comply with IES LM-79 and LM-80 requirements.
   b. Minimum CRI: 80 or higher. Minimum Color Fidelity Index (IES Rf): 80 or higher.
   c. Color temperature between 3500° - 5000°K and as specified in the drawings' LIGHTING FIXTURE SCHEDULE.
   d. Minimum Rated Life: 50,000 hours per IES L70.
   e. Light output lumens as indicated in the LIGHTING FIXTURE SCHEDULE.

B. LED Downlights:
   1. Housing, LED driver, and LED module shall be products of the same manufacturer.

C. LED Troffers:
   1. LED drivers, modules, and reflector shall be accessible, serviceable, and replaceable from below the ceiling.
   2. Housing, LED driver, and LED module shall be products of the same manufacturer.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Installation shall be in accordance with the NEC, manufacturer's instructions, and as shown on the drawings or specified.

B. Align, mount, and level the lighting fixtures uniformly.

C. Wall-mounted fixtures shall be attached to the studs in the walls, or to a 20 gauge metal backing plate that is attached to the studs in the walls. Lighting fixtures shall not be attached directly to gypsum board.

D. Lighting Fixture Supports:
   1. Shall provide support for all of the fixtures. Supports may be anchored to channels of the ceiling construction, to the structural slab or to structural members within a partition, or above a suspended ceiling.

2. Shall maintain the fixture positions after cleaning and relamping.
3. Shall support the lighting fixtures without causing the ceiling or partition to deflect.

4. Hardware for recessed fixtures:
   a. Where the suspended ceiling system is supported at the four corners of the fixture opening, hardware devices shall clamp the fixture to the ceiling system structural members, or plaster frame at not less than four points in such a manner as to resist spreading of the support members and safely lock the fixture into the ceiling system.
   b. Where the suspended ceiling system is not supported at the four corners of the fixture opening, hardware devices shall independently support the fixture from the building structure at four points.
5. Hardware for surface mounting fixtures to suspended ceilings:
   a. In addition to being secured to any required outlet box, fixtures shall be bolted to a grid ceiling system at four points spaced near the corners of each fixture. The bolts shall be not less than 6 mm (1/4 inch) secured to channel members attached to and spanning the tops of the ceiling structural grid members. Non-turning studs may be attached to the ceiling structural grid members or spanning channels by special clips designed for the purpose, provided they lock into place and require simple tools for removal.
   b. In addition to being secured to any required outlet box, fixtures shall be bolted to ceiling structural members at four points spaced near the corners of each fixture. Pre-positioned 6 mm (1/4 inch) studs or threaded plaster inserts secured to ceiling structural members shall be used to bolt the fixtures to the ceiling. In lieu of the above, 6 mm (1/4 inch) toggle bolts may be used on new or existing ceiling provided the plaster and lath can safely support the fixtures without sagging or cracking.

6. Hardware for recessed lighting fixtures:
   a. All fixture mounting devices connecting fixtures to the ceiling system or building structure shall have a capacity for a horizontal force of 100 percent of the fixture weight and a vertical force of 400 percent of the fixture weight.
   b. Mounting devices shall clamp the fixture to the ceiling system structure (main grid runners or fixture framing cross runners) at four points in such a manner as to resist spreading of these supporting members. Each support point device shall utilize a screw or approved hardware to "lock" the fixture housing to the ceiling system, restraining the fixture from movement in any direction relative to the ceiling. The screw (size No. 10 minimum) or approved hardware shall pass through the ceiling member (T-bar, channel or spline), or it may extend over the inside of the flange of the channel (or spline) that faces away from the fixture, in a manner that prevents any fixture movement.

   c. In addition to the above, the following is required for fixtures exceeding 9 kg (20 pounds) in weight.
      1) Where fixtures mounted in ASTM Standard C635 "Intermediate Duty" and "Heavy Duty" ceilings and weigh between 9 kg and 25 kg (20 pounds and 56 pounds), provide two 12 gauge safety hangers hung slack between diagonal corners of the fixture and the building structure.
      2) Where fixtures weigh over 25 kg (56 pounds), they shall be independently supported from the building structure by approved hangers. Two-way angular bracing of hangers shall be provided to prevent lateral motion.
   d. Where ceiling cross runners are installed for support of lighting fixtures, they must have a carrying capacity equal to that of the main ceiling runners and be rigidly secured to the main runners.
7. Surface mounted lighting fixtures:
   a. Fixtures shall be bolted against the ceiling independent of the outlet box at four points spaced near the corners of each unit. The bolts (or stud-clips) shall be minimum 6 mm (1/4 inch) bolt, secured to main ceiling runners and/or secured to cross runners.

Non-turning studs may be attached to the main ceiling runners and cross runners with special non-friction clip devices designed for the purpose, provided they bolt through the runner, or are also secured to the building structure by 12 gauge safety hangers. Studs or bolts securing fixtures weighing in excess of 25 kg (56 pounds) shall be supported directly from the building structure.

b. Where ceiling cross runners are installed for support of lighting fixtures, they must have a carrying capacity equal to that of the main ceiling runners and be rigidly secured to the main runners.

c. Fixtures less than 6.8 kg (15 pounds) in weight and occupying less than 3715 sq cm (two square feet) of ceiling area may, when designed for the purpose, be supported directly from the outlet box when all the following conditions are met.

1) Screws attaching the fixture to the outlet box pass through round holes (not key-hole slots) in the fixture body.
2) The outlet box is attached to a main ceiling runner (or cross runner) with approved hardware.
3) The outlet box is supported vertically from the building structure.

d. Fixtures mounted in open construction shall be secured directly to the building structure with approved bolting and clamping devices.

8. Single or double pendant-mounted lighting fixtures:

a. Each stem shall be supported by an approved outlet box mounted swivel joint and canopy which holds the stem captive and provides spring load (or approved equivalent) dampening of fixture oscillations. Outlet box shall be supported vertically from the building structure.

9. Outlet boxes for support of lighting fixtures (where permitted) shall be secured directly to the building structure with approved devices or supported vertically in a hung ceiling from the building structure with a nine gauge wire hanger, and be secured by an approved device to a main ceiling runner or cross runner to prevent any horizontal movement relative to the ceiling.

E. Furnish and install the new lamps as specified for all lighting fixtures installed under this project, and for all existing lighting fixtures reused under this project.

F. The electrical and ceiling trades shall coordinate to ascertain that approved lighting fixtures are furnished in the proper sizes and installed with the proper devices (hangers, clips, trim frames, flanges, etc.), to match the ceiling system being installed.

G. Bond lighting fixtures to the grounding system as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.

H. At completion of project, replace all defective components of the lighting fixtures at no cost to the Government.

I. Dispose of lamps per requirements of Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT, and Section 02 41 00, DEMOLITION.

3.2 ACCEPTANCE CHECKS AND TESTS

A. Perform the following:

1. Visual Inspection:

a. Verify proper operation by operating the lighting controls.

b. Visually inspect for damage to fixtures, lenses, reflectors, diffusers, and louvers. Clean fixtures, lenses, reflectors, diffusers, and louvers that have accumulated dust, dirt, or fingerprints during construction.

2. Electrical tests:

a. Exercise dimming components of the lighting fixtures over full range of dimming capability by operating the control devices(s) in the presence of the /COTR. Observe for visually detectable flicker over full dimming range, and replace defective components at no cost to the Government.

b. Burn-in all lamps that require specific aging period to operate properly, prior to occupancy by Government. Burn-in period to be 40 hours minimum, unless specifically recommended otherwise by the lamp manufacturer. Burn-in dimmed fluorescent and compact fluorescent lamps for at least 100 hours at full voltage, unless specifically recommended otherwise by the lamp manufacturer. Replace any lamps and ballasts which fail during burn-in.

3.3 FOLLOW-UP VERIFICATION

A. Upon completion of acceptance checks and tests, the Contractor shall show by demonstration in service that the lighting systems are in good operating condition and properly performing the intended function.

---END---

DIVISION 27
COMMUNICATIONS

SECTION 27 05 11
REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section includes common requirements to communications installations and applies to all sections of Division 27 and Division 28.

B. Provide completely functioning communications systems.

C. Comply with VAAR 852.236.91 and FAR clause 52.236-21 in circumstance of a need for additional detail or conflict between drawings, specifications, reference standards or code.

1.2 REFERENCES

A. Abbreviations and Acronyms

1. Refer to http://www.cfm.va.gov/til/sdetail.asp for Division 00, ARCHITECTURAL ABBREVIATIONS.

2. Additional Abbreviations and Acronyms:

A	Ampere
AC	Alternating Current
AE	Architect and Engineer
AFF	Above Finished Floor
AHJ	Authority Having Jurisdiction
ANSI	American National Standards Institute
AWG	American Wire Gauge (refer to STP and UTP)
AWS	Advanced Wireless Services
BCT	Bonding Conductor for Telecommunications (also Telecommunications Bonding Conductor (TBC))
BDA	Bi-Directional Amplifier
BICSI	Building Industry Consulting Service International
BIM	Building Information Modeling
BOM	Bill of Materials
BTU	British Thermal Units
BUCR	Back-up Computer Room
BTS	Base Transceiver Station

CAD	AutoCAD
CBOPC	Community Based Out Patient Clinic
CBC	Coupled Bonding Conductor
CBOC	Community Based Out Patient Clinic (refer to CBOPC, OPC, VAMC)
CCS	TIP's Cross Connection System (refer to VCCS and HCCS)
CFE	Contractor Furnished Equipment
CFM	US Department of Veterans Affairs Office of Construction and Facilities Management
CFR	Consolidated Federal Regulations
CIO	Communication Information Officer (Facility, VISN or Region)
cm	Centimeters
CO	Central Office
COR	Contracting Officer Representative
CPU	Central Processing Unit
CSU	Customer Service Unit
CUP	Conditional Use Permit(s) - Federal/GSA for VA
dB	Decibel
dBm	Decibel Measured
dBmV	Decibel per milli-Volt
DC	Direct Current
DEA	United States Drug Enforcement Administration
DSU	Data Service Unit
EBC	Equipment Bonding Conductor
ECC	Engineering Control Center (refer to DCR, EMCR)
EDGE	Enhanced Data (Rates) for GSM Evolution
EDM	Electrical Design Manual
EMCR	Emergency Management Control Room (refer to DCR, ECC)
EMI	Electromagnetic Interference (refer to RFI)

EMS	Emergency Medical Service
EMT	Electrical Metallic Tubing or thin wall conduit
ENTR	Utilities Entrance Location (refer to DEMARC, POTS, LEC)
EPBX	Electronic Digital Private Branch Exchange
ESR	Vendor's Engineering Service Report
FA	Fire Alarm
FAR	Federal Acquisition Regulations in Chapter 1 of Title 48 of Code of Federal Regulations
FMS	VA's Headquarters or Medical Center Facility's Management Service
FR	Frequency (refer to RF)
FTS	Federal Telephone Service
GFE	Government Furnished Equipment
GPS	Global Positioning System
GRC	Galvanized Rigid Metal Conduit
GSM	Global System (Station) for Mobile
HCCS	TIP's Horizontal Cross Connection System (refer to CCS & VCCS)
HDPE	High Density Polyethylene Conduit
HDTV	Advanced Television Standards Committee High-Definition Digital Television
HEC	Head End Cabinets(refer to HEIC, PA)
HEIC	Head End Interface Cabinets(refer to HEC, PA)
HF	High Frequency (Radio Band; Re FR, RF, VHF & UHF)
HSPA	High Speed Packet Access
HZ	Hertz
IBT	Intersystem Bonding Termination (NEC 250.94)
IC	Intercom
ICRA	Infectious Control Risk Assessment
IDEN	Integrated Digital Enhanced Network

IDC	Insulation Displacement Contact
IDF	Intermediate Distribution Frame
ILSM	Interim Life Safety Measures
IMC	Rigid Intermediate Steel Conduit
IRM	Department of Veterans Affairs Office of Information Resources Management
ISDN	Integrated Services Digital Network
ISM	Industrial, Scientific, Medical
IWS	Intra-Building Wireless System
LAN	Local Area Network
LBS	Location Based Services, Leased Based Systems
LEC	Local Exchange Carrier (refer to DEMARC, PBX & POTS)
LED	Light Emitting Diode
LMR	Land Mobile Radio
LTE	Long Term Evolution, or 4G Standard for Wireless Data Communications Technology
M	Meter
MAS	Medical Administration Service
MATV	Master Antenna Television
MCR	Main Computer Room
MCOR	Main Computer Operators Room
MDF	Main Distribution Frame
MH	Manholes or Maintenance Holes
MHz	Megaherts (10^6 Hz)
mm	Millimeter
MOU	Memorandum of Understanding
MW	Microwave (RF Band, Equipment or Services)
NID	Network Interface Device (refer to DEMARC)
NEC	National Electric Code
NOR	Network Operations Room
NRTL	OSHA Nationally Recognized Testing Laboratory

NS	Nurse Stations
NTIA	U.S. Department of Commerce National Telecommunications and Information Administration
OEM	Original Equipment Manufacturer
OI&T	Office of Information and Technology
OPC	VA's Outpatient Clinic (refer to CBOC, VAMC)
OSH	Department of Veterans Affairs Office of Occupational Safety and Health
OSHA	United States Department of Labor Occupational Safety and Health Administration
OTDR	Optical Time-Domain Reflectometer
PA	Public Address System (refer to HE, HEIC, RPEC)
PBX	Private Branch Exchange (refer to DEMARC, LEC, POTS)
PCR	Police Control Room (refer to SPCC, could be designated SCC)
PCS	Personal Communications Service (refer to UPCS)
PE	Professional Engineer
PM	Project Manager
PoE	Power over Ethernet
POTS	Plain Old Telephone Service (refer to DEMARC, LEC, PBX)
PSTN	Public Switched Telephone Network
PSRAS	Public Safety Radio Amplification Systems
PTS	Pay Telephone Station
PVC	Poly-Vinyl Chloride
PWR	Power (in Watts)
RAN	Radio Access Network
RBB	Rack Bonding Busbar
RE	Resident Engineer or Senior Resident Engineer
RF	Radio Frequency (refer to FR)
RFI	Radio Frequency Interference (refer to EMI)

RFID	RF Identification (Equipment, System or Personnel)
RMC	Rigid Metal Conduit
RMU	Rack Mounting Unit
RPEC	Radio Paging Equipment Cabinets(refer to HEC, HEIC, PA)
RTLS	Real Time Location Service or System
RUS	Rural Utilities Service
SCC	Security Control Console (refer to PCR, SPCC)
SMCS	Spectrum Management and Communications Security (COMSEC)
SFO	Solicitation for Offers
SME	Subject Matter Experts (refer to AHJ)
SMR	Specialized Mobile Radio
SMS	Security Management System
SNMP	Simple Network Management Protocol
SPCC	Security Police Control Center (refer to PCR, SMS)
STP	Shielded Balanced Twisted Pair (refer to UTP)
STR	Stacked Telecommunications Room
TAC	VA's Technology Acquisition Center, Austin, Texas
TCO	Telecommunications Outlet
TER	Telephone Equipment Room
TGB	Telecommunications Grounding Busbar (also Secondary Bonding Busbar (SBB))
TIP	Telecommunications Infrastructure Plant
TMGB	Telecommunications Main Grounding Busbar (also Primary Bonding Busbar (PBB))
TMS	Traffic Management System
TOR	Telephone Operators Room
TP	Balanced Twisted Pair (refer to STP and UTP)
TR	Telecommunications Room (refer to STR)
TWP	Twisted Pair

UHF	Ultra High Frequency (Radio)
UMTS	Universal Mobile Telecommunications System
UPCS	Unlicensed Personal Communications Service (refer to PCS)
UPS	Uninterruptible Power Supply
USC	United States Code
UTP	Unshielded Balanced Twisted Pair (refer to TP and STP)
UV	Ultraviolet
V	Volts
VAAR	Veterans Affairs Acquisition Regulation
VACO	Veterans Affairs Central Office
VAMC	VA Medical Center (refer to CBOC, OPC, VACO)
VCCS	TIP's Vertical Cross Connection System (refer to CCS and HCCS)
VHF	Very High Frequency (Radio)
VISN	Veterans Integrated Services Network (refers to geographical region)
VSWR	Voltage Standing Wave Radio
W	Watts
WEB	World Electronic Broadcast
WiMAX	Worldwide Interoperability (for MW Access)
WI-FI	Wireless Fidelity
WMTS	Wireless Medical Telemetry Service
WSP	Wireless Service Providers

B. Definitions:

1. Access Floor: Pathway system of removable floor panels supported on adjustable pedestals to allow cable placement in area below.
2. BNC Connector (BNC): United States Military Standard MIL-C-39012/21 bayonet-type coaxial connector with quick twist mating/unmating, and two lugs preventing accidental disconnection from pulling forces on cable.

3. Bond: Permanent joining of metallic parts to form an electrically conductive path to ensure electrical continuity and capacity to safely conduct any currents likely to be imposed to earth ground.
4. Bundled Microducts: All forms of jacketed microducts.
5. Conduit: Includes all raceway types specified.
6. Conveniently Accessible: Capable of being reached without use of ladders, or without climbing or crawling under or over obstacles such as, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.
7. Distributed (in house) Antenna System (DAS): An Emergency Radio Communications System installed for Emergency Responder (or first responders and Government personnel) use while inside facility to maintain contact with each respective control point; refer to Section 27 53 19, DISTRIBUTED RADIO ANTENNA (WITHIN BUILDING) EQUIPMENT AND SYSTEMS.
8. Effectively Grounded: Intentionally bonded to earth through connections of low impedance having current carrying capacity to prevent buildup of currents and voltages resulting in hazard to equipment or persons.
9. Electrical Supervision: Analyzing a system’s function and components (i.e. cable breaks / shorts, inoperative stations, lights, LEDs and states of change, from primary to backup) on a 24/7/365 basis; provide aural and visual emergency notification signals to minimum two remote designated or accepted monitoring stations.
10. Electrostatic Interference (ESI) or Electrostatic Discharge Interference: Refer to EMI and RFI.
11. Emergency Call Systems: Wall units (in parking garages and stairwells) and pedestal mounts (in parking lots) typically provided with a strobe, camera and two-way audio communication functions.
12. Project 25 (2014) (P25 (TIA-102 Series)): Set of standards for local, state and Federal public safety organizations and agencies digital LMR services. P25 is applicable to LMR equipment authorized or licensed under the US Department of Commerce National Telecommunications and Information Administration or FCC rules and regulations, and is a required standard capability for all LMR equipment and systems.

13. Grounding Electrode Conductor: (GEC) Conductor connected to earth grounding electrode.
14. Grounding Electrode System: Electrodes through which an effective connection to earth is established, including supplementary, communications system grounding electrodes and GEC.
15. Grounding Equalizer or Backbone Bonding Conductor (BBC): Conductor that interconnects elements of telecommunications grounding infrastructure.
16. Head End (HE): Equipment, hardware and software, or a master facility at originating point in a communications system designed for centralized communications control, signal processing, and distribution that acts as a common point of connection between equipment and devices connected to a network of interconnected equipment, possessing greatest authority for allowing information to be exchanged, with whom other equipment is subordinate.
17. Microducts: All forms of air blown fiber pathways.
18. Ohm: A unit of restive measurement.
19. Received Signal Strength Indication (RSSI): A measurement of power present in a received RF signal.
20. Service Provider Demarcation Point (SPDP): Not owned by LEC or service provider, but designated by Government as point within facility considered the DEMARC.
21. Sound (SND): Changing air pressure to audible signals over given time span.
22. System: Specific hardware, firmware, and software, functioning together as a unit, performing task for which it was designed.
23. Telecommunications Bonding Backbone (TBB): Conductors of appropriate size (minimum 53.49 mm2 [1/0 AWG]) stranded copper wire, that connect to Grounding Electrode System and route to telecommunications main grounding busbar (TMGB) and circulate to interconnect various TGBs and other locations shown on drawings.
24. Voice over Internet Protocol (VoIP): A telephone system in which voice signals are converted to packets and transmitted over LAN network using Transmission Control Protocol (TCP)/Internet Protocol (IP). VA'S VoIP is not listed or coded for life and public safety, critical, emergency or other protection functions. When VoIP system

or equipment is provided instead of PBX system or equipment, each TR (STR) and DEMARC requires increased AC power provided to compensate for loss of PBX's telephone instrument line power; and, to compensate for absence of PBX's UPS capability.

25. Wide Area Network (WAN): A digital network that transcends localized LANs within a given geographic location. VA'S WAN/LAN is not nationally listed or coded for life and public safety, critical, emergency or other safety functions.

1.3 APPLICABLE PUBLICATIONS

A. Applicability of Standards: Unless documents include more stringent requirements, applicable construction industry standards have same force and effect as if bound or copied directly into the documents to extent referenced. Such standards are made a part of these documents by reference.

1. Each entity engaged in construction must be familiar with industry standards applicable to its construction activity.
2. Obtain standards directly from publication source, where copies of standards are needed to perform a required construction activity.

B. Government Codes, Standards and Executive Orders: Refer to http://www.cfm.va.gov/TIL/cPro.asp:

1. Federal Communications Commission, (FCC) CFR, Title 47:

Part 15	Restrictions of use for Part 15 listed RF Equipment in Safety of Life Emergency Functions and Equipment Locations
Part 47	Chapter A, Paragraphs 6.1-6.23, Access to Telecommunications Service, Telecommunications Equipment and Customer Premises Equipment
Part 58	Television Broadcast Service
Part 73	Radio and Television Broadcast Rules
Part 90	Rules and Regulations, Appendix C
Form 854	Antenna Structure Registration
Chapter XXIII	National Telecommunications and Information Administration (NTIA, P/O Commerce, Chapter XXIII) the 'Red Book'- Chapters 7, 8 & 9 compliments CFR, Title 47, FCC Part 15, RF

Restriction of Use and Compliance in "Safety of Life" Functions & Locations

2. US Department of Agriculture, (Title 7, USC, Chapter 55, Sections 2201, 2202 & 2203:RUS 1755 Telecommunications Standards and Specifications for Materials, Equipment and Construction:

RUS Bull 1751F-630	Design of Aerial Cable Plants
RUS Bull 1751F-640	Design of Buried Cable Plant, Physical Considerations
RUS Bull 1751F-643	Underground Plant Design
RUS Bull 1751F-815	Electrical Protection of Outside Plants,
RUS Bull 1753F-201	Acceptance Tests of Telecommunications Plants (PC-4)
RUS Bull 1753F-401	Splicing Copper and Fiber Optic Cables (PC-2)
RUS Bull 345-50	Trunk Carrier Systems (PE-60)
RUS Bull 345-65	Shield Bonding Connectors (PE-65)
RUS Bull 345-72	Filled Splice Closures (PE-74)
RUS Bull 345-83	Gas Tube Surge Arrestors (PE-80)

3. US Department of Commerce/National Institute of Standards Technology,(NIST):

FIPS PUB 1-1	Telecommunications Information Exchange
FIPS PUB 100/1	Interface between Data Terminal Equipment (DTE) Circuit Terminating Equipment for operation with Packet Switched Networks, or Between Two DTEs, by Dedicated Circuit
FIPS PUB 140/2	Telecommunications Information Security Algorithms
FIPS PUB 143	General Purpose 37 Position Interface between DTE and Data Circuit Terminating Equipment
FIPS 160/2	Electronic Data Interchange (EDI),
FIPS 175	Federal Building Standard for Telecommunications Pathway and Spaces
FIPS 191	Guideline for the Analysis of Local Area Network Security
FIPS 197	Advanced Encryption Standard (AES)
FIPS 199	Standards for Security Categorization of Federal Information and Information Systems

4. US Department of Defense, (DoD):

MIL-STD-188-110	Interoperability and Performance Standards for Data Modems
MIL-STD-188-114	Electrical Characteristics of Digital Interface Circuits
MIL-STD-188-115	Communications Timing and Synchronizations Subsystems
MIL-C-28883	Advanced Narrowband Digital Voice Terminals
MIL-C-39012/21	Connectors, Receptacle, Electrical, Coaxial, Radio Frequency, (Series BNC (Uncabled), Socket Contact, Jam Nut Mounted, Class 2)

5. US Department of Health and Human Services:
   The Health Insurance Portability and Accountability Act of 1996 (HIPAA) Privacy, Security and Breach Notification Rules
6. US Department of Justice:
   2010 Americans with Disabilities Act Standards for Accessible Design (ADAAD).
7. US Department of Labor, (DoL) - Public Law 426-62 - CFR, Title 29, Part 1910, Chapter XVII - Occupational Safety and Health Administration (OSHA), Occupational Safety and Health Standards):

Subpart 7	Approved NRTLs; obtain a copy at https://www.osha.gov/dts/otpca/nrtl/nrtllist.html
Subpart 35	Compliance with NFPA 101, Life Safety Code
Subpart 36	Design and Construction Requirements for Exit Routes
Subpart 268	Telecommunications
Subpart 305	Wiring Methods, Components, and Equipment for General Use
Subpart 508	Americans with Disabilities Act Accessibility Guidelines; technical requirement for accessibility to buildings and facilities by individuals with disabilities

8. US Department of Transportation, (DoT):
   a. Public Law 85-625, CFR, Title 49, Part 1, Subpart C - Federal Aviation Administration (FAA):AC 110/460-ID & AC 707 / 460-2E -

Advisory Circulars Standards for Construction of Antenna Towers, and 7450 and 7460-2 - Antenna Construction Registration Forms.

9. US Department of Veterans Affairs (VA): Office of Telecommunications (OI&T), MP-6, PART VIII, TELECOMMUNICATIONS, CHAPTER 5, AUDIO, RADIO AND TELEVISION (and COMSEC) COMMUNICATIONS SYSTEMS: Spectrum Management and COMSEC Service (SMCS), AHJ for:
   a. CoG, "Continuance of Government" communications guidelines and compliance.
   b. COMSEC,"VA wide coordination and control of security classified communication assets."
   c. COOP, "Continuance of Operations" emergency communications guidelines and compliance.
   d. FAA, FCC, and US Department of Commerce National Telecommunications and Information Administration, "VA wide RF Co-ordination, Compliance and Licensing."
   e. Handbook 6100 - Telecommunications: Cyber and Information Security Office of Cyber and Information Security, and Handbook 6500 - Information Security Program.
   f. Low Voltage Special Communications Systems "Design, Engineering, Construction Contract Specifications and Drawings Conformity, Proof of Performance Testing, VA Compliance and Life Safety Certifications for CFM and VA Facility Low Voltage Special Communications Projects (except Fire Alarm, Telephone and Data Systems)."
   g. SATCOM, "Satellite Communications" guidelines and compliance, and Security and Law Enforcement Systems - "Coordinates the Design, Engineering, Construction Contract Specifications and Drawings Conformity, Proof of Performance Testing, VA Compliance, DEA and Public Safety Certification(s) for CFM and VA Facility Security Low Voltage Special Communications and Physical Security Projects.
   h. VHA's National Center for Patient Safety - Veterans Health Administration (VHA) Warning System, Failure of Medical Alarm Systems using Paging Technology to Notify Clinical Staff, July 2004.

i. VA's CEOSH, concurrence with warning identified in VA Directive 7700.

j. Wireless and Handheld Devices, "Guidelines and Compliance,"

k. Office of Security and Law Enforcement: VA Directive 0730 and Health Special Presidential Directive (HSPD)-12.

C. NRTL Standards: Refer to https://www.osha.gov/laws-regs/regulations/standardnumber/1926

D. Contractor shall follow the latest standards of dated drawings.

1. Canadian Standards Association (CSA); same tests as presented by UL
2. Communications Certifications Laboratory (CEL); same tests as presented by UL.
3. Intertek Testing Services NA, Inc., (ITSNA), formerly Edison Testing Laboratory (ETL) same tests as presented by UL).
4. Underwriters Laboratory (UL):

1-2023	Flexible Metal Conduit
5-2011	Surface Metal Raceway and Fittings
6-2022	Rigid Metal Conduit
44-2022	Thermoset-Insulated Wires and Cables
50-1995	Enclosures for Electrical Equipment
65-2010	Wired Cabinets
83-2008	Thermoplastic-Insulated Wires and Cables
96-2007	Lightning Protection Components
96A-2007	Installation Requirements for Lightning Protection Systems
360-2013	Liquid-Tight Flexible Steel Conduit
444-2008	Communications Cables
467-2022	Grounding and Bonding Equipment
486A-486B-2013	Wire Connectors
486C-2013	Splicing Wire Connectors
486D-2005	Sealed Wire Connector Systems
486E-2009	Standard for Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors
493-2007	Thermoplastic-Insulated Underground Feeder and Branch Circuit Cable
497/497A/497B/497C	

497D/497E	Protectors for Paired Conductors/Communications Circuits/Data Communications and Fire Alarm Circuits/coaxial circuits/voltage protections/Antenna Lead In
510-2005	Polyvinyl Chloride, Polyethylene and Rubber Insulating Tape
514A-2018	Metallic Outlet Boxes
514B-2018	Fittings for Cable and Conduit
514C-1996	Nonmetallic Outlet Boxes, Flush-Device Boxes and Covers
651-2011	Schedule 40 and 80 Rigid PVC Conduit
651A-2011	Type EB and A Rigid PVC Conduit and HDPE Conduit
797-2007	Electrical Metallic Tubing
884-2011	Underfloor Raceways and Fittings
1069-2007	Hospital Signaling and Nurse Call Equipment
1242-2006	Intermediate Metal Conduit
1449-2006	Standard for Transient Voltage Surge Suppressors
1479-2003	Fire Tests of Through-Penetration Fire Stops
1480-2003	Speaker Standards for Fire Alarm, Emergency, Commercial and Professional use
1666-2007	Standard for Wire/Cable Vertical (Riser) Tray Flame Tests
1685-2007	Vertical Tray Fire Protection and Smoke Release Test for Electrical and Fiber Optic Cables
1861-2012	Communication Circuit Accessories
1863-2013	Standard for Safety, communications Circuits Accessories
1865-2007	Standard for Safety for Vertical-Tray Fire Protection and Smoke-Release Test for Electrical and Optical-Fiber Cables
2024-2011	Standard for Optical Fiber Raceways
2024-2014	Standard for Cable Routing Assemblies and Communications Raceways
2196-2001	Standard for Test of Fire Resistive Cable

60950-1 ed. 2-2014 Information Technology Equipment Safety

E. Industry Standards:

1. Advanced Television Systems Committee (ATSC):

A/53 Part 1: 2013	ATSC Digital Television Standard, Part 1, Digital Television System
A/53 Part 2: 2011	ATSC Digital Television Standard, Part 2, RF/Transmission System Characteristics
A/53 Part 3: 2023	ATSC Digital Television Standard, Part 3, Service Multiplex and Transport System Characteristics
A/53 Part 4: 2009	ATSC Digital Television Standard, Part 4, MPEG-2 Video System Characteristics
A/53 Part 5: 2014	ATSC Digital Television Standard, Part 5, AC-3 Audio System Characteristics
A/53 Part 6: 2013	ATSC digital Television Standard, Part 6, Enhanced AC-3 Audio System Characteristics

2. American Institute of Architects (AIA): 2019 Guidelines for Design & Construction of Health Care Facilities.

3. American Society of Mechanical Engineers (ASME):

17.4 (2015)	Guide for Emergency Personnel

4. American Society for Testing and Materials (ASTM):

B1 (2018)	Standard Specification for Hard-Drawn Copper Wire
B8 (2023)	Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft
D1557 (2021)	Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Modified Effort 56,000 ft-lbf/ft3 (2,700 kN-m/m3)
D2301 (2024)	Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape
B258-02 (2018)	Standard Specification for Standard Nominal Diameters and Cross-Sectional Areas of AWG Sizes of Solid Round Wires Used as Electrical Conductors

D709-01(2007)	Standard Specification for Laminated Thermosetting Materials
D4566 (2020)	Standard Test Methods for Electrical Performance Properties of Insulations and Jackets for Telecommunications Wire and Cable

5. American Telephone and Telegraph Corporation (AT&T) - Obtain following AT&T Publications at https://ebiznet.sbc.com/sbcnebs/

ATT-TP-76200 (2013)	Network Equipment and Power Grounding, Environmental, and Physical Design Requirements
ATT-TP-76300(2012)	Merged AT&T Affiliate Companies Installation Requirements
ATT-TP-76305 (2013)	Common Systems Cable and Wire Installation and Removal Requirements - Cable Racks and Raceways
ATT-TP-76306 (2009)	Electrostatic Discharge Control
ATT-TP-76400 (2012)	Detail Engineering Requirements
ATT-TP-76402 (2013)	AT&T Raised Access Floor Engineering and Installation Requirements
ATT-TP-76405 (2011)	Technical Requirements for Supplemental Cooling Systems in Network Equipment Environments
ATT-TP-76416 (2011)	Grounding and Bonding Requirements for Network Facilities
ATT-TP-76440 (2005)	Ethernet Specification
ATT-TP-76450 (2013)	Common Systems Equipment Interconnection Standards for AT&T Network Equipment Spaces
ATT-TP-76461 (2008)	Fiber Optic Cleaning
ATT-TP-76900 (2010)	AT&T Installation Testing Requirement
ATT-TP-76911 (1999)	AT&T LEC Technical Publication Notice

6. British Standards Institution (BSI):

BS EN 50109-2	Hand Crimping Tools - Tools for The Crimp Termination of Electric Cables and Wires for Low Frequency and Radio Frequency Applications - All Parts & Sections. October 1997

7. Building Industry Consulting Service International(BICSI):

ANSI/BICSI 002-2011	Data Center Design and Implementation Best Practices

ANSI/BICSI 004-2012	Information Technology Systems Design and Implementation Best Practices for Healthcare Institutions and Facilities
ANSI/NECA/BICSI 568-2006	Standard for Installing Commercial Building Telecommunications Cabling
NECA/BICSI 607-2011	Standard for Telecommunications Bonding and Grounding Planning and Installation Methods for Commercial Buildings
ANSI/BICSI 005-2013	Electronic Safety and Security (ESS) System Design and Implementation Best Practices

8. Electronic Components Assemblies and Materials Association,(ECA).

ECA EIA/RS-270 (1973)	Tools, Crimping, Solderless Wiring Devices - Recommended Procedures for User Certification
EIA/ECA 310-E (2005)	Cabinets, and Associated Equipment

9. Facility Guidelines Institute: 2010 Guidelines for Design and Construction of Health Care Facilities.
10. Insulated Cable Engineers Association (ICEA):

ANSI/ICEA S-80-576-2002	Category 1 & 2 Individually Unshielded Twisted-Pair Indoor Cables for Use in Communications Wiring Systems
ANSI/ICEA S-84-608-2010	Telecommunications Cable, Filled Polyolefin Insulated Copper Conductor, S-87-640(2011) Optical Fiber Outside Plant Communications Cable
ANSI/ICEA S-90-661-2012	Category 3, 5, & 5e Individually Unshielded Twisted-Pair Indoor Cable for Use in General Purpose and LAN Communication Wiring Systems
S-98-688 (2012)	Broadband Twisted Pair Cable Aircore, Polyolefin Insulated, Copper Conductors
S-99-689 (2012)	Broadband Twisted Pair Cable Filled, Polyolefin Insulated, Copper Conductors
ICEA S-102-700	

(2004) Category 6 Individually Unshielded Twisted Pair Indoor Cables (With or Without an Overall Shield) for use in Communications Wiring Systems Technical Requirements

11. Institute of Electrical and Electronics Engineers (IEEE):

ISSN 0739-5175 March-April 2008 Engineering in Medicine and Biology Magazine, IEEE (Volume: 27, Issue:2) Medical Grade-Mission Critical-Wireless Networks

IEEE C2-2012 National Electrical Safety Code (NESC)

C62.41.2-2002/
Cor 1-2012 IEEE Recommended Practice on Characterization of Surges in Low-Voltage (1000 V and Less) AC Power Circuits 4)

C62.45-2002 IEEE Recommended Practice on Surge Testing for Equipment Connected to Low-Voltage (1000 V and Less) AC Power Circuits

81-2012 IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Grounding System

100-1992 IEEE the New IEEE Standards Dictionary of Electrical and Electronics Terms

602-2007 IEEE Recommended Practice for Electric Systems in Health Care Facilities

1100-2005 IEEE Recommended Practice for Powering and Grounding Electronic Equipment

12. International Code Council:

AC193 (2014) Mechanical Anchors in Concrete Elements

13. International Organization for Standardization (ISO):

ISO/TR 21730 (2007) Use of Mobile Wireless Communication and Computing Technology in Healthcare Facilities - Recommendations for Electromagnetic Compatibility (Management of Unintentional Electromagnetic Interference) with Medical Devices

14. National Electrical Manufacturers Association (NEMA):

NEMA 250 (2008)	Enclosures for Electrical Equipment (1,000V Maximum)
ANSI C62.61 (1993)	American National Standard for Gas Tube Surge Arresters on Wire Line Telephone Circuits
ANSI/NEMA FB 1 (2012)	Fittings, Cast Metal Boxes and Conduit Bodies for Conduit, Electrical Metallic Tubing EMT) and Cable
ANSI/NEMA OS 1 (2009)	Sheet-Steel Outlet Boxes, Device Boxes, Covers, and Box Supports
NEMA SB 19 (R2007)	NEMA Installation Guide for Nurse Call Systems
TC 3 (2004)	Polyvinyl Chloride (PVC) Fittings for Use with Rigid PVC Conduit and Tubing
NEMA VE 2 (2006)	Cable Tray Installation Guidelines

15. National Fire Protection Association (NFPA):

70E-2024	Standard for Electrical Safety in the Workplace
70-2023	National Electrical Code (NEC)
72-2025	National Fire Alarm Code
75-2024	Standard for the Fire Protection of Information Technological Equipment
76-2024	Recommended Practice for the Fire Protection of Telecommunications Facilities
77-2024	Recommended Practice on Static Electricity
90A-2024	Standard for the Installation of Air Conditioning and Ventilating Systems
99-2024	Health Care Facilities Code
101-2024	Life Safety Code
241	Safeguarding construction, alternation and Demolition Operations
255-2023	Standard Method of Test of Surface Burning Characteristics of Building Materials
262 - 2023	Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces
780-2020	Standard for the Installation of Lightning Protection Systems

1221-2019	Standard for the Installation, Maintenance, and Use of Emergency Services Communications Systems
5000-2021	Building Construction and Safety Code

16. Society for Protective Coatings (SSPC):

SSPC SP 6/NACE No.3 (2007)	Commercial Blast Cleaning

17. Society of Cable Telecommunications Engineers (SCTE):

ANSI/SCTE 15 2006	Specification for Trunk, Feeder and Distribution Coaxial Cable

18. Telecommunications Industry Association (TIA):

TIA-120 Series	Telecommunications Land Mobile communications (APCO/Project 25) (January 2014)
TIA TSB-140	Additional Guidelines for Field-Testing Length, Loss and Polarity of Optical Fiber Cabling Systems (2004)
TIA-155	Guidelines for the Assessment and Mitigation of Installed Category 6 Cabling to Support 10GBASE-T (2010)
TIA TSB-162-A	Telecommunications Cabling Guidelines for Wireless Access Points (2013)
TIA-222-G	Structural Standard for Antenna Supporting Structures and Antennas (2014)
TIA/EIA-423-B	Electrical Characteristics of Unbalanced Voltage Digital Interface Circuits (2012)
TIA-455-C	General Requirements for Standard Test Procedures for Optical Fibers, Cables, Transducers, Sensors, Connecting and Terminating Devices, and other Fiber Optic Components (August 2014)
TIA-455-53-A	FOTP-53 Attenuation by Substitution Measurements for Multimode Graded-Index Optical Fibers in Fiber Assemblies (Long Length) (September 2001)
TIA-455-61-A	FOTP-61 Measurement of Fiber of Cable Attenuation Using an OTDR (July 2003)

TIA-472D000-B	Fiber Optic Communications Cable for Outside Plant Use (July 2007)
ANSI/TIA-492-B	62.5-µ Core Diameter/125-um Cladding Diameter Class 1a Graded-Index Multimode Optical Fibers (November 2009)
ANSI/TIA-492AAAB-A	50-um Core Diameter/125-um Cladding Diameter Class IA Graded-Index Multimode Optically Optimized American Standard Fibers (November 2009
TIA-492CAAA	Detail Specification for Class IVa Dispersion-Unshifted Single-Mode Optical Fibers (September 2002)
TIA-492E000	Sectional Specification for Class IVd Nonzero-Dispersion Single-Mode Optical Fibers for the 1,550 nm Window (September 2002)
TIA-526-7-B	Measurement of Optical Power Loss of Installed Single-Mode Fiber Cable Plant - OFSTP-7 (December 2008)
TIA-526.14-A	Optical Power Loss Measurements of Installed Multimode Fiber Cable Plant - SFSTP-14 (August 1998)
TIA-568	Revision/Edition: C Commercial Building Telecommunications Cabling Standard Set: (TIA-568-C.0-2 Generic Telecommunications Cabling for Customer Premises (2012), TIA-568-C.1-1 Commercial Building Telecommunications Cabling Standard Part 1: General Requirements (2012), TIA-568-C.2 Commercial Building Telecommunications Cabling Standard—Part 2: Balanced Twisted Pair Cabling Components (2009), TIA-568-C.3-1 Optical Fiber Cabling Components Standard, (2011) AND TIA-568-C.4 Broadband Coaxial Cabling and Components Standard (2011) with addendums and erratas
TIA-569	Revision/Edition C Telecommunications Pathways and Spaces (March 2013)

TIA-574	Position Non-Synchronous Interface between Data Terminal equipment and Data Circuit Terminating Equipment Employing Serial Binary Interchange (May 2003)
TIA/EIA-590-A	Standard for Physical Location and Protection of Below Ground Fiber Optic Cable Plant (July 2001)
TIA-598-D	Optical Fiber Cable Color Coding (January 2005)
TIA-604-10-B	Fiber Optic Connector Intermateablility Standard (August 2008)
ANSI/TIA-606-B	Administration Standard for Telecommunications Infrastructure (2012)
TIA-607-B	Generic Telecommunications Bonding and Grounding (Earthing) For Customer Premises (January 2013)
TIA-613	High Speed Serial Interface for Data Terminal Equipment and Data Circuit Terminal Equipment (September 2005)
ANSI/TIA-758-B	Customer-owned Outside Plant Telecommunications Infrastructure Standard (April 2012)
ANSI/TIA-854	A Full Duplex Ethernet Specification for 1000 Mb/s (1000BASE-TX) Operating over Category 6 Balanced Twisted-Pair Cabling (2001)
ANSI/TIA-862-A	Building Automation Systems Cabling Standard (April 2011)
TIA-942-A	Telecommunications Infrastructure Standard for Data Centers (March 2014)
TIA-1152	Requirements for Field Testing Instruments and Measurements for Balanced Twisted Pair Cabling (September 2009)
TIA-1179	Healthcare Facility Telecommunications Infrastructure Standard (July 2010)

1.4 SINGULAR NUMBER

A. Where any device or part of equipment is referred in singular number (such as " rack"), reference applies to as many such devices as are required to complete installation.

1.5 RELATED WORK

A. Specification Order of Precedence: FAR Clause 52.236-21, VAAR Clause 852.236-71.

1. Field Cutting and Patching: Section 09 91 00, PAINTING.
2. Additional submittal requirements: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
3. Availability and source of references and standards specified in applicable publications: Section 01 42 19, REFERENCE STANDARDS.
4. Control of environmental pollution and damage for air, water, and land resources: Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS.
5. Requirements for non-hazardous building construction and demolition waste: Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT.
6. General requirements and procedures to comply with various federal mandates and U.S. Department of Veterans Affairs (VA) policies for sustainable design: Section 01 81 13, SUSTAINABLE DESIGN REQUIREMENTS.
7. Closures of openings in walls, floors, and roof decks against penetration of flame, heat, and smoke or gases in fire resistant rated construction: Section 07 84 00, FIRESTOPPING.
8. Sealant and caulking materials and their application: Section 07 92 00, JOINT SEALANTS.
9. General electrical requirements that are common to more than one section of Division 26: Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
10. Electrical conductors and cables in electrical systems rated 600 V and below: Section 26 05 19, LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW).
11. Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents: Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
12. Conduit and boxes: Section 26 05 33, RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS.
13. Wiring devices: Section 26 27 26, WIRING DEVICES.
14. Lightning protection: Section 26 41 00, FACILITY LIGHTNING PROTECTION.

15. General requirements common to more than one section in Division 28: Section 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.
16. Conductors and cables for electronic safety and security systems: Section 28 05 13, CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY.
17. Low impedance path to ground for electronic safety and security system ground fault currents: Section 28 05 26, GROUNDING AND BONDING FOR SECURITY SYSTEMS.
18. Conduits and partitioned telecommunications raceways for Electronic Safety and Security systems: Section 28 05 28.33, CONDUITS AND BACK BOXES FOR ELECTRONIC SAFETY AND SECURITY.
19. Physical Access Control System field-installed controllers connected by data transmission network: Section 28 13 00, PHYSICAL ACCESS DETECTION.
20. Video surveillance system cameras, data transmission wiring, and control stations with associated equipment: Section 28 23 00, VIDEO SURVEILLANCE EQUIPMENT AND SYSTEMS.
21. Duress-panic alarms, emergency phones or call boxes, intercom systems, data transmission wiring and associated equipment: Section 28 26 00, ELECTRONIC PERSONAL PROTECTION EQUIPMENT AND SYSTEMS.
22. Alarm initiating devices, alarm notification appliances, control units, fire safety control devices, annunciators, power supplies, and wiring: Section 28 31 00, FIRE DETECTION AND ALARM.

1.6 ADMINISTRATIVE REQUIREMENTS

A. Assign a single communications project manager to serve as point of contact for Government, contractor, and design professional.

B. Be proactive in scheduling work.
   1. Use of premises is restricted at times directed by COR.
   2. Movement of materials: Unload materials and equipment delivered to site. Pay costs for rigging, hoisting, lowering and moving equipment on and around site, in building or on roof.
   3. Coordinate installation of required supporting devices and sleeves to be set in poured-in-place concrete and other structural components, as they are constructed.

4. Sequence, coordinate, and integrate installations of materials and equipment for efficient flow of Work.
5. Coordinate connection of materials, equipment, and systems with exterior underground and overhead utilities and services. Comply with requirements of governing regulations, franchised service companies, and controlling agencies; provide required connection for each service.
6. Initiate and maintain discussion regarding schedule for ceiling construction and install cables to meet that schedule.

C. Contact the Office of Telecommunications, Special Communications Team (005OP2H3) (202)461-5310 to have a Government-accepted Telecommunications COR assigned to project for telecommunications review, equipment and system approval and coordination with other VA personnel.

D. Communications Project Manager Responsibilities:
1. Assume responsibility for overall telecommunications system integration and coordination of work among trades, subcontractors, and authorized system installers.
2. Coordinate with related work indicated on drawings or specified.
3. Manage work related to telecommunications system installation in a manner approved by manufacturer.

1.7 SUBMITTALS

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Provide parts list including quantity of spare parts.

C. Provide manufacturer product information. Government reserves the right to require a list of installations where products have been in operation.

D. Provide Source Quality Control Submittal:
1. Submit written certification from OEM indicating that proposed supervisor of installation and proposed provider of warranty maintenance are authorized representatives of OEM. Include individual's legal name, contact information and OEM credentials in certification.
2. Submit written certification from OEM that wiring and connection diagrams meet Government Life Safety Guidelines, NFPA, NEC, NRTL,

these specifications, and Joint Commission requirements and instructions, requirements, recommendations, and guidance set forth by OEM for the proper performance of system.

3. Pre-acceptance Certification: Certification in accordance with procedure outlined in Section 01 00 00, GENERAL REQUIREMENTS and specific Division 27 qualification documentation.

E. Installer Qualifications: Submit three installations of similar size and complexity furnished and installed by installer; include:
   1. Installation location and name.
   2. Owner’s name and contact information including, address, telephone and email.
   3. Date of project start and date of final acceptance.
   4. System project number.
   5. Three paragraph description of each system related to this project; include function, operation, and installation.

F. Provide delegated design submittals (e.g. seismic support design).

G. Submittals are required for all equipment anchors and supports. Include weights, dimensions, center of gravity, standard connections, manufacturer's recommendations and behavior problems (e.g., vibration, thermal expansion,) associated with equipment or conduit. Anchors and supports to resist seismic load based on seismic design categories per section 4.0 of VA seismic design requirements H-18-8 dated August, 2013.

H. Test Equipment List:
   1. Supply test equipment of accuracy better than parameters to be tested.
   2. Submit test equipment list including make and model number:
      a. ANSI/TIA-1152 Level IIIe twisted pair cabling test instrument.
      b. Fiber optic insertion loss power meter with light source.
      c. Optical time domain reflectometer (OTDR).
      d. Volt-Ohm meter.
      e. Bit Error Test Set (BERT).
      f. Time domain reflectometer (TDR) with strip chart recorder (Data and Optical Measuring).

3. Supply only test equipment with a calibration tag from Government-accepted calibration service dated not more than 12 months prior to test.
4. Provide sample test and evaluation reports.

I. Submittal Drawings:

1. Telecommunications Space Plans/Elevations: Provide enlarged floor plans of telecommunication spaces indicating layout of equipment and devices, including receptacles and grounding provisions. Submit detailed plan views and elevations of telecommunication spaces showing racks, termination blocks, and cable paths. Include following rooms:
   a. Telecommunications rooms.
   b. Server rooms/Data Center.
2. Logical Drawings: Provide logical riser or schematic drawings for all systems.
   a. Provide riser diagrams systems and interconnection drawings for equipment assemblies; show termination points and identify wiring connections.
3. Access Panel Schedule on Submittal Drawings: Coordinate and prepare a location, size, and function schedule of access panels required to fully service equipment.

J. Provide sustainable design submittals.

K. Furnish electronic certified test reports to COR prior to final inspection and not more than 90 days after completion of tests.

1.8 CLOSEOUT SUBMITTALS

A. Provide following closeout submittals prior to project closeout date:

1. Warranty certificate.
2. Evidence of compliance with requirements such as low voltage certificate of inspection.
3. Project record documents.
4. Instruction manuals and software that are a part of system.

B. Maintenance and Operation Manuals: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

1. Prepare a manual for each system and equipment specified.
2. Furnish on portable storage drive in PDF format or equivalent accepted by COR.

3. Furnish complete manual as specified in specification section, fifteen days prior to performance of systems or equipment test.
4. Furnish remaining manuals prior to final completion.
5. Identify storage drive "MAINTENANCE AND OPERATION MANUAL" and system name.
6. Include name, contact information and emergency service numbers of each subcontractor installing system or equipment and local representatives for system or equipment.
7. Provide a Table of Contents and assemble files to conform to Table of Contents.
8. Operation and Maintenance Data includes:
   a. Approved shop drawing for each item of equipment.
   b. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of equipment.
   c. A control sequence describing start-up, operation, and shutdown.
   d. Description of function of each principal item of equipment.
   e. Installation and maintenance instructions.
   f. Safety precautions.
   g. Diagrams and illustrations.
   h. Test Results and testing methods.
   i. Performance data.
   j. Pictorial "exploded" parts list with part numbers. Emphasis to be placed on use of special tools and instruments. Indicate sources of supply, recommended spare parts, and name of servicing organization.
   k. Warranty documentation indicating end date and equipment protected under warranty.
   l. Appendix; list qualified permanent servicing organizations for support of equipment, including addresses and certified personnel qualifications.

C. Record Wiring Diagrams:

1. Red Line Drawings: Keep one E size 91.44 cm x 121.92 cm (36 inches x 48 inches) set of floor plans, on site during work hours, showing installation progress marked and backbone cable labels noted. Make these drawings available for examination during construction meetings or field inspections.

2. General Drawing Specifications: Detail and elevation drawings to be D size 61 cm x 91.44 cm (24 inches x 36 inches) with a minimum scale of 0.635 cm = 30.48 cm (1/4 inch = 12 inches). ER, TR and other enlarged detail floor plan drawings to be D size 61 cm x 91.44 cm (24" x 36") with a minimum scale of 0.635 cm = 30.48 cm (1/4 inch = 12 inches). Building composite floor plan drawings to be D size 61 cm x 91.44 cm (24 inches x 36 inches) with a minimum scale of 3.175 mm = 30.48 cm (1/8 inch = 1' 0 inch).
3. Building Composite Floor Plans: Provide building floor plans showing work area outlet locations and configuration, types of jacks, distance for each cable, and cable routing locations.
4. Floor plans to include:
   a. Final room numbers pathway locations and labeling.
   b. Inputs and outputs of equipment identified according to labels installed on cables and equipment
   c. Device locations with labels.
   d. Conduit.
   e. Wiring diagram.
   f. Labeling and administration documentation.
5. Submit Record Wiring Diagrams within five business days after final cable testing.
6. Deliver Record Wiring Diagrams as CAD files in .dwg formats as determined by COR.
7. Deliver four complete sets of electronic record wiring diagrams to COR on portable storage drive.

D. Service Qualifications: Submit name and contact information of service organizations providing service to this installation within four hours of receipt of notification service is needed.

1.9 MAINTENANCE MATERIAL SUBMITTALS

A. After approval and prior to installation, furnish COR with the following:
1. A 300 mm (12 inch) length of each type and size of wire and cable along with tag from coils of reels from which samples were taken.
2. One coupling, bushing and termination fitting for each type of conduit.
3. Samples of each hanger, clamp and supports for conduit and pathways.

4. Duct sealing compound.

1.10 QUALITY ASSURANCE

A. Manufacturer's Qualifications: Manufacturer must produce, as a principal product, the equipment and material specified for this project, and have manufactured item for at least three years.

B. Product and System Qualification:

1. OEM must have three installations of equipment submitted presently in operation of similar size and type as this project, that have continuously operated for a minimum of three years.
2. Government reserves the right to require a list of installations where products have been in operation before approval.
3. Authorized representative of OEM must be responsible for design, satisfactory operation of installed system, and certification.

C. Trade Contractor Qualifications: Trade contractor must have completed three or more installations of similar systems of comparable size and complexity with regards to coordinating, engineering, testing, certifying, supervising, training, and documentation. Identify these installations as a part of submittal.

D. System Supplier Qualifications: System supplier must be authorized by OEM to warranty installed equipment.

E. Telecommunications technicians assigned to system must be trained, and certified by OEM on installation and testing of system; provide written evidence of current OEM certifications for installers.

F. Manufactured Products:

1. Comply with FAR clause 52.236-5 for material and workmanship.
2. When more than one unit of same class of equipment is required, units must be product of a single manufacturer.
3. Equipment Assemblies and Components:
   a. Components of an assembled unit need not be products of same manufacturer.
   b. Manufacturers of equipment assemblies, which include components made by others, to assume complete responsibility for final assembled unit.
   c. Provide compatible components for assembly and intended service.
   d. Constituent parts which are similar must be product of a single manufacturer.

4. Identify factory wiring on equipment being furnished and on wiring diagrams.

G. Testing Agencies: Government reserves the option of witnessing factory tests. Notify COR minimum 15 working days prior to manufacturer performing the factory tests.

1. When equipment fails to meet factory test and re-inspection is required, contractor is liable for additional expenses, including expenses of Government.

1.11 DELIVERY, STORAGE, AND HANDLING

A. Delivery and Acceptance Requirements:

1. Government's approval of submittals must be obtained for equipment and material before delivery to job site.
2. Deliver and store materials to job site in OEM's original unopened containers, clearly labeled with OEM's name and equipment catalog numbers, model and serial identification numbers for COR to inventory cable, patch panels, and related equipment.

B. Storage and Handling Requirements:

1. Equipment and materials must be protected during shipment and storage against physical damage, dirt, moisture, cold and rain:
   a. Store and protect equipment in a manner that precludes damage or loss, including theft.
   b. Protect painted surfaces with factory installed removable heavy kraft paper, sheet vinyl or equivalent.
   c. Protect enclosures, equipment, controls, controllers, circuit protective devices, and other like items, against entry of foreign matter during installation; vacuum clean both inside and outside before testing and operating.

C. Coordinate storage.

1.12 FIELD CONDITIONS

A. Where variations from documents are requested in accordance with GENERAL CONDITIONS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, connecting work and related components must include additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

B. A contract adjustment or additional time will not be granted because of field conditions pursuant to FAR 52.236-2 and FAR 52.236-3; a contract adjustment or additional time will not be granted for additional work required for complete and usable construction and systems pursuant to FAR 52.246-12.

1.13 WARRANTY

A. Comply with FAR clause 52.246-21.

PART 2 - PRODUCTS

2.1 PERFORMANCE AND DESIGN CRITERIA

A. Provide communications spaces and pathways conforming to TIA 569, at a minimum.

2.2 EQUIPMENT IDENTIFICATION

A. Provide laminated black phenolic resin with a white core nameplates with minimum 6 mm (1/4 inch) high engraved lettering.

B. Nameplates furnished by manufacturer as standard catalog items, unless other method of identification is indicated.

2.3 UNDERGROUND WARNING TAPE (NOT USED)

2.4 WIRE LUBRICATING COMPOUND

A. Provide non-hardening or forming adhesive coating cable lubricants suitable for cable jacket material and raceway.

2.5 FIREPROOFING TAPE

A. Provide flexible, conformable fabric tape of organic composition and coated one side with flame-retardant elastomer.

B. Tape must be self-extinguishing and cannot support combustion; arc-proof and fireproof.

C. Tape cannot deteriorate when subjected to water, gases, salt water, sewage, or fungus; and tape must be resistant to sunlight and ultraviolet light.

D. Application must withstand a 200-ampere arc for minimum 30 seconds.

E. Securing Tape: Glass cloth electrical tape minimum 0.18 mm (7 mils) thick and 19 mm (3/4 inch) wide.

2.6 UNDERGROUND CABLES (NOT USED)

2.7 AERIAL (ABOVEGROUND) ENCLOSURES (NOT USED)

2.8 TEMPORARY TIP PATHS (OVERHEAD TRACKS, ROAD/PATH BRIDGES, ETC.)(NOT USED)

2.9 ACCESS PANELS

A. Panels: 304 mm x 304 mm (12 inches by 12 inches)/, or size allowed by location to provide optimum access to equipment for maintenance and service.

B. Provide access panels and doors as required to allow service of materials and equipment that require inspection, replacement, repair or service.

C. Provide access panels where items installed require access and are concealed in floor, wall, furred space or above ceiling; ceilings consisting of lay-in or removable splined tiles do not require access panels.

D. Provide access panels with same fire rating classification as surface penetrated.

PART 3 - EXECUTION

3.1 PREPARATION

A. Penetrations and Sleeves:

1. Lay out penetration and sleeve openings in advance, to permit provision in work.
2. Set sleeves in forms before concrete is poured.
3. Set sleeves prior to installation of structure for passage of pipes, conduit, ducts, etc.
4. Provide sleeves and packing materials at penetrations of foundations, walls, slabs, partitions, and floors.
5. Fill slots, sleeves and other openings in floors or walls if not used.
   a. Fill spaces in openings after installation of conduit or cable.
   b. Provide fill for floor penetrations to prevent passage of water, smoke, fire, and fumes.
   c. Provide fire resistant fill in rated floors and walls, to prevent passage of air, smoke and fumes.
6. Install sleeves through floors watertight and extend minimum 50.8 mm (2 inches) above floor surface.

7. Match and set sleeves flush with adjoining floor, ceiling, and wall finishes where raceways passing through openings are exposed in finished rooms.
8. Annular space between conduit and sleeve must be minimum 6 mm (1/4 inch).
9. Do not provide sleeves for slabs-on-grade, unless specified or indicated otherwise.
10. Comply with requirements for firestopping, for sleeves through rated fire walls and smoke partitions.
11. Do not support piping risers or conduit on sleeves.
12. Identify unused sleeves and slots for future installation.
13. Provide core drilling if walls are poured or otherwise constructed without sleeves and wall penetration is required; do not penetrate structural members.

B. Core Drilling:

1. Avoid core drilling whenever possible.
2. Coordinate openings with other trades and utilities, and prevent damage to structural reinforcement.
3. Investigate existing conditions in vicinity of required opening prior to coring, including an x-ray of floor if determined necessary by competent person or COR.
4. Protect areas from damage.

C. Verification of In-Place Conditions:

1. Verify location, use and status of all material, equipment, and utilities that are specified, indicated, or determined necessary for removal.
   a. Verify materials, equipment, and utilities to be removed are inactive, not required, or in use after completion of project.
   b. Replace with equivalent any material, equipment and utilities that were removed by contractor that are required to be left in place.
2. Existing Utilities: Do not interrupt utilities serving facilities occupied by Government or others unless permitted under following conditions and then only after arranging to provide temporary utility services, according to requirements indicated:

a. Notify COR in writing at least 14 days in advance of proposed utility interruptions.

b. Do not proceed with utility interruptions without Government's written permission.

D. Provide suspended platforms, strap hangers, brackets, shelves, stands or legs for floor, wall and ceiling mounting of equipment as required.

E. Provide steel supports and hardware for installation of hangers, anchors, guides, and other support hardware.

F. Obtain and analyze catalog data, weights, and other pertinent data required for coordination of equipment support provisions and installation.

G. Verify site conditions and dimensions of equipment to ensure access for proper installation of equipment without disassembly that would void warranty.

3.2 INSTALLATION – GENERAL

A. Coordinate systems, equipment, and materials installation with other building components.

B. Install systems, materials, and equipment to conform with approved submittal data, including coordination drawings.

C. Conform to VAAR 852.236.91 arrangements indicated, recognizing that work may be shown in diagrammatic form or have been impracticable to detail all items because of variances in manufacturers' methods of achieving specified results.

D. Install systems, materials, and equipment level and plumb, parallel and perpendicular to other building systems and components, where installed in both exposed and un-exposed spaces.

E. Install equipment according to manufacturers' written instructions.

F. Install wiring and cabling between equipment and related devices.

G. Install cabling, wiring, and equipment to facilitate servicing, maintenance, and repair or replacement of equipment components. Connect equipment for ease of disconnecting, with minimum interference of adjacent other installations.

H. Provide access panel or doors where units are concealed behind finished surfaces.

I. Arrange for chases, slots, and openings in other building components during progress of construction, to allow for wiring, cabling, and equipment installations.

J. Where mounting heights are not detailed or dimensioned, install systems, materials, and equipment to provide maximum headroom and access for service and maintenance as possible.

K. Install systems, materials, and equipment giving priority to systems required to be installed at a specified slope.

L. Avoid interference with structure and with work or other trades, preserving adequate headroom and clearing doors and passageways to satisfaction of COR and code requirements.

M. Provide supplementary or miscellaneous items, appurtenances, devices and materials for a complete installation.

3.3 EQUIPMENT INSTALLATION

A. Locate equipment as close as practical to locations shown on drawings.

B. Note locations of equipment requiring access on record drawings.

C. Access and Access Panels: Verify access panel locations and construction with COR.

D. Inaccessible Equipment:

1. Where Government determines that contractor has installed equipment not conveniently accessible for operation and maintenance, equipment must be removed and reinstalled as directed and without additional cost to Government.

3.4 EQUIPMENT IDENTIFICATION

A. Install an identification sign which clearly indicates information required for use and maintenance of equipment.

B. Secure identification signs with screws.

3.5 CUTTING AND PATCHING

A. Perform cutting and patching according to contract general requirements and as follows:

1. Remove samples of installed work as specified for testing.
2. Perform cutting, fitting, and patching of equipment and materials required to uncover existing infrastructure in order to provide access for correction of improperly installed existing or new work.
3. Remove and replace defective work.

4. Remove and replace non-conforming work.

B. Cut, remove, and legally dispose of selected equipment, components, and materials, including removal of material, equipment, devices, and other items indicated to be removed and items made obsolete by new work.

C. Provide and maintain temporary partitions or dust barriers adequate to prevent spread of dust and dirt to adjacent areas.

D. Protect adjacent installations during cutting and patching operations.

E. Protect structure, furnishings, finishes, and adjacent materials not indicated or scheduled to be removed.

F. Patch finished surfaces and building components using new materials specified for original installation and experienced installers.

3.6 FIELD QUALITY CONTROL

A. Provide work according to VAAR 852.236.91 and FAR clause 52.236-5.

B. Provide minimum clearances and work required for compliance with NFPA 70, National Electrical Code (NEC), and manufacturers' instructions; comply with additional requirements indicated for access and clearances.

C. Verify all field conditions and dimensions that affect selection and provision of materials and equipment, and provide any disassembly, reassembly, relocation, demolition, cutting and patching required to provide work specified or indicated, including relocation and reinstallation of existing wiring and equipment.

1. Protect facility, equipment, and wiring from damage.

D. Submit written notice that:

1. Project has been inspected for compliance with documents.
2. Work has been completed in accordance with documents.

E. Non-Conforming Work: Conduct project acceptance inspections, final completion inspections, substantial completion inspections, and acceptance testing and demonstrations after verification of system operation and completeness by Contractor.

F. For project acceptance inspections, final completion inspections, substantial completion inspections, and testing/demonstrations that require more than one site visit by COR or design professional to verify project compliance for same material or equipment, Government reserves right to obtain compensation from contractor to defray cost of additional site visits that result from project construction or testing

deficiencies and incompleteness, incorrect information, or non-compliance with project provisions.

1. COR will notify contractor, of hourly rates and travel expenses for additional site visits, and will issue an invoice to Contractor for additional site visits.
2. Contractor is not be eligible for extensions of project schedule or additional charges resulting from additional site visits that result from project construction or testing deficiencies/incompleteness, incorrect information, or non-compliance with Project provisions.

G. Tests:

1. Interim inspection is required at approximately 50 percent of installation.
2. Request inspection ten working days prior to interim inspection start date by notifying COR in writing; this inspection must verify equipment and system being provided adheres to installation, mechanical and technical requirements of construction documents.
3. Inspection to be conducted by OEM and factory-certified contractor representative, and witnessed by COR, facility and SMCS 0050P2H3 representatives.
4. Check each item of installed equipment to ensure appropriate NRTL listing labels and markings are fixed in place.
5. Verify cabling terminations in MCR, TRs, workstation locations and TCO adhere to color code for T568B pin assignments and cabling connections are in compliance with TIA standards.
6. Visually confirm minimum Category 6A cable marking at TCOs locations, patch cords and origination locations.
7. Review cable tray, conduit and path/wire way installation practice.
8. OEM and contractor to perform:
   a. Fiber optical cable field inspection tests via attenuation measurements on factory reels; provide results along with OEM certification for factory reel tests.
   b. Coaxial cable field inspection tests via attenuation measurements on factory reels; provide results along with OEM certification for factory reel tests.

c. Baseband cable field inspection tests via attenuation measurements on factory reels and provide results along with OEM certification for factory reel tests.

9. Relocate failed cable reels to a secured location for inventory, as directed by COR, and then remove from project site within two working days; provide COR with written confirmation of defective cable reels removal from project site.
10. Provide results of interim inspections to COR.
11. If major or multiple deficiencies are discovered, additional interim inspections could be required until deficiencies are corrected, before permitting further system installation.
    a. Additional inspections are scheduled at direction of COR.
    b. Re-inspection of deficiencies noted during interim inspections, must be part of system's Final Acceptance Proof of Performance Test.
    c. The interim inspection cannot affect the system's completion date unless directed by COR.
12. Facility COR will ensure test documents become a part of system's official documentation package.

H. Pretesting: Re-align, re-balance, sweep, re-adjust and clean entire system and leave system working for a "break-in" period, upon completing installation of system and prior to Final Acceptance Proof of Performance Test. System RF transmitting equipment must not be connected to keying or control lines during "break-in" period.
   1. Pretesting Procedure:
      a. Verify systems are fully operational and meet performance requirements, utilizing accepted test equipment and spectrum analyzer.
      b. Pretest and verify system functions and performance requirements conform to construction documents and, that no unwanted physical, aural and electronic effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise are present.
   2. Measure and record signal, aural and control carrier levels of each DAS RF, voice and data channel, at each of the following minimum points in system:
      a. Second floor 2K, 2B areas.

b. Others as required by AHJ (SMCS 005OP2H3).

3. Provide recorded system pretest measurements and certification that the system is ready for formal acceptance test to COR.

I. Acceptance Test:

1. Schedule an acceptance test date after system has been pretested, and pretest results and certification submitted to COR.
2. Give COR fifteen working days written notice prior to date test is expected to begin; include expected duration of time for test in notification.
3. Test in the presence of the following:
   a. COR.
   b. OEM representatives.
   c. VACO:
      1) CFM representative.
      2) AHJ-SMCS 005OP2H3, (202)461-5310.
   d. VISN-CIO, Network Officer and VISN representatives.
   e. Facility:
      1) FMS Service Chief, Bio-Medical Engineering and facility representatives.
      2) OI&T Service Chief and OI&T representatives.
      3) Safety Officer, Police Chief and facility safety representatives.
   f. Local Community Safety Personnel:
      1) Fire Marshal representative.
      2) Disaster Coordinator representative.
      3) EMS Representatives: Police, Sherriff, City, County or State representatives.
4. Test system utilizing accepted test equipment to certify proof of performance and Life and Public Safety compliance, FCC, NRTL, NFPA and OSHA compliance.
   a. Rate system as acceptable or unacceptable at conclusion of test; make only minor adjustments and connections required to show proof of performance.
      1) Demonstrate and verify that system complies with performance requirements under operating conditions.

2) Failure of any part of system that precludes completion of system testing, and which cannot be repaired within four hours, terminates acceptance test of that portion of system.
3) Repeated failures that result in a cumulative time of eight hours to affect repairs is cause for entire system to be declared unacceptable.
4) If system is declared unacceptable, retesting must be rescheduled at convenience of Government and costs borne by the contractor.

J. Acceptance Test Procedure:
1. Physical and Mechanical Inspection: The test team representatives must tour major areas to determine system and sub-systems are completely and properly installed and are ready for acceptance testing.
2. A system inventory including available spare parts must be taken at this time.
3. Each item of installed equipment must be re-checked to ensure appropriate NRTL (i.e. UL) certification listing labels are affixed.
4. Confirm that deficiencies reported during Interim Inspections and Pretesting are corrected prior to start of Acceptance Test.
5. Inventory system diagrams, record drawings, equipment manuals, pretest results.
6. Failure of system to meet installation requirements of specifications is grounds for terminating testing and to schedule re-testing.

K. Operational Test:
1. Individual Item Test: VACO AHJ representative (SMCS 005OP2H3) may select individual items of DAS equipment for detailed proof of performance testing until 100 percent of system has been tested and found to meet requirements of the construction documents.
2. Government's Condition of Acceptance of System Language:
   a. Without Acceptance: Until system fully meets conditions of construction documents, system's ownership, use, operation and warranty commences at Government's final acceptance date.
   b. With Conditional Acceptance: Stating conditions that need to be addressed by contractor or OEM and stating system's use and

operation to commence immediately while its warranty commences only at Government's agreed final extended acceptance date.

c. With Full Acceptance: Stating system's ownership, use, operation and warranty to immediately commence at Government's agreed to date of final acceptance.

L. Acceptance Test Conclusion: Reschedule testing on deficiencies and shortages with COR, after COR and SMCS AHJ jointly agree to results of the test, using the generated punch list or discrepancy list. Perform retesting to comply with these specifications at contractor's expense.

M. Proof of Performance Certification:

1. If system is declared acceptable, AHJ (SMCS 005OP2H3) provides COR notice stating system processes to required operating standards and functions and is Government accepted for use by facility.
2. Validate items with COR needing to be provided to complete project contract (i.e. charts & diagrams, manuals, spare parts, system warranty documents executed, etc.). Once items have been provided, COR contacts FMS service chief to turn over system from CFM oversight for beneficial use by facility.
3. If system is declared unacceptable without conditions, rescheduled testing expenses are to be borne by contractor.

3.7 CLEANING

A. Remove debris, rubbish, waste material, tools, construction equipment, machinery and surplus materials from project site and clean work area, prior to final inspection and acceptance of work.

B. Put building and premises in neat and clean condition.

C. Remove debris on a daily basis.

D. Remove unused material, during progress of work.

E. Perform cleaning and washing required to provide acceptable appearance and operation of equipment to satisfaction of COR.

F. Clean exterior surface of all equipment, including concrete residue, dirt, and paint residue, after completion of project.

G. Perform final cleaning prior to project acceptance by COR.

H. Remove paint splatters and other spots, dirt, and debris; touch up scratches and mars of finish to match original finish.

I. Clean devices internally using methods and materials recommended by manufacturer.

J. Tighten wiring connectors, terminals, bus joints, and mountings, to include lugs, screws and bolts according to equipment manufacturer's published torque tightening values for equipment connectors. In absence of published connection or terminal torque values, comply with torque values specified in UL 486A-486B.

3.8 TRAINING

A. Provide training for equipment or system as required in each associated specification.

B. Develop and submit training schedule for approval by COR, at least 30 days prior to planned training.

3.9 PROTECTION

A. Protection of Fireproofing:

1. Install clips, hangers, clamps, supports and other attachments to surfaces to be fireproofed, if possible, prior to start of spray fireproofing work.
2. Install conduits and other items that would interfere with proper application of fireproofing after completion of spray fire proofing work.
3. Patch and repair fireproofing damaged due to cutting or course of work must be performed by installer of fireproofing and paid for by trade responsible for damage.

B. Maintain equipment and systems until final acceptance.

C. Ensure adequate protection of equipment and material during installation and shutdown and during delays pending final test of systems and equipment because of seasonal conditions.

- - - E N D - - -

12-01-22

SECTION 27 05 26
GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies grounding and bonding requirements of communications installations based on the requirements of ANSI/TIA-607-D, Telecommunications Bonding and Grounding (Earthing) for Customer Premises. Work covered by this Section shall consist of furnishing supplies, labor, materials, equipment, labeling, and tools. Testing is required unless otherwise specified. An operable grounding and bonding infrastructure is required as described on the Drawings and/or required by these specifications. All materials shall be listed by a nationally recognized testing laboratory (NRTL).

1.2 SUMMARY

Section Includes:

A. Joining Requirements.

1.3 REFERENCES

A. VA Infrastructure Standard for Telecommunications Spaces.
B. ANSI/TIA-607-D, Telecommunications Bonding and Grounding (Earthing) for Customer Premises.
C. NFPA 70, National Electrical Code (NEC).
D. International Annealed Copper Standard (IACS).
E. BICSI Information Technology Systems Installation Methods Manual (ITSIMM), Recommended Testing Procedures and Criteria.

F. UL 497 & UL 497A, UL Standards for Primary & Secondary Safety Protectors for Paired-Conductor Communications Circuits.

1.4 RELATED WORK

A. Facility grounding and bonding requirements: Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.

B. Cable trays: Section 27 05 36, CABLE TRAYS FOR COMMUNICATIONS SYSTEMS.

1.5 SUBMITTALS

A. Submit in accordance with Section 27 05 11, COMMON WORK RESULTS FOR COMMUNICATIONS SYSTEMS.

B. Provide riser diagram indicating location of communications grounding system connections indicating routing of grounding conductors.

C. Closeout Submittals: Provide test reports of ground resistance to each primary or secondary bonding busbar (PBB/SBB) located in each telecommunications space impacted by the work.

PART 2 - PRODUCTS

2.1 BONDING BUSBARS.

Bonding busbars are located in each telecommunications space and in each network rack/cabinet. Utilize existing.

2.2 BONDING CONDUCTORS.

A. Equipment/Unit Bonding Conductor (EBC/UBC). Equipment Bonding conductors are also used as cable tray bonding conductors to bond cable tray sections to the Telecommunications Equipment Bonding Conductor (TEBC).

1. Material. Stranded copper wire with a green jacket run as a continuous conductor.

2. Size. The minimum size for the RBC shall be AWG 6.

3. Bonding.

a. Where used as a cable tray bonding conductor connecting cable tray sections, bonded to each adjoining section of the cable tray using UL Listed two-hole compression lugs.

d. Where used as a cable tray bonding conductor connecting cable tray sections to the Telecommunications Equipment Bonding Conductor (TEBC), bonded to the TEBC using UL Listed irreversible compression (crimp) connectors and to the cable tray via a UL Listed two-hole compression lug.

PART 3 - EXECUTION

3.1 IMPLEMENTATION

A. Components of the telecommunications bonding system will be installed and connected using materials and techniques required by ANSI/TIA-607-D. The use of antioxidant joint compound is required for all connections excluding protector 110 block connections.

B. Testing.

1. Perform tests per BICSI Information Technology Systems Installation Methods Manual (ITSIMM), Recommended Testing Procedures and Criteria.
2. Perform two-point bond test using trained installers qualified to use test equipment.
3. Conduct continuity tests to verify that metallic pathways in telecommunications spaces are bonded to PBB or SBB.

4. Conduct electrical continuity test to verify that PBB is effectively bonded to the facility grounding electrode conductor.
5. Perform resistance tests to ensure rack and cabinet bonding connection resistance measures less than 4Ω to PBB or SBB.

- - - E N D - - -

12-01-22

SECTION 27 05 33
CONDUITS AND BACKBOXES FOR COMMUNICATIONS SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies conduit, fittings, and boxes to form raceway systems for communications cabling.

1.2 RELATED WORK

A. Sealing around penetrations to maintain integrity of fire rated construction: Section 07 84 00, FIRESTOPPING.

B. Fabrications for deflection of water away from building envelope at penetrations: Section 07 60 00, FLASHING AND SHEET METAL.

C. Sealing around conduit penetrations through building envelope to prevent moisture migration into building: Section 07 92 00, JOINT SEALANTS.

D. Identification and painting of conduit and other devices: Section 09 91 00, PAINTING.

E. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.

1.3 SUBMITTALS

A. In accordance with Section 27 05 00, COMMON WORK RESULTS FOR COMMUNICATIONS SYSTEMS, submit the following:

1. Size and location of cabinets, splice boxes, and pull boxes.
2. Layout of required conduit penetrations through structural elements.
3. Catalog cuts marked with specific item proposed and area of application identified.

B. Certification: Provide letter prior to final inspection, certifying material is in accordance with construction documents and properly installed.

PART 2 - PRODUCTS

2.1 MATERIAL

A. Minimum Conduit Size: 19 mm (3/4 inch).

B. Conduit:

1. Rigid Galvanized Steel: Conform to UL 6, ANSI C80.1.
2. Rigid Intermediate Steel Conduit (IMC): Conform to UL 1242, ANSI C80.6.
3. Electrical Metallic Tubing (EMT):
   a. Maximum Size: 105 mm (4 inches).
   b. Install only for cable rated 600 volts or less.
   c. Conform to UL 797, ANSI C80.3.
4. Flexible Galvanized Steel Conduit: Conform to UL 1.
5. Liquid-tight Flexible Metal Conduit: Conform to UL 360.
6. Surface Metal Raceway: Conform to UL 5.

C. Conduit Fittings:

1. Rigid Galvanized Steel and Rigid Intermediate Steel Conduit Fittings:
   a. Provide fittings meeting requirements of UL 514B and ANSI/ NEMA FB 1.
   b. Sealing: Provide threaded cast iron type. Use continuous drain type sealing fittings to prevent passage of water and vapor. In concealed work, install sealing fittings in flush steel boxes with blank cover plates having same finishes as other electrical plates in room.

c. Standard Threaded Couplings, Locknuts, Bushings, and Elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.

d. Locknuts: Bonding type with sharp edges for digging into metal wall of an enclosure.

e. Bushings: Metallic insulating type, consisting of an insulating insert molded or locked into metallic body of fitting. Bushings made entirely of metal or nonmetallic material are not permitted.

f. Erickson (union-type) and Set Screw Type Couplings:

1) Couplings listed for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete.

2) Use set screws of case hardened steel with hex head and cup point to seat in conduit wall for positive ground.

g. Provide OEM approved fittings.

2. Electrical Metallic Tubing Fittings:

a. Conform to UL 514B and ANSI/ NEMA FB1; only steel or malleable iron materials are acceptable.

b. Couplings and Connectors:

1) Use gland and ring compression type couplings and connectors for conduit sizes 50 mm (2 inches) and smaller.

2) Use set screw type couplings with four set screws each for conduit sizes over 50 mm (2 inches).

3) Use set screws of case-hardened steel with hex head and cup point to seat in wall of conduit for positive grounding.

c. Indent type connectors or couplings are not permitted.

d. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are not permitted.

e. Provide OEM approved fittings.

3. Flexible Steel Conduit Fittings:

a. Conform to UL 514B; only steel or malleable iron materials are acceptable.

b. Provide clamp type, with insulated throat.

c. Provide OEM approved fittings.

4. Liquid-tight Flexible Metal Conduit Fittings:

a. Conform to UL 514B and ANSI/ NEMA FB1; only steel or malleable iron materials are acceptable.

b. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening.

c. Provide connectors with insulated throats to prevent damage to cable jacket.

d. Provide OEM approved fittings.

5. Expansion and Deflection Couplings:

a. Conform to UL 467 and UL 514B.

b. Accommodate 19 mm (3/4 inch) deflection, expansion, or contraction in any direction, and allow 30-degree angular deflections.

c. Include internal flexible metal braid sized to ensure conduit ground continuity and fault currents in

accordance with UL 467, and NEC code tables for ground conductors.

d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat resistant molded rubber material with stainless steel jacket clamps.

D. Conduit Supports:

1. Parts and Hardware: Provide zinc-coat or equivalent corrosion protection.
2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
3. Multiple Conduit (Trapeze) Hangers: Minimum 38 mm by 38 mm (1-1/2 by 1-1/2 inch), 2.78 mm (12 gage) steel, cold formed, lipped channels; with minimum 9 mm (3/8 inch) diameter steel hanger rods.
4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.

E. Outlet, Splice, and Pull Boxes:

1. Conform to UL-50 and UL-514A.
2. Cast metal where required by NEC or shown, and equipped with rustproof boxes.
3. Sheet Metal Boxes: Galvanized steel, except where otherwise shown.
4. Install flush mounted wall or ceiling boxes with raised covers so that front face of raised cover is flush with wall.
5. Install surface mounted wall or ceiling boxes with surface style flat or raised covers.

F. Flexible Nonmetallic Communications Raceway (Innerduct) and Fittings:

1. General: Provide UL 910 listed plenum, riser, and general purpose corrugated pliable communications raceway.
2. Provide Communications Raceway with a factory installed 567 kg (1250 lb.) tensile pre-lubricated pull tape.
3. Use only metallic straps, hangers and fittings to support raceway from building structure. Cable ties are not permitted for securing raceway to building structure.
4. Provide fittings to be installed in spaces used for environmental air made of materials that do not exceed flammability, smoke generation, ignitibility, and toxicity requirements of environmental air space.
5. Size: Metric Designator 53 (trade size 2) or smaller.
6. Inside Plant: Listed and marked for installation in plenum airspaces and minimum 25 mm (1 inch) inside diameter.
7. Plenum: Non-metallic communications raceway.
   a. Constructed of low smoke emission, flame retardant PVC with corrugated construction.
   b. UL 94 V-O rating for flame spreading limitation.
8. Provide innerduct reel lengths as necessary to ensure ducts are continuous.
9. Provide pulling accessories used for innerduct including but not limited to, inner duct lubricants, spreaders, applicators, grips, swivels, harnesses, and line missiles (blown air) compatible with materials being pulled.

G. Outlet Boxes:

1. Flush wall mounted minimum 11.9 cm (4-11/16 inches) square, 9.2 cm (3-5/8 inches) deep pressed galvanized steel.
2. 2-Gang Tile Box:
   a. Flush backbox type for installation in block walls.
   b. Minimum 92 mm (3-5/8 inches) deep.

PART 3 - EXECUTION

3.1 EQUIPMENT INSTALLATION AND REQUIREMENTS

A. Raceways typically required for cabling systems unless otherwise indicated:

System	Specification Section	Installed Method
Grounding	27 05 26	Conduit Not Required
Control, Communication and Signal Wiring	27 10 00	Complete Conduit Allowed in Non-Partitioned Cable Tray or Cable Ladders
Communications Copper Horizontal Cabling	27 15 13	Conduit to Cable Tray Partitioned Cable Tray
Public Address and Mass Notification Systems	27 51 16	Complete conduit
Nurse Call	27 52 23	Complete Conduit
Grounding and Bonding for Electronic Safety and Security	28 05 26	Conduit Not Required Unless Required by Code
Physical Access Control System	28 13 00	Conduit to Cable Tray Partitioned Cable Tray
Video Surveillance	28 23 00	Complete Conduit

System	Specification Section	Installed Method
Electronic Personal Protection System	28 26 00	Conduit to Cable Tray, Partitioned Cable Tray
Fire Detection and Alarm	28 31 00	Complete Conduit

B. Penetrations:

1. Cutting or Holes:

a. Locate holes in advance of installation. Where proposed in structural sections, obtain approval of structural engineer and COR prior to drilling through structural sections.

b. Make holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammer, impact electric, hand or manual hammer type drills are not permitted; COR may grant limited permission by request, in condition of limited working space.

c. Fire Stop: Where conduits, wireways, and other communications raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.

1) Fill and seal clearances between raceways and openings with fire stop material.

2) Install only retrofittable, non-hardening, and reusable firestop material that can be removed and reinstalled to seal around cables inside conduits.

C. Conduit Installation:

1. Minimum conduit size of 19 mm (3/4 inch), but not less than size required for 40 percent fill.
2. Install insulated bushings on all conduit ends.
3. Install pull boxes after every 180 degrees of bends (two 90-degree bends) or every 100ft. Size boxes per TIA 569.
4. Where drilling is necessary for vertical conduits, locate holes so as not to affect structural sections.
5. Seal empty conduits located in telecommunications rooms or on backboards to prevent entrance of moisture and gases and to meet fire resistance requirements.
6. Complete each entire conduit run installation before pulling in cables.
7. Flattened, dented, or deformed conduit is not permitted.
8. Ensure conduit installation does not encroach into ceiling height head room, walkways, or doorways.
9. Cut conduit square with a hacksaw, ream, remove burrs, and draw tight.
10. Install conduit mechanically continuous.
11. Independently support conduit at 2.44 m (8 feet) on center; do not use other supports (i.e., suspended ceilings, suspended ceiling supporting members, luminaires, conduits, mechanical piping, or mechanical ducts).
12. Support conduit within 300 mm (1 foot) of changes of direction, and within 300 mm (1 foot) of each enclosure to which connected.
13. Close ends of empty conduit with plugs or caps to prevent entry of debris, until cables are pulled in.

14. Attach conduits to cabinets, splice cases, pull boxes and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on inside of enclosure, made up wrench tight. Do not make conduit connections to box covers.
15. Unless otherwise indicated on drawings or specified herein, conceal conduits within finished walls, floors and ceilings.
16. Conduit Bends:
    a. Make bends with standard conduit bending machines; observe minimum bend radius for cable type and outside diameter.
    b. Conduit hickey is permitted only for slight offsets, and for straightening stubbed conduits.
    c. Bending of conduits with a pipe tee or vise is not permitted.
    d. Minimum radius of communication conduit bends:

Sizes of Conduit Trade Size	Radius of Conduit Bends mm, Inches
3/4	150 (6)
1	230 (9)
1-1/4	350 (14)
1-1/2	430 (17)
2	525 (21)
2-1/2	635 (25)
3	775 (31)
3-1/2	900 (36)
4	1125 (45)

17. Layout and Homeruns – Deviations: Make only where necessary to avoid interferences and only after drawings showing proposed deviations have been submitted and approved by COR.

D. Furred or Suspended Ceilings and in Walls:
   1. Rigid steel or IMC. Different type conduits mixed indiscriminately in same system is not permitted.
   2. Align and run conduit parallel or perpendicular to building lines.
   3. Tightening set screws with pliers is not permitted.

E. Exposed Work Installation:
   1. Unless otherwise indicated on drawings, exposed conduit is only permitted in telecommunications rooms.
      a. Provide rigid steel or IMC.
      b. Different type of conduits mixed indiscriminately in system is not permitted.
   2. Align and run conduit parallel or perpendicular to building lines.
   3. Install horizontal runs close to ceiling or beams and secure with conduit straps.
   4. Support horizontal or vertical runs at not over 2400 mm (96 inches) intervals.
   5. Painting:
      a. Paint exposed conduit as specified in Section 09 91 00, PAINTING.
      b. Refer to Section 09 91 00, PAINTING for preparation, paint type, and exact color.

c. Provide labels where conduits pass through walls and floors and at maximum 6000 mm (20 foot) intervals in between.

F. Expansion Joints:

1. Conduits 75 mm (3 inches) and larger, that are secured to building structure on opposite sides of a building expansion joint, require expansion and deflection couplings. Install couplings in accordance with manufacturer's recommendations.
2. Provide conduits smaller than 75 mm (3 inches) with pull boxes on both sides of expansion joint. Connect conduits to expansion and deflection couplings as specified.
3. Install expansion and deflection couplings where shown.

G. Seismic Areas:

1. In seismic areas, follow H-18-8 Seismic Design Requirements.
2. Rigidly secure conduit to building structure on opposite sides of a building expansion joint with pull boxes on both sides of joint.
3. Connect conduits to pull boxes with 375 mm (15 inches) of slack flexible conduit.
4. Install green copper wire minimum #6 AWG in flexible conduit for bonding jumper.

H. Conduit Supports, Installation:

1. Select AC193 code listed mechanical anchors or fastening devices with safe working load not to exceed 1/4 of proof test load.

2. Use pipe straps or individual conduit hangers for supporting individual conduits. Maximum distance between supports is 2.5 m (8 foot) on center.
3. Support multiple conduit runs with trapeze hangers. Use trapeze hangers designed to support a load equal or greater than sum of the weights of the conduits, wires, hanger itself, and 90 kg (200 pounds). Attach each conduit with U-bolts or other accepted fasteners.
4. Support conduit independent of pull boxes, luminaires, suspended ceiling components, angle supports, duct work, and similar items.
5. Fastenings and Supports in Solid Masonry and Concrete:
   a. Existing Construction:
      1) Code AC193 listed wedge type steel expansion anchors minimum 6 mm (1/4 inch) bolt size and minimum 28 mm (1-1/8 inch) embedment.
      2) Power set fasteners minimum 6 mm (1/4 inch) diameter with depth of penetration minimum 75 mm (3 inches).
      3) Use vibration and shock resistant anchors and fasteners for attaching to concrete ceilings.
6. Fastening to Hollow Masonry: Toggle bolts are permitted.
7. Fastening to Metal Structures: Use machine screw fasteners or other devices designed and accepted for application.
8. Bolts supported only by plaster or gypsum wallboard are not acceptable.
9. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.

10. Do not support conduit from chain, wire, or perforated strap.
11. Spring steel type supports or fasteners are not permitted except horizontal and vertical supports/fasteners within walls.
12. Vertical Supports:
    a. Install riser clamps and supports for vertical conduit runs in accordance with NEC.
    b. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

I. Box Installation:

1. Boxes for Concealed Conduits:
    a. Flush mounted.
    b. Provide raised covers for boxes to suit wall or ceiling, construction and finish. In spaces not controlled by VA (i.e., common hallways) covers must be lockable.
2. In addition to boxes shown, install additional boxes where needed to prevent damage to cables during pulling.
3. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
4. Stencil or install phenolic nameplates on covers of boxes identified on riser diagrams; for example "SIG-FA JB No. 1".
5. Outlet boxes mounted back-to-back in same wall are not permitted. A minimum 600 mm (24 inches) center-to-center lateral spacing must be maintained between boxes.

J. Flexible Nonmetallic Communications Raceway (Innerduct), Installation:

1. Install Innerduct in cable tray. Innerduct may not be free-hung.
2. Install only in accessible spaces not subject to physical damage or corrosive influences.
3. Make bends manually to assure internal diameter of tubing is not effectively reduced.
4. Extend each segment of innerduct minimum 300 mm (12 inches) beyond end of service conduit tie or cable tray. Restrain innerduct ends with wall mount clamps and seal when cable is installed.

3.2 TESTING

A. Examine fittings and locknuts for secureness.

B. Test RMC, IMC and EMT systems for electrical continuity and resistance to ground.

- - - E N D - - -

SECTION 27 05 36
CABLE TRAYS FOR COMMUNICATIONS SYSTEMS

PART 1 – GENERAL

1.1 DESCRIPTION:

This section specifies requirements for telecommunications cabling cable tray and raceway equipment.

1.2 SUMMARY

Section Includes:

A. Cable Tray.

1.3 REFERENCES

A. VA Infrastructure Standard for Telecommunications Spaces.

1.4 RELATED WORK:

A. Grounding and bonding: Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.

1.5 SUBMITTALS:

A. Submit in accordance with Section 27 05 00, COMMON WORK RESULTS FOR COMMUNICATIONS SYSTEMS.

PART 2 – PRODUCTS

2.1 CABLE TRAY.

A. Design. Wire basket with tray insert. Maximum 2” x 4” wire mesh construction. Constructed of round, smooth wire with continuous top side to minimize cable sheath damage.

B. Finish. Coated to prevent rust.

C. Size. Cable tray shall be sized to hold the maximum expected cable load at not more than 40% fill and not more than 6” maximum cable depth.

D. Accessories. Provide and install the following components and accessories as necessary to achieve the design:

1. Overhead mounting equipment (thread-rod, unistrut, nuts, washers, etc.) suitable for the supporting structural elements.

2. Tray section splicing hardware.

3. Tray insert.

4. Ground strap kits.

5. Bend radius limiters.

PART 3 – EXECUTION

3.1 IMPLEMENTION:

A. Cable tray shall be used in horizontal applications.

B. Cable tray sections shall be bonded together with bonding conductors and the system bonded to the bonding busbar in the space.

C. Support horizontal cable tray not less than every 5’ (shorter spans if recommended by the equipment manufacturer).

– – – E N D – – –

SECTION 27 05 53
IDENTIFICATION FOR COMMUNICATIONS SYSTEMS

PART 1 – GENERAL

1.1 DESCRIPTION:

This section specifies labeling and identification requirements for information technology (IT) cabling.

1.2 SUMMARY

Section Includes:

A. Labeling implementation requirements.

1.3 REFERENCES

A. VA Infrastructure Standard for Telecommunications Spaces.

1.4 RELATED WORK:

A. Fiber optic cabling: Section 27 13 23, COMMUNICATIONS OPTICAL FIBER BACKBONE CABLING.

PART 2 – PRODUCTS

2.1 EQUIPMENT AND COMPONENT LABELS.

A. Materials. Materials used for labeling telecommunications cabling shall be appropriate for the installation environment, durable and permanent, and heat-resistant if necessary for labeling in high-temperature environments.

PART 3 – EXECUTION

3.1 IMPLEMENTION:

A. Governing Standard. Labeling and identification telecommunications cabling shall be based on ANSI/TIA-606-C, Administration Standard for Telecommunications Infrastructure, and NFPA 70, National Electrical Code, as modified by guidance in the VA Infrastructure Standard for Telecommunications Spaces.

B. All telecommunications cabling installed shall be labeled at the time of installation.

C. Telecommunications cable labeling shall include delivery of complete and accurate connection documentation (where each cable terminates at each end) matching the installed labels.

D. Label locations shall be as specified in the VA Infrastructure Standard for Telecommunications Spaces.

- - - E N D - - -

SECTION 27 08 00
COMMISSIONING OF COMMUNICATIONS SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section includes requirements for commissioning facility communications systems, related subsystems and related equipment. This Section supplements general requirements specified in Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

B. Complete list of equipment and systems to be commissioned is specified in Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS and Specification 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.

C. Commissioned Systems:

1. Commissioning of systems specified in Division 27 and 28 is part of project's construction process including documentation and proof of performance testing of these systems, as well as training of VA's Operation and Maintenance personnel in accordance with requirements of Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS and Division 27, in cooperation with Government and Commissioning Agent.
2. The facility exterior closure systems commissioning includes communications systems listed in Section 01 91 00 GENERAL COMMISSIONING REQUIRMENTS and 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.

1.2 RELATED WORK

A. System tests: Section 01 00 00, GENERAL REQUIREMENTS.

B. Commissioning process requires review of selected submittals that pertain to systems to be commissioned: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.

C. Construction phase commissioning process and procedures including roles and responsibilities of commissioning team members and user training: Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

1.3 COORDINATION

A. Commissioning Agent will provide a list of submittals that must be reviewed by Commissioning Agent simultaneously with engineering review; do not proceed with work of sections identified without engineering and Commissioning Agent's review completed.

B. Commissioning of communications systems require inspection of individual elements of communications system construction throughout construction period. Coordinate with Commissioning Agent in accordance with Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS and commissioning plan to schedule communications systems inspections as required to support the commissioning process.

1.4 CLOSEOUT SUBMITTALS

A. Refer to Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for pre-functional checklists, equipment startup reports, and other commissioning documents.

B. Pre-Functional Checklists:

1. Complete pre-functional checklists provided by commissioning agent to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing.
2. Submit completed checklists to COR and to Commissioning Agent. Commissioning Agent can spot check a sample of completed checklists. If Commissioning Agent determines that information provided on the checklist is not accurate, Commissioning Agent then returns the marked-up checklist to Contractor for correction and resubmission.
3. If Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, Commissioning Agent can select a broader sample of checklists for review.
4. If Commissioning Agent determines that a significant number of broader sample of checklists is also inaccurate, all checklists for the type of equipment will be returned to Contractor for correction and resubmission.

C. Submit training agendas and trainer resumes in accordance with requirements of Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

PART 2 - PRODUCTS - NOT USED

PART 3 - EXECUTION

3.1 FIELD QUALITY CONTROL

A. Contractor's Tests:

1. Scheduled tests required by other sections of Division 27 must be documented in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
2. Incorporate all testing into project schedule. Provide minimum seven calendar days' notice of testing for Commissioning Agent to witness selected Contractor tests at sole discretion of Commissioning Agent.
3. Complete tests prior to scheduling Systems Functional Performance Testing.

B. Systems Functional Performance Testing:

1. Commissioning process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions.
2. Commissioning Agent prepares detailed Systems Functional Performance Test procedures for review and acceptance by COR.
3. Provide required labor, materials, and test equipment identified in test procedure to perform tests.
4. Commissioning Agent must witness and document the testing.
   a. Provide test reports to Commissioning Agent. Commissioning Agent will sign test reports to verify tests were performed.

3.2 TRAINING

A. Training of Government's operation and maintenance personnel is required in cooperation with COR and Commissioning Agent.

B. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning location, operation, and troubleshooting of installed systems.

C. Schedule instruction in coordination with COR after submission and approval of formal training plans.

- - - E N D - - -

SECTION 27 10 00
STRUCTURED CABLING

PART 1 – GENERAL

1.1 DESCRIPTION:

This section specifies requirements for telecommunications structured cabling systems.

1.2 SUMMARY

Section Includes:

A. Facility Backbone Structured Cabling.

B. Facility Horizontal Structured Cabling.

1.3 REFERENCES

A. VA Infrastructure Standard for Telecommunications Spaces.

1.4 RELATED WORK:

A. Cabling labeling and identification: Section 27 05 53, IDENTIFICATION FOR COMMUNICATIONS SYSTEMS.

B. Cable termination locations and equipment: Section 27 11 19, COMMUNICATIONS TERMINATION BLOCKS AND PATCH PANELS.

1.5 SUBMITTALS:

A. Submit in accordance with Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.

PART 2 – PRODUCTS

2.1 COMPUTER ROOM BACKBONE STRUCTURED CABLING. (NOT USED)

2.2 COMPUTER ROOM HORIZONTAL STRUCTURED CABLING. (NOT USED)

2.3 FACILITY BACKBONE STRUCTURED CABLING.

Backbone structured cabling (intra-building first level backbone) connects the Main Distribution Areas to each Telecommunications Room (TR).

A. Interior to each telecommunications space, install facility backbone structured cabling in overhead cable tray and fiber raceway systems.

B. All facility backbone structured cabling shall be redundant and follow diverse path routing.

C. Facility backbone cabling shall be field-terminated (fusion spliced).

D. Between each MDA and each TR:

1. No zone/intermediate distribution areas (ZDAs/IDAs) intermediate cross-connects (ICCs) shall be used. All facility backbone

cabling between the MDAs and TRs shall be run directly and continuously.

2. Replace 1 diversely routed path of backbone cabling, one from the MDA.
3. Where the TR is located in the same building as the computer room MDAs (does not transit outside plant pathways) and the path distance is less than 400 meters, install a minimum of 24 strands of multimode fiber optic cabling and 12 strands of single-mode fiber optic cabling per path.
   a. Populate the fiber optic distribution cabinets on each end with a sufficient quantity of multimode OM4 and single-mode OS1 fiber optic splice cassettes per path.

2.4 FACILITY HORIZONTAL STRUCTURED CABLING.

Facility horizontal structured cabling (horizontal distribution) connects the Telecommunications Room (TR) to each end-user Work Area Outlet (WAO).

A. Interior to each TR, install horizontal distribution structured cabling in overhead cable tray systems.
B. All horizontal distribution structured cabling shall have a minimum of 2 cables per WAO. Except for TV outlets.
C. Horizontal distribution structured cabling may be field-terminated.
D. In each TR install sufficient UTP patch panels to support the quantity of WAOs in the TR's serving zone.
   1. Plan network racks such that patch panels and horizontal cable managers are located in the top 1/3 (RU31-45).
E. Install a minimum of 2 UTP cables between the TR UTP patch panels and each work area faceplate.
F. Each typical end-user receptacle shall be constructed of a two-gang workbox with one connector chassis, a minimum of two non-proprietary Category 6A 8P8C media interface connectors (RJ-45), and a four-position keystone faceplate.
   1. Modular plug terminated links (MPTL) are permitted to service wireless access points (WAPs), cameras, and other Power over Ethernet (PoE) devices where mating will be very infrequent.

PART 3 – EXECUTION

3.1 IMPLEMENTION:

A. 100% construction drawing sets shall include drawings detailing the facility structured cabling systems, including:

1. Cable media performance categories for each type of run.
2. Cabling and equipment quantities.
3. Elevation drawings showing equipment placement in individual enclosures.
4. Full interconnection diagram for all structured cabling.
5. Port map and cable label matrices.

B. All cabling and equipment shall be labeled per the requirements of the VA Infrastructure Standard for Telecommunications Spaces.

– – – E N D – – –

SECTION 27 11 19
COMMUNICATIONS TERMINATION BLOCKS AND PATCH PANELS

PART 1 – GENERAL

1.1 DESCRIPTION:

This section specifies cable termination and management equipment to be mounted in information technology (IT) equipment cabinets and racks.

1.2 SUMMARY

Section Includes:

A. Copper UTP Patch Panels.

B. Horizontal Cable Managers.

C. Blanking Panels.

1.3 REFERENCES

A. VA Infrastructure Standard for Telecommunications Spaces.

1.4 RELATED WORK:

A. Server cabinets and network racks: Section 27 11 16, COMMUNICATIONS CABINETS, RACKS, FRAMES, AND ENCLOSURES.

B. Labeling and identification requirements: Section 27 05 53, IDENTIFICATION FOR COMMUNICATIONS SYSTEMS.

C. Copper UTP cabling termination: Section 27 13 13.13, COMMUNICATIONS COPPER CABLE SPLICING AND TERMINATIONS.

1.5 SUBMITTALS:

A. Submit in accordance with Section 27 05 11, COMMON WORK RESULTS FOR COMMUNICATIONS SYSTEMS.

PART 2 – PRODUCTS

2.1 COPPER (UTP) PATCH PANELS.

A. Form Factor. 1U, 19” rack-mountable. Default form factor for patch panels shall be angled to extend not less than 4” (104mm) forward from the mounting rail.

B. Capacity. 48 copper 8P8C ports in groupings of 6.

C. Interface. Copper (UTP) patch panels shall accept pre-terminated single 8P8C keystone jacks and 6-jack cassettes.

D. Accessories. Provide each patch panel installation with the following accessories.

1. Angled panel cover. Specify angled panel covers at the top and bottom of each stack of angled patch panels. Covers shall mount to the same RU rail positions as the top and bottom patch panels.
2. Rear cable manager tray. Specify one rear cable manager tray per patch panel. Trays shall mount to the same RU rail positions as the patch panel.

2.2 HORIZONTAL CABLE MANAGERS.

A. Form Factor. 2U, 19" rack-mountable.

B. Door. Horizontal cable managers shall have a double-hinged front cover to protect installed cables.

C. Fingers. 6-port spacing (five fingers).

2.3 BLANKING PANELS.

A. Form Factor. 1U , 19" rack-mountable, angled to extend 4" (104mm) forward from the mounting rail.

B. Transition. Blanking panel shall have a transition cover from angled front to flat front.

C. Quantity. Provide blanking panels to fill 75% of all RUs in all server cabinets and network cabinets.

PART 3 - EXECUTION

3.1 INSTALLATION:

Not used.

- - - E N D - - -

SECTION 27 13 13.13
COMMUNICATIONS COPPER CABLE SPLICING AND TERMINATIONS

PART 1 – GENERAL

1.1 DESCRIPTION:

This section specifies requirements for terminations of copper (UTP) cabling.

1.2 SUMMARY

Section Includes:

A. Termination Requirements.

B. Splicing.

1.3 REFERENCES

A. VA Infrastructure Standard for Telecommunications Spaces.

1.4 RELATED WORK:

A. Copper (UTP) cabling requirements: Section 27 15 13, COMMUNICATIONS COPPER HORIZONTAL CABLING.

1.5 SUBMITTALS:

A. Submit in accordance with Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.

PART 2 – PRODUCTS

Not used.

PART 3 – EXECUTION

3.1 TERMINATION REQUIREMENTS.

A. Terminate copper (UTP) cabling used for data communications per TIA 568B.

B. Connections shall be made to equipment certified to performance category 6A.

3.2 SPLICING.

Splicing of copper (UTP) cabling is prohibited.

- - - E N D - - -

SECTION 27 13 23.13
COMMUNICATIONS OPTICAL FIBER SPLICING AND TERMINATIONS

PART 1 – GENERAL

1.1 DESCRIPTION:

This section specifies requirements for terminations of fiber optic cabling.

1.2 SUMMARY

Section Includes:

A. Termination Requirements.

1.3 REFERENCES

A. VA Infrastructure Standard for Telecommunications Spaces.

1.4 RELATED WORK:

B. Fiber optic cabling requirements: Section 27 13 23, COMMUNICATIONS OPTICAL FIBER BACKBONE CABLING.

1.5 SUBMITTALS:

A. Not used.

PART 2 – PRODUCTS

Not used.

PART 3 – EXECUTION

3.1 TERMINATION REQUIREMENTS.

A. Terminate fiber optic cabling with duplex Lucent connector (LC) adapters , 12-fiber multi-fiber push on (MPO) connectors or 24-fiber multi-fiber push on (MPO) connectors as required for the application.

B. Field termination (fusion splicing) for non-computer room applications where cable lengths cannot be determined in advance is acceptable.

- - - E N D - - -

SECTION 27 13 23
COMMUNICATIONS OPTICAL FIBER BACKBONE CABLING

PART 1 – GENERAL

1.1 DESCRIPTION:

This section specifies requirements for telecommunications optical fiber backbone cabling.

1.2 SUMMARY

Section Includes:

A. Multimode Optical Fiber Backbone Cables.

B. Single Mode Optical Fiber Backbone Cables.

C. Hybrid Optical Fiber Backbone Cables.

1.3 REFERENCES

A. VA Infrastructure Standard for Telecommunications Spaces.

1.4 RELATED WORK:

A. Computer room structured cabling: Section 27 10 00, STRUCTURED CABLING.

B. Cable labeling requirements: Section 27 05 53, IDENTIFICATION FOR COMMUNICATIONS SYSTEMS.

1.5 SUBMITTALS:

A. Submit in accordance with Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.

PART 2 – PRODUCTS

2.1 MULTIMODE OPTICAL FIBER BACKBONE CABLES.

Multimode fiber optic backbone cables are specified for inside plant use, for intrabuilding facility backbone.

A. Performance Category. Laser-optimized OM4 or OM5 cables are specified.

B. Testing. All fiber optic backbone media shall pass all Tier 1 requirements (attenuation with an Optical Loss Test Set or OLTS, verification of cable length and polarity) and all Tier 2 requirements (characterization by an Optical Time Domain Reflectometer or OTDR resulting in indication of the uniformity of cable attenuation and connector insertion loss).

C. Termination. Fiber will be field terminated (fusion spliced) when used to connect the computer room to Telecommunications Rooms (TRs).

D. Jacket Color.

1. OM4. Aqua.

2. OM5. Lime.

E. Jacket Rating. Communications Multipurpose Cable, Plenum (CMP) shall be specified if any portion of the cable passes through an NEC-defined plenum. Communications Multipurpose Cable, Riser (CMR) shall be specified for all other applications. CMP may be used as a substitute for CMR.

F. Bundling and Construction. Bundles consisting of multiples of sub-bundles (subunits) of 12 and 24 strands of fiber are specified. Cables shall be dielectric and tight-buffered. Construction shall match the rear entry requirements of the fiber optic distribution or splice cassette such that the sub-bundle (subunit) remains jacketed into the cassette.

G. Length. Backbone cabling for computer room first level backbone use (pre-terminated) shall be procured to the specific length required by the design (horizontal and vertical paths) with no more than 1 meter of excess length on each end.

2.2 SINGLE MODE OPTICAL FIBER BACKBONE CABLES.

Single mode fiber optic backbone cables are specified for inside use, for campus backbone (intrabuilding) use.

A. Performance Category. OS1 is specified for inside plant applications.

B. Testing. All fiber optic backbone media shall pass all Tier 1 requirements (attenuation with an Optical Loss Test Set or OLTS, verification of cable length and polarity) and all Tier 2 requirements (characterization by an Optical Time Domain Reflectometer or OTDR resulting in indication of the uniformity of cable attenuation and connector insertion loss).

C. Termination. Fiber will be field terminated (fusion spliced) when used to connect the computer room to Telecommunications Rooms (TRs).

D. Jacket Color. Yellow.

E. Jacket Rating. Communications Multipurpose Cable, Plenum (CMP) shall be specified if any portion of the cable passes through an NEC-defined plenum. Communications Multipurpose Cable, Riser (CMR) shall be specified for all other applications. CMP may be used as a substitute for CMR.

F. Bundling and Construction. Bundles consisting of multiples of sub-bundles (subunits) of 12 and 24 strands of fiber are specified. Cables shall be dielectric and tight-buffered for OS1, and loose-tube gel-filled for OS2.

2.3 HYBRID OPTICAL FIBER BACKBONE CABLES.

Hybrid cables containing multiple 12 and 24-strand bundles (subunits) of multimode and/or single mode fiber are acceptable.

PART 3 - EXECUTION

3.1 IMPLEMENTATION.

A. All cabling and equipment shall be labeled per the requirements of the VA Infrastructure Standard for Telecommunications Spaces.

B. Interior to telecommunications spaces, install fiber optic backbone cabling in overhead cable tray and fiber raceway systems.

- - - E N D - - -

SECTION 27 15 13
COMMUNICATIONS COPPER HORIZONTAL CABLING

PART 1 – GENERAL

1.1 DESCRIPTION:

This section specifies requirements for telecommunications copper (UTP) horizontal distribution cabling outside of the computer room.

1.2 SUMMARY

Section Includes:

A. Copper (UTP) Horizontal Cables.

1.3 REFERENCES

A. VA Infrastructure Standard for Telecommunications Spaces.

1.4 RELATED WORK:

A. Termination equipment: Section 27 11 19, COMMUNICATIONS TERMINATION BLOCKS AND PATCH PANELS.

B. Cable labeling requirements: Section 27 05 53, IDENTIFICATION FOR COMMUNICATIONS SYSTEMS.

1.5 SUBMITTALS:

A. Submit in accordance with Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.

PART 2 – PRODUCTS

2.1 COPPER (UTP) HORIZONTAL CABLES.

Copper (UTP) horizontal cables connect the Telecommunications Room (TR) to each end-user Work Area Outlet (WAO) (horizontal distribution).

A. Performance Category. Copper (UTP) horizontal cables shall meet the Category 6A performance requirements. Category 6A connectors are required.

B. Performance Specifications. Meets or exceeds TIA-EIA-568-C.2-10 and TSB-155.

C. Limited Power (LP) Certification. UL Listed as x-LP (0.5A).

D. Termination. Field terminated TIA 568B.

E. Testing. Following installation, each cable shall be field certified to meet performance category requirements per TIA 568-C.2.

F. Conductor Size. 22-24AWG.

G. Jacket Rating. Communications Multipurpose Cable, Plenum (CMP) shall be specified if any portion of the cable passes through an NEC-defined plenum. Communications Multipurpose Cable, Riser (CMR) shall be specified for all other applications. CMP may be used as a substitute for CMR.

H. Construction. Copper Clad Aluminum (CCA) cable is not permitted.

J. Length. The maximum distance for UTP horizontal cables is limited to 295 feet.

PART 3 – EXECUTION

3.1 IMPLEMENTATION.

A. A. All cabling and equipment shall be labeled per the requirements of the VA Infrastructure Standard for Telecommunications Spaces.

B. Interior to the TR, install horizontal copper (UTP) structured cabling in overhead cable tray.

- - - E N D - - -

SECTION 27 16 19
COMMUNICATIONS PATCH CORDS, STATION CORDS, AND CROSS CONNECT WIRE

PART 1 – GENERAL

1.1 DESCRIPTION:

This section specifies requirements for telecommunications patch cords.

1.2 SUMMARY

Section Includes:

A. Copper (UTP) Patch Cables.

1.3 REFERENCES

A. VA Infrastructure Standard for Telecommunications Spaces.

1.4 RELATED WORK:

A. Termination equipment: Section 27 11 19, COMMUNICATIONS TERMINATION BLOCKS AND PATCH PANELS.

B. Cable labeling requirements: Section 27 05 53, IDENTIFICATION FOR COMMUNICATIONS SYSTEMS.

1.5 SUBMITTALS:

A. Submit in accordance with Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.

PART 2 – PRODUCTS

2.1 COPPER (UTP) PATCH CABLES.

A. Performance Category. Patch cables shall meet the Category 6A performance requirements. Category 6A connectors are required.

B. Termination Method. Factory pre-terminated TIA 568B.

C. Conductor Size. 22-28AWG. Where 28AWG patch cords are specified, the overall horizontal channel distance is reduced.

D. Length. Patch cords of the shortest appropriate length shall be used.

PART 3 – EXECUTION

3.1 IMPLEMENTATION.

A. Patch cords shall not be used to connect equipment in different server cabinets.

B. Patch cords shall be neatly installed using cable management equipment and following cable management principles.

C. Upon installation patch cords shall be labeled in accordance with the requirements of the VA Infrastructure Standard for Telecommunications Spaces.

- - - E N D - - -

SECTION 27 51 16
PUBLIC ADDRESS AND MASS NOTIFICATION SYSTEMS

PART 1 – GENERAL

1.1 SECTION SUMMARY

A. Work covered by this document includes design, engineering, labor, material and products, equipment warranty and system warranty, and services for, and incidental to, the complete installation of new and fully operating National Fire Protection Association (NFPA) – Life Safety Code 101.3-2 (a) Labeled and (b) Listed Emergency Service Public Address System (PAS) and associated equipment (here-in-after referred to as the System) in approved locations indicated on the contract drawings. These items shall be tested and certified capable of receiving, distributing, interconnecting and supporting PAS communications signals generated local and remotely as detailed herein.

B. Work shall be complete, Occupational Safety and Health Administration (OSHA), National Recognized Testing Laboratory (NRTL – i.e. Underwriters Laboratory [UL]) Listed and Labeled; and VA Central Office (VACO), Telecommunications Voice Engineering (TVE 005OP3B) tested, certified and ready for operation.

C. The System shall be delivered free of engineering, manufacturing, installation, and functional defects. It shall be designed, engineered and installed for ease of operation, maintenance, and testing.

D. The term "provide", as used herein, shall be defined as: designed, engineered, furnished, installed, certified, and tested, by the Contractor.

E. Specification Order of Precedence: In the event of a conflict between the text of this document and the Project's Contract Drawings outlined and/or cited herein; THE TEXT OF THIS DOCUMENT TAKES PRECEDENCE. *HOWEVER, NOTHING IN THIS DOCUMENT WILL SUPERSEDE APPLICABLE EMERGENCY LAWS AND REGULATIONS,* SPECIFICALLY NATIONAL AND/OR LOCAL LIFE AND PUBLIC SAFETY CODES. The Local Fire Marshall and/or VA Public Safety Officer are the only authorities that may modify this document's EMERGENCY CODE COMPLIANCE REQUIREMENTS, on a case by case basis, in writing and confirmed by VA's PM, COR and TVE-005OP3B. *The VA PM is the only approving authority* for other amendments to this document that may be granted, on a case by case basis, in writhing with technical

concurrencies by VA's COR, TVE-005OP3B and identified Facility Project Personnel.

F. The Original Equipment Manufacturer (OEM) and Contractor shall ensure ***that all*** management, sales, engineering and installation personnel have read and understand the requirements of this specification ***before*** the system is designed, engineered, delivered and provided. The Contractor shall furnish a written statement attesting this requirement as a part of the technical submittal that includes each name and certification, including the OEMs.

1.2 RELATED SECTIONS

A. 01 33 23 – Shop Drawings, Product Data and Samples.

B. 07 84 00 – Firestopping.

C. 26 05 19 – Low – Voltage Electrical Power Conductors and Cables (600 Volts and Below).

E. 27 05 11 – Requirements for Communications Installations.

F. 27 05 26 – Grounding and Bonding for Communications Systems.

G. 27 05 33 – Raceways and Boxes for Communications Systems.

H. 27 10 00 – Structured Cabling.

I. 27 15 13 – Communications Copper Horizontal Cabling.

1.3 DEFINITIONS

A. Provide: Design, engineer, furnish, install, connect complete, test, certify and warranty.

B. Work: Materials furnished and completely installed.

C. Review of contract drawings: A service by the engineer to reduce the possibility of materials being ordered which do not comply with contract documents. The engineer's review shall not relieve the Contractor of responsibility for dimensions or compliance with the contract documents. The reviewer's failure to detect an error does not constitute permission for the Contractor to proceed in error.

D. Headquarters Technical Review, for National and VA communications and security, codes, frequency licensing, standards, guidelines compliance:

Office of Telecommunications
Special Communications Team (005OP2B)
1335 East West Highway – 3rd Floor
Silver Spring, Maryland 20910
(O) 301-734-0350, (F) 301-734-0360

H. Contractor: Radio Contractor; you; successful bidder

1.4 REFERENCES

A. The installation shall comply fully with all governing authorities, laws and ordinances, regulations, codes and standards, including, but not limited to:

1. United States Federal Law:

a. Departments of:

1) Commerce, Consolidated Federal Regulations (CFR), Title 15 – Under the Information Technology Management Reform Act (Public Law 104-106), the Secretary of Commerce approves standards and guidelines that are developed by the:

a) Chapter II, National Institute of Standards Technology (NIST – formerly the National Bureau of Standards). Under Section 5131 of the Information Technology Management Reform Act of 1996 and the Federal Information Security Management Act of 2002 (Public Law 107-347), NIST develops – Federal Information Processing Standards Publication (FIPS) 140-2—Security Requirements for Cryptographic Modules.

b) Chapter XXIII, National Telecommunications and Information Administration (NTIA – aka 'Red Book') Chapter 7.8 / 9; CFR, Title 47 Federal communications Commission (FCC) Part 15, Radio Frequency Restriction of Use and Compliance in "Safety of Life" Functions & Locations

2) FCC – Communications Act of 1934, as amended, CFR, Title 47 – Telecommunications, in addition to Part 15 – Restrictions of use for Part 15 listed Radio Equipment in Safety of Life / Emergency Functions / Equipment/ Locations (also see CFR, Title 15 – Department of Commerce, Chapter XXIII – NTIA):

a) Part 15 – Restrictions of use for Part 15 listed Radio Equipment in Safety of Life / Emergency Functions / Equipment/Locations.

b) Part 58 – Television Broadcast Service.

c) Part 90 – Rules and Regulations, Appendix C.

d) Form 854 – Antenna Structure Registration.

3) Health, (Public Law 96-88), CFR, Title 42, Chapter IV Health & Human Services, CFR, Title 46, Subpart 1395(a)(b) JCAHO "a hospital that meets JCAHO accreditation is deemed to meet the Medicare conditions of Participation by meeting Federal Directives:"
   a) All guidelines for Life, Personal and Public Safety; and, Essential and Emergency Communications.
4) Labor, CFR, Title 29, Part 1910, Chapter XVII – Occupational Safety and Health Administration (OSHA), Occupational Safety and Health Standard:
   a) Subpart 7 – Definition and requirements (for a NRTL – 15 c's, for complete list, contact (http://www.osha.gov/dts/otpca/nrtl/faq_nrtl.html):
      1) UL:
         a) 44-02 – Standard for Thermoset-Insulated Wires and Cables.
         b) 65 – Standard for Wired Cabinets.
         c) 83-03 – Standard for Thermoplastic-Insulated Wires and Cables.
         d) 467-01 – Standard for Electrical Grounding and Bonding Equipment
         e) 468 – Standard for Grounding and Bonding Equipment.
         f) 486A-01 – Standard for Wire Connectors and Soldering Lugs for Use with Copper Conductors
         g) 486C-02 – Standard for Splicing Wire Connectors.
         h) 486D-02 – Standard for Insulated Wire Connector Systems for Underground Use or in Damp or Wet Locations.
         i) 486E-00 – Standard for Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors.
         j) 493-01 – Standard for Thermoplastic-Insulated Underground Feeder and Branch Circuit Cable.
         k) 514B-02 – Standard for Fittings for Cable and Conduit.
         l) 1069 – Hospital Signaling and Nurse Call Equipment.
         m) 1333 – Vertical (Riser) Fire Rating.

n) 1449 - Standard for Transient Voltage Surge Suppressors.
o) 1479-03 - Standard for Fire Tests of Through-Penetration Fire Stops.
p) 1863 - Standard for Safety, Communications Circuits Accessories.
q) 2024 - Standard for Optical Fiber Raceways.
r) 60950-1/2 - Information Technology Equipment - Safety.

2) Canadian Standards Association (CSA): same tests as for UL.
3) Communications Certifications Laboratory (CCL): same tests as for UL.
4) Intertek Testing Services NA, Inc. (ITSNA formerly Edison Testing Laboratory [ETL]): same tests as for UL.

b) Subpart 35 - Compliance with NFPA 101 - Life Safety Code.
c) Subpart 36 - Design and construction requirements for exit routes.
d) Subpart 268 - Telecommunications.
e) Subpart 305 - Wiring methods, components, and equipment for general use.

5) Department of Transportation, CFR, Title 49 (Public Law 89-670), Part 1, Subpart C - Federal Aviation Administration (FAA):
a) Standards AC 110/460-ID & AC 707 / 460-2E - Advisory Circulars for Construction of Antenna Towers.
b) Forms 7450 and 7460-2 - Antenna Construction Registration.

6) Veterans Affairs (Public Law No. 100-527), CFR, Title 38, Volumes I & II:
a) Office of Telecommunications:
1) Handbook 6100 - Telecommunications.
a) Spectrum Management FCC & NTIA Radio Frequency Compliance and Licensing Program.
b) Special Communications Proof of Performance Testing, VACO Compliance and Life Safety Certification(s).

b) Office of Cyber and Information Security (OCIS):

1) Handbook 6500 – Information Security Program.
2) Wireless and Handheld Device Security Guideline Version 3.2, August 15, 2005.

c) VA's National Center for Patient Safety – Veterans Health Administration Warning System, Failure of Medical Alarm Systems using Paging Technology to Notify Clinical Staff, July 2004.

d) VA's Center for Engineering Occupational Safety and Health, concurrence with warning identified in VA Directive 7700.

e) Office of Construction and Facilities Management (CFM):
1) Master Construction Specifications (PG-18-1).
2) Standard Detail and CAD Standards (PG-18-4).
3) Equipment Guide List (PG-18-5.
4) Electrical Design Manual for VA Facilities (PG 18-10), Articles 7 & 8.
5) Minimum Requirements of A/E Submissions (PG 18-15):
a) Volume B, Major New Facilities, Major Additions; and Major Renovations, Article VI, Paragraph B.
b) Volume C – Minor and NRM Projects, Article III, Paragraph S.
c) Volume E – Request for Proposals Design/Build Projects, Article II, Paragraph F.
6) Mission Critical Facilities Design Manual (Final Draft – 2007).
7) Life Safety Protected Design Manual (Final Draft – 2007).
8) Solicitation for Offerors (SFO) for Lease Based Clinics – (05-2009).

b. Federal Specifications (Fed. Specs.):
1) A-A-59544-00 – Cable and Wire, Electrical (Power, Fixed Installation).

2. United States National Codes:
a. American Institute of Architects (AIA): Guidelines for Healthcare Facilities.

b. American National Standards Institute/Electronic Industries Association/Telecommunications Industry Association (ANSI/EIA/TIA):
   1) 568-B - Commercial Building Telecommunications Wiring Standards:
      a) B-1 - General Requirements.
      b) B-2 - Balanced twisted-pair cable systems.
      c) B-3 - Fiber optic cable systems.
   2) 569 - Commercial Building Standard for Telecommunications Pathways and Spaces.
   3) 606 - Administration Standard for the Telecommunications Infrastructure of Communications Buildings.
   4) 607 - Commercial Building Grounding and Bonding Requirements for Telecommunications.
   5) REC 127-49 - Power Supplies.
   6) RS 160-51 - Sound systems.
   7) RS 270 - Tools, Crimping, Solderless Wiring Devices, Recommended Procedures for User Certification.
   8) SE 101-A49 - Amplifier for Sound Equipment
   9) SE 103-49 - Speakers for Sound Equipment

c. American Society of Mechanical Engineers (ASME):
   1) Standard 17.4 - Guide for Emergency Personnel.
   2) Standard 17.5 - Elevator & Escalator Equipment (prohibition of installing non-elevator equipment in Elevator Equipment Room / Mechanical Penthouse).

d. American Society of Testing Material (ASTM):
   1) D2301-04 - Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape.

e. Building Industries Communications Services Installation (BICSI):
   1) All standards for smart building wiring, connections and devices for commercial and medical facilities.
   2) Structured Building Cable Topologies.
   3) In consort with ANSI/EIA/TIA.

f. Institute of Electrical and Electronics Engineers (IEEE):
   1) SO/TR 21730:2007 - Use of mobile wireless communication and computing technology in healthcare facilities -

Recommendations for electromagnetic compatibility (management of unintentional electromagnetic interference) with medical devices.

2) 0739-5175/08/©2008 IEEE - Medical Grade - Mission Critical - Wireless Networks.

3) C62.41 - Surge Voltages in Low-Voltage AC Power Circuits.

g. NFPA:

1) 70 - National Electrical Code (current date of issue) - Articles 517, 645 & 800.

2) 75 - Standard for Protection of Electronic Computer Data-Processing Equipment.

3) 77 - Recommended Practice on Static Electricity.

4) 99 - Healthcare Facilities.

5) 101 - Life Safety Code.

6) 1600 - Disaster Management, Chapter 5.9 - Communications and Warning

3. State Hospital Code(s).

4. Local Town, City and/or County Codes.

5. Accreditation Organization(s):

a. Joint Commission on Accreditation of Hospitals Organization (JCAHO) - Section VI, Part 3a - Operating Features.

1.5 QUALIFICATIONS

A. The OEM shall have had experience with three (3) or more installations of systems of comparable size and complexity with regards to type and design as specified herein. Each of these installations shall have performed satisfactorily for at least one (1) year after final acceptance by the user. Include the names, locations and point of contact for these installations as a part of the submittal.

B. The Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of three (3) years. The Contractor shall be authorized by the OEM to pass thru the OEM's warranty of the installed equipment to VA. In addition, the OEM and Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the System. This documentation, along with

the System Contractor and OEM certifications must be provided in writing as part of the Contractor's Technical submittal.

C. The Contractor's Communications Technicians assigned to the System shall be fully trained, qualified, and certified by the OEM on the engineering, installation, operation, and testing of the System. The Contractor shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the COR before being allowed to commence work on the System.

D. The Contractor shall display all applicable national, state and local licenses.

E. The Contractor shall submit copy (s) of Certificate of successful completion of OEM's installation/training school for installing technicians of the System's PA equipment being proposed.

1.6 CODES AND PERMITS

A. Provide all necessary permits and schedule all inspections as identified in the contract's milestone chart, so that the system is proof of performance tested and ready for operation on a date directed by the Owner.

B. The contractor is responsible to adhere to all codes described herein and associated contractual, state and local codes.

C. The Contractor shall display all applicable national, state and local licenses and permits.

1.7 SCHEDULING

A. After the award of contract, the Contractor shall prepare a detailed schedule (aka milestone chart) using "Microsoft Project" software or equivalent. The Contractor Project Schedule (CPS) shall indicate detailed activities for the projected life of the project. The CPS shall consist of detailed activities and their restraining relationships. It will also detail manpower usage throughout the project.

B. It is the responsibility of the Contractor to coordinate all work with the other trades for scheduling, rough-in, and finishing all work specified. The owner will not be liable for any additional costs due to missed dates or poor coordination of the supplying contractor with other trades.

1.8 REVIEW OF CONTRACT DRAWINGS AND EQUIPMENT DATA SUBMITTALS

(Note: The Contractor is encouraged, but not required, to submit separate technical submittal(s) outlining alternate technical approach(s) to the system requirements stated here-in as long as each alternate technical document(s) is complete, separate, and submitted in precisely the same manner as outlined herein. VA will review and rate each received alternate submittal, which follows this requirement, in exactly the same procedure as outlined herein. Partial, add-on, or addenda type alternates will not be accepted or reviewed.)

A. Submit at one time within 10 days of contract awarding, drawings and product data on all proposed equipment and system. Check for compliance with contract documents and certify compliance with Contractor's "APPROVED" stamp and signature.

B. Support all submittals with descriptive materials, i.e., catalog sheets, product data sheets, diagrams, and charts published by the manufacturer. These materials shall show conformance to specification and drawing requirements.

C. Where multiple products are listed on a single cut-sheet, circle or highlight the one that you propose to use. Provide a complete and through equipment list of equipment expected to be installed in the system, with spares, as a part of the submittal. Special Communications (TVE-005OP3B) will not review any submittal that does not have this list.

D. Provide four (4) copies to the PM for technical review. The PM will provide a copy to the offices identified in Paragraph 1.3.C & D, at a minimum for compliance review as described herein where each responsible individual(s) shall respond to the PM within 10 days of receipt of their acceptance or rejection of the submittal(s).

E. Provide interconnection methods, conduit (where not already installed), junction boxes (J-Boxes), cable, interface fixtures and equipment lists for the: approved TCO locations Telecommunications Infrastructure Plant (TIP) interface distribution layout drawing, as they are to be installed and interconnected to each other (REFER TO APPENDIX B - SUGGESTED TELECOMMUNI-CAITONS ONE LINE TOPOLOGY pull-out drawing).

F. Equipment OEM technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.

G. Engineering drawings of the System, showing calculated of expected signal levels at the headend input and output, each input and output distribution point, and signal level at each telecommunications outlet.

H. Surveys Required as a Part of The Technical Submittal:

1. The Contractor shall provide the following System survey(s) that depict various system features and capacities required *in addition to* the on-site survey requirements described herein. Each survey shall be in writing and contain the following information (the formats are suggestions and may be used for the initial Technical Submittal Survey requirements), as a minimum:

a. PA Cable System Design Plan:

1) An OEM and contractor designed functioning PA System cable plan to populate the entire TIP empty conduit/pathway distribution systems shall be provided as a part of the technical proposal. A specific functioning PA: cable, interfaces, J-boxes and back boxes shall coincide with the total growth items as described herein. It is the Contractor's responsibility to provide the Systems' entire PA cable and accessory requirements and engineer a functioning PA distribution system and equipment requirement plan of the following paragraph(s), at a minimum:

2) The required PA Equipment Locations:

EQUIPPED ITEM	**CAPACITY**	**GROWTH**
Master Control Stations		
Telephone Operators Room		
Police Control Room		
Other		
Zone Amplifiers		
All Call (complete Zone 1)		
Admissions (Zone 2)		
Entrance (Zone 2a)		
Pharmacy Dispensing (Zone 2a)		
Agent Cashier (Zone 2a)		
Other (Zone 2a)		
Labs (Zone 3)		

10-01-18

EQUIPPED ITEM	CAPACITY	GROWTH
Blood (Zone 3a)		
Dissecting (Zone 3a)		
Other (Zone 3a)		
Clinics (Zone 4)		
Dental (Zone 4a)		
Radiology (Zone 4a)		
Oncology (Zone 4a)		
Other (Zone 4a)		
// _____ (Zone 5)		
_____ (Zone 5a)		
_____ (Zone 5a)		
Other (Zone 5a)		
Spare (Zones 6, 7 & 8)		
Other (Zone __) //		
Supervisory Panel(s)		
Trouble Panel(s)		
Locations		
Speakers		
Overhead		
Locations		
Other		
Other		
Outside		
Locations		
Other		
Horn		
Locations		
Other		
Power Supply(s)		
Location		

EQUIPPED ITEM	CAPACITY	GROWTH
Other		
UPS(s)		
Location		
Other		
Radio Paging Access **(when pre-approved by TVE-005OP3B)**		
Wireless Access **(when pre-approved by TVE-005OP3B)**		
Maintenance/Programming Console		
Location(s)		
Other		

3) The required PA Cable Plant/Connections:

The Contractor shall clearly and fully indicate this category for each item identified herein as a part of the technical submittal. For this purpose, the following definitions and sample connections are provided to detail the system's capability:

EQUIPPED ITEM	CAPACITY	GROWTH
Central Control Cabinet/Equipment		
Location		
Power Supply(s)		
UPS(s)		
Essential Electrical Power Panel(s)		
Other		
Cable Plant		
Supply to Locations Identified herein		
Speaker Locations		
Remote Locations		
Telephone Operator Room		
Police Control Room		
Other		
Maintenance/Program Console		

EQUIPPED ITEM	CAPACITY	GROWTH
Location(s)		
Other		
LAN (Local Facility) Access/Equipment/Location **(when pre-approved by TVE-005OP3B)**		
Wireless Access/Equipment/Location **(when pre-approved by TVE-005OP3B)**		
Other		

1.9 PROJECT RECORD DOCUMENTS (AS BUILTS)

A. Throughout progress of the Work, maintain an accurate record of changes in Contract Documents. Upon completion of Work, transfer recorded changes to a set of Project Record Documents.

B. The floor plans shall be marked in pen to include the following:

1. All device locations with UL labels affixed.
2. Conduit locations.
3. Head-end equipment and specific location.
4. Each interface and equipment specific location.
5. Telecommunication Outlet (s -TCO) equipment and specific location
6. TIP Wiring diagram(s).
7. Warranty certificate.
8. System test results.
9. System Completion Document(s) or MOU.

1.10 WARRANTIES / GUARANTY

A. The Contractor shall warrant the installation to be free from defect in material and workmanship for a period of two (2) years from the date of acceptance of the project by the owner. The Contractor shall agree to remedy covered defects within four (4) hours of notification of major failures or within twenty-four (24) hours of notification for individual station related problems.

B. The Contractor shall agree to grantee the system according to the guidelines outlined in Article 4 herein.

1.11 USE OF THE SITE

A. Use of the site shall be at the GC's direction.

B. Coordinate with the GC for lay-down areas for product storage and administration areas.

C. Coordinate work with the GC and their sub-contractors.

D. Access to buildings wherein the work is performed shall be directed by the GC.

1.12 DELIVERY, STORAGE, AND HANDLING

A. Deliver, store, and handle products using means and methods that will prevent damage, deterioration, and loss, including theft.

B. Store products in original containers.

C. Coordinate with the GC for product storage. There may be little or no storage space available on site. Plan to potentially store materials off site.

D. Do not install damaged products. Remove damaged products from the site and replaced with new product at no cost to the Owner.

1.13 PROJECT CLOSE-OUT

A. Prior to final inspection and acceptance of the work, remove all debris, rubbish, waste material, tools, construction equipment, machinery and surplus materials from the project site and thoroughly clean your work area.

B. Before the project closeout date, the Contractor shall submit:

1. Warranty certificate.
2. Evidence of compliance with requirements of governing authorities such as the Low Voltage Certificate of Inspection.
3. Project record documents.
4. Instruction manuals and software that is a part of the system.

C. Contractor shall submit written notice that:

1. Contract Documents have been reviewed.
2. Project has been inspected for compliance with contract.
3. Work has been completed in accordance with the contract.

PART 2 - PRODUCTS / FUNCTIONAL REQUIREMENTS

2.0 GENERAL REQUIREMENTS FOR EQUIPMENT AND MATERIALS

A. The specific location for each PA: Central Control Cabinet is existing located in Building 1, third floor, room Tenant IT Space 3435.

B. Coordinate features and select interface components to form an integrated PA system. Match components and interconnections between the systems for optimum performance of specified functions.

C. Expansion Capability: The PA equipment interfaces and cables shall be able to increase number of enunciation points in the future by a

minimum of 50 percent (%) above those indicated without adding any internal or external components or main trunk cable conductors.

D. Equipment: Active electronic type shall use solid-state components, fully rated for continuous duty unless otherwise indicated. Select equipment for normal operation on input power usually supplied between 110 to 130 VAC, 60 Hz.

E. Meet all FCC requirements regarding low radiation and/or interference of RF signal(s). The system shall be designed to prevent direct pickup of signals from within and outside the building structure.

F. Deliver a fully functioning and operable PA in the specific locations shown on the drawings.

2.1 SYSTEM DESCRIPTION

A. Furnish and install a complete and fully functional and operable HF Radio System.

B. The Contractor shall continually employ interfacing methods that are approved by the OEM and VA. At a minimum, an acceptable interfacing method requires not only a physical and mechanical connection, but also a matching of signal, voltage, and processing levels with regard to signal quality and impedance. The total PA system shall be configured and installed so that the combination of equipment actually employed does not produce any undesirable visual or aural effects such as signal distortions, noise pulses, glitches, hum, transients, images, etc. The interface points must adhere to all standards described herein for the full separation of Critical Care and Life Safety systems.

C. It is not acceptable to utilize the telephone cable system for the control of radio signals and equipment. The System Contractor shall connect the Telephone System Remote Control System to the Radio System Paging Control Unit ensuring that all NFPA and UL Critical Care and Life Safety Circuit and System separation guidelines are satisfied. The System Contractor is not allowed to make any connections to the Telephone System. The Owner shall arrange for the interconnection between the PA and Telephone Systems with the appropriate responsible parties.

D. System hardware shall consist of a an extension of and interface with existing VAMC as shown on drawings. All necessary equipment required to meet the intent of these specifications, whether or not enumerated

within these specifications, shall be supplied and installed to provide a complete and operating nurse/patient communications network.

E. The System shall interface with the Facility's existing PAS so that a global page (aka "all call" page) is communicated to the existing PAS and the new System of this project. Arrangements for interconnection of the System and the telephone system(s) shall be coordinated with the owner and the PBX provider.

F. The system shall be designed to provide continuous electrical supervision of the complete and entire system (i.e. wires, contact switch connections, audio, and communication busses, etc.). All alarm initiating and signaling circuits shall be supervised for open circuits, short circuits, and system grounds.

G. All passive distribution equipment shall meet or exceed -80 dB radiation shielding (aka RFI) shielding specifications and be provided with screw type audio connectors.

H. All equipment face plates utilized in the system shall be stainless steel, anodized aluminum.

I. All trunk, branch, and interconnecting cables and unused equipment ports or taps shall be terminated with proper terminating resistors designed for RF, audio and digital cable systems without adapters.

J. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. Unless otherwise noted in this Part, equipment quantities shall be as indicated on the drawings.

2.2 SYSTEM PRFORMANCE:

A. At a minimum, each distribution, interconnection, interface, terminating point and TCO shall be capable of supporting the Facility's PA system voice and data service as follows:

1. Shall be compliant with and not degrade the operating parameters of the Public Switched Telephone Network (PSTN) and the Federal Telecommunications System (FTS) at each PSTN and FTS interface, interconnection and terminating locations in the TERs.
2. Audio Output: The audio signal level at each speaker shall be a MINIMUM of +0.25 Watt (W) and a maximum of +20 W, 600 Ohms balanced impedance, on a 70.7 V audio distribution line Contractor to determine and set each speaker's proper audio signal level (top)

based on speaker location and the ambient noise level in speaker coverage area.

3. The system shall meet the following MINIMUM parameters at each speaker:
   a. Cross Modulation: -46 dB
   b. Hum Modulation: -55 dB
   c. Isolation (outlet-outlet): 24 dB
   d. Impedance:
      1) Distribution: 600 Ohm balanced @ 70.7 V audio line level.
      2) Speaker: Selectable, as required.
   e. Audio Gain: 10 dB minimum @ mid-range measured with a sound pressure level meter (SPL)
   f. Signal to noise (S/N) ratio: 35 dB, minimum

2.3 MANUFACTURERS

A. The products specified shall be new, FCC and UL Listed, labeled and produced by OEM of record. An OEM of record shall be defined as a company whose main occupation is the manufacture for sale of the items of equipment supplied and which:
   1. Maintains a stock of replacement parts for the item submitted,
   2. Maintains engineering drawings, specifications, and operating manuals for the items submitted, and
   3. Has published and distributed descriptive literature and equipment specifications on the items of equipment submitted at least 30 days prior to the Invitation for Bid (IFB).

B. Specifications contained herein as set forth in this document detail the salient operating and performance characteristics of equipment in order for VA to distinguish acceptable items of equipment from unacceptable items of equipment. When an item of equipment is offered or furnished for which there is a specification contained herein, the item of equipment offered or furnished shall meet or exceed the specification for that item of equipment.

C. Equipment Standards and Testing:
   1. The System has been defined herein as connected to systems identified as an Emergency performing Public Safety Support Functions. Therefore, at a minimum, the system shall conform to all aforementioned National and/or Local Public and Life Safety Codes

(which ever are the more stringent), NFPA, NEC, this specification, JCAHCO Life Safety Accreditation requirements, and the OEM recommendations, instructions, and guidelines.

2. All supplies and materials shall be listed, labeled or certified by UL or a nationally recognized testing laboratory (NRTL) where such standards have been established for the supplies, materials or equipment.
3. The provided equipment required by the System design and approved technical submittal must conform with each UL standard in effect for the equipment, as of the date of the technical submittal (or the date when the COR approved system equipment necessary to be replaced) was technically reviewed and approved by VA. Where a UL standard is in existence for equipment to be used in completion of this contract, the equipment must bear the approved UL seal.
4. Each item of electronic equipment to be provided under this contract must bear the approved UL seal or the seal of the testing laboratory that warrants the equipment has been tested in accordance with, and conforms to the specified standards. The placement of the UL Seal shall be a permanent part of the electronic equipment that is not capable of being transportable from one equipment item to another.

2.4 PRODUCTS

A. General.

1. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. The equipment quantities provided herein shall be as indicated on the drawings with the exception of the indicated spare equipment.
3. Contractor Furnished Equipment List (CFEs):
   a. The Contractor is required to provide a list of the CFE equipment to be furnished. The quantity, make and model number of each item is required. Select the required equipment items quantities that will satisfy the needs of the system as described herein and with the OEM's concurrence applied to the list(s), in writing.
   b. The following equipment items are the minimum requirements of VA to provide an acceptable system described herein:

Item	Quantity	Unit

1.	//As required//	Interface Panel(s)
1.a	//As required//	Electrical Supervision Trouble Enunciator
1.a.1.	//As required//	Equipment Back Box(s)
1.a.2.	//As required//	Telephone Access Equipment
1.a.3.	//As required//	Radio Paging Access Equipment
1.a.3.a.	//As required//	Radio Pager Equipment
1.a.4.	//As required//	Wireless Access Equipment
1.a.5.	//As required//	Personal Communicator Equipment
2.	//As required//	Lightning Arrestor
3.	//As required//	Head End Equipment Locations
3.a	//As required//	Cabinet(s)
3.a.1.	//As required//	AC Power Conditioner & Filter
3.a.2.	//As required//	AC Power Strip
3.a.3.	//As required//	UPS
3.a.3.a	//As required//	Main Power Amplifiers
3.a.3.b	//As required//	Remote Power Amplifiers
3.a.3.c	//As required//	Distributed Amplifiers (When Approved)
3.a.4.	//As required//	Interconnecting wire Cable(s)
3.a.4.a	//As required//	Wire Cable Connector(s)
3.a.4.b	//As required//	Wire Cable Terminator(s)
3.a.4.c	//As required//	Wire Management System
3.b.	//As required//	Head End Function(s)
4.	//As required//	Distribution System(s)
4.a	//As required//	Equipment Back Box(s)
4.a.1.	//As required//	Speakers
4.a.1.a	//As required//	Overhead
4.a.1.b	//As required//	Horn
4.a.1.c	//As required//	Outside
4.a.1.d	//As required//	Speaker w/ Microphone
5.	2 (MIN)	Remote Station(s)
5.a.	//As required//	Spare Items
6.	//As required//	Mental Health Unit
6.a.	//As required//	Interface Panel(s)
6.b.	//As required//	Electrical Supervision Trouble Enunciator
6.c.	//As required//	Equipment Back Box(s)
6.d.	//As required//	Telephone Access Equipment
6.e.	//As required//	Radio Paging Access Equipment
6.e.1.	//As required//	Radio Pager Equipment
6.f.	//As required//	Wireless Access Equipment
6.g.	//As required//	Personal Communicator Equipment
6.h.	//As required//	Lightning Arrestor
6.i.	//As required//	Head End Equipment Location(s)
6.i.1.	//As required//	Cabinets
6.i.2.	//As required//	AC Power Conditioner & Filter
6.i.3.	//As required//	AC Power Strip
6.i.4.	//As required//	UPS
6.i.5.	//As required//	Main Power Amplifiers
6.j.	//As required//	Remote Power Amplifiers

6.k.	//As required//	Distributed Amplifiers (When Approved)
6.l.	//As required//	Interconnecting Wire Cable(s)
6.l.1.	//As required//	Wire Cable Connector(s)
6.l.2.	//As required//	Wire Cable Terminator(s)
6.l.3.	//As required//	Wire Management System
6.m.	//As required//	Head End Function(s)
6.n.	//As required//	Distribution System(s)
6.n.1	//As required//	Equipment Back Box(S)
6.n.2	//As required//	Speakers
6.n.2(a)	//As required//	Overhead
6.n.2(b)	//As required//	Horn
6.n.2(c)	//As required//	Outside
6.n.2(d)	//As required//	Speaker w/ Microphone
6.o	2 (MIN)	Remote Station(s)
6.p.	//As required//	Spare Items
//7.	**//As required//**	**Blind Rehabilitation Unit//**
7.a	**//As required//**	**Interface Panel(s)**
7.b	**//As required//**	**Electrical Supervision Trouble Enunciator**
7.c	**//As required//**	**Equipment Back Box(s)**
7.d.	**//As required//**	**Telephone Access Equipment**
7.e.	**//As required//**	**Radio Paging Access Equipment**
7.e.1.	**//As required//**	**Radio Pager Equipment**
7.f.	**//As required//**	**Wireless Access Equipment**
7.g.	**//As required//**	**Personal. Communicator Equipment**
7.h.	**//As required//**	**Lightning Arrestor**
7.i.	**//As required//**	**Head End Equipment Location(s)**
7.i.1.	**//As required//**	**Cabinets**
7.i.2.	**//As required//**	**AC Power Conditioner & Filter**
7.i.3.	**//As required//**	**AC Power Strip**
7.i.4.	**//As required//**	**UPS**
7.i.5.	**//As required//**	**Main Power Amplifiers**
7.j.	**//As required//**	**Remote Power Amplifiers**
7.k.	**//As required//**	**Distributed Amplifiers (When Approved)**
7.l.	**//As required//**	**Interconnecting Wire Cable(s)**
7.l.1.	**//As required//**	**Wire Cable Connector(s)**
7.l.2.	**//As required//**	**Wire Cable Terminator(s)**
7.l.3.	**//As required//**	**Wire Management System**
7.k.	**//As required//**	**Head End Function(s)**
7.m.	**//As required//**	**Distribution System(s)**
7.m.1.	**//As required//**	**Equipment Back Box(s)**
7.m.2.	**//As required//**	**Speakers**
7.m.2(a)	**//As required//**	**Overhead**
7.m.2(b)	**//As required//**	**Horn**
7.m.2(c)	**//As required//**	**Outside**
7.m.2(d)	**//As required//**	**Speaker w/ Microphone**
7.n.	**2 (MIN)**	**Remote Station(s)**
7.o.	**//As required//**	**Spare Items**

//8. //As required// Oncology, Radiology, Dialysis, Units (These units are treated the same as Blind Rehabilitation Unit EXCEPT it does contains a CODE BLUE Function. If these units are provided as a part of the project, AT A MINIMUM – DUPLI-CATE THE BLINE REHABILITATION UNIT'S EQUIPMETN LISTE AND EDIT AND RENUMBER ACCORD-INGLY)//

B. TIP DISTRIBUTION SYSTEM:

1. System Speakers:

a. Ceiling Cone-Type:

1) Minimum Axial Sensitivity: 91 dB at one meter, with 1-W input.

2) Frequency Response: Within plus or minus 3 dB from 70 to 15,000 Hz.

3) Minimum Dispersion Angle: 100 degrees.

4) Line Transformer: Maximum insertion loss of 0.5 dB, power rating equal to speaker's, and at least four level taps.

5) Enclosures: Steel housings or back boxes, acoustically dampened, with front face of at least 0.0478-inch steel and whole assembly rust proofed and factory primed; complete with mounting assembly and suitable for surface ceiling, flush ceiling, pendant or wall mounting; with relief of back pressure.

6) Baffle: For flush speakers, minimum thickness of 0.032-inch aluminum with textured white finish. Completely fill the baffle with fiberglass.

7) Vandal-Proof, High-Strength Baffle: For flush-mounted speakers, self-aging cast aluminum with tensile strength of 44,000 psi, 0.025-inch minimum thickness; countersunk heat-treated alloy mounting screws; and textured white epoxy finish.

8) Size: 8 inches with 1-inch voice coil and minimum 5-oz. ceramic magnet.

9) Have a minimum of two (2) safety wires installed to a solid surface or use a flexible conduit from ceiling / wall back box to the speaker back box.

10) The speakers and mounting shall be self contained and wall mounted with flush back box at a minimum of 10 meter intervals and shall match (or contrast with, at the direction of the COR) the color of the adjacent surfaces.

11) Provide one spare speaker, mount, and back box for each 50 speakers or portion thereof.

b. System Cables: TIP Horizontal and Vertical Communications Cabling, provide the following additional TIP installation and testing requirements, provide the following minimum System TIP cables & interconnections:

2) Speaker Level (Audio 70.7Volt V) Cable, Riser Rated:

a) For use with 70.7 V audio speaker circuits.

b) 18 AWG stranded pair, minimum.

c) UL-1333 listed.

3) Speaker Level Audio Cable, Plenum Rated (70.7V):

a) For use with 70.7 V audio speaker circuits.

b) 18 AWG stranded pair, minimum.

2. Raceways, Back Boxes and conduit:

a. Raceways:

1) Provide the following additional TIP raceway and fittings:

2) Each raceway that is open top, shall be: UL certified for telecommunications systems, partitioned with metal partitions in order to comply with NEC Parts 517 & 800 to "mechanically separate telecommunications systems of different service, protect the installed cables from falling out when vertically mounted and allow junction boxes to be attached to the side to interface "drop" type conduit cable feeds.

3) Intercommunication System cable infrastructure: EMT above accessible ceilings, 24 inches on center.

4) Junction boxes shall be not less than 2-1/2 inches deep and 6 inches wide by 6 inches long.

5) Flexible metal conduit is prohibited unless specifically approved by 005OP3B.

b. System Conduit:

1) The PA system is NFPA listed as Emergency / Public Safety Communication System which requires the entire system to be installed in a separate conduit system.

2) The use of centralized mechanically partitioned wireways may be used to augment main distribution conduit on a case by case basis when specifically approved by VA Headquarters (005OP3B).

3) Conduit Sleeves:

a) The AE has made a good effort to identify where conduit sleeves through full-height and fire rated walls on the drawings, and has instructed the electrician to provide the sleeves as shown on the drawings.

b) While the sleeves shown on the drawings will be provided by others, the contractor is responsible for installing conduit sleeves and fire-proofing where necessary. It is often the case, that due to field conditions, the nurse-call cable may have to be installed through an alternate route. Any conduit sleeves required due to field conditions or those omitted by the engineer shall be provided by the cabling contractor.

3. Device Back Boxes:

a. Furnish to the electrical contractor all back boxes required for the PA system devices.

b. The electrical contractor shall install the back boxes as well as the system conduit. Coordinate the delivery of the back boxes with the construction schedule.

4. Telecommunication Outlets (TCO): Populate each TCO that is required to perform system operations in the locations that were provided and cabled as a part of Specifications Sections 27 11 00 and 27 15 00. Provide additional TCO equipment, interfaces and connections as required by System design. Provide secured pathway(s) and TCOs as required.

C. Installation Kit:

1. General: The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink

tubing, cable ties, solder, hangers, clamps, bolts, conduit, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. Turn over to the COR all unused and partially opened installation kit boxes, and twisted pair cable reels, conduit, , wire rolls, physical installation hardware. The following are the minimum required installation sub-kits:

2. System Grounding:
   a. The grounding kit shall include all cable and installation hardware required. All radio equipment shall be connected to earth ground via internal building wiring, according to the NEC.
   b. This includes, but is not limited to:
      3) Data Cable Shields.
      6) Conduits.
      10) Connector Panels.
      11) Grounding Blocks.
4. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
5. Conduit: The kit shall include all conduit, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
6. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
7. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to completely and correctly label each subsystem according to the OEM requirements, as-installed drawings, and this document.
8. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment,

maintenance, and operation manuals, and OEM materials needed to completely and correctly provide the system documentation as required by this document and explained herein.

PART 3 – EXECUTION

3.1 PROJECT MANAGEMENT

A. Assign a single project manager to this project who will serve as the point of contact for the Owner, the General Contractor, and the Engineer.

B. The Contractor shall be proactive in scheduling work at the hospital, specifically the Contractor will initiate and maintain discussion with the general contractor regarding the schedule for ceiling cover up and install cables to meet that schedule.

C. Contact the Office of Telecommunications, Special Communications Team (005OP3B) at (301) 734-0350 to have a VA Certified Telecommunications COR assigned to the project for telecommunications review, equipment and system approval and co-ordination with VA's Spectrum Management and OCIS Teams.

3.2 COORDINATION WITH OTHER TRADES

A. Coordinate with the cabling contractor the location of the PA system faceplate and the faceplate opening for the PA system back boxes.

B. Coordinate with the cabling contractor the location of TIP equipment in the **PA, HER and TCOs in order to connect to the TIP cable network that was installed. Contact the COR immediately, in writing, if additional location(s) are discovered to be activated that was not previously provided.**

C. Before beginning work, verify the location, quantity, size and access for the following:

1. Isolated ground AC power circuits provided for systems.
2. Junction boxes, wall boxes, wire troughs, conduit stubs and other related infrastructure for the systems.
3. System components installed by others.
4. Overhead supports and rigging hardware installed by others.

D. Immediately notify the Owner, GC and Consultant(s) in writing of any discrepancies

3.3 NEEDS ASSESSMENT

Provide a one-on-one meeting with the particular manager of each unit affected by the installation of the new PA system.

3.4 INSTALLATION

A. General

1. Execute work in accordance with National, State and local codes, regulations and ordinances.
2. Install work neatly, plumb and square and in a manner consistent with standard industry practice. Carefully protect work from dust, paint and moisture as dictated by site conditions. The Contractor will be fully responsible for protection of his work during the construction phase up until final acceptance by the Owner.
3. Install equipment according to OEM's recommendations. Provide any hardware, adaptors, brackets, rack mount kits or other accessories recommended by OEM for correct assembly and installation.
4. Secure equipment firmly in place, including receptacles, speakers, equipment racks, system cables, etc.
   a. All supports, mounts, fasteners, attachments and attachment points shall support their loads with a safety factor of at least 5:1.
   b. Do not impose the weight of equipment or fixtures on supports provided for other trades or systems.
   c. Any suspended equipment or associated hardware must be certified by the OEM for overhead suspension.
   d. The Contractor is responsible for means and methods in the design, fabrication, installation and certification of any supports, mounts, fasteners and attachments.
5. Locate overhead ceiling-mounted loudspeakers as shown on drawings, with minor changes not to exceed 12" in any direction.
   a. Mount transformers securely to speaker brackets or enclosures using screws. Adjust torsion springs as needed to securely support speaker assembly.
   b. Speaker back boxes shall be completely filled with fiberglass insulation.
   c. Seal cone speakers to their enclosures to prevent air passing from one side of the speaker to the other.

6. Finishes for any exposed work such as plates, racks, panels, speakers, etc. shall be approved by the Architect, Owner and 005OP3B.
7. Coordinate cover plates with field conditions. Size and install cover plates as necessary to hide joints between back boxes and surrounding wall. Where cover plates are not fitted with connectors, provide grommeted holes in size and quantity required. Do not allow cable to leave or enter boxes without cover plates installed.
8. Active electronic component equipment shall consist of solid state components, be rated for continuous duty service, comply with the requirements of FCC standards for telephone and data equipment, systems, and service.
9. Color code all distribution wiring to conform to the PA Industry Standard, EIA/TIA, and this document, whichever is the more stringent. At a minimum, all equipment, cable duct and/or conduit, enclosures, wiring, terminals, and cables shall be clearly and permanently labeled according to and using the provided record drawings, to facilitate installation and maintenance.
11. Product Delivery, Storage and Handling:
    a. Delivery: Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name and equipment catalog numbers, model and serial identification numbers. The COR may inventory the cable, patch panels, and related equipment.
    b. Storage and Handling: Store and protect equipment in a manner, which will preclude damage as directed by the COR.
12. Where TCOs are installed adjacent to each other, install one outlet for each instrument.
13. Equipment installed outdoors shall be weatherproof or installed in weatherproof enclosures with hinged doors and locks with two keys.

B. Wiring Practice – in addition to the MANDATORY infrastructure requirements the following additional practices shall be adhered too:
1. Comply with requirements for raceways and boxes specified in Division 26 Section "Raceway and Boxes for Electrical Systems."

2. Execute all wiring in strict adherence to the National Electrical Code, applicable local building codes and standard industry practices.
3. Wiring shall be classified according to the following low voltage signal types:
   a. Balanced microphone level audio (below -20dBm) or Balanced line level audio (-20dBm to +30dBm)
   b. 70V audio speaker level audio.
   c. Low voltage DC control or power (less than 48VDC)
4. Where raceway is to be EMT (conduit), wiring of differing classifications shall be run in separate conduit. Where raceway is to be an enclosure (rack, tray, wire trough, utility box) wiring of differing classifications which share the same enclosure shall be mechanically partitioned and separated by at least four (4) inches. Where Wiring of differing classifications must cross, they shall cross perpendicular to one another.
5. Do not splice wiring anywhere along the entire length of the run. Make sure cables are fully insulated and shielded from each other and from the raceway for the entire length of the run.
6. Do not pull wire through any enclosure where a change of raceway alignment or direction occurs. Do not bend wires to less than radius recommended by manufacturer.
7. Replace the entire length of the run of any wire or cable that is damaged or abraided during installation. There are no acceptable methods of repairing damaged or abraided wiring.
8. Use wire pulling lubricants and pulling tensions as recommended by the OEM.
9. Use grommets around cut-outs and knock-outs where conduit or chase nipples are not installed.
10. Do not use tape-based or glue-based cable anchors.
11. Ground shields and drain wires to the Facility's signal ground system as indicated by the drawings.
12. Field wiring entering equipment racks shall be terminated as follows:

a. Provide ample service loops at harness break-outs and at plates, panels and equipment. Loops should be sufficient to allow plates, panels and equipment to be removed for service and inspection.
b. Line level and speaker level wiring may be terminated inside the equipment rack using specified terminal blocks (see "Products.")
c. If specified terminal blocks are not designed for rack mounting, utilize ¾" plywood or 1/8" thick aluminum plates/blank panels as a mounting surface. Do not mount on the bottom of the rack.
d. Employ permanent strain relief for any cable with an outside diameter of 1" or greater.

13. Use only balanced audio circuits unless noted otherwise
14. Make all connections as follows:
    a. Make all connections using rosin-core solder or mechanical connectors appropriate to the application.
    b. For crimp-type connections, use only tools that are specified by the manufacturer for the application.
    c. Use only insulated spade lugs on screw terminals. Spade lugs shall be sized to fit the wire gauge. Do not exceed two lugs per terminal.
    d. Wire nuts, electrical tape or "Scotch Lock" connections are not acceptable for any application.
15. Make all connections as follows:
    a. Make all connections using rosin-core solder or mechanical connectors appropriate to the application.
    b. For crimp-type connections, use only tools that are specified by the manufacturer for the application.
    c. Use only insulated spade lugs on screw terminals. Spade lugs shall be sized to fit the wire gauge. Do not exceed two lugs per terminal.
    d. Wire nuts, electrical tape or "Scotch Lock" connections are not acceptable for any application.
17. Wires or cables **previously approved** to be installed outside of conduit, cable trays, wireways, cable duct, etc:
    a. Only when specifically authorized as described herein, will wires or cables be identified and approved to be installed outside of

conduit. The wire or cable runs shall be UL rated plenum and OEM certified for use in air plenums.

b. Wires and cables shall be hidden, protected, fastened and tied at 600 mm (24 in.) intervals, maximum, as described herein to building structure.

c. Closer wire or cable fastening intervals may be required to prevents sagging, maintain clearance above suspended ceilings, remove unsightly wiring and cabling from view and discourage tampering and vandalism. Wire or cable runs, not provided in conduit, that penetrate outside building walls, supporting walls, and two hour fire barriers shall be sleeved and sealed with an approved fire retardant sealant.

d. Wire or cable runs to system components installed in walls (i.e.: volume attenuators, circuit controllers, signal, or data outlets, etc.) may, when specifically authorized by the COR , be fished through hollow spaces in walls and shall be certified for use in air plenum areas.

e. Completely test all of the cables after installation and replace any defective cables.

f. Wires or cables that are installed outside of buildings shall be in conduit, secured to solid building structures. If specifically approved, on a case by case basis, to be run outside of conduit, the wires or cables shall be installed, as described herein. The bundled wires or cables must: Be tied at not less than 460 mm (18 in.) intervals to a solid building structure; have ultra violet protection and be totally waterproof (including all connections). The laying of wires or cables directly on roof tops, ladders, drooping down walls, walkways, floors, etc. is not allowed and will not be approved.

C. Cable Installation – In addition to the ***MANDATORY*** infrastructure requirements the following additional practices shall be adhered too:

1. Support cable on maximum 2’-0” centers. Acceptable means of cable support are cable trays. Velcro wrap cable bundles loosely to the means of support with plenum rated Velcro straps. Plastic tie wraps are not acceptable as a means to bundle cables.
2. Run cables parallel to walls.

3. Install maximum of 10 cables in a single row. Provide necessary rows as required by the number of cables.
4. Do not lay cables on top of light fixtures, ceiling tiles, mechanical equipment, or ductwork. Maintain at least 2'-0" clearance from all shielded electrical apparatus.
5. All cables shall be tested after the total installation is fully complete. All test results are to be documented. All cables shall pass acceptable test requirements and levels. Contractor shall remedy any cabling problems or defects in order to pass or comply with testing. This includes the re-pull of new cable as required at no additional cost to the Owner.
6. Ends of cables shall be properly terminated on both ends per industry and OEM's recommendations.
7. Provide proper temporary protection of cable after pulling is complete before final dressing and terminations are complete. Do not leave cable lying on floor. Bundle and tie wrap up off of the floor until you are ready to terminate.
8. Terminate all conductors; no cable shall contain unterminated elements. Make terminations only at outlets and terminals.
9. Splices, Taps, and Terminations: Arrange on numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures. Cables may not be spliced.
10. Bundle, lace, and train conductors to terminal points without exceeding OEM's limitations on bending radii. Install lacing bars and distribution spools.
11. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used.
12. Cable shall not be run through structural members or be in contact with pipes, ducts, or other potentially damaging items.
13. Separation of Wires: (REFER TO RACEWAY INSTALLATION) Separate speaker-microphone, line-level, speaker-level, and power wiring runs. Install in separate raceways or, where exposed or in same enclosure, separate conductors at least 12 inches apart for speaker microphones and adjacent parallel power and telephone wiring. Separate other intercommunication equipment conductors as recommended by equipment manufacturer.

14. Serve all cables as follows:
    a. Cover the end of the overall jacket with a 1" (minimum) length of transparent heat-shrink tubing. Cut unused insulated conductors 2" (minimum) past the heat-shrink, fold back over jacket and secure with cable-tie. Cut unused shield/drain wires 2" (minimum) past the Heatshrink and serve as indicated below.
    b. Cover shield/drain wires with heat-shrink tubing extending back to the overall jacket. Extend tubing ¼" past the end of unused wires, fold back over jacket and secure with cable tie.
    c. For each solder-type connection, cover the bare wire and solder connection with heat-shrink tubing.

D. Labeling: Provide labeling in accordance with ANSI/EIA/TIA-606-A. All lettering for PA circuits shall be stenciled using laser printers.
    1. Cable and Wires (Hereinafter referred to as "Cable"): Cables shall be labeled at both ends in accordance with ANSI/EIA/TIA-606-A. Labels shall be permanent in contrasting colors. Cables shall be identified according to the System "Record Wiring Diagrams."
    2. Equipment: System equipment shall be permanently labeled with contrasting plastic laminate or Bakelite material. System equipment shall be labeled on the face of the unit corresponding to its source.
        a. Clearly, consistently, logically and permanently mark switches, connectors, jacks, relays, receptacles and electronic and other equipment.
        b. Engrave and paint fill all receptacle panels using 1/8" (minimum) high lettering and contrasting paint.
        c. For rack-mounted equipment, use engraved Lamacoid labels with white 1/8" (minimum) high lettering on black background. Label the front and back of all rack-mounted equipment.
    3. Conduit: The Contractor shall label all conduit including utilized GFE, with permanent marking devices or spray painted stenciling a minimum of 3 meters (10 ft.) identifying it as the System. In addition, each enclosure shall be labeled according to this standard.

4. Termination Hardware: The Contractor shall label TCOs and patch panel connections using color coded labels with identifiers in accordance with ANSI/EIA/TIA-606-A and the "Record Wiring Diagrams."
6. Permanently label cables at each end, including intra-rack connections. Labels shall be covered by the same, transparent heat-shrink tubing covering the end of the overall jacket. Alternatively, computer generated labels of the type which include a clear protective wrap may be used.
7. Contractor's name shall appear no more than once on each continuous set of racks. The Contractor's name shall not appear on wall plates or portable equipment.
8. Ensure each OEM supplied item of equipment has appropriate UL Labels / Marks for the service the equipment is performed permanently attached / marked. SYSTEM EQUIPMENT INSTALLED NOT BEARING THESE UL MARKS WILL NOT BE ALLOWED TO BE A PART OF THE SYSTEM. THE CONTRACTOR SHALL BEAR ALL COSTS REQUIRED TO PROVIDE REPLACEMENT EQUIPMENT WITH APPROVED UL MARKS.

E. Conduit and Signal Ducts: When the Contractor and/or OEM determines additional system conduits and/or signal ducts are required in order to meet the system minimum performance standards outlined herein, the contractor shall provide these items as follows:

1. Conduit:
   a. The Contractor shall employ the latest installation practices and materials. The Contractor shall provide conduit, junction boxes, connectors, sleeves, weather heads, pitch pockets, and associated sealing materials not specifically identified in this document as GFE. Conduit penetrations of walls, ceilings, floors, interstitial space, fire barriers, etc., shall be sleeved and sealed.
   b. All cables shall be installed in separate conduit (exception from the separate conduit requirement to allow PA cables to be installed in partitioned cable tray with voice cables may be granted in writing by the COR if requested). Conduits shall be provided in accordance with Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and NEC Articles 517 for Critical Care and 800 for Communications systems, at a minimum.

c. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.

d. When ”interduct” flexible cable protective systems is specifically authorized to be provided for use in the System, it’s installation guidelines and standards shall be as the specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.

e. Conduit fill (including GFE approved to be used in the system) shall not exceed 40%. Each conduit end shall be equipped with a protective insulator or sleeve to cover the conduit end, connection nut or clamp, to protect the wire or cable during installation and remaining in the conduit. Electrical power conduit shall be installed in accordance with the NEC. AC power conduit shall be run separate from signal conduit.

f. Ensure that Critical Care PA Systems (as identified by NEC Section 517) are completely separated and protected from all other systems.

3.5 PROTECTION OF NETWORK DEVICES (NOT USED)

3.6 CUTTING, CLEANING AND PATCHING

A. It shall be the responsibility of the contractor to keep their work area clear of debris and clean area daily at completion of work.

B. It shall be the responsibility of the contractor to patch and paint any wall or surface that has been disturbed by the execution of this work.

C. The Contractor shall be responsible for providing any additional cutting, drilling, fitting or patching required that is not indicated as provided by others to complete the Work or to make its parts fit together properly.

D. The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or separate contractors by cutting, patching or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter such construction by the Owner or a separate contractor except with written consent of the Owner and of such separate

contractor; such consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold from the Owner or a separate Contractor the Contractor's consent to cutting or otherwise altering the Work.

E. Where coring of existing (previously installed) concrete is specified or required, including coring indicated under unit prices, the location of such coring shall be clearly identified in the field and the location shall be approved by the Project Manager prior to commencement of coring work.

3.7 FIREPROOFING

A. Where PA wires, cables and conduit penetrate fire rated walls, floors and ceilings, fireproof the opening.

B. Provide conduit sleeves (if not already provided by electrical contractor) for cables that penetrate fire rated walls and Telecommunications Rooms floors and ceilings. After the cabling installation is complete, install fire proofing material in and around all conduit sleeves and openings. Install fire proofing material thoroughly and neatly. Seal all floor and ceiling penetrations.

C. Use only materials and methods that preserve the integrity of the fire stopping system and its rating.

D. Install fireproofing where low voltage cables are installed in the same manholes with high voltage cables; also cover the low voltage cables with arc proof and fireproof tape.

E. Use approved fireproofing tape of the same type as used for the high voltage cables, and apply the tape in a single layer, one-half lapped or as recommended by the manufacturer. Install the tape with the coated side towards the cable and extend it not less than 25 mm (one inch) into each duct.

F. Secure the tape in place by a random wrap of glass cloth tape.

3.8 GROUNDING

A. Ground PA cable shields and equipment to eliminate shock hazard and to minimize ground loops, common mode returns, noise pickup, cross talk, and other impairments as specified in CFM Division 27, Section 27 05 26 - Grounding and Bonding for Communications Systems.

B. When required, install grounding electrodes as specified in CFM Division 26, Section 26 05 26 –Grounding and Bonding for Electrical Systems.

C. Do not use "3rd or 4th" wire internal electrical system conductors for communications signal ground.

D. Do not connect the signal ground to the building's external lightning protection system.

E. Do Not "mix grounds" of different systems.

F. Insure grounds of different systems are installed as to not violate OSHA Safety and NEC installation requirements for protection of personnel.

PART 4 – TESTING

4.0 SYSTEM LISTING

The PA System is NFPA listed as an "Emergency / Public Safety" Communications system. Where Code Blue signals are transmitted, that listing is elevated to "Life Support/Safety." Therefore, the following testing provisions are the minimum to be performed and provided by the contractor and OEM.

4.1 PROOF OF PERFORMANCE TESTING

A. Intermediate Testing:

1. After completion of 25 – 30% the installation of a head end cabinet(s) and equipment, one microphone console, local and remote enunciation stations, two (2) zones, two (2) sub zones prior to any further work, this portion of the system must be pretested, inspected, and certified. Each item of installed equipment shall be checked to ensure appropriate UL Listing and Certification Labels are affixed as required by NFPA –Life Safety Code 101–3.2 (a) & (b) and JCHCO evaluation guidelines, and proper installation practices are followed. The intermediate test shall include a full operational test.

2. All inspections and tests shall be conducted by an OEM–certified contractor representative and witnessed by TVE–005OP3B if there is no local Government Representative that processes OEM and VA approved Credentials to inspect and certify the system. The results of the inspection will be officially recorded by the Government Representative and maintained on file by the COR, until completion

of the entire project. The results will be compared to the Acceptance Test results. An identical inspection may be conducted between the 65 - 75% of the system construction phase, at the direction of the COR.

B. Pretesting:

1. Upon completing installation of the PA System, the Contractor shall align, balance, and completely pretest the entire system under full operating conditions.
2. Pretesting Procedure:
   a. During the System Pretest the Contractor shall verify (utilizing approved test equipment) that the System is fully operational and meets all the System performance requirements of this standard.
   b. The Contractor shall pretest and verify that all PA System functions and specification requirements are met and operational, no unwanted aural effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise, etc. are present. At a minimum, each of the following locations shall be fully pretested:
      1) Central Control Cabinets.
      2) Local Control Stations.
      5) Remote Control Panels.
         a.)TCR.
         b.)PCR/SCC.
      6) All Networked locations.
      7) System interface locations (i.e. TELCO, two way radio, etc.).
      8) System trouble reporting.
      9) System Electrical Supervision.
      11)STRs.
      12)NSs
      13)TCOs.
3. The Contractor shall provide four (4) copies of the recorded system pretest measurements and the written certification that the System is ready for the formal acceptance test shall be submitted to the COR.

C. Acceptance Test:

1. After the PA System has been pretested and the Contractor has submitted the pretest results and certification to the COR , then the Contractor shall schedule an acceptance test date and give the COR 30 day's written notice prior to the date the acceptance test is expected to begin. The System shall be tested in the presence of TVE 005OP3B and an OEM certified representatives. The System shall be tested utilizing the approved test equipment to certify proof of performance and Emergency / Public Safety compliance. The tests shall verify that the total System meets all the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.
2. The acceptance test shall be performed on a "go-no-go" basis. Only those operator adjustments required to show proof of performance shall be allowed. The test shall demonstrate and verify that the installed System does comply with all requirements of this specification under operating conditions. The System shall be rated as either acceptable or unacceptable at the conclusion of the test. Failure of any part of the System that precludes completion of system testing, and which cannot be repaired in four (4) hours, shall be cause for terminating the acceptance test of the System. Repeated failures that result in a cumulative time of eight (8) hours to affect repairs shall cause the entire System to be declared unacceptable. Retesting of the entire System shall be rescheduled at the convenience of the Government.
3. Retesting of the entire System shall be rescheduled at the convenience of the Government and costs borne by the Contractor at the direction of the SRE.

D. Acceptance Test Procedure:

1. Physical and Mechanical Inspection:
   a. The TVE 005OP3B Representative will tour all areas where the PA system and all sub-systems are completely and properly installed to insure they are operationally ready for proof of performance testing. A system inventory including available spare parts will be taken at this time. Each item of installed equipment shall be checked to ensure appropriate UL certification labels are affixed.

b. The System diagrams, record drawings, equipment manuals, TIP Auto CAD Disks, intermediate, and pretest results shall be formally inventoried and reviewed.
c. Failure of the System to meet the installation requirements of this specification shall be grounds for terminating all testing.

2. Operational Test:
   a. After the Physical and Mechanical Inspection, the system head end equipment shall be checked to verify that it meets all performance requirements outlined herein. A spectrum analyzer and sound level meter may be utilized to accomplish this requirement.
   b. Following the head end equipment test, each speaker (or on board speaker) shall be inspected to ensure there are no signal distortions such as intermodulation, data noise, popping sounds, erratic system functions, on any function.
   c. The distribution system shall be checked at each interface, junction, and distribution point, first, middle, and last speaker in each leg to verify the PA distribution system meets all system performance standards.
   d. If the RED system is a part of the system, each volume stepper switches shall be checked to insure proper operation of the pillow speaker, the volume stepper and the RED system (if installed).
   e. Additionally, each installed
   f. Once these tests have been completed, each installed sub-system function shall be tested as a unified, functioning and fully operating system. The typical functions are: "all call," three sub-zoned, minimum of 15 minutes of UPS operation, electrical supervision, trouble panel, corridor speakers and audio paging.
   h. Individual Item Test: The TVE 005OP3B Representative will select individual items of equipment for detailed proof of performance testing until 100% of the System has been tested and found to meet the contents of this specification. Each item shall meet or exceed the minimum requirements of this document.

3. Test Conclusion:
   a. At the conclusion of the Acceptance Test, using the generated punch list (or discrepancy list) the VA and the Contractor shall

jointly agree to the results of the test, and reschedule testing on deficiencies and shortages with the COR . Any retesting to comply with these specifications will be done at the Contractor's expense.

b. If the System is declared unacceptable without conditions, all rescheduled testing expenses will be borne by the Contractor.

E. Acceptable Test Equipment: The test equipment shall furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:

1. Spectrum Analyzer.
2. Signal Level Meter.
3. Volt-Ohm Meter.
4. Sound Pressure Level (SPL) Meter.
5. Oscilloscope.
6. Random Noise Generator.
7. Audio Amplifier with External Speaker.

4.2 WARRANTY

A. Comply with FAR 52.246-21, except that warranty shall be as follows:

B. Contractor’s Responsibility:

1. The Contractor shall warranty that all provided material and equipment will be free from defects, workmanship and will remain so for a period of two (2) years from date of final acceptance of the System by the VA. The Contractor shall provide OEM’s equipment warranty documents, to the COR, that certifies each item of equipment installed conforms to OEM published specifications.
2. The Contractor's maintenance personnel shall have the ability to contact the Contractor and OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and assistance in resolving technical problems at any time. This contact capability shall be provided by the Contractor and OEM at no additional cost to the VA.
3. All Contractor maintenance and supervisor personnel shall be fully qualified by the OEM and must provide two (2) copies of current and

qualified OEM training certificates and OEM certification upon request.

4. Additionally, the Contractor shall accomplish the following minimum requirements during the two year guaranty period:
   a. Response Time During the ***Two Year*** Guaranty Period:
      1) The COR is the Contractor's ONLY OFFICIAL reporting and contact official for nurse call system trouble calls, during the guaranty period.
      2) A standard work week is considered 8:00 A.M. to 5:00 P.M. or as designated by the COR, Monday through Friday exclusive of Federal Holidays.
      3) The Contractor shall respond and correct on-site trouble calls, during the standard work week to:
         a) A routine trouble call within one (1) working day of its report. A routine trouble is considered a trouble which causes a power supply; one (1) master System control station, microphone console or amplifier to be inoperable.
         b) Routine trouble calls in critical emergency health care facilities (i.e., cardiac arrest, intensive care units, etc.) shall also be deemed as an emergency trouble call. The COR shall notify the Contractor of this type of trouble call.
         c) An emergency trouble call within four (4) hours of its report. An emergency trouble is considered a trouble which causes a sub-zone, zone, distribution point, terminal cabinet, or all call system to be inoperable at anytime.
      4) If a PA System component failure cannot be corrected within four (4) hours (exclusive of the standard work time limits), the Contractor shall be responsible for providing alternate System equipment. The alternate equipment/system shall be operational within a maximum of 12 hours after the four (4) hour trouble shooting time and restore the effected location operation to meet the System performance standards. If any sub-system or major system trouble cannot be corrected within one working day, the Contractor shall furnish and install compatible substitute equipment returning the System or sub-

system to full operational capability, as described herein, until repairs are complete.

b. Required On-Site Visits During the ***Two Year*** Guaranty Period

1) The Contractor shall visit, on-site, for a minimum of eight (8) hours, once every 12 weeks, during the guaranty period, to perform system preventive maintenance, equipment cleaning, and operational adjustments to maintain the System according the descriptions identified in this document.
2) The Contractor shall arrange all Facility visits with the COR prior to performing the required maintenance visits.
3) Preventive maintenance procedure(s)shall be performed by the Contractor in accordance with the OEM's recommended practice and service intervals during non-busy time agreed to by the COR and Contractor.
4) The preventive maintenance schedule, functions and reports shall be provided to and approved by the COR.
5) The Contractor shall provide the COR a type written report itemizing each deficiency found and the corrective action performed during each required visit or official reported trouble call. The Contractor shall provide the COR with sample copies of these reports for review and approval at the beginning of the Acceptance Test. The following reports are the minimum required:
   a) The Contractor shall provide a monthly summary all equipment and sub-systems serviced during this warranty period to COR by the fifth (5th) working day after the end of each month. The report shall clearly and concisely describe the services rendered, parts replaced and repairs performed. The report shall prescribe anticipated future needs of the equipment and systems for preventive and predictive maintenance.
   b) The Contractor shall maintain a separate log entry for each item of equipment and each sub-system of the System. The log shall list dates and times of all scheduled, routine, and emergency calls. Each emergency call shall be described with details of the nature and causes of

emergency steps taken to rectify the situation and specific recommendations to avoid such conditions in the future.

6) The COR shall convey, two (2) copies of actual reports for evaluation.
   a) The COR shall ensure a copy of these reports is entered into the System's official acquisition documents.
   b) The Facility Chief Engineer shall ensure a copy of these reports is entered into the System's official technical record documents.

C. Work Not Included: Maintenance and repair service shall not include the performance of any work due to improper use; accidents; other vendor, contractor, or owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall immediately notify the COR in writing upon the discovery of these incidents. The COR will investigate all reported incidents and render an official opinion in writing concerning the supplied information.

4.3 TRAINING (NOT USED)

- - - E N D - - -

SECTION 27 52 23
NURSE CALL SYSTEM

PART 1 – GENERAL

1.1 SECTION SUMMARY

A. Work covered by this document includes design, engineering, labor, material and products, equipment warranty and system warranty, training and services for, and incidental to, the complete installation of new and fully operating National Fire Protection Association (NFPA) – Life Safety Code 101.3-2 (a) Labeled and (b) Listed, Emergency Service Nurse-Call and associated equipment (here-in-after referred to as the System) provided in approved locations indicated on the contract drawings. These items shall be tested and certified capable of receiving, distributing, interconnecting and supporting Nurse-Call communications signals generated local and remotely as detailed herein.

B. Work shall be complete, Occupational Safety and Health Administration (OSHA), National Recognized Testing Laboratory (NRTL – i.e. Underwriters Laboratory [UL]) Listed and Labeled; and VA Central Office (VACO), Telecommunications Voice Engineering (TVE 005OP3B) tested, certified and ready for operation.

C. The System shall be delivered free of engineering, manufacturing, installation, and functional defects. It shall be designed, engineered and installed for ease of operation, maintenance, and testing.

D. The term "provide", as used herein, shall be defined as: designed, engineered, furnished, installed, certified, tested, and warranty by the Contractor.

E. Specification Order of Precedence: In the event of a conflict between the text of this document and the Project's Contract Drawings outlined and/or cited herein; THE TEXT OF THIS DOCUMENT TAKES PRECEDENCE. *HOWEVER, NOTHING IN THIS DOCUMENT WILL SUPERSEDE APPLICABLE EMERGENCY LAWS AND REGULATIONS,* SPECIFICALLY NATIONAL AND/OR LOCAL LIFE AND PUBLIC SAFETY CODES. The Local Fire Marshall and/or VA Public Safety Officer are the only authorities that may modify this document's EMERGENCY CODE COMPLIANCE REQUIREMENTS, on a case by case basis, in writing and confirmed by VA's Project Manager (PM), COR and TVE-005OP3B. *The VA PM is the only approving authority* for other

amendments to this document that may be granted, on a case by case basis, in writhing with technical concurrencies by VA's PM, COR, TVE-005OP3B and identified Facility Project Personnel.

F. The Original Equipment Manufacturer (OEM) and Contractor shall ensure ***that all*** management, sales, engineering and installation personnel have read and understand the requirements of this specification ***before*** the system is designed, engineered, delivered and provided. The Contractor shall furnish a written statement stating this requirement as a part of the technical submittal that includes each name and certification, including the OEMs. The Contractor is cautioned to obtain ***in writing, all approvals for system changes relating to the published contract specifications and drawings, from the PM and/or the*** COR ***before proceeding with the change***.

1.2 RELATED SECTIONS

A. 01 33 23 – Shop Drawings, Product Data and Samples.

B. 07 84 00 – Firestopping.

C. 26 05 19 – Low – Voltage Electrical Power Conductors and Cables (600 Volts and Below).

D. 26 41 00 – Facility Lightning Protection.

E. 27 05 11 – Requirements for Communications Installations.

F. 27 05 26 – Grounding and Bonding for Communications Systems.

G. 27 05 33 – Raceways and Boxes for Communications Systems.

H. 27 10 00 – CONTROL, COMMUNICATION AND SIGNAL WIRING.

J. 27 15 13 – TIP Communications Copper Horizontal Cabling.

L. 27 51 16 – Public Address & Mass Notification System (PA).

1.3 DEFINITION

A. Provide: Design, engineer, furnish, install, connect complete, test, certify and warranty.

B. Work: Materials furnished and completely installed.

C. Review of contract drawings: A service by the engineer to reduce the possibility of materials being ordered which do not comply with contract documents. The engineer's review shall not relieve the Contractor of responsibility for dimensions or compliance with the contract documents. The reviewer's failure to detect an error does not constitute permission for the Contractor to proceed in error.

D. Headquarters (aka VACO) Technical Review, for National and VA Communications and Security, Codes, Frequency Licensing Standards, Guidelines and Compliance:
Office of Telecommunications
Special Communications Team (07A2)
202-461-5301, 202-461-5311

E. Engineer: // XXXXXXX //
// XXXXXXX //
// XXXXXXX //
// XXXXXXX //
// XXXXXXX //

F. Owner: // XXXXXXX //

G. General Contractor (GC): // XXXXXXX //

H. Contractor: Systems Contractor; you; successful bidder.

1.4 REFERENCES

A. The installation shall comply fully with all governing authorities, laws and ordinances, regulations, codes and standards, including, but not limited to:

1. United States Federal Law:

a. Departments of:

1) Commerce, Consolidated Federal Regulations (CFR), Title 15 - Under the Information Technology Management Reform Act (Public Law 104-106), the Secretary of Commerce approves standards and guidelines that are developed by the:

a) Chapter II, National Institute of Standards Technology (NIST - formerly the National Bureau of Standards). Under Section 5131 of the Information Technology Management Reform Act of 1996 and the Federal Information Security Management Act of 2002 (Public Law 107-347), NIST develops - Federal Information Processing Standards Publication (FIPS) 140-2—Security Requirements for Cryptographic Modules.

b) Chapter XXIII, National Telecommunications and Information Administration (NTIA - aka 'Red Book') Chapter 7.8 / 9; CFR, Title 47 Federal communications Commission (FCC) Part

15, Radio Frequency Restriction of Use and Compliance in "Safety of Life" Functions & Locations.

2) FCC – Communications Act of 1934, as amended, CFR, Title 47 – Telecommunications, in addition to Part 15 – Restrictions of use for Part 15 listed Radio Equipment in Safety of Life / Emergency Functions / Equipment/ Locations (also see CFR, Title 15 – Department of Commerce, Chapter XXIII – NTIA):
   a) Part 15 – Restrictions of use for Part 15 listed Radio Equipment in Safety of Life / Emergency Functions / Equipment/Locations.
   b) Part 58 – Television Broadcast Service.
   c) Part 90 – Rules and Regulations, Appendix C.
3) Health, (Public Law 96-88), CFR, Title 42, Chapter IV Health & Human Services, CFR, Title 46, Subpart 1395(a)(b) JCAHO "a hospital that meets JCAHO accreditation is deemed to meet the Medicare conditions of Participation by meeting Federal Directives:"
   a) All guidelines for Life, Personal and Public Safety; and, Essential and Emergency Communications.
4) Labor, CFR, Title 29, Part 1910, Chapter XVII – Occupational Safety and Health Administration (OSHA), Occupational Safety and Health Standard:
   a) Subpart 7 – Definition and requirements (for a NRTL – 15 Laboratory's, for complete list, contact (**http://www.osha.gov/dts/otpca/nrtl/faq_nrtl.html**):
      1) UL:
         a) 44-02 – Standard for Thermoset-Insulated Wires and Cables.
         b) 65 – Standard for Wired Cabinets.
         c) 83-03 – Standard for Thermoplastic-Insulated Wires and Cables.
         d) 467-01 – Standard for Electrical Grounding and Bonding Equipment
         e) 468 – Standard for Grounding and Bonding Equipment.
         f) 486A-01 – Standard for Wire Connectors and Soldering Lugs for Use with Copper Conductors

g) 486C-02 - Standard for Splicing Wire Connectors.

h) 486D-02 - Standard for Insulated Wire Connector Systems for Underground Use or in Damp or Wet Locations.

i) 486E-00 - Standard for Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors.

j) 493-01 - Standard for Thermoplastic-Insulated Underground Feeder and Branch Circuit Cable.

k) 514B-02 - Standard for Fittings for Cable and Conduit.

l) 1069 - Hospital Signaling and Nurse Call Equipment.

m) 1449 - Standard for Transient Voltage Surge Suppressors.

n) 1479-03 - Standard for Fire Tests of Through-Penetration Fire Stops.

o) 1666 - Standard for Wire/Cable Vertical (Riser) Tray Flame Tests.

p) 1863 - Standard for Safety, Communications Circuits Accessories.

q) 2024 - Standard for Optical Fiber Raceways.

r) 60950-1/2 - Information Technology Equipment - Safety.

2) Canadian Standards Association (CSA): same tests as for UL.

3) Communications Certifications Laboratory (CCL): same tests as for UL.

4) Intertek Testing Services NA, Inc. (ITSNA formerly Edison Testing Laboratory [ETL]): same tests as for UL.

b) Subpart 35 - Compliance with NFPA 101 - Life Safety Code.

c) Subpart 36 - Design and construction requirements for exit routes.

d) Subpart 268 - Telecommunications.

e) Subpart 305 - Wiring methods, components, and equipment for general use.

5) Department of Transportation, CFR, Title 49 (Public Law 89-670), Part 1, Subpart C – Federal Aviation Administration (FAA):
   a) Standards AC 110/460-ID & AC 707 / 460-2E – Advisory Circulars for Construction of Antenna Towers.
   b) Forms 7450 and 7460-2 – Antenna Construction Registration.
6) Veterans Affairs (Public Law No. 100-527), CFR, Title 38, Volumes I & II:
   a) Office of Telecommunications:
      1) Handbook 6100 – Telecommunications.
         a) Spectrum Management FCC & NTIA Radio Frequency Compliance and Licensing Program.
         b) Special Communications Proof of Performance Testing, VACO Compliance and Life Safety Certification(s).
   b) Office of Cyber and Information Security (OCIS):
      1) Handbook 6500 – Information Security Program.
      2) Wireless and Handheld Device Security Guideline Version 3.2, August 15, 2005.
   c) VA's National Center for Patient Safety – Veterans Health Administration Warning System, Failure of Medical Alarm Systems using Paging Technology to Notify Clinical Staff, July 2004.
   d) VA's Center for Engineering Occupational Safety and Health, concurrence with warning identified in VA Directive 7700.
   e) Office of Construction and Facilities Management (CFM):
      1) Master Construction Specifications (PG-18-1).
      2) Standard Detail and CAD Standards (PG-18-4).
      3) Equipment Guide List (PG-18-5).
      4) Electrical Design Manual for VA Facilities (PG 18-10), Articles 7 & 8.
      5) Minimum Requirements of A/E Submissions (PG 18-15):
         a) Volume B, Major New Facilities, Major Additions; and Major Renovations, Article VI, Paragraph B.
         b) Volume C – Minor and NRM Projects, Article III, Paragraph S.
         c) Volume E – Request for Proposals Design/Build

Projects, Article II, Paragraph F.

6) Mission Critical Facilities Design Manual (Final Draft - 2007).

7) Life Safety Protected Design Manual (Final Draft - 2007).

8) Solicitation for Offerors (SFO) for Lease Based Clinics - (05-2009).

b. Federal Specifications (Fed. Specs.):

1) A-A-59544-00 - Cable and Wire, Electrical (Power, Fixed Installation).

2. National Codes:

a. American Institute of Architects (AIA): Guidelines for Healthcare Facilities.

b. American National Standards Institute/Electronic Industries Association/Telecommunications Industry Association (ANSI/EIA/TIA):

1) 568-B - Commercial Building Telecommunications Wiring Standards:

a) B-1 - General Requirements.

b) B-2 - Balanced twisted-pair cable systems.

c) B-3 - Fiber optic cable systems.

2) 569 - Commercial Building Standard for Telecommunications Pathways and Spaces.

3) 606 - Administration Standard for the Telecommunications Infrastructure of Communications Buildings.

4) 607 - Commercial Building Grounding and Bonding Requirements for Telecommunications.

5) REC 127-49 - Power Supplies.

6) RS 270 - Tools, Crimping, Solderless Wiring Devices, Recommended Procedures for User Certification.

c. American Society of Mechanical Engineers (ASME):

1) Standard 17.4 - Guide for Emergency Personnel.

2) Standard 17.5 - Elevator & Escalator Equipment (prohibition of installing non-elevator equipment in Elevator Equipment Room / Mechanical Penthouse).

d. American Society of Testing Material (ASTM):

1) D2301-04 - Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape.

e. Building Industries Communications Services Installation (BICSI):

1) All standards for smart building wiring, connections and devices for commercial and medical facilities.

2) Structured Building Cable Topologies.

3) In consort with ANSI/EIA/TIA.

f. Institute of Electrical and Electronics Engineers (IEEE):

1) SO/TR 21730:2007 - Use of mobile wireless communication and computing technology in healthcare facilities - Recommendations for electromagnetic compatibility (management of unintentional electromagnetic interference) with medical devices.

2) 0739-5175/08/©2008 IEEE - Medical Grade - Mission Critical - Wireless Networks.

3) C62.41 - Surge Voltages in Low-Voltage AC Power Circuits.

g. NFPA:

1) 70 - National Electrical Code (current date of issue) - Articles 517, 645 & 800.

2) 75 - Standard for Protection of Electronic Computer Data-Processing Equipment.

3) 77 - Recommended Practice on Static Electricity.

4) 99 - Healthcare Facilities.

5) 101 - Life Safety Code.

3. State Hospital Code(s).

4. Local Town, City and/or County Codes.

5. Accreditation Organization(s):

a. Joint Commission on Accreditation of Hospitals Organization (JCAHO) - Section VI, Part 3a - Operating Features.

1.5 QUALIFICATIONS

A. The OEM shall have had experience with three (3) or more installations of Nurse Call systems of comparable size and interfacing complexity with regards to type and design as specified herein. Each of these installations shall have performed satisfactorily for at least one (1) year after final acceptance by the user. Include the names, locations

and point of contact for these installations as a part of the submittal.

B. The Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of three (3) years. The Contractor shall be authorized by the OEM to pass thru the OEM's warranty of the installed equipment to VA. In addition, the OEM and Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the System. This documentation, along with the System Contractor and OEM certifications must be provided in writing as part of the Contractor's Technical submittal.

C. The Contractor's Communications Technicians assigned to the System shall be fully trained, qualified, and certified by the OEM on the engineering, installation, operation, and testing of the System. The Contractor shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the COR before being allowed to commence work on the System.

D. The Contractor shall display all applicable national, state and local licenses.

E. The Contractor shall submit copy (s) of Certificate of successful completion of OEM's installation/training school for installing technicians of the System's Nurse Call equipment being proposed.

1.6 CODES AND PERMITS

A. Provide all necessary permits and schedule all inspections as identified in the contract's milestone chart, so that the system is proof of performance tested, certified and approved by VA and ready for operation on a date directed by the Owner.

B. The contractor is responsible to adhere to all codes described herein and associated contractual, state and local codes.

1.7 SCHEDULING

A. After the award of contract, the Contractor shall prepare a detailed schedule (aka milestone chart) using "Microsoft Project" software or equivalent. The Contractor Project Schedule (CPS) shall indicate detailed activities for the projected life of the project. The CPS shall consist of detailed activities and their restraining

relationships. It will also detail manpower usage throughout the project.

B. It is the responsibility of the Contractor to coordinate all work with the other trades for scheduling, rough-in, and finishing all work specified. The owner will not be liable for any additional costs due to missed dates or poor coordination of the supplying contractor with other trades.

1.8 REVIEW OF CONTRACT DRAWINGS AND EQUIPMENT DATA SUBMITTALS (AKA TECHNICAL SUBMITTAL[S])

(Note: The Contractor is encouraged, but not required, to submit separate technical submittal(s) outlining alternate technical approach(s) to the system requirements stated here-in as long as each alternate technical document(s) is complete, separate, and submitted in precisely the same manner as outlined herein. VA will review and rate each received alternate submittal, which follows this requirement, in exactly the same procedure as outlined herein. Partial, add-on, or addenda type alternates will not be accepted or reviewed.)

A. Submit at one time within 10 days of contract awarding, drawings and product data on all proposed equipment and system. Check for compliance with contract documents and certify compliance with Contractor's "APPROVED" stamp and signature.

B. Support all submittals with descriptive materials, i.e., catalog sheets, product data sheets, diagrams, and charts published by the manufacturer. These materials shall show conformance to specification and drawing requirements.

C. Where multiple products are listed on a single cut-sheet, circle or highlight the one that you propose to use. Provide a complete and through equipment list of equipment expected to be installed in the system, with spares, as a part of the submittal. Special Communications (TVE-005OP3B) will not review any submittal that does not have this list.

D. Provide four (4) copies to the PM for technical review. The PM will provide a copy to the offices identified in Paragraph 1.3.C & D, at a minimum for compliance review as described herein where each responsible individual(s) shall respond to the PM within 10 days of receipt of their acceptance or rejection of the submittal(s).

E. Provide interconnection methods, conduit (where not already installed), junction boxes (J-Boxes), cable, interface fixtures and equipment lists for the: Nurses Stations (NS), Head End Room (HER), Head End Cabinet (HEC), Head End Interface Cabinet (HEIC) and approved TCO locations TIP interface distribution layout drawing, as they are to be installed and interconnected to teach other (REFER TO APPENDIX B - SUGGESTED TELECOMMUNI-CAITONS ONE LINE TOPOLOGY pull-out drawing).

F. Equipment technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.

G. Engineering drawings of the System, showing calculated of expected signal levels at the headend input and output, each input and output distribution point, and signal level at each telecommunications outlet.

H. Surveys Required as a Part of The Technical Submittal:

1. The Contractor shall provide the following System surveys that depict various system features and capacities required ***in addition to*** the on-site survey requirements described herein ***(see Specification Paragraph 2.4.3)***. Each survey shall be in writing and contain the following information (the formats are suggestions and may be used for the initial Technical Submittal Survey requirements), as a minimum:

   a. Nurse Call Cable System Design Plan:

      1) An OEM and contractor designed functioning Nurse Call System cable plan **to populate the entire TIP empty conduit/pathway distribution systems** shall be provided as a part of the technical proposal. A specific functioning Nurse Call: cable, interfaces, J-boxes and back boxes shall coincide with the total growth items as described herein. It is the Contractor's responsibility to provide the Systems' entire Nurse Call cable and accessory requirements and engineer a functioning Nurse Call distribution system and equipment requirement plan of the following paragraph(s), at a minimum:

      2) The required Nurse Call Equipment Locations:

EQUIPPED ITEM	**CAPACITY**	**GROWTH**
Master Stations		
Dome Lights		

12-01-20

EQUIPPED ITEM	CAPACITY	GROWTH
Room		
Corridor		
Other		
Patient Stations		
Single		
Dual		
Isolation		
Other		
Emergency Stations		
Bath		
Toilet		
Isolation		
Other		
Staff Stations		
Duty Stations		
Code Blue		
Patient Locations		
Surgical Recovery Locations		
Medical Recovery Locations		
ICU Locations		
SICU		
MICU		
CCU		
Other		
Emergency Room Locations		
Other		
Supervisory Locations		
Nurse Stations		
On-Call Rooms		
Other		
Remote Locations		
Telephone Operator's Room		

EQUIPPED ITEM	CAPACITY	GROWTH
Police Control Room		
Other		
Radio Paging Access **(when pre-approved by TVE-005OP3B)**		
Audio Paging Access **(when pre-approved by TVE-005OP3B)**		
Wireless Access **(when pre-approved by TVE-005OP3B)**		
Maintenance/Programming Console		
Location(s)		
Central Control Cabinet/Equipment		
Location		
Power Supply(s)		
UPS(s)		

3) The required Nurse Call Plant/Connections:

The Contractor shall clearly and fully indicate this category for each item identified herein as a part of the technical submittal. For this purpose, the following definitions and sample connections are provided to detail the system's capability:

EQUIPPED ITEM	CAPACITY	GROWTH
Central Control Cabinet/Equipment		
Location		
Power Supply(s)		
UPS(s)		
Essential Electrical Power Panel(s)		
Other		
Cable Plant		
Supply to Locations Identified in Paragraph 1.8.H.1.a.2)		
Remote Locations		
Telephone Operator Room		
Police Control Room		
Other		

EQUIPPED ITEM	CAPACITY	GROWTH
Maintenance/Program Console		
Location(s)		
Other		
LAN (Local Facility) Access/Equipment/Location **(when pre-approved by TVE-005OP3B)**		
Wireless Access/Equipment/Location **(when pre-approved by TVE-005OP3B)**		
PA Access/Equipment/Location **(when pre-approved by TVE-005OP3B)**		
Other		

1.9 PROJECT RECORD DOCUMENTS (AS BUILTS)

A. Throughout progress of the Work, maintain an accurate record of changes in Contract Documents. Upon completion of Work, transfer recorded changes to a set of Project Record Documents.

B. The floorplans shall be marked in pen to include the following:

1. Each device specific locations with UL labels affixed.
2. Conduit locations.
3. Each interface and equipment specific location.
4. Head-end equipment and specific location.
5. Wiring diagram.
6. Labeling and administration documentation.
7. Warranty certificate.
8. System test results.

1.10 WARRANTIES

A. The Contractor shall warrant the installation to be free from defect in material and workmanship for a period of two (2) years from the date of acceptance of the project by the owner. The Contractor shall agree to remedy covered defects within four (4) hours of notification of major failures or within twenty-four (24) hours of notification for individual station related problems.

1.11 USE OF THE SITE

A. Use of the site shall be at the GC's direction.

B. Coordinate with the GC for lay-down areas for product storage and administration areas.

C. Coordinate work with the GC and their sub-contractors.

D. Access to buildings wherein the work is performed shall be directed by the GC.

1.12 DELIVERY, STORAGE, AND HANDLING

A. Deliver, store, and handle products using means and methods that will prevent damage, deterioration, and loss, including theft.

B. Store products in original containers.

C. Coordinate with the GC for product storage. There may be little or no storage space available on site. Plan to potentially store materials off site.

D. Do not install damaged products. Remove damaged products from the site and replaced with new product at no cost to the Owner.

1.13 PROJECT CLOSE-OUT

A. Prior to final inspection and acceptance of the work, remove all debris, rubbish, waste material, tools, construction equipment, machinery and surplus materials from the project site and thoroughly clean your work area.

B. Before the project closeout date, the Contractor shall submit:

1. OEM Equipment Warranty Certificates.
2. Evidence of compliance with requirements of governing authorities such as the Low Voltage Certificate of Inspection.
3. Project record documents.
4. Instruction manuals and software that is a part of the system.
5. System Guaranty Certificate.

C. Contractor shall submit written notice that:

1. Contract Documents have been reviewed.
2. Project has been inspected for compliance with contract.
3. Work has been completed in accordance with the contract.

PART 2 – PRODUCTS / FUNCTIONAL REQUIREMENTS

2.0 GENERAL REQUIREMENTS FOR EQUIPMENT AND MATERIALS

A. Furnish and install a complete and fully functional and operable Nurse Call System for each location shown on the contract drawings and TCOs.

B. The specific location for each Nurse Call: Central Control Cabinet, power supply, electrical supervisor panel, UPS is TR2 2718, Master Station is in Building 1, third floor, Healthcare Admin SVC Switchboard Operation Room 3313, Emergency Station are in patient toilet rooms, Dome Light are outside the patient toilet rooms.

C. Coordinate features and select interface components to form an integrated Nurse Call system. Match components and interconnections between the systems for optimum performance of specified functions.

D. Expansion Capability: The Nurse Call equipment interfaces and cables shall be able to increase number of enunciation points in the future by a minimum of 50 percent (%) above those indicated without adding any internal or external components or main trunk cable conductors.

E. Equipment: Active electronic type shall use solid-state components, fully rated for continuous duty unless otherwise indicated. Select equipment for normal operation on input power usually supplied between 110 to 130 VAC, 60 Hz supplied from the Facility's Emergency Electrical Power System.

F. Meet all FCC requirements regarding equipment listing, low radiation and/or interference of RF signal(s). The system shall be designed to prevent direct pickup of signals from within and outside the building structure.

2.1 SYSTEM DESCRIPTION

A. Furnish and install a complete and fully functional and operable Nurse Call System.

B. The Contractor is responsible for interfacing with the PA System.

C. The Contractor shall continually employ interfacing methods that are approved by the OEM and VA. At a minimum, an acceptable interfacing method requires not only a physical and mechanical connection, but also a matching of signal, voltage, and processing levels with regard to signal quality and impedance. The interface point must adhere to all standards described herein for the full separation of Critical Care and Life Safety systems.

D. The System Contractor shall connect the System ensuring that all NFPA and UL Critical Care and Life Safety Circuit and System separation guidelines are satisfied. The System Contractor is not allowed to make any connections to the Telephone System. VA shall arrange for the

interconnection between the PA System with the appropriate responsible parties.

E. System hardware shall consist of a ***standalone (separate)*** nurse call patient communications network comprised of corridor dome lights, pull cord stations, wiring. And, other options such as, ***pocket page interfaces***, computer interfaces, printer interfaces, wireless / telephone network interfaces, and nurse locating system interface **(when specifically approved first by TVE 005OP3B)** and as shown on drawings. All necessary equipment required to meet the intent of these specifications, whether or not enumerated within these specifications, shall be supplied and installed to provide a complete and operating nurse call patient communications network. ***It is not acceptable to utilize the telephone cable system for the control and distribution of nurse call signals and equipment.***

F. System firmware shall be the product of a reputable firmware OEM of record with a proven history of product reliability and sole control over all source code. Manufacturer shall provide, free of charge, product firmware/software upgrades for a period of two (2) years from date of acceptance by VA for any product feature enhancements. System configuration programming changes shall not require any exchange of parts and shall be capable of being executed remotely via a modem connection **(when specifically approved first by TVE 005OP3B)**.

G. The Nurse Call Head End Equipment shall be located in Telecommunications Room TR2 2718. The Nurse Call System may interface the PA system when specifically approved by VA Headquarters TVE 005OP3B during the project approval process prior to contract bidding.

H. The System shall utilize microprocessor components for all signaling and programming circuits and functions. Self-contained or on board system program memory shall be non-volatile and protected from erasure from power outages for a minimum of 12 hours.

I. Provide a backup battery or a UPS for the System (including each distribution cabinet/point, CRT and Monitor) to allow normal operation and function (as if there was no AC power failure) in the event of an AC power failure or during input power fluctuations for a minimum of 30 minutes.

J. The System is defined as Critical Service functions is defined as Life Safety/Support by NFPA (re Part 1.1.A) and so evaluated by JCAHCO. **Therefore, the system shall have a minimum of two (2) additional remote enunciation points in order to satisfy NFPA's Life Safety Code 101 (the typical secondary locations are Telephone Operators Room, MAS ER Desk, Boiler Plant, etc; AND the primary location is required to be in the SCC Room.**

1. These two (2) additional remote locations shall be fully manned:
   a. 24/7/365 for certified Hospital **Clinics**.
   b. As long as other identified VA Medical / Servicing Facilities are open for servicing patients.
   c. The minimum remote enunciation locations shall be:
      1) The Telephone / PBX Operator Room.
      2) The Police Control / Operations Room.
      3) Other location(s) that is specifically approved by VA Headquarters TVE – 005OP3B DURING THE PROJECT DEVELOPMENT STAGES AND PRIOR TO EQUIPMENT PURCHASE.
2. In addition to the two (2) remote locations afore described, the following locations are the minimum required for additional Nurse Call Annunciation:
   a. "On Call" Rooms.
   b. Each Nurse Master Station.
   c. Each Staff Station.
   d. Each Duty Station.

K. When the System is approved to connect to a separate communications system (i.e. LAN, WAN, Telephone, Public Address, radio raging, wireless systems, etc) the connection point shall meet the following minimum requirements for each hard wired / wireless connection (note each wireless system connection MUST BE APPROVED PRIOR TO CONTRACT BID BY VA HEADQUARTERS TVE – 005OP3B AND SPECTRUM MANAGEMENT – 005OP2B – hereinafter referred to as SM – 005OP2B):

1. UL 60950-1/2.
2. FIPS 142.
3. FCC Part 15 Listed Radio Equipment restriction compliance approved by SM – 005OP2B.

M. All passive distribution equipment shall meet or exceed -80 dB radiation shielding (aka RFI) shielding specifications and be provided with connectors specified by the OEM.

N. All equipment face plates utilized in the system shall be stainless steel, anodized aluminum or UL approved cycolac plastic for the areas where provided.

O. Noise filters and surge protectors shall be provided for each equipment interface cabinet, headend cabinet, control console and local and remote amplifier locations to insure protection from input primary AC power surges and to insure noise glitches are not induced into low voltage data circuits.

P. Plug-in connectors shall be provided to connect all equipment. Base band cable systems shall utilize barrier terminal screw type connectors, at a minimum. As an alternate, crimp type connectors installed with a ratchet type installation tool are acceptable provided the cable dress, pairs, shielding, grounding, connections and labeling are the same as the barrier terminal strip connectors. Tape of any type, wire nuts or solder type connections are unacceptable and will not be approved.

R. Audio Level Processing: The control equipment shall consist of audio mixer(s), volume limiter(s) and/or compressor(s), and power amplifier(s) to process, adjust, equalize, isolate, filter, and amplify each audio channel for each sub-zone in the system and distribute them into the System's RF interfacing distribution trunks and amplification circuits. It is acceptable to use identified Telephone System cable pairs designated for Two-Way Radio interface and control use or identified as spare telephone cable pairs by the Facility's Telephone System Contractor. The use of telephone cable to distribute RF signals, carrying system or sub-system AC or DC voltage is not acceptable and will not be approved. Additionally, each control location shall be provided with the equipment required to insure the system can produce its designed audio channel capacity at each speaker identified on the contract drawings. The Contractor shall provide: a spare set of telephone paging modules as recommended by the OEM (as a minimum provide one spare module for each installed module); one spare audio power amplifier, one spare audio mixer, one spare audio volume limiter

and/or compressor, and one spare audio automatic gain adjusting device, and minimum RF equipment recommended by the OEM.

S. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. Unless otherwise noted in this Part, equipment quantities shall be as indicated on the drawings.

R. System Performance:

1. At a minimum, each distribution, interconnection, interface, terminating point and TCO shall be capable of supporting the Facility's Nurse Call System voice and data service as follows:
   a. Shall be compliant with and not degrade the operating parameters of the Public Switched Telephone Network (PSTN) and the Federal Telecommunications System (FTS) at each PSTN and FTS interface (if attachment is permitted by TVE 005OP3B), interconnection and TCO terminating locations detailed on the contract drawings.
   b. The System shall provide the following minimum operational functions:
2. Each System Nurse Call location shall generate a minimum of distinct calls:
   a. Routine: single flashing dome lights & master station color and audio tone,
   b. Staff Assist: rapid flashing dome lights & master station color and audio tone,
   c. Emergency: Red flashing done lights & master station color and audio tone,
   d. Each generated call shall be cancelable at ONLY the originating location,
   e. Staff Locator: Green Flashing dome lights & master station color and audio tone, and

2.3 MANUFACTURERS

A. The products specified shall be new, FCC and UL Listed, labeled and produced by OEM manufacturer of record. An OEM of record shall be defined as a company whose main occupation is the manufacture for sale of the items of equipment supplied and which:

1. Maintains a stock of replacement parts for the item submitted,

2. Maintains engineering drawings, specifications, and operating manuals for the items submitted, and
3. Has published and distributed descriptive literature and equipment specifications on the items of equipment submitted at least 30 days prior to the Invitation for Bid.

B. Specifications contained herein as set forth in this document detail the salient operating and performance characteristics of equipment in order for VA to distinguish acceptable items of equipment from unacceptable items of equipment. When an item of equipment is offered or furnished for which there is a specification contained herein, the item of equipment offered or furnished shall meet or exceed the specification for that item of equipment.

C. Equipment Standards and Testing:

1. The System has been defined herein as connected to systems identified as Critical Service performing various Emergency and Life Support Functions. Therefore, at a minimum, the system shall conform to all aforementioned National and/or Local Life Safety Codes (which ever are the more stringent), NFPA, NEC, this specification, JCAHCO Life Safety Accreditation requirements, and the OEM recommendations, instructions, and guidelines.
2. All supplies and materials shall be listed, labeled or certified by UL or a NRTL where such standards have been established for the supplies, materials or equipment.
3. The provided equipment required by the System design and approved technical submittal must conform with each UL standard in effect for the equipment, as of the date of the technical submittal (or the date when the COR approved system equipment necessary to be replaced) was technically reviewed and approved by VA. Where a UL standard is in existence for equipment to be used in completion of this contract, the equipment must bear the approved UL seal.
4. Each item of electronic equipment to be provided under this contract must bear the approved UL seal or the seal of the testing laboratory that warrants the equipment has been tested in accordance with, and conforms to the specified standards. The placement of the UL Seal shall be a permanent part of the electronic equipment that is not capable of being transportable from one equipment item to another.

2.4 PRODUCTS

A. General.

1. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. The equipment quantities provided herein shall be as indicated on the drawings with the exception of the indicated spare equipment.

2. Contractor Furnished Equipment List (CFEs):

a. The Contractor is required to provide a list of the CFE equipment to be furnished. The quantity, make and model number of each item is required. Select the required equipment items quantities that will satisfy the needs of the system as described herein and with the OEM's concurrence applied to the list(s), in writing.

CONTRACTOR NOTE: Select the required equipment items quantities that will satisfy the needs of the system and edit between the // - - //. Do not delete equipment items that are not required - place a "0" in the appropriate Item location. The two color coded sections for the Mental Health and Blind Rehabilitation Units are provided for use when these units are a part of the project. If these units are not a part of the project - retain each unit's heading and place "0" in the respective "as required" column and delete the remaining system items.

Item	Quantity	Unit
1.	//As required//	Interface Panel(s)
1.a	//As required//	Electrical Supervision Trouble Enunciator
1.a.1	//As required//	Equipment Back Box(s)
1.b	//As required//	Telephone
1.c	//As required//	Public Address
1.d	//As required//	Radio Paging / Equipment
1.e	//As required//	Wireless / Equipment
1.f.	//As required//	Radio Pager / Equipment
1.g	//As required//	Wireless / Equipment
1.f	//As required//	Personal Communicator / Equipment
2.	//As required//	Lightning Arrestor
3.	//As required//	Head End Equipment/Locations
3.a	//As required//	Cabinet(s)
3.a.1	//As required//	AC Power Conditioner & Filter

3.a.2	//As required//	AC Power Strip
3.a.3	//As required//	UPS
3.a.4	//As required//	Interconnecting Wire/Cables
3.a.5	//As required//	Wire / Cable Connector(s)
3.a.6	//As required//	Wire / Cable Terminator(s)
3.b	//As required//	Wire Management System
3.b	//As required//	Head End Function(s)
3.b.1	//As required//	H7 Interface
3.b.2	//As required//	Nurse Locator
3.b.3	//As required//	Staff Locator
4.	//As required//	Master Station(s)
4.a	//As required//	Nurse Locator
4.b	//As required//	Staff Locator
5.	//As required//	Distribution System(s)
5.a	//As required//	Staff Station
5.a.1	//As required//	Equipment Back Box(s)
5.b	//As required//	Duty Station
5.b.1	//As required//	Equipment Back Box(s)
5.c	//As required//	Code Blue Station
5.c.1	//As required//	Equipment Back Box(s)
5.c.2	2 (MIN)	Remote Station(s)
5.d	//As required//	Patient Station(s)
5.d.1	//As required//	Equipment Back Box(s)
5.d.2	//As required//	Bed Interface(s)
5.d.3	//As required//	Pillow Speaker
5.d.4	//As required//	Push Button Cordset
5.d.5	//As required//	Dummy Plugs
5.d.6	//As required//	Bed Integrated Control
5.d.7	//As required//	Lighting Interface Module
5.d.8	//As required//	TV Control Interface
5.d.9	//As required//	TV Control Jack
5.d.10	//As required//	TV Interconnection Cables
5.d.11	//As required//	HDTV Coaxial
5.d.12	//As required//	HDTV/Nurses Call Interface/ Control
5.d.13	//As required//	Auxiliary Mounting Interface
5.e	//As required//	Emergency Station(s)
5.e.1	//As required//	Equipment Back Box(s)
5.e.2	//As required//	Toilet Emergency Station (waterproof)
5.e.3	//As required//	Shower Emergency Station (waterproof)
5.e.4	//As required//	Lavatory Emergency Station (waterproof)
5.f.	//As required//	Room Dome Light
5.f.1	//As required//	Equipment Back Box(s)
5.g	//As required//	Other Dome Light(s)
5.g.1	//As required//	Equipment Back Box(s)
5.g.2	//As required//	Corridor Dome Light
5.g.3	//As required//	Intersectional Dome Light
5.h	//As required//	System Cable(s)
5.h.1	//As required//	Coaxial

5.h.2	//As required//	System Pin
5.h.3	//As required//	Audio
5.h.4	//As required//	Control
5.h.5	//As required//	Video
5.i	//As required//	System Connector(s)
5.i.1	//As required//	Coaxial
5.i.2	//As required//	System Pin
5.i.2	//As required//	Audio
5.i.3	//As required//	Control
5.i.4	//As required//	Video
5.j	//As required//	Wire Management Required as described herein
//6.	**//As required//**	**Mental Health Unit**
6.a	**//As required//**	**Head End Function(s)**
6.a.1	**//As required//**	**H7 Interface**
6.a.2	**//As required//**	**Nurse Locator**
6.a.3	**//As required//**	**Staff Locator**
6.b.	**//As required//**	**Master Station(s)**
6.b.1	**//As required//**	**Nurse Locator**
6.b.2	**//As required//**	**Staff Locator**
6.c	**//As required//**	**Distribution System(s)**
6.c.1	**//As required//**	**Staff Station**
6.c.1.a	**//As required//**	**Equipment Back Box(s)**
6.c.2	**//As required//**	**Duty Station**
6.c.2.a	**//As required//**	**Equipment Back Box(s)**
6.c.3	**//As required//**	**Patient Station(s)**
6.c.3.a	**//As required//**	**Equipment Back Box(s)**
6.c.4	**//As required//**	**Security Room(s)**
6.c.4.a	**//As required//**	**Security Station(s)**
6.c.4.b	**//As required//**	**Equipment Back Box(s)**
6.c.4.c	**//As required//**	**Overhead Speaker/Microphone**
6.c.4.d	**//As required//**	**Equipment Back Box(s)**
6.c.4.e	**//As required//**	**TV Surveillance System**
6.c.4.f	**//As required//**	**Equipment Back Box(s)**
6.c.4.g	**//As required//**	**TV Interconnection Cables**
6.c.4.h	**//As required//**	**Audio Interconnection Cables**
6.c.5	**//As required//**	**Emergency Station(s)**
6.c.5.a	**//As required//**	**Equipment Back Box(s)**
6.c.5.b	**//As required//**	**Toilet Emergency Station (waterproof)**
6.c.5.c	**//As required//**	**Shower Emergency Station (waterproof)**
6.c.5.d	**//As required//**	**Lavatory Emergency Station (waterproof)**
6.c.6	**//As required//**	**Room Dome Light**
6.c.7	**//As required//**	**Other Dome Light(s)**
6.c.7.a	**//As required//**	**Equipment Back Box(s)**
6.c.7.b	**//As required//**	**Corridor Dome Light**
6.c.7.c	**//As required//**	**Intersectional Dome Light**
6.c.8	**//As required//**	**System Cable(s)**
6.c.8.a	**//As required//**	**Coaxial**
6.c.8.b	**//As required//**	**System Pin**
6.c.8.c	**//As required//**	**Audio**

6.c.8.d	//As required//	Control
6.c.8.e	//As required//	Video
6.c.9	//As required//	System Connector(s)
6.c.9.a	//As required//	Coaxial
6.c.9.b	//As required//	System Pin
6.c.9.c	//As required//	Audio
6.c.9.d	//As required//	Control
6.c.9.e	//As required//	Video
6.c.9.f	//As required//	Wire Management Required as described herein//
//7	//As required//	Blind Rehabilitation Unit
7.a	//As required//	Head End Function(s)
7.a.1	//As required//	H7 Interface
7.a.2	//As required//	Nurse Locator
7.a.3	//As required//	Staff Locator
7.b.	//As required//	Master Station(s)
7.b.1	//As required//	Nurse Locator
7.b.2	//As required//	Staff Locator
7.c	//As required//	Distribution System(s)
7.c.1	//As required//	Staff Station
7.c.1.a	//As required//	Equipment Back Box(s)
7.c.2	//As required//	Duty Station
7.c.2.a	//As required//	Equipment Back Box(s)
7.c.3	//As required//	Patient Station(s)
7.c.3.a	//As required//	Equipment Back Box(s)\
7.c.4	//As required//	Emergency Station(s)
7.c.4.a	//As required//	Equipment Back Box(s)
7.c.4.b	//As required//	Toilet Emergency Station (waterproof)
7.c.4.c	//As required//	Shower Emergency Station (waterproof)
7.c.4.d	//As required//	Lavatory Emergency Station (waterproof)
7.c.5	//As required//	Room Dome Light
7.c.5.a	//As required//	Equipment Back Box(s)
7.c.6	//As required//	Other Dome Light(s)
7.c.6.a	//As required//	Equipment Back Box(s)
7.c.6.b	//As required//	Corridor Dome Light
7.c.6.c	//As required//	Intersectional Dome Light
7.c.7	//As required//	System Cable(s)
7.c.7.a	//As required//	Coaxial
7.c.6.b	//As required//	System Pin
7.c.7.c	//As required//	Audio
7.c.7.d	//As required//	Control
7.c.7.e	//As required//	Video
7.c.8	//As required//	System Connector(s)
7.c.8.a	//As required//	Coaxial
7.c.8.b	//As required//	System Pin
7.c.8.c	//As required//	Audio
7.c.8.d	//As required//	Control
7.c.8.e	//As required//	Video
7.c.9	//As required//	Wire Management Required as described herein//

//8.	//As required//	Center for the Aging (aka Nursing Home Care Unit)
8.a	//As required//	Head End Function(s)
8.a.1	//As required//	H7 Interface
8.a.2	//As required//	Nurse Locator
8.a.3	//As required//	Staff Locator
8.b.	//As required//	Master Station(s)
8.b.1	//As required//	Nurse Locator
8.b.2	//As required//	Staff Locator
8.c	//As required//	Distribution System(s)
8.c.1	//As required//	Staff Station
8.c.1.a	//As required//	Equipment Back Box(s)
8.c.2	//As required//	Duty Station
8.c.2.a	//As required//	Equipment Back Box(s)
8.c.3	//As required//	Patient Station(s)
8.c.3.a	//As required//	Equipment Back Box(s)\
8.c.4	//As required//	Security Room(s)
8.c.4.a	//As required//	Security Station(s)
8.c.4.b	//As required//	Equipment Back Box(s)\
8.c.4.c	//As required//	Overhead Speaker/Microphone
8.c.4.d	//As required//	Equipment Back Box(s)\
8.c.4.e	//As required//	TV Surveillance System
8.c.4.f	//As required//	Equipment Back Box(s)\
8.c.4.g	//As required//	TV Interconnection Cables
8.c.4.h	//As required//	Audio Interconnection Cables
8.c.5	//As required//	Emergency Station(s)
8.c.5.a	//As required//	Equipment Back Box(s)
8.c.5.b	//As required//	Toilet Emergency Station (waterproof)
8.c.5.c	//As required//	Shower Emergency Station (waterproof)
8.c.5.d	//As required//	Lavatory Emergency Station (waterproof)
8.c.6	//As required//	Room Dome Light
8.c.7	//As required//	Other Dome Light(s)
8.c.7.a	//As required//	Equipment Back Box(s)
8.c.7.b	//As required//	Corridor Dome Light
8.c.7.c	//As required//	Intersectional Dome Light
8.c.8	//As required//	System Cable(s)
8.c.8.a	//As required//	Coaxial
8.c.8.b	//As required//	System Pin
8.c.8.c	//As required//	Audio
8.c.8.d	//As required//	Control
8.c.8.e	//As required//	Video
8.c.9	//As required//	System Connector(s)
8.c.9.a	//As required//	Coaxial
8.c.9.b	//As required//	System Pin
8.c.9.c	//As required//	Audio
8.c.9.d	//As required//	Control
8.c.9.e	//As required//	Video
8.c.9.f	//As required//	Wire Management Required as described herein//

//9.	**As required//**	**Oncology, Radiology, Dialysis, Units (These units are treated the same as Blind Rehabilitation Unit EXCEPT it does contains a CODE BLUE Function. If these units are provided as a part of the project, AT A MINIMUM – DUPLI-CATE THE BLINE REHABILITATION UNIT'S EQUIPMETN LISTE AND EDIT AND RENUMBER ACCORD-INGLY)//**
10.		**On Hand Spares Provide a separate system spares list as indicated in each equipment description.**

B. NS Room(s):

Refer to CFM Physical Security Manual (07-2007) for VA Facilities, Chapters 9.3 & 1) and PG 18-10, EDM, Chapters 7- Table 7-1, 8 & Appendix B, Telecommunications One Line Topology for specific Room and TIP Connection Requirements.

C. HER Rooms and Equipment:

Refer to CFM Physical Security Manual (07-2007) for VA Facilities, Chapters 9.3 & 1) and PG 18-10, EDM, Chapters 7- Table 7-1, 8 & Appendix B, Telecommunications One Line Topology for specific Room and TIP Connection Requirements.

D. Telecommunications Room(s) (TR):

1. Locate the Nurse Call floor distribution equipment as required by system design and OEM direction. Provide secured and lockable cabinet/rack(s) as required.
2. Head-End Equipment:
   a. Provide all required power supplies, communications hubs, network switches, intelligent controllers and other devices necessary to form a complete system. Head-end components may be rack mounted or wall mounted in an enclosed metal enclosure.
   b. Provide the head end equipment in the closest Telecommunications Room where the System is installed.
   c. Provide the System UPS inside the cabinet or in a separate cabinet adjacent to the head end cabinet that shall maintain a minimum of 30 minute battery back-up to all system components.

d. Equipment Cabinet: Comply with TIA/EIA-310-D. Lockable, ventilated metal cabinet houses terminal strips, power supplies, amplifiers, system volume control, and other switching and control devices required for conversation channels and control functions. See Paragraph 2.5.E for the Cabinet's minimum internal items that are in addition to the installed System equipment.

e. Vertical Equipment Rack, Wall Mounted (to be included inside of the Equipment Cabinet) containing the following minimum items:

1) 36" (28RU) internal rack space, welded steel construction, minimum 20" usable depth, adjustable front mounting rails.

2) Install the following products in rack provided by same manufacturer or as specified:

a) Security screws w/ nylon isolation bushings.

b) Textured blank panels.

c) Custom mounts for components without rack mount kits.

d) Security covers.

e) Internal system ground copper buss (may be substituted with a bare #0 AWG copper wire or equivalent size copper mesh strip connected to ONLY THE FACILITY'S SIGNAL GROUNDING SYSTEM.

f) Power Sequencer- rack-mounted power conditioner and (provide as-needed) delayed sequencer(s) with (2) unswitched outlets each and contact closure control inputs. Connect the conditioner to one of the dual duplex outlets.

g) Two (2) each 120VAC @ 20A dual duplex outlets, connected via conduit to the nearest Electrical Service Panel that is supplied by the Facility's Essential Electrical System.

h) One (1) each 120VAC @ 15A Power Distribution Strip(s). Connect each strip to the unstitched outlet on the power conditioner.

3. HL7 Interface:

a. The system may support downloading and updating of patient data from the hospital admission system (or other database) via the HL7 standard. The data only has to travel one way, i.e. from the admission system to the nurse-call system.

b. Coordinate with the Owner the exact fields that will be populated from the admissions system in the nurse-call system.

c. The Facility's LAN/WAN is not allowed for Nurses Call main wiring / function that must be a "stand alone primary cable infrastructure" as described herein.

d. Connections to the VA LAN/WAN for functional or operable conditions will be allowed ONLY when the LAN/WAN system has been demonstrated and NFPA (at a minimum by TVE-005OP3B) Certified meeting Life Safety Standards.

e. Provide one (1) spare HL Interface unit.

F. TIP Cable Systems:

Connect the system to the TIP system provided as a part of Speciation Section 27 15 13. Provide additional TIP equipment, interfaces and connections as required by System design. Provide secured pathway(s) and lockable cabinet/rack(s) as required.

G. Interface Equipment:

1. TCR:

a. Electrical Supervision Trouble Annunciator Panel:

1) The Electrical Supervision Trouble Annunciation Panel shall be located in the Telephone Operators Room, Police Control Center, associate Nurses Station(s).

2) The panel(s) shall be compatible with the generated electrical and/or electronic supervising signals to continuously monitor the operating condition for the System head-end processing equipment, master stations, staff stations, patient stations, duty stations, audio power amplifier(s), UPS, power supplies, dome lights and interconnecting trunks. The panels shall generate an audible and visual signal when the System's supervising system detects a system and equipment trouble or trunk-line is malfunctioning.

3) Provide one (1) spare panel.

2. Nurse (aka Staff) Locator Interface:

a. The System must be capable of performing nurse-locator functions.

b. The System must be capable of performing staff-locator functions

c. These functions may be combined into one operation.

d. Provide two (2) spare interfaces.

H. Call Initiation, Annunciation and Response:

1. Light and Tones:

a Calls may be initiated through:

1) Toilet Emergency Station pull cord.

b Once a call is initiated, it must be annunciated at the following locations:

1) The Corridor, Intersectional and Room dome light associated with the initiating device.

2) A local master control station indicating the call location and priority.

3) Each duty station.

4) Each staff station.

5) Each remote location.

c) All calls must be displayed until they are cleared by the nursing staff **ONLY** from the initiating device location.

2. Voice:

a Calls may be initiated through:

1) Staff station.

2) Toilet Emergency pull cord station.

3) Master Station.

b. Once a call is initiated, it must be annunciated at the following locations:

1) The Corridor, Intersectional and Room dome light associated with the initiating device.

2) A master station indicating the call location and priority.

3) Any duty stations associated with the unit.

4) Any staff Stations associated with the unit.

5) Each remote location.

c. All calls must be displayed until they are cleared by the nursing staff **ONLY** from the initiating device location.

3. Provide two-way voice communication between a master station and patient, staff, duty and each of the two (2) remote stations.

4. Failure of voice intercom portion of system shall not interfere with visual and audible signal systems.

5. All calls must be displayed on the master station until they are cleared by the nursing staff at ONLY the originating station. If

multiple calls are received at the master station within a short period of time, they shall be stacked based on priority and wait time. If there are more calls than the master station screen can display at one time (four [4] minimum), the system must provide a simple scrolling feature. The nurse must be able to answer any call in any order at the master station. The nurse must also be able to forward calls to staff members. If a call is not answered within a programmable time period, then the system must forward the call to appropriate back-up staff identified by each shift supervisor in a manner technically approved by VA Headquarters 005OP3B.

J. Patient and Staff Assignment:

1. System may provide for transfer of one or more individual or groups of stations from one master station to another without mechanical switches or additional wiring of the stations. The transfer may be initiated manually be the nurse or automatically at certain times of the day.
2. The Facility's LAN/WAN IS NOT ALLOWED for Nurses Call main wiring which must be a "stand alone primary cable infrastructure." ***Connections to the VA LAN/WAN will be allowed ONLY when the LAN/WAN system has been demonstrated and certified by TVE – 005OP3B meeting the minimum guidelines and requirements of the Life Safety Code.***

K. Reports:

1. The system's generated reports logging all calls, alarms, response time, bed, and staff assignments may be allowed to transmit these reports to a central archiving entity.
2. Reports function shall be limited by passwords and security tier level access, so that only supervisors may access it when desired.
3. Provide instructions to the owner on how to enable/disable the reporting functions.
4. The Facility's LAN/WAN IS NOT ALLOWED for Nurses Call main wiring that must be a "stand alone primary cable infrastructure." Connections to the VA LAN/WAN will be allowed ONLY when the system has been demonstrated and certified by 005OP2B meeting the minimum guidelines and requirements of the Life Safety Code.

L. System/Management Software:

1. Provide and install system/management software on minimum of three (3) owner-provided computers.
   a. The management software shall at a minimum provide all historical reporting features of the system as well as real-time monitoring of events.
   b. The system software shall at a minimum provide the system's operating and functioning parameters and script. The OEM shall provide VA with access to the software's script writing and functions.
2. Provide two (2) spare CD's with the software installed and operable.
3. Rights in Data: VA shall have the right to all script and programming language of system management software. If commercial off the shelf (COTS) or a memorandum of understanding (MOU) is required for follow-on maintenance, the Contractor is required to accomplish the COTS Survey document and the COR is required to accomplish the COTS Acquisition document supplied in Part 5 Attachments herein.

M. Distribution System: Refer to Specification Sections 27 11 00, Structured TIP Communications Cables; 27 15 13, HORIZONTAL and Vertical TIP Communications Cabling for additional specific TIP wire and cable standards and installation requirements used to install the Facility's TIP network.
   1. In addition to the TIP provided under the aforementioned Specification Sections, the contractor shall provide the following additional TIP installation and testing requirements, provide the following minimum additional System TIP requirements, cables & interconnections:
      a. Each wire and cable used in the System shall be specifically OEM certified by tags on each reel and recommended and approved for installation in the Facility.
      b. The Contractor shall provide the COR a 610 mm (2 foot) sample of each wire and/or cable actually employed in the System ***and each*** certification tag for approval before continuing with the installation as described herein.
      d. Copper Cables: Refer to Specification Section 27 15 13, Communications Copper Horizontal Cabling; Paragraph 2.4.C12.c.

Copper Cables – for minimum technical standards and requirements for additional System voice and data cables.

e. Line Level Audio Microphone Cable:
   1) Line level audio and microphone cable for inside racks and conduit.
   2) Shielded, twisted pair Minimum 22AWG, stranded conductors and 24AWG drain wire with overall jacket.
f. Speaker Level Audio (70.7Volt RMS):
   1) For use with 70.7V speaker circuits.
   2) 18AWG stranded pair, minimum.

2. Raceways, Back Boxes and conduit:
   a. In addition to the Raceways, Equipment Room Fittings provided under Specification Section 27 15 13 – TIP Communications Copper Horizontal Cabling, provide the following additional TIP raceway and fittings:
   b. Each raceway that is open top, shall be: UL certified for telecommunications systems, partitioned with metal partitions in order to comply with NEC Parts 517 & 800 to "mechanically separate telecommunications systems of different service, protect the installed cables from falling out when vertically mounted and allow junction boxes to be attached to the side to interface "drop" type conduit cable feeds.
   c. Intercommunication System cable infrastructure: EMT above accessible ceilings, 24 inches on center.
   d. Junction boxes shall be not less than 2-1/2 inches deep and 6 inches wide by 6 inches long.
   e. Flexible metal conduit is prohibited unless specifically approved by 005OP3B.
   f. System Conduit:
      1) The PA system is NFPA listed as Emergency / Public Safety Communication System which requires the entire system to be installed in a separate conduit system.
      2) The use of centralized mechanically partitioned wireways may be used to augment main distribution conduit on a case by case basis when specifically approved by VA Headquarters (005OP3B).
      3) Conduit Sleeves:

a) The AE has made a good effort to identify where conduit sleeves through full-height and fire rated walls on the drawings, and has instructed the electrician to provide the sleeves as shown on the drawings.

b) While the sleeves shown on the drawings will be provided by others, the contractor is responsible for installing conduit sleeves and fire-proofing where necessary. It is often the case, that due to field conditions, the nurse-call cable may have to be installed through an alternate route. Any conduit sleeves required due to field conditions or those omitted by the engineer shall be provided by the cabling contractor.

g. Device Back Boxes:

1) Furnish to the electrical contractor all back boxes required for the PA system devices.

2) The electrical contractor shall install the back boxes as well as the system conduit. Coordinate the delivery of the back boxes with the construction schedule.

3. UPS:

a. Provide a backup battery or a UPS for the System to allow normal operation and function (as if there was no AC power failure) in the event of an AC power failure or during input power fluctuations for a minimum of 30 minutes.

b. As an alternate solution, the telephone system UPS may be utilized to meet this requirement at the headend location, as long as this function is specifically approved by the Telephone Contractor and the COR.

c. The Nurse Call Contractor shall not make any attachments or connection to the telephone system until specifically directed to do so, in writing, by the COR.

d. Provide UPS for all active system components including but not limited to:

1) System Amplifiers.

2) Microphone Consoles.

3) Telephone Interface Units.

4) Headend Equipment Rack(s).

P. Installation Kit:

1. General: The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. Turn over to the COR all unused and partially opened installation kit boxes, fiberoptic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware. The following are the minimum required installation sub-kits:
2. System Grounding:
   a. The grounding kit shall include all cable and installation hardware required. All radio equipment shall be connected to earth ground via internal building wiring, according to the NEC.
   b. This includes, but is not limited to:
      3) Control Cable Shields.
      4) Data Cable Shields.
      5) Equipment Racks.
      6) Equipment Cabinets.
      7) Conduits.
      11) Power Panels.
      12) Connector Panels.
      15) Grounding Blocks.
5. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
6. Conduit: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit installation in accordance with the NEC and this document.

7. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
8. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to completely and correctly label each subsystem according to the OEM requirements, as-installed drawings, and this document.
9. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to completely and correctly provide the system documentation as required by this document and explained herein.

PART 3 – EXECUTION

3.1 PROJECT MANAGEMENT

A. Assign a single project manager to this project who will serve as the point of contact for the Owner, the General Contractor, and the Engineer.

B. The Contractor shall be proactive in scheduling work at the hospital, specifically the Contractor will initiate and maintain discussion with the general contractor regarding the schedule for ceiling cover up and install cables to meet that schedule.

C. Contact the Office of Telecommunications, Special Communications Team (07A2) at 202-461-5301/5311 to have a VA Certified Telecommunications COR assigned to the project for telecommunications review, equipment and system approval and co-ordination with VA's Spectrum Management and OCIS Teams.

3.2 COORDINATION WITH OTHER TRADES

B. Coordinate with the cabling contractor the location of TIP equipment in the **NSs, and TCOs in order to connect to the TIP cable network that was installed. Contact the COR immediately, in writing, if additional location(s) are discovered to be activated that was not previously provided.**

C. Before beginning work, verify the location, quantity, size and access for the following:

1. Isolated ground AC power circuits provided for systems.

2. Primary, emergency and extra auxiliary AC power generator requirements.
3. Junction boxes, wall boxes, wire troughs, conduit stubs and other related infrastructure for the systems.
4. System components installed by others.
5. Overhead supports and rigging hardware installed by others.

D. Immediately notify the Owner, GC and Consultant(s) in writing of any discrepancies.

3.3 NEEDS ASSESSMENT

Provide a one-on-one meeting with the particular nursing manager of each unit affected by the installation of the new nurse call system. Review the floor plan drawing, educate the nursing manager with the functions of the equipment that is being provided and gather details specific to the individual units; coverage and priorities of calls; staffing patterns; and other pertinent details that will affect system programming and training.

3.4 INSTALLATION

A. General:

1. Execute work in accordance with National, State and local codes, regulations and ordinances.
2. Install work neatly, plumb and square and in a manner consistent with standard industry practice. Carefully protect work from dust, paint and moisture as dictated by site conditions. The Contractor will be fully responsible for protection of his work during the construction phase up until final acceptance by the Owner.
3. Install equipment according to OEM's recommendations. Provide any hardware, adaptors, brackets, rack mount kits or other accessories recommended by OEM for correct assembly and installation.
4. Secure equipment firmly in place, including receptacles, speakers, equipment racks, system cables, etc.
   a. All supports, mounts, fasteners, attachments and attachment points shall support their loads with a safety factor of at least 5:1.
   b. Do not impose the weight of equipment or fixtures on supports provided for other trades or systems.

c. Any suspended equipment or associated hardware must be certified by the OEM for overhead suspension.

d. The Contractor is responsible for means and methods in the design, fabrication, installation and certification of any supports, mounts, fasteners and attachments.

5. Finishes for any exposed work such as plates, racks, panels, speakers, etc. shall be approved by the Architect, Owner and TVE 005OP3B.

6. Coordinate cover plates with field conditions. Size and install cover plates as necessary to hide joints between back boxes and surrounding wall. Where cover plates are not fitted with connectors, provide grommeted holes in size and quantity required. Do not allow cable to leave or enter boxes without cover plates installed.

7. Active electronic component equipment shall consist of solid state components, be rated for continuous duty service, comply with the requirements of FCC standards for telephone and data equipment, systems, and service.

8. Color code all distribution wiring to conform to the Nurse Call Industry Standard, EIA/TIA, and this document, whichever is the more stringent. At a minimum, all equipment, cable duct and/or conduit, enclosures, wiring, terminals, and cables shall be clearly and permanently labeled according to and using the provided record drawings, to facilitate installation and maintenance.

9. Connect the System’s primary input AC power to the Facility’ Critical Branch of the Emergency AC power distribution system as shown on the plans or if not shown on the plans consult with COR regarding a suitable circuit location prior to bidding.

10. Product Delivery, Storage and Handling:

a. Delivery: Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name and equipment catalog numbers, model and serial identification numbers. The COR may inventory the cable, patch panels, and related equipment.

b. Storage and Handling: Store and protect equipment in a manner, which will preclude damage as directed by the COR.

11. Where TCOs are installed adjacent to each other, install one outlet for each instrument.
12. Equipment installed outdoors shall be weatherproof or installed in weatherproof enclosures with hinged doors and locks with two keys.

B. Equipment Racks/Cabinets:
1. Fill unused equipment mounting spaces with blank panels or vent panels. Match color to equipment racks/cabinets.
2. Provide security covers for all devices not requiring routine operator control.
3. Provide vent panels and cooling fans as required for the operation of equipment within the OEM' specified temperature limits. Provide adequate ventilation space between equipment for cooling. Follow manufacturer’s recommendations regarding ventilation space between amplifiers.
4. Provide insulated connections of the electrical raceway to equipment racks.
5. Provide continuous raceway/conduit with no more than 40% fill between wire troughs and equipment racks/cabinets for all non-plenum-rated cable. Ensure each system is mechanically separated from each other in the wireway.
6. Ensure a minimum of 36 inches around each cabinet and/or rack to comply with OSHA Safety Standards. Cabinets and/or Racks installed side by side - the 36” rule applies to around the entire assembly

C. Distribution Frames.
1. A new stand-alone (i.e., self supporting, free standing) PA rack/frame may be provided in each TR to interconnect the NS. Rack/frames shall be wired in accordance with industry standards and shall employ "latest state-of-the-art" modular cross-connect devices. The PA riser cable shall be sized to satisfy all voice/digital requirements plus not less than 50% spare (growth) capacity in each TR which includes a fiber optic backbone.
2. The frames/racks shall be connected to the TER/MCR system ground.

D. Wiring Practice - in addition to the MANDATORY infrastructure requirements outlined in VA Construction Specifications 27 10 00 - TIP

Structured Cabling, 27 15 13 - TIP Communications Copper Horizontal Cabling, the following additional practices shall be adhered too:

1. Comply with requirements for raceways and boxes specified in Division 26 Section "Raceway and Boxes for Electrical Systems."
2. Execute all wiring in strict adherence to the National Electrical Code, applicable local building codes and standard industry practices.
3. Wiring shall be classified according to the following low voltage signal types:
   a. Balanced microphone level audio (below -20dBm) or Balanced line level audio (-20dBm to +30dBm)
   b. 70V audio speaker level audio.
   c. Low voltage DC control or power (less than 48VDC)
4. Where raceway is to be EMT (conduit), wiring of differing classifications shall be run in separate conduit. Where raceway is to be an enclosure (rack, tray, wire trough, utility box) wiring of differing classifications which share the same enclosure shall be mechanically partitioned and separated by at least four (4) inches. Where Wiring of differing classifications must cross, they shall cross perpendicular to one another.
5. Do not splice wiring anywhere along the entire length of the run. Make sure cables are fully insulated and shielded from each other and from the raceway for the entire length of the run.
6. Do not pull wire through any enclosure where a change of raceway alignment or direction occurs. Do not bend wires to less than radius recommended by manufacturer.
7. Replace the entire length of the run of any wire or cable that is damaged or abraided during installation. There are no acceptable methods of repairing damaged or abraided wiring.
8. Use wire pulling lubricants and pulling tensions as recommended by the OEM.
9. Use grommets around cut-outs and knock-outs where conduit or chase nipples are not installed.
10. Do not use tape-based or glue-based cable anchors.
11. Ground shields and drain wires to the Facility's signal ground system as indicated by the drawings.

12. Field wiring entering equipment racks shall be terminated as follows:
    a. Provide OEM directed service loops at harness break-outs and at plates, panels and equipment. Loops should be sufficient to allow plates, panels and equipment to be removed for service and inspection.
    b. Line level and speaker level wiring may be terminated inside the equipment rack using specified terminal blocks (see "Products.") Provide 15% spare terminals inside each rack. Microphone level wiring may only be terminated at the equipment served.
    c. If specified terminal blocks are not designed for rack mounting, utilize ¾" plywood or 1/8" thick aluminum plates/blank panels as a mounting surface. Do not mount on the bottom of the rack.
    d. Employ permanent strain relief for any cable with an outside diameter of 1" or greater.
13. Use only balanced audio circuits unless noted otherwise directed and indicated on the drawings.
14. Make all connections as follows:
    a. Make all connections using rosin-core solder or mechanical connectors appropriate to the application.
    b. For crimp-type connections, use only tools that are specified by the manufacturer for the application.
    c. Use only insulated spade lugs on screw terminals. Spade lugs shall be sized to fit the wire gauge. Do not exceed two lugs per terminal.
    d. Wire nuts, electrical tape or "Scotch Lock" connections are not acceptable for any application.
15. Noise filters and surge protectors shall be provided for each equipment interface cabinet, switch equipment cabinet, control console, local, and remote active equipment locations to ensure protection from input primary AC power surges and noise glitches are not induced into low Voltage data circuits.
16. Wires or cables **previously approved** to be installed outside of conduit, cable trays, wireways, cable duct, etc:
    a Only when specifically authorized as described herein, will wires or cables be identified and approved to be installed outside of

conduit. The wire or cable runs shall be UL rated plenum and OEM certified for use in air plenums.

b Wires and cables shall be hidden, protected, fastened and tied at 600 mm (24 in.) intervals, maximum, as described herein to building structure.

c Closer wire or cable fastening intervals may be required to prevents sagging, maintain clearance above suspended ceilings, remove unsightly wiring and cabling from view and discourage tampering and vandalism. Wire or cable runs, not provided in conduit, that penetrate outside building walls, supporting walls, and two hour fire barriers shall be sleeved and sealed with an approved fire retardant sealant.

d Wire or cable runs to system components installed in walls (i.e.: volume attenuators, circuit controllers, signal, or data outlets, etc.) may, when specifically authorized by the COR, be fished through hollow spaces in walls and shall be certified for use in air plenum areas.

e Completely test all of the cables after installation and replace any defective cables.

f Wires or cables that are installed outside of buildings shall be in conduit, secured to solid building structures. If specifically approved, on a case by case basis, to be run outside of conduit, the wires or cables shall be installed, as described herein. The bundled wires or cables must: Be tied at not less than 460 mm (18 in.) intervals to a solid building structure; have ultra violet protection and be totally waterproof (including all connections). The laying of wires or cables directly on roof tops, ladders, drooping down walls, walkways, floors, etc. is not allowed and will not be approved.

E. Cable Installation – Cable Installation – In addition to the ***MANDATORY*** infrastructure requirements outlined in VA Construction Specifications 27 10 00 – Structured TIP Cabling and 27 15 13 – TIP Communications Copper Horizontal Cabling and the following additional practices shall be adhered too:

1. Support cable on maximum 2’-0” centers. Acceptable means of cable support are cable trays. Velcro wrap cable bundles loosely to the

means of support with plenum rated Velcro straps. Plastic tie wraps are not acceptable as a means to bundle cables.

2. Run cables parallel to walls.
3. Install maximum of 10 cables in a single row. Provide necessary rows as required by the number of cables.
4. Do not lay cables on top of light fixtures, ceiling tiles, mechanical equipment, or ductwork. Maintain at least 2'-0" clearance from all shielded electrical apparatus.
5. All cables shall be tested after the total installation is fully complete. All test results are to be documented. All cables shall pass acceptable test requirements and levels. Contractor shall remedy any cabling problems or defects in order to pass or comply with testing. This includes the re-pull of new cable as required at no additional cost to the Owner.
6. Ends of cables shall be properly terminated on both ends per industry and OEM's recommendations.
7. Provide proper temporary protection of cable after pulling is complete before final dressing and terminations are complete. Do not leave cable lying on floor. Bundle and tie wrap up off of the floor until you are ready to terminate.
8. Terminate all conductors; no cable shall contain unterminated elements. Make terminations only at outlets and terminals.
9. Splices, Taps, and Terminations: Arrange on numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures. Cables may not be spliced.
10. Bundle, lace, and train conductors to terminal points without exceeding OEM's limitations on bending radii. Install lacing bars and distribution spools.
11. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used.
12. Cable shall not be run through structural members or be in contact with pipes, ducts, or other potentially damaging items.
13. Separation of Wires: (REFER TO RACEWAY INSTALLATION) Separate speaker-microphone, line-level, speaker-level, and power wiring runs. Install in separate raceways or, where exposed or in same enclosure, separate conductors at least 12 inches apart for speaker

microphones and adjacent parallel power and telephone wiring. Separate other intercommunication equipment conductors as recommended by equipment manufacturer.

14. Serve all cables as follows:
    a. Cover the end of the overall jacket with a 1" (minimum) length of transparent heat-shrink tubing. Cut unused insulated conductors 2" (minimum) past the heat-shrink, fold back over jacket and secure with cable-tie. Cut unused shield/drain wires 2" (minimum) past the Heatshrink and serve as indicated below.
    b. Cover shield/drain wires with heat-shrink tubing extending back to the overall jacket. Extend tubing ¼" past the end of unused wires, fold back over jacket and secure with cable tie.
    c. For each solder-type connection, cover the bare wire and solder connection with heat-shrink tubing.

F. Labeling: Provide labeling in accordance with ANSI/EIA/TIA-606-A. All lettering for Nurse Call circuits shall be stenciled using **laser printers.**
    1. Cable and Wires (Hereinafter referred to as "Cable"): Cables shall be labeled at both ends in accordance with ANSI/EIA/TIA-606-A. Labels shall be permanent in contrasting colors. Cables shall be identified according to the System "Record Wiring Diagrams."
    2. Equipment: System equipment shall be permanently labeled with contrasting plastic laminate or Bakelite material. System equipment shall be labeled on the face of the unit corresponding to its source.
        a. Clearly, consistently, logically and permanently mark switches, connectors, jacks, relays, receptacles and electronic and other equipment.
        b. Engrave and paint fill all receptacle panels using 1/8" (minimum) high lettering and contrasting paint.
        c. For rack-mounted equipment, use engraved Lamacoid labels with white 1/8" (minimum) high lettering on black background. Label the front and back of all rack-mounted equipment.
    3. Conduit, Cable Duct, and/or Cable Tray: The Contractor shall label all conduit, duct and tray, including utilized GFE, with permanent marking devices or spray painted stenciling a minimum of 3 meters

(10 ft.) identifying it as the System. In addition, each enclosure shall be labeled according to this standard.

4. Termination Hardware: The Contractor shall label TCOs and patch panel connections using color coded labels with identifiers in accordance with ANSI/EIA/TIA-606-A and the "Record Wiring Diagrams."
5. Where multiple pieces of equipment reside in the same rack group, clearly and logically label each indicating to which room, channel, receptacle location, etc. they correspond.
6. Permanently label cables at each end, including intra-rack connections. Labels shall be covered by the same, transparent heat-shrink tubing covering the end of the overall jacket. Alternatively, computer generated labels of the type which include a clear protective wrap may be used.
7. Contractor's name shall appear no more than once on each continuous set of racks. The Contractor's name shall not appear on wall plates or portable equipment.
8. Ensure each OEM supplied item of equipment has appropriate UL Labels / Marks for the service the equipment is performed permanently attached / marked to a ***non-removal*** board in the unit. EQUIPMENT INSTALLED NOT BEARING THESE UL MARKS WILL NOT BE ALLOWED TO BE A PART OF THE SYSTEM. THE CONTRACTOR SHALL BEAR ALL COSTS REQUIRED TO PROVIDE REPLACEMENT EQUIPMENT WITH APPROVED UL MARKS.

G. Conduit: When the Contractor and/or OEM determines additional system conduits and/or signal ducts are required in order to meet the system minimum performance standards outlined herein, the contractor shall provide these items as follows:

1. Conduit:
   a. The Contractor shall employ the latest installation practices and materials. The Contractor shall provide conduit, junction boxes, connectors, sleeves, weather heads, pitch pockets, and associated sealing materials not specifically identified in this document as GFE. Conduit penetrations of walls, ceilings, floors, interstitial space, fire barriers, etc., shall be sleeved and sealed.
   b. All cables shall be installed in separate conduit and/or signal ducts (exception from the separate conduit requirement to allow

Nurse Call cables to be installed in partitioned cable tray with voice cables may be granted in writing by the COR if requested). Conduits shall be provided in accordance with Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and NEC Articles 517 for Critical Care and 800 for Communications systems, at a minimum.

c. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.

d. When ”interduct” flexible cable protective systems is specifically authorized to be provided for use in the System, it’s installation guidelines and standards shall be as the specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.

e. Conduit fill (including GFE approved to be used in the system) shall not exceed 40%. Each conduit end shall be equipped with a protective insulator or sleeve to cover the conduit end, connection nut or clamp, to protect the wire or cable during installation and remaining in the conduit. Electrical power conduit shall be installed in accordance with the NEC. AC power conduit shall be run separate from signal conduit.

f. Ensure that Critical Care Nurse Call Systems (as identified by NEC Section 517) are completely separated and protected from all other systems.

3.5 PROTECTION OF NETWORK DEVICES

A. Contractor shall protect network devices during unpacking and installation by wearing manufacturer approved electrostatic discharge (ESD) wrist straps tied to chassis ground. The wrist strap shall meet OSHA requirements for prevention of electrical shock, should technician come in contact with high voltage.

3.6 CUTTING, CLEANING AND PATCHING

A. It shall be the responsibility of the contractor to keep their work area clear of debris and clean area daily at completion of work.

B. It shall be the responsibility of the contractor to patch and paint any wall or surface that has been disturbed by the execution of this work.

C. The Contractor shall be responsible for providing any additional cutting, drilling, fitting or patching required that is not indicated as provided by others to complete the Work or to make its parts fit together properly.

D. The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or separate contractors by cutting, patching or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter such construction by the Owner or a separate contractor except with written consent of the Owner and of such separate contractor; such consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold from the Owner or a separate Contractor the Contractor's consent to cutting or otherwise altering the Work.

E. Where coring of existing (previously installed) concrete is specified or required, including coring indicated under unit prices, the location of such coring shall be clearly identified in the field and the location shall be approved by the Project Manager prior to commencement of coring work.

3.7 FIREPROOFING

A. Where Nurse Call wires, cables and conduit penetrate fire rated walls, floors and ceilings, fireproof the opening.

B. Provide conduit sleeves (if not already provided by electrical contractor) for cables that penetrate fire rated walls and Telecommunications Rooms floors and ceilings. After the cabling installation is complete, install fire proofing material in and around all conduit sleeves and openings. Install fire proofing material thoroughly and neatly. Seal all floor and ceiling penetrations.

C. Use only materials and methods that preserve the integrity of the fire stopping system and its rating.

D. Use approved fireproofing tape of the same type as used for the high voltage cables, and apply the tape in a single layer, one-half lapped or as recommended by the manufacturer. Install the tape with the coated

side towards the cable and extend it not less than 25 mm (one inch) into each duct.

E. Secure the tape in place by a random wrap of glass cloth tape.

3.8 GROUNDING

A. Ground Nurse Call cable shields and equipment to eliminate shock hazard and to minimize ground loops, commonmode returns, noise pickup, cross talk, and other impairments as specified in CFM Division 27, Section 27 05 26 – Grounding and Bonding for Communications Systems.

B. Facility Signal Ground Terminal: Locate at main room or area signal ground within the room (i.e. head end and telecommunications rooms) or area(s) and indicate each signal ground location on the drawings.

C. Extend the signal ground to inside each equipment cabinet and/or rack. Ensure each cabinet and/or rack installed item of equipment is connected to the extended signal ground. Isolate the signal ground from power and major equipment grounding systems.

D. When required, install grounding electrodes as specified in CFM Division 26, Section 26 05 26 –Grounding and Bonding for Electrical Systems.

E. Do not use "3rd or 4th" wire internal electrical system conductors for communications signal ground.

F. Do not connect the signal ground to the building's external lightning protection system.

G. Do Not "mix grounds" of different systems.

H. Insure grounds of different systems are installed as to not violate OSHA Safety and NEC installation requirements for protection of personnel.

PART 4 – TESTING / TRAINING

4.0 SYSTEM LISTING

The Nurses Call System is NFPA listed as an "Emergency" Communication system.

4.1 PROOF OF PERFORMANCE TESTING

A. Intermediate Testing:

1. After completion of 30 – 40% of the installation of a head end cabinet(s) and equipment, one master stations, local and remote stations, treatment rooms, and prior to any further work, this

portion of the system must be pretested, inspected, and 1certified. Each item of installed equipment shall be checked to ensure appropriate UL Listing and Certification Labels are affixed as required by NFPA –Life Safety Code 101-3.2 (a) & (b), UL Nurse Call Standard 1069 and JCHCO evaluation guidelines, and proper installation practices are followed. The intermediate test shall include a full operational test.

2. All inspections and tests shall be conducted by an OEM-certified contractor representative and witnessed by TVE-005OP3B if there is no local Government Representative that processes OEM and VA approved Credentials to inspect and certify the system. The results of the inspection will be officially recorded by the Government Representative and maintained on file by the COR, until completion of the entire project. The results will be compared to the Acceptance Test results. An identical inspection may be conducted between the 65 - 75% of the system construction phase, at the direction of the COR.

B. Pretesting:

1. Upon completing installation of the Nurse Call System, the Contractor shall align, balance, and completely pretest the entire system under full operating conditions.
2. Pretesting Procedure:
   a. During the System Pretest the Contractor shall verify (utilizing approved test equipment) that the System is fully operational and meets all the System performance requirements of this standard.
   b. The Contractor shall pretest and verify that all PSM System functions and specification requirements are met and operational, no unwanted aural effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise, etc. are present. At a minimum, each of the following locations shall be fully pretested:
      1) Central Control Cabinets.
      2) Nurse Control Stations.
         a) Master Stations
         b) Emergency Stations
      3) Dome Lights.

a) Corridors

b) Intersectional

4) STRs

5) Electrical Supervision Panels/Functions/locations.

6) All Networked locations.

7) System interface locations (i.e. wireless, PA, telephone, etc.).

8) System trouble reporting.

9) System electrical supervision.

10) UPS operation.

11) Primary / Emergency AC Power Requirements

12) Extra Auxiliary Generator Requirements.

13) NSs.

3. The Contractor shall provide four (4) copies of the recorded system pretest measurements and the written certification that the System is ready for the formal acceptance test shall be submitted to the COR.

C. Acceptance Test:

1. After the Nurse Call System has been pretested and the Contractor has submitted the pretest results and certification to the COR, then the Contractor shall schedule an acceptance test date and give the COR 15 working days written notice prior to the date the acceptance test is expected to begin. The System shall be tested in the presence of a TVE 005OP3B and OEM certified representatives. The System shall be tested utilizing the approved test equipment to certify proof of performance and Life Safety / Critical Service compliance. The tests shall verify that the total System meets all the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.

2. The acceptance test shall be performed on a "go-no-go" basis. Only those operator adjustments required to show proof of performance shall be allowed. The test shall demonstrate and verify that the installed System does comply with all requirements of this specification under operating conditions. The System shall be rated as either acceptable or unacceptable at the conclusion of the test.

Failure of any part of the System that precludes completion of system testing, and which cannot be repaired in four (4) hours, shall be cause for terminating the acceptance test of the System. Repeated failures that result in a cumulative time of eight (8) hours to affect repairs shall cause the entire System to be declared unacceptable.

3. Retesting of the entire System shall be rescheduled at the convenience of the Government and costs borne by the Contractor at the direction of the SRE.

D. Acceptance Test Procedure:

1. Physical and Mechanical Inspection:
   a. The TVE 005OP3B Representative will tour all major areas where the Nurse Call System and all sub-systems are completely and properly installed to insure they are operationally ready for proof of performance testing. A system inventory including available spare parts will be taken at this time. Each item of installed equipment shall be checked to ensure appropriate UL certification labels are affixed.
   b. The System diagrams, record drawings, equipment manuals, TIP Auto CAD Disks, intermediate, and pretest results shall be formally inventoried and reviewed.
   c. Failure of the System to meet the installation requirements of this specification shall be grounds for terminating all testing.
2. Operational Test:
   a. After the Physical and Mechanical Inspection, the central terminating and nurse call master control equipment shall be checked to verify that it meets all performance requirements outlined herein. A spectrum analyzer and sound level meter may be utilized to accomplish this requirement.
   b. Following the central equipment test, a pillow speaker (or on board speaker) shall be connected to the central terminating and nurse call master control equipment’s output tap to ensure there are no signal distortions such as intermodulation, data noise, popping sounds, erratic system functions, on any function.
   c. The distribution system shall be checked at each interface, junction, and distribution point, first, middle, and last

intersectional, room, and bed dome light in each leg to verify that the nurse call distribution system meets all system performance standards.

f. Additionally, each installed emergency, patient, staff, duty, panic station, intersectional, room, and bed dome light, power supply, code one, and remote annunciator panels shall be checked insuring they meet the requirements of this specification.

g. Once these tests have been completed, each installed sub-system function shall be tested as a unified, functioning and fully operating system. The typical functions are: nurse follower, three levels of emergency signaling (i.e. flashing red emergency, flashing white patient emergency, flashing white or combination lights for staff emergency), minimum of 10 minutes of UPS operation, memory saving, minimum of ten station audio paging, canceling emergency calls at each originating station only, and storage and prioritizing of calls.

h. Individual Item Test: The TVE 005OP3B Representative will select individual items of equipment for detailed proof of performance testing until 100% of the System has been tested and found to meet the contents of this specification. Each item shall meet or exceed the minimum requirements of this document.

3. Test Conclusion:

a. At the conclusion of the Acceptance Test, using the generated punch list (or discrepancy list) the VA and the Contractor shall jointly agree to the results of the test, and reschedule testing on deficiencies and shortages with the COR. Any retesting to comply with these specifications will be done at the Contractor's expense.

b. If the System is declared unacceptable without conditions, all rescheduled testing expenses will be borne by the Contractor.

E. Acceptable Test Equipment: The test equipment shall furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:

1. Spectrum Analyzer.

2. Signal Level Meter.
3. Volt-Ohm Meter.
4. Sound Pressure Level (SPL) Meter.
5. Oscilloscope.
6. Patient Push Button Cord Test Set.

4.2 WARRANTY

A. Comply with FAR 52.246-21, except that warranty shall be as follows:

B. Contractor's Responsibility:

1. The Contractor shall warranty that all provided material and equipment will be free from defects, workmanship and will remain so for a period of one year from date of final acceptance of the System by the VA. The Contractor shall provide OEM's equipment warranty documents, to the COR, that certifies each item of equipment installed conforms to OEM published specifications.
2. The Contractor's maintenance personnel shall have the ability to contact the Contractor and OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and assistance in resolving technical problems at any time. This contact capability shall be provided by the Contractor and OEM at no additional cost to the VA.
3. All Contractor maintenance and supervisor personnel shall be fully qualified by the OEM and must provide two (2) copies of current and qualified OEM training certificates and OEM certification upon request.
4. Additionally, the Contractor shall accomplish the following minimum requirements during the two year guaranty period:
   a. Response Time during the Two Year Guaranty Period:
      1) The COR (or Facility Contracting Officer if the system has been turned over to the Facility) is the Contractor's ONLY OFFICIAL reporting and contact official for nurse call system trouble calls, during the guaranty period.
      2) A standard work week is considered 8:00 A.M. to 5:00 P.M. or as designated by the COR (or Facility Contracting Officer), Monday through Friday exclusive of Federal Holidays.
   3) The Contractor shall respond and correct on-site trouble calls, during the standard work week to:

a) A routine trouble call within one (1) working day of its report. A routine trouble is considered a trouble which causes a pillow speaker or cordset, one (1) master nurse control station, patient station, emergency station, or dome light to be inoperable.

b) Routine trouble calls in critical emergency health care facilities (i.e., cardiac arrest, intensive care units, etc.) shall also be deemed as an emergency trouble call. The COR (or Facility Contracting Officer) shall notify the Contractor of this type of trouble call.

c) An emergency trouble call within four hours of its report. An emergency trouble is considered a trouble which causes a sub-system (ward), distribution point, terminal cabinet, or code one system to be inoperable at anytime.

4) If a Nurse Call component failure cannot be corrected within four (4) hours (exclusive of the standard work time limits), the Contractor shall be responsible for providing alternate nurse call equipment. The alternate equipment/system shall be operational within a maximum of 20 hours after the four (4) hour trouble shooting time and restore the effected location operation to meet the System performance standards. If any sub-system or major system trouble cannot be corrected within one working day, the Contractor shall furnish and install compatible substitute equipment returning the System or sub-system to full operational capability, as described herein, until repairs are complete.

C. Work Not Included: Maintenance and repair service shall not include the performance of any work due to improper use; accidents; other vendor, contractor, or owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall immediately notify the COR or Facility Contracting Officer in writing upon the discovery of these incidents. The COR or Facility Contracting Officer will investigate all reported incidents and render

4.3 TRAINING

A. Provide thorough training of all nursing staff assigned to those nursing units receiving new networked nurse/patient communications

equipment. This training shall be developed and implemented to address two different types of staff. Floor nurses/staff shall receive training from their perspective, and likewise, unit secretaries (or any person whose specific responsibilities include answering patient calls and dispatching staff) shall receive operational training from their perspective. A separate training room will be set up that allows this type of individualized training utilizing in-service training unit, prior to cut over of the new system.

B. Provide the following minimum training times and durations:

1. **48** hours prior to opening for nursing staff (in 8-hour increments) - split evenly over 3 weeks and day and night shifts. Coordinate schedule with Owner.
2. **32** hours during the opening week for nursing staff - both day and night shifts.
3. **24** hours for supervisors and system administrators.

5.0 ATTACHMENTS

A. The following items are required as a part of the system:

1. COTS Documents:

a.

CHECKLIST FOR SOFTWARE LICENSING AGREEMENTS

(For use in commercial item acquisition [COTS] conforming to – FAR Part 12)

The Government may not be able to accept standard commercial licensing agreement without modification; *you must* negotiate terms and conditions so it is consistent with the FAR and the VAAR.		
Is the license (check all that apply):	**Yes**	**No**
Exclusive		
Non-exclusive		
Perpetual		
Limited term		
If limited term, state the period (months or years):		
If limited term, is there an automatic renewal provision?		
CPU based		
If CPU based, state number of machines and whether simultaneous use is permitted:		
Site license		
If site license, state the site/location:		
Network license		
Other basis (e.g., # of users, # of transactions, etc.) (state specifics)		
Applicable to only the current version (doesn't apply to future versions)		
Software maintenance included at no extra cost		
Allow for office relocation or transfer		
Allow copying for backup or archival purpose		
Allow no cost copy at disaster recovery site		
Restricted on Use: (see note below)		
Restricted on the processing of data by or for user's subsidiaries and affiliates		
Restricted on processing of third party data (or use in service bureau)		
Restricted on network use		
Restricted on site and equipment limitations		
Restricted on number of users (e.g., cannot exceed _____ # of users)		

Terms and Conditions that may need to be negotiated:	**Yes**	**No**
Does the license prohibit use of the software outside of the Government? If yes, this needs to be deleted/modified if other Government contractors need access to the software (as GFP) to fulfill obligations of their own contracts.		
Does license state that the software is Year 2000 compliant or include a Year 2000 warranty? If no, must ensure it is compliant per FAR 39 or include a Y2K warranty.		
Does the license state that it provides no warranties or guarantees of any kind? If yes, need to determine whether additional warranty would be in the best interest of the Government.		
Does the license warrant that the software does not contain any code (e.g., virus) that will disable the software, and if such code exists, that Licensor agrees to indemnify the licensee (user) for all damages suffered as a result of such code? If no, need to negotiate for such warranty.		
Does the license allow access to source code? If no, negotiate for access if software will be modified or customized for the Government's needs or if the Government intends to maintain the software itself.		
Does the license require Licensor to deposit source code in escrow account? If no and source code is needed, consider negotiating for this provision, and state what "release conditions" are.		
Does the license allow the Government to hold the rights to customized code and to the data that the software manipulates? If no, negotiate for the rights if the Government (customer) requires them.		
Does the license authorize us to copy user manuals for internal purposes? If no, negotiate for authorization if multiple copies must be made for our internal use or ensure that the vendor supplies adequate number of copies. May also negotiate for updated manuals at periodic intervals, e.g., with each major update.		
Does the license state that licensee modifications to the software void all warranties? If yes, ensure that the vendor still warrants the unmodified portions.		
Does the license include clauses that prohibit needed uses of software, restrict the use of output from the software, or inappropriately burden the operation of the computer facilities? If yes, need to negotiate better terms and conditions.		
Is the dispute clause in the license consistent with FAR 52.233-1, Disputes Clause? If no, then need to modify license to be consistent with FAR.		
Does the default clause in the license allow for the Government to terminate for convenience or for cause, consistent with FAR 52.212-4(l) or FAR 52.212-4(m)? If no, then need to modify license to be consistent with FAR Part 12 (not FAR Part 49).		

b.

SOLICITATION/CONTRACT/ORDER FOR COMMERCIAL ITEMS OFFEROR TO COMPLETE BLOCKS 12, 17, 23, 24, & 30			1. REQUISITION NUMBER	PAGE 1 OF 7
2. CONTRACT NO.	3. AWARD/EFFECTIVE DATE SEE BLOCK 31C	4. ORDER NUMBER	5. SOLICITATION NO.	6. SOLICITATION ISSUE DATE
7. FOR SOLICITATION INFORMATION	a. NAME		b. TELEPHONE NUMBER (No collect calls)	8. OFFER DUE DATE/ LOCAL TIME

9. ISSUED BY: CODE	10. THIS ACQUISITION IS ☐ UNRESTRICTED ☐ SETASIDE: 100 % FOR ☐ SMALL BUSINESS ☐ HUBZONE SMALL BUSINESS ☐ 8(A) NAICS: 541511 SIZE STANDARD:	11. DELIVERY FOR FOB DESTINATION UNLESS BLOCK IS MARKED ☐ SEE SCHEDULE	12. DISCOUNT TERMS
		☐ 13a. THIS CONTRACT IS A RATED ORDER UNDER DPAS (15 CFR 700)	
		13b. RATING	
		14. METHOD OF SOLICITATION ☒ RFQ ☐ IFB ☐ RFP	

15. DELIVER TO CODE	16. ADMINISTERED BY CODE
	See #9 above

17a. CONTRACTOR/ CODE OFFEROR	FACILITY CODE	18a. PAYMENT WILL BE MADE BY CODE
TELEPHONE NO: 703.246-0392		UNITED STATES OF AMERICA Department of Veterans Affairs FMS P.O. Box 149971 Austin, TX 78714-8971

☐ 17b. CHECK IF REMITTANCE IS DIFFERENT AND PUT SUCH ADDRESS IN OFFER	18b. SUBMIT INVOICES TO ADDRESS SHOWN IN BLOCK 18a. UNLESS BLOCK BELOW IS CHECKED ☒ SEE ADDENDUM

19. ITEM NO.	20. SCHEDULE OF SUPPLIES/SERVICES	21. QUANTITY	22. UNIT	23. UNIT PRICE	24. AMOUNT
	See page 2 Use Reverse and/or (Attach Additional Sheets as Necessary)				
25. ACCOUNTING AND APPROPRIATION DATA				26. TOTAL AWARD AMOUNT *(For Govt. Use Only)*	

☐ 27a. SOLICITATION INCORPORATES BY REFERENCE FAR 52.212-1, 52.212-4. FAR 52.212-3 AND 52.212-5 ARE ATTACHED. ADDENDA ☐ ARE ☐ ARE NOT ATTACHED.
☒ 27b. CONTRACT/PURCHASE ORDER INCORPORATES BY REFERENCE FAR 52.212-4, 52.227-14, 52.227-16, and 52.227-19. ADDENDA ☒ ARE ☐ ARE NOT ATTACHED.

☒ 28. CONTRACTOR IS REQUIRED TO SIGN THIS DOCUMENT AND RETURN __1_ COPIES TO ISSUING OFFICE. CONTRACTOR AGREES TO FURNISH AND DELIVER ALL ITEMS SET FORTH OR OTHERWISE IDENTIFIED ABOVE AND ON ANY ADDITIONAL SHEETS SUBJECT TO THE TERMS AND CONDITIONS SPECIFIED HEREIN.	☐ 29. AWARD OF CONTRACT: REF. _____OFFER DATED___ _____. YOUR OFFER ON SOLICITATION (BLOCK 5), INCLUDING ANY ADDITIONS OR CHANGES WHICH ARE SET FORTH HEREIN, IS ACCEPTED AS TO ITEMS:
30A. SIGNATURE OF OFFEROR/CONTRACTOR	31a. UNITED STATES OF AMERICA (SIGNATURE OF CONTRACTING OFFICER)

30b. NAME AND TITLE OF SIGNER *(Type or Print)*	30c. DATE SIGNED	31b. NAME OF CONTRACTING OFFICER (*Type or Print*) Contracting Officer	31c. DATE SIGNED

AUTHORIZED FOR LOCAL REPRODUCTION
PREVIOUS EDITION IS NOT USABLE
COMPUTER-GENERATED
STANDARD FORM 1449 (REV. 4/2002)
Prescribed By GSA - FAR (48CFR) 53.212

19. ITEM NO.	20. SCHEDULE OF SUPPLIES/SERVICES	21. QUANTITY	22. UNIT	23. UNIT PRICE	24. AMOUNT

This Contract is Firm Fixed Price (FFP). The Contractor is required to provide the software, software license, and software maintenance services for the computer software identified below. Distribution of maintenance copies shall be accomplished by using an appropriate magnetic, electronic or printed media. Software maintenance includes periodic updates, enhancements and corrections to the software, and reasonable technical support, all of which are customarily provided by the Contractor to its customers.

The name of the software is: Word 2008
License Type: Perpetual or Term?????
Software Manufacturer: Microsoft

Governing Law. Federal law and regulations, including the Federal Acquisition Regulations ("FAR"), shall govern this Contract or Order (Contract/Order). Commercial license agreements may be made a part of this Contract/Order but only if both parties expressly make them an addendum. If the commercial license agreement is not made an addendum, it shall not apply, govern, be a part of or have any effect whatsoever on this Contract/Order; this includes, but is not limited to, any agreement embedded in the computer software (clickwrap) or any agreement that is otherwise delivered with or provided to the Government with the commercial computer software or documentation (shrinkwrap), or any other license agreement otherwise referred to in any document. If a commercial license agreement is made an addendum, only those provisions addressing data rights regarding the Government's use, duplication and disclosure of data (e.g., restricted computer software) are included and made a part of this Contract/Order, and only to the extent that those provisions are not duplicative or inconsistent with Federal law, Federal regulation or the incorporated FAR clauses; those provisions in the commercial license agreement that do not address data rights regarding the Government's use, duplication and disclosure of data shall not be included or made a part of the Contract/Order. Federal law and regulation, including without limitation, the Contract Disputes Act (41 U.S.C. §601-613), the Anti-Deficiency Act (31 U.S.C. §1341 et seq.), the Competition in Contracting Act (41 U.S.C. §251, et seq), the Prompt Payment Act (31 U.S.C. §3901, et seq.) and FAR clauses 52.212-4, 52.227-14, 52.227-19 shall supersede, control and render ineffective any inconsistent, conflicting or duplicative provision in any commercial license agreement. In the event of conflict between this clause and any provision in the Contract/Order or the commercial license agreement or elsewhere, the terms of this clause

	shall prevail. Claims of patent or copyright infringement brought against the Government as a party shall be defended by the U.S. Department of Justice (DOJ). 28 U.S.C. § 516. At the discretion of DOJ, the Contractor may be allowed reasonable participation in the defense of the litigation. Any additional changes to the Contract/Order must be made by contract modification (Standard Form 30). Nothing in this Contract/Order or any commercial license agreement shall be construed as a waiver of sovereign immunity. See also Addendum A and B attached hereto.				
1	Microsoft Word 2008 Software License, Part No. 9891-7069. Software may be installed on four separate personal computers and be used by any VA employee or support service contractor. Licenses are perpetual.	4	EA	$10,000.00	$40,000.00
2	12 months of Standard Microsoft Word Software Maintenance and Technical Support Services for the software being acquired under CLIN 1; Part No. 9891-7069.	4	EA	$2,500.00	$10,000.00
	Total				$50,000.00

32a. QUANTITY IN COLUMN 21 HAS BEEN
☐ RECEIVED ☐ INSPECTED ☐ ACCEPTED, AND CONFORMS TO THE CONTRACT, EXCEPT AS NOTED:

32b. SIGNATURE OF AUTHORIZED GOVT. REPRESENTATIVE	32c. DATE	32d. PRINTED NAME AND TITLE OF AUTHORIZED GOVERNMENT REPRESENTATIVE
32e. MAILING ADDRESS OF AUTHORIZED GOVERNMENT REPRESENTATIVE		32f. TELEPHONE NO. OF AUTHORIZED GOVERNMENT REPRESENTATIVE 32g. E-MAIL OF AUTHORIZED GOVERNMENT REPRESENTATIVE

33. SHIP NUMBER	34. VOUCHER NUMBER	35. AMOUNT VERIFIED CORRECT FOR	36. PAYMENT ☐ COMPLETE ☐ PARTIAL ☐ FINAL	37. CHECK NUMBER
☐ PARTIAL ☐ FINAL				
38. S/R ACCOUNT NUMBER	39. S/R VOUCHER NUMBER	40. PAID BY		

41a. I CERTIFY THIS ACCOUNT IS CORRECT AND PROPER FOR PAYMENT	42a. RECEIVED BY (Print)
41b. SIGNATURE AND TITLE OF CERTIFYING OFFICER	41c. DATE

	42b. RECEIVED AT (Location)	
	42c. DATE REC'D *(YY/MM/DD)*	42d. TOTAL CONTAINERS

STANDARD FORM 1449 (REV. 4/2002) **BACK**

ADDENDUM A –ADDITIONAL TERMS AND CONDITIONS FOR CONTRACT # _____OR ORDER#_____

A.1 ***Federal Acquisition Regulation (FAR) Incorporated by Reference.*** The Contractor agrees to comply with the following FAR clauses, which the Contracting Officer has indicated as being incorporated in this Contract/Order by reference, to implement provisions of law or executive orders applicable to acquisitions of this nature, to implement department policy or to clarify the Government's requirement. Copies of clauses in full text will be provided on request. FAR Clauses can be viewed at http://www.arnet.gov/far/.

1) FAR 52.212-4, Contract Terms and Conditions-Commercial Items (Oct 2003)
2) FAR 52.227-14, Rights in Data—General (Dec 2007), Alt III
3) FAR 52.227-16, Additional Data Requirements (Jun 1987)
4) FAR 52.227-19, Commercial Computer Software License (Dec 2007)

A.2 ***Contracting Officer's Authority.*** The Contracting Officer is the only person authorized to make or approve any changes in any of the requirements of this Contract, and notwithstanding any provisions contained elsewhere in this Contract/Order, the said authority remains solely within the Contracting Officer. In the event the Contractor makes any changes at the direction of any person other than the Contracting Officer, the changes will be considered to have been made without authority and no adjustment will be made in the contract price to cover any increase in costs incurred as a result thereof.

A.3 ***VAAR 852.270-1 Representatives of Contracting Officers (APR 1984).*** The Contracting Officer reserves the right to designate representatives to act for him/her in furnishing technical guidance and advice or generally supervise the work to be performed under this Contract/Order. Such designation will be in writing and will define the scope and limitations of the designee's authority. A copy of the designation shall be furnished the Contractor.

A.4 ***VAAR 852.270-4 Commercial Advertising (NOV 1984).*** The Contractor will not advertise the award of this Contract/Order in his/her commercial advertising in such a manner as to state or imply that the Department of Veterans Affairs endorses a product, project or commercial line of endeavor.

A.5 ***VAAR 852.237-70 Contractor Responsibilities (APR 1984)*** The Contractor shall obtain all necessary licenses and/or permits required to perform this work. He/she shall take all reasonable precautions necessary to protect persons and property from injury or damage during the performance of the Contract/Order. He/she shall be responsible for any injury to himself/herself, his/her employees, as well as for any damage to personal or public property that occurs during the performance of the Contract/Order that is caused by his/her employees fault or negligence, and shall maintain personal liability and property damage

insurance having coverage for a limit as required by the laws of the state where services are performed. Further, it is agreed that any negligence of the Government, its officers, agents, servants and employees, shall not be the responsibility of the Contractor hereunder with the regard to any claims, loss, damage, injury, and liability resulting there from.

A.6 ***Indemnification.*** The Contractor shall save and hold harmless and indemnify the Government against any and all liability claims, and cost of whatsoever kind and nature for injury to or death of any person or persons and for loss or damage to any Contractor property or property owned by a third party occurring in connection with or in any way incident to or arising out of the occupancy, use service, operation, or performance of work under the terms of the Contract/Order, resulting in whole or in part from the acts or omissions of the Contractor, any subcontractor, or any employee, agent, or representative of the Contractor or subcontractor.

A.7 ***Government's Liability.*** The Government shall not be liable for any injury to the Contractor's personnel or damage to the Contractor's property unless such injury or damage is due to negligence on the part of the Government and is recoverable under the Federal Torts Claims Act, or pursuant to other Federal statutory authority.

A.10 ***Uniform Computer Information Transaction Act (UCITA).*** UCITA is not applicable to the Contract/Order.

A.11 ***Software License and Software Maintenance Subscription and Technical Support.***

(1) Definitions.

(a) Licensee. The term "licensee" shall mean the U.S. Department of Veterans Affairs ("VA") and is synonymous with "Government."

(b) Licensor. The term "licensor" shall mean the software manufacturer of the computer software being acquired. The term "Contractor" is the company identified in Block 17a on the SF1449. If the Contractor is a reseller and not the Licensor, the Contractor remains responsible for performance under this Contract.

(c) Software. The term "software" shall mean the licensed computer software product(s) cited in the Schedule of Supplies (Page 2).

(d) Maintenance. The term "maintenance" is the process of enhancing and optimizing software, as well as remedying defects. It shall include all new fixes, patches, releases, updates, versions and upgrades, as further defined below.

(e) Technical Support. The term "technical support" refers to the range of services providing assistance for the software via the telephone, email, a website or otherwise.

(f) Release or Update. The term "release" or "update" are terms that refer to a revision of software that contains defect corrections, minor enhancements or improvements of the software's functionality. This is usually designated by a change in the number to the right of the decimal point (e.g., from Version 5.3 to 5.4). An example of an update is the addition of new hardware.

(g) Version or Upgrade. The term "version" or "upgrade" are terms that refer to a revision of software that contains new or improved

functionality. This is usually designated by a change in the number to the left of the decimal point (e.g., from Version 5.4 to 6).

(2) License. Grant of License and Term.

(a) See also Addendum B.
(b) Unless otherwise stated in the Schedule of Supplies/Services, the software license provided to the Government is a perpetual, nonexclusive license to use the software.
(c) The license authorizes the Government to use the software in processing data for other federal agencies.
(d) If the licensed software requires a password (or license key) to be operational, it shall be delivered with the software media and have no expiration date.
(e) If the Government decides to outsource or contract its services, the Government may allow the outsourcer to use the licensed software solely to provide the services on its behalf. The outsourcer shall be bound by the provisions of this Contract relating to the use of the software.
(f) If the software is for use in a networked environment, as may be reflected by the number of servers or users described in the Contract/Order, the license grant provided by the Contractor includes the Government's use of the software in such environment.
(g) Any dispute regarding the license grant or usage limitations shall be resolved in accordance with the Disputes Clause incorporated in FAR 52.212-4(d).
(h) If the Government purchases additional licenses, the terms and conditions for those additional licenses (including technical support and upgrade subscription) shall be the same as agreed to in this Contract/Order, unless negotiated otherwise by mutual agreement of the parties.
(i) The licensed software contains critical product functionality that meets the minimum needs of the Government and is the basis for the Government's procurement of the software; consequently, the Contractor agrees that the Government has the right to successor products at no additional cost when functionality is later unbundled from the product licensed herein and bundled into a new or different product, provided the Government is current on maintenance.
(j) If the Contractor is a reseller for the computer software being acquired under this Contract/Order, it is permissible for the actual software manufacturer (Licensor) to deliver the software directly to the Government.
(k) All limitations of software usage are expressly stated in the SF 1449 and Addendum A and Addendum B.

(3) Software Maintenance Subscription and Technical Support.

(a) See also Addendum B.
(b) Software maintenance and technical support are included at the agreed upon price. However, if additional charges are assessed during the maintenance and technical support period as a result of negotiated changes in the license (e.g., CPU upgrades), the fee shall be by mutual agreement of the parties and any dispute thereof

shall be resolved in accordance with the Disputes Clause incorporated herein at FAR 52.212-4(g).

(c) If the Government desires to continue software maintenance and support beyond the period identified in this Contract/Order, the Government will issue a separate contract or order to renew annual maintenance and technical support. Conversely, if an order or contract to renew software maintenance and technical support is not received, no assumption by the Contractor shall be made that it has been renewed. It shall not be automatically renewed.

(d) Unless otherwise agreed, for any new additional software that may be licensed, the Contractor shall provide for software maintenance and technical support for the first year of the license at no additional cost.

(e) Unless otherwise agreed, the Contractor shall provide VA with software maintenance, which includes periodic updates, upgrades, enhancements and corrections to the software, and reasonable technical support, all of which are customarily provided by the Contractor to its customers so as to cause the software to perform according to its specifications, documentation or demonstrated claims.

(f) Any telephone support provided by Contractor shall be at no additional cost.

(g) All technical support services will be provided in a timely manner in accordance with the Contractor's customary practice. However, prolonged delay in resolving software problems will be noted in the Government's various past performance records on the Contractor (e.g., www.ppirs.gov).

(h) If the Government allows the maintenance and/or technical support to lapse and subsequently wishes to reinstate maintenance and technical support, any reinstatement fee charged shall not exceed the amounts that would have been charged if the Government had not allowed it to lapse.

A.12 ***Disabling Software Code.*** The Government requires delivery of computer software that does not contain any code that will, upon the occurrence or the nonoccurrence of any event, disable the software. Such code includes but is not limited to a computer virus, restrictive key, node lock, time-out or other function, whether implemented by electronic, mechanical, or other means, which limits or hinders the use or access to any computer software based on residency on a specific hardware configuration, frequency of duration of use, or other limiting criteria. If any such code is present, the Contractor agrees to indemnify the Government for all damages suffered as a result of a disabling caused by such code, and the Contractor agrees to remove such code upon the Government's request at no extra cost to the Government. Inability of the Contractor to remove the disabling software code will be considered an inexcusable delay and a material breach of contract, and the Government may exercise its right to terminate for cause. In addition, the Government is permitted to remove the code as it deems appropriate and charge the Contractor for consideration for the time and effort in removing the code.

A.13 ***Disaster Recovery Clause.*** Government hereby certifies to Contractor that it has a bona fide disaster plan with respect to the computer software programs used in its operations. The Contract/Order authorizes the Government's

operation to maintain a second copy of software on tape for use at loading at sites that are not live (e.g. subscription-based disaster recovery services) for the sole purpose of duplicating or mirroring the software environment of the "primary" licenses at the designated licensed site and as described herein. Additionally, use of the software at the contingency sites must not include general access or any processing for program development or production. Contractor shall permit operation and testing of all licensed programs at the contingency sites as designated by the Government without prior approval and at no additional cost to the Government solely for the purpose of maintaining or implementing disaster recovery readiness including continuity of business operations. CPU's, MIPS or MSU's at these contingency sites are excluded from the total CPU's, MIPS or MSU's count included elsewhere in the Contract/Order and are not separately billable. Activation of operations at a contingency site shall be at Government's discretion. Government is authorized to install all software at the contingency sites for testing, problem resolution purposes, and to ensure there will be no operational delays in association with transition of workload from the designated licensed site to the contingency sites. Use of the software at the contingency sites in the event of a disaster shall continue until such time as normal processing can be resumed at the "primary" site regardless of the duration required. Nothing in the Contract/Order diminishes the Government's rights in accordance with the data rights clause(s). Any license keys, codes, or passwords required by the Contractor in order to use the software at the contingency sites shall be provided to the Government within 10 days of the Government's request.

A.14 *NOTICE OF THE FEDERAL ACCESSIBILITY LAW AFFECTING ALL ELECTRONIC AND INFORMATION TECHNOLOGY PROCUREMENTS (SECTION 508)*

On August 7, 1998, Section 508 of the Rehabilitation Act of 1973 was amended to require that when Federal departments or agencies develop, procure, maintain, or use Electronic and Information Technology, that they shall ensure it allows Federal employees with disabilities to have access to and use of information and data that is comparable to the access to and use of information and data by other Federal employees.

Section 508 required the Architectural and Transportation Barriers Compliance Board (Access Board) to publish standards setting forth a definition of electronic and information technology and the technical and functional criteria for such technology to comply with Section 508. These standards have been developed were published with an effective date of December 21, 2000. Federal departments and agencies must develop all Electronic and Information Technology requirements to comply with the standards found in 36 CFR 1194 .___*____ in performing this contract. (*Fill in Section Number and Title*)

ADDENDUM B – STATEMENT OF WORK FOR CONTRACT #_____ or ORDER#_____

B.1 *License.* BROADLY DESCRIBE COMPUTING ENVIRONMENT AND HOW VA INTENDS TO USE THE SOFTWARE, HOW ITS LICENSED, WHAT THE SOFTWARE IS EXPECTED TO DO, ETC. TO GET YOU STARTED: The Department of Veterans Affairs (VA) has a need for the computer software identified on the Schedule of Supplies/Services (page

2) (software media and license) and software support services. The software will be installed **onto multiple servers** at the ITAC in Austin Texas for support/training/staging of the _____ Project. These are processor-based licenses that allow for unlimited users utilizing the processor(s). Contractor shall grant the Government the necessary license to accommodate this need. VA may move the software to any other location or hardware at any time.

B.2 ***Maintenance.*** The Contractor will provide software maintenance services, which includes periodic updates, enhancements and corrections to the software, and reasonable technical support, all of which are customarily provided by the Contractor to its customers so as to cause the software to perform according to its specifications, documentation or demonstrated claims. Add detailed, specific maintenance and support information here. The Contractor will distribute maintenance updates or releases by using an appropriate magnetic, electronic, or printed media to the address in Block 15 of page one, but to the attention of **Joe Smith**. Alternatively, the Contractor may offer access to maintenance copies through its website. All maintenance services will be provided in a timely manner in accordance with the Contractor's customary practice. However, prolonged delay in resolving software problems will be noted in the Government's various past performance records on the Contractor (e.g., www.ppirs.gov).

2. MOU



Spct Mgt Part 15
MOU, 09-2020.doc

3. Risk Assessment



Spct Mgt Risk Assest, 07-2016.doc

- - - E N D - - -

SECTION 27 78 00
CLOSEOUT SUBMITTALS FOR COMMUNICATIONS

PART 1 - GENERAL

1.1 DESCRIPTION

This section includes submittal requirements for communications installations and applies to all sections of Division 27.

1.2 REFERENCES

A. VA Infrastructure Standard for Telecommunications Spaces.

1.3 RELATED WORK

The requirements of this specification shall apply to all sections of Division 27.

A. General requirements: Section 01 00 00, GENERAL REQUIREMENTS.

B. Submittal requirements: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.4 ADMINISTRATIVE REQUIREMENTS

A. Assign a single communications project manager to serve as point of contact for Government, contractor, and design professional.

B. Contact the project Contracting Officer's Representative (COR) to have reviewers from the VA Office of Information Technology (OIT) Data Center & Infrastructure Engineering team assigned to review project submittals and designs.

1.5 SUBMITTALS

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Government preapproval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. When used, a designation following the "G" designation identifies the office(s) that will review the submittal for the Government.

C. Submittal Drawings (G): All drawings shall utilize current equipment and telecommunications space nomenclature. G: Data Center & Infrastructure Operations (DCIE), local site Facility Management Service (FMS) , local site Office of Information Technology (OIT) , Healthcare Environment and Facilities Program (HEFP) , and others as necessary.

1. Telecommunications Space Plans/Elevations: Provide enlarged floor plans of telecommunication spaces indicating layout of equipment and devices. Submit detailed plan views and elevations of telecommunication spaces showing enclosures, termination equipment, supporting electrical and mechanical infrastructure equipment, and cable paths. Include following rooms:
   a. Telecommunications Rooms (TRs) and Antenna Entrance Rooms.
   b. Telecommunication Entrance Rooms.
   c. Computer Room.
2. Cable Plant Distribution Plans: Provide facility plan drawings showing inside plant diverse path distribution pathways, distances, media types, and equipment.
3. Logical Drawings: Provide logical riser or schematic drawings for cable plant and grounding/bonding systems. Show termination points and identify wiring connections.

D. Submittal Components (G): Provide manufacturer's cut sheets or similar for each element below showing conformance with Division 27 and VA Infrastructure Standard for Telecommunications Spaces salient characteristics and requirements. G: Data Center & Infrastructure Operations (DCIE), local site Facility Management Service (FMS) , local site Office of Information Technology (OIT) , Healthcare Environment and Facilities Program (HEFP) and others as necessary.

1. Bonding Busbars (Primary, Secondary, Rack)
2. Overvoltage Surge Protectors
3. Wire Basket Cable Tray and Accessories
4. Server Cabinets and Accessories
5. Network Channel Racks or Network Cabinets and Accessories
6. Telecommunications Enclosures and Accessories
7. Copper UTP Patch Panels and Accessories
8. Fiber Distribution Panels and Accessories
9. Horizontal Cable Managers
10. Blanking Panels
11. Zone Power Distribution Units (zPDUs)

12. Rack Power Distribution Units (rPDUs)
13. Rack-Mounted Uninterruptible Power Supply (UPS) Units
14. Temperature/Humidity Sensors
15. Copper UTP Backbone (Trunk) Cables
16. Multimode Optical Fiber Backbone Cables (data center backbone)
17. Single Mode Optical Fiber Backbone Cable Media (campus backbone)
18. Hybrid MM/SM Optical Fiver Backbone Cable Media (campus backbone)
19. Copper UTP Horizontal Cable Media
20. Copper UTP Patch Cords
21. Fiber Optic Patch Cords

E. Provide parts list including quantity of spare parts.

F. Provide manufacturer product information. Government reserves the right to require a list of installations where products have been in operation.

G. Submittals are required for all equipment anchors and supports, including seismic support design.

H. Furnish electronic certified test reports to COR prior to final inspection and not more than 90 days after completion of tests.

1.6 CLOSEOUT SUBMITTALS

A. Provide following closeout submittals prior to project closeout date:

1. Warranty certificate.
2. Evidence of compliance with requirements such as low voltage certificate of inspection.
3. Project record documents.
4. Instruction manuals and software that are a part of system.

B. Maintenance and Operation Manuals: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

1. Prepare a manual for each system and equipment specified.

2. Furnish on portable storage drive in PDF format or equivalent accepted by COR.
3. Furnish complete manual as specified in specification section, fifteen days prior to performance of systems or equipment test.
4. Furnish remaining manuals prior to final completion.
5. Identify storage drive "MAINTENANCE AND OPERATION MANUAL" and system name.
6. Include name, contact information and emergency service numbers of each subcontractor installing system or equipment and local representatives for system or equipment.
7. Provide a Table of Contents and assemble files to conform to Table of Contents.
8. Operation and Maintenance Data includes (as appropriate for each item):
   a. Approved shop drawing for each item of equipment.
   b. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of equipment.
   c. A control sequence describing start-up, operation, and shutdown.
   d. Description of function of each principal item of equipment.
   e. Installation and maintenance instructions.
   f. Safety precautions.
   g. Diagrams and illustrations.
   h. Test Results and testing methods.
   i. Performance data.
   j. Pictorial "exploded" parts list with part numbers. Emphasis to be placed on use of special tools and instruments. Indicate sources of supply, recommended spare parts, and name of servicing organization.
   k. Warranty documentation indicating end date and equipment protected under warranty.
   l. Appendix: List qualified permanent servicing organizations for support of equipment, including addresses and certified personnel qualifications.

1.7 QUALITY ASSURANCE

A. System Supplier Qualifications: System supplier must be authorized by OEM to warranty installed equipment.

B. Manufactured Products:

1. Comply with FAR clause 52.236-5 for material and workmanship.
2. When more than one unit of same class of equipment is required, units must be product of a single manufacturer.
3. Equipment Assemblies and Components:
   a. Components of an assembled unit need not be products of same manufacturer.
   b. Manufacturers of equipment assemblies, which include components made by others, to assume complete responsibility for final assembled unit.
   c. Provide compatible components for assembly and intended service.
   d. Constituent parts which are similar must be product of a single manufacturer.
4. Identify factory wiring on equipment being furnished and on wiring diagrams.

C. Testing Agencies: Government reserves the option of witnessing factory tests. Notify COR minimum 15 working days prior to manufacturer performing the factory tests.

1. When equipment fails to meet factory test and re-inspection is required, contractor is liable for additional expenses, including expenses of Government.

1.8 DELIVERY, STORAGE, AND HANDLING

A. Delivery and Acceptance Requirements:

1. Government's approval of submittals must be obtained for equipment and material before delivery to job site.
2. Deliver and store materials to job site in OEM's original unopened containers, clearly labeled with OEM's name and equipment catalog numbers, model and serial identification numbers for COR to inventory equipment.

B. Storage and Handling Requirements:

1. Equipment and materials must be protected during shipment and storage against physical damage, dirt, moisture, cold and rain:
   a. Store and protect equipment in a manner that precludes damage or loss, including theft.
   b. Protect painted surfaces with factory installed removable heavy kraft paper, sheet vinyl or equivalent.

c. Protect enclosures, equipment, controls, controllers, circuit protective devices, and other like items, against entry of foreign matter during installation; vacuum clean both inside and outside before testing and operating.

C. Coordinate storage.

1.9 FIELD CONDITIONS

A. Where variations from documents are requested in accordance with Section 01 00 00, GENERAL CONDITIONS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, connecting work and related components must include additions or changes to equipment, components, and installation methods.

1.10 WARRANTY

A. Comply with FAR clause 52.246-21.

PART 2 - PRODUCTS

Not used.

PART 3 - EXECUTION

3.1 INSTALLATION - GENERAL

A. Coordinate systems, equipment, and materials installation with other building components.

B. Install systems, materials, and equipment to conform with approved submittal data, including coordination drawings.

C. Install systems, materials, and equipment level and plumb, parallel and perpendicular to other building systems and components, where installed in both exposed and un-exposed spaces.

D. Install equipment according to manufacturers' written instructions.

E. Install cabling, wiring, and equipment to facilitate servicing, maintenance, and repair or replacement of equipment components. Connect equipment for ease of disconnecting, with minimum interference of adjacent other installations.

F. Provide supplementary or miscellaneous items, appurtenances, devices and materials for a complete installation.

3.2 FIELD QUALITY CONTROL

A. Provide minimum clearances and work required for compliance with NFPA 70, National Electrical Code (NEC), and manufacturers' instructions; comply with additional requirements indicated for access and clearances.

B. Conduct project acceptance inspections, final completion inspections, substantial completion inspections, and acceptance testing and demonstrations after verification of system operation and completeness by Contractor.

C. Interim Inspection:

1. Interim inspection is required at approximately 50 percent of installation.
2. Request inspection ten working days prior to interim inspection start date by notifying COR in writing; this inspection must verify equipment and system being provided adheres to installation and technical requirements of construction documents.
3. Where applicable, check each item of installed (special telecommunications system) equipment to ensure appropriate NRTL listing labels and markings are fixed in place.
4. Verify cabling terminations in telecommunications spaces and end-user Work Area Outlets (WAOs) adhere to T568B pin assignments and cabling connections are in compliance with TIA standards.
5. Visually confirm minimum performance category cable marking of backbone, horizontal, and patch cabling for both copper UTP and fiber optic cabling.
6. Review communications bonding system in each telecommunications space.
7. Review cable tray installation practices.
8. Provide results of interim inspections to COR.
9. If major or multiple deficiencies are discovered, additional interim inspections may be required until deficiencies are corrected, before permitting further system installation.
   a. Additional inspections are scheduled at direction of COR.
   b. Re-inspection of deficiencies noted during interim inspections, must be part of system’s Final Acceptance Proof of Performance Test.
   c. The interim inspection cannot affect the system’s completion date unless directed by COR.
10. Facility COR will ensure test documents become a part of system’s official documentation package.

3.3 CLEANING

A. Remove debris, rubbish, waste material, tools, construction equipment, machinery and surplus materials from project site and clean work area, prior to final inspection and acceptance of work.

B. Put building and premises in neat and clean condition.

C. Remove debris on a daily basis.

D. Remove unused material, during progress of work.

E. Perform cleaning and washing required to provide acceptable appearance and operation of equipment to satisfaction of COR.

F. Clean exterior surface of all equipment, including concrete residue, dirt, and paint residue, after completion of project.

G. Perform final cleaning prior to project acceptance by COR.

H. Remove paint splatters and other spots, dirt, and debris; touch up scratches and mars of finish to match original finish.

I. Clean devices internally using methods and materials recommended by manufacturer.

J. Tighten wiring connectors, terminals, bus joints, and mountings, to include lugs, screws and bolts according to equipment manufacturer’s published torque tightening values for equipment connectors. In absence of published connection or terminal torque values, comply with torque values specified in UL 486A-486B.

3.4 TRAINING

A. Not used.

- - - E N D - - -

DIVISION 28
ELECTRONIC SAFETY AND SECURITY

SECTION 28 05 00
COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY

PART 1 – GENERAL

1.1 DESCRIPTION

A. This Section, Common Work Results for Electronic Safety and Security (ESS), applies to all sections of Division 28.

B. Furnish and install fully functional electronic safety and security cabling system(s), equipment and approved accessories in accordance with the specification section(s), drawing(s), and referenced publications. Capacities and ratings of cable and other items and arrangements for the specified items are shown on each system's required Bill of Materials (BOM) and verified on the approved system drawing(s). If there is a conflict between contract's specification(s) and drawings(s), the contract's specification requirements shall prevail.

C. The Contractor shall provide a fully functional and operating ESS, programmed, configured, documented, and tested as required herein and the respective Safety and Security System Specification(s). The Contractor shall provide calculations and analysis to support design and engineering decisions as specified in submittals. The Contractor shall provide and pay all labor, materials, and equipment, sales and gross receipts and other taxes. The Contractor shall secure and pay for plan check fees, permits, other fees, and licenses necessary for the execution of work as applicable for the project. Give required notices; the Contractor will comply with codes, ordinances, regulations, and other legal requirements of public authorities, which bear on the performance of work.

D. The Contractor shall provide an ESS, installed, programmed, configured, documented, and tested. The security system shall include but not limited to: physical access control, duress alarms, fire alarm interface, equipment cabinetry, and uninterruptible power supplies (UPS) interface. Operator training shall not be required as part of the Security Contractors scope and shall be provided by the Owner. The Security Contractor shall still be required to provide necessary maintenance and troubleshooting manuals as well as submittals as

identified herein. The work shall include the procurement and installation of electrical wire and cables, the installation and testing of all system components. Inspection, testing, demonstration, and acceptance of equipment, software, materials, installation, documentation, and workmanship, shall be as specified herein. The Contractor shall provide all associated installation support, including the provision of primary electrical input power circuits.

E. Repair Service Replacement Parts On-site service during the warranty period shall be provided as specified under "Emergency Service". The Contractor shall guarantee all parts and labor for a term of one (1) year, unless dictated otherwise in this specification from the acceptance date of the system as described in Part 5 of this Specification. The Contractor shall be responsible for all equipment, software, shipping, transportation charges, and expenses associated with the service of the system for one (1) year. The Contractor shall provide 24-hour telephone support for the software program at no additional charge to the owner. Software support shall include all software updates that occur during the warranty period.

F. Section Includes:
   1. Description of Work for Electronic Security Systems,
   2. Electronic security equipment coordination with relating Divisions,
   3. Submittal Requirements for Electronic Security,
   4. Miscellaneous Supporting equipment and materials for Electronic Security,
   5. Electronic security installation requirements.

1.2 RELATED WORK

A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
B. Section 07 84 00 - FIRESTOPPING. Requirements for firestopping application and use.
C. Section 08 51 13 - ALUMINUM WINDOWS. Requirements for window installation.
D. Section 08 71 00 - DOOR HARDWARE. Requirements for door installation.
E. Section 10 14 00 - SIGNAGE. Requirements for labeling and signs.
F. Section 26 05 11 - REQUIREMENTS FOR ELECTRICAL INSTALLATIONS. Requirements for connection of high voltage.

G. Section 26 05 19 - LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Requirements for power cables.

H. Section 26 05 33 - RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS. Requirements for infrastructure.

P. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.

Q. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.

R. Section 28 05 28.33 - CONDUITS AND BOXES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for infrastructure.

S. Section 28 08 00 - COMMISIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS. Requirements for Commissioning.

T. Section 28 13 00 - PHYSICAL ACCESS CONTROL SYSTEMS (PACS). For physical access control integration.

X. Section 28 23 00 - VIDEO SURVEILLANCE. Requirements for security camera systems.

Y. Section 28 26 00 - ELECTRONIC PERSONAL PROTECTION SYSTEM (EPPS). Requirements for emergency and interior communications.

1.3 DEFINITIONS

A. AGC: Automatic Gain Control.

B. Basket Cable Tray: A fabricated structure consisting of wire mesh bottom and side rails.

C. BICSI: Building Industry Consulting Service International.

D. CCD: Charge-coupled device.

E. Central Station: A PC with software designated as the main controlling PC of the security access system. Where this term is presented with initial capital letters, this definition applies.

F. Channel Cable Tray: A fabricated structure consisting of a one-piece, ventilated-bottom or solid-bottom channel section.

G. Controller: An intelligent peripheral control unit that uses a computer for controlling its operation. Where this term is presented with an initial capital letter, this definition applies.

H. CPU: Central processing unit.

I. Credential: Data assigned to an entity and used to identify that entity.

J. DGP: Data Gathering Panel - component of the Physical Access Control System capable to communicate, store and process information received from readers, reader modules, input modules, output modules, and Security Management System.

K. DTS: Digital Termination Service: A microwave-based, line-of-sight communications provided directly to the end user.

L. EMI: Electromagnetic interference.

M. EMT: Electric Metallic Tubing.

N. ESS: Electronic Security System.

O. File Server: A PC in a network that stores the programs and data files shared by users.

P. GFI: Ground fault interrupter.

Q. IDC: Insulation displacement connector.

R. Identifier: A credential card, keypad personal identification number or code, biometric characteristic, or other unique identification entered as data into the entry-control database for the purpose of identifying an individual. Where this term is presented with an initial capital letter, this definition applies.

S. I/O: Input/Output.

T. Intrusion Zone: A space or area for which an intrusion must be detected and uniquely identified, the sensor or group of sensors assigned to perform the detection, and any interface equipment between sensors and communication link to central-station control unit.

U. Ladder Cable Tray: A fabricated structure consisting of two longitudinal side rails connected by individual transverse members (rungs).

V. LAN: Local area network.

W. LCD: Liquid-crystal display.

X. LED: Light-emitting diode.

Y. Location: A Location on the network having a PC-to-Controller communications link, with additional Controllers at the Location connected to the PC-to-Controller link with RS-485 communications loop. Where this term is presented with an initial capital letter, this definition applies.

Z. Low Voltage: As defined in NFPA 70 for circuits and equipment operating at less than 50 V or for remote-control and signaling power-limited circuits.

AA. M-JPEG: Motion - Joint Photographic Experts Group.

BB. MPEG: Moving picture experts group.

CC. NEC: National Electric Code

DD. NEMA: National Electrical Manufacturers Association

EE. NFPA: National Fire Protection Association

FF. NTSC: National Television System Committee.

GG. NRTL: Nationally Recognized Testing Laboratory.

HH. Open Cabling: Passing telecommunications cabling through open space (e.g., between the studs of a wall cavity).

II. PACS: Physical Access Control System; A system comprised of cards, readers, door controllers, servers and software to control the physical ingress and egress of people within a given space

JJ. PC: Personal computer. This acronym applies to the Central Station, workstations, and file servers.

KK. PCI Bus: Peripheral component interconnect; a peripheral bus providing a high-speed data path between the CPU and peripheral devices (such as monitor, disk drive, or network).

LL. PDF: (Portable Document Format.) The file format used by the Acrobat document exchange system software from Adobe.

MM. RCDD: Registered Communications Distribution Designer.

NN. RFI: Radio-frequency interference.

OO. RIGID: Rigid conduit is galvanized steel tubing, with a tubing wall that is thick enough to allow it to be threaded.

PP. RS-232: An TIA/EIA standard for asynchronous serial data communications between terminal devices. This standard defines a 25-pin connector and certain signal characteristics for interfacing computer equipment.

QQ. RS-485: An TIA/EIA standard for multipoint communications.

RR. Solid-Bottom or Non-ventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal side rails, and a bottom without ventilation openings.

SS. SMS: Security Management System - A SMS is software that incorporates multiple security subsystems (e.g., physical access control, intrusion

detection, closed circuit television, intercom) into a single platform and graphical user interface.

TT. TCP/IP: Transport control protocol/Internet protocol incorporated into Microsoft Windows.

UU. Trough or Ventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal rails and a bottom having openings sufficient for the passage of air and using 75 percent or less of the plan area of the surface to support cables.

VV. UPS: Uninterruptible Power Supply

WW. UTP: Unshielded Twisted Pair

XX. Workstation: A PC with software that is configured for specific limited security system functions.

1.4 QUALITY ASSURANCE

A. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.

B. Product Qualification:

1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.

C. Contractor Qualification:

1. The Contractor or security sub-contractor shall be a licensed security Contractor with a minimum of five (5) years experience installing and servicing systems of similar scope and complexity. The Contractor shall be an authorized regional representative of the Security Management System’s (PACS) manufacturer. The Contractor shall provide four (4) current references from clients with systems of similar scope and complexity which became operational in the past three (3) years. At least three (3) of the references shall be utilizing the same system components, in a similar configuration as the proposed system. The references must include a current point of contact, company or agency name, address, telephone number, complete

system description, date of completion, and approximate cost of the project. The owner reserves the option to visit the reference sites, with the site owner's permission and representative, to verify the quality of installation and the references' level of satisfaction with the system. The Contractor shall provide copies of system manufacturer certification for all technicians. The Contractor shall only utilize factory-trained technicians to install, program, and service the PACS. The Contractor shall only utilize factory-trained technicians to install, terminate and service controller/field panels and reader modules. The technicians shall have a minimum of five (5) continuous years of technical experience in electronic security systems. The Contractor shall have a local service facility. The facility shall be located within [60] miles of the project site. The local facility shall include sufficient spare parts inventory to support the service requirements associated with this contract. The facility shall also include appropriate diagnostic equipment to perform diagnostic procedures. The Contracting Officer's Representative reserves the option of surveying the company's facility to verify the service inventory and presence of a local service organization.

2. The Contractor shall provide proof project superintendent with BICSI Certified Commercial Installer Level 1, Level 2, or Technician to provide oversight of the project.
3. Cable installer must have on staff a Registered Communication Distribution Designer (RCDD) certified by Building Industry Consulting Service International. The staff member shall provide consistent oversight of the project cabling throughout design, layout, installation, termination and testing.

D. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

1.5 GENERAL ARANGEMENT OF CONTRACT DOCUMENTS

A. The Contract Documents supplement to this specification indicates approximate locations of equipment. The installation and/or locations

of the equipment and devices shall be governed by the intent of the design; specification and Contract Documents, with due regard to actual site conditions, recommendations, ambient factors affecting the equipment and operations in the vicinity. The Contract Documents are diagrammatic and do not reveal all offsets, bends, elbows, components, materials, and other specific elements that may be required for proper installation. If any departure from the contract documents is deemed necessary, or in the event of conflicts, the Contractor shall submit details of such departures or conflicts in writing to the owner or owner's representative for his or her comment and/or approval before initiating work.

B. Anything called for by one of the Contract Documents and not called for by the others shall be of like effect as if required or called by all, except if a provision clearly designed to negate or alter a provision contained in one or more of the other Contract Documents shall have the intended effect. In the event of conflicts among the Contract Documents, the Contract Documents shall take precedence in the following order: the Form of Agreement; the Supplemental General Conditions; the Special Conditions; the Specifications with attachments; and the drawings.

1.6 SUBMITTALS

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. The Government's approval shall be obtained for all equipment and material before delivery to the job site. Delivery, storage or installation of equipment or material which has not had prior approval will not be permitted at the job site.

C. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.

1. Mark the submittals, "SUBMITTED UNDER SECTION_____".
2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
3. Submit each section separately.

D. The submittals shall include the following:

1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, pictures, nameplate data and test reports as required.

2. For projects in seismic areas of moderate-high, high and very high seismicities as listed in Table 4 of VA Handbook H-18-8, Seismic Design Requirements.

3. Parts list which shall include those replacement parts recommended by the equipment manufacturer, quantity of parts, current price and availability of each part.

E. Submittals shall be in full compliance of the Contract Documents. All submittals shall be provided in accordance with this section. Submittals lacking the breath or depth these requirements will be considered incomplete and rejected. Submissions are considered multidisciplinary and shall require coordination with applicable divisions to provide a complete and comprehensive submission package. All submittals shall include adequate descriptive literature, catalog cuts, shop drawings and other data necessary for the Government to ascertain that the proposed equipment and materials comply with specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify equipment being submitted. Additional general provisions are as follows:

1. The Contractor shall schedule submittals in order to maintain the project schedule. For coordination drawings refer to Specification Section 01 33 10 - Design Submittal Procedures, which outline basic submittal requirements and coordination. Section 01 33 10 shall be used in conjunction with this section.

2. The Contractor shall identify variations from requirements of Contract Documents and state product and system limitations, which may be detrimental to successful performance of the completed work or system.

3. Each package shall be submitted at one (1) time for each review and include components from applicable disciplines (e.g., electrical work, architectural finishes, door hardware, etc.) which are required to produce an accurate and detailed depiction of the project.

4. Manufacturer's information used for submittal shall have pages with items for approval tagged, items on pages shall be identified, and capacities and performance parameters for review shall be clearly marked through use of an arrow or highlighting. Provide space for Contracting Officer's Representative and Contractor review stamps.
5. Technical Data Drawings shall be in the latest version of AutoCAD®, drawn accurately, and in accordance with VA CAD Standards CAD Standard Application Guide, and VA BIM Guide. FREEHAND SKETCHES OR COPIED VERSIONS OF THE CONSTRUCTION DOCUMENTS WILL NOT BE ACCEPTED. The Contractor shall not reproduce Contract Documents or copy standard information as the basis of the Technical Data Drawings. If departures from the technical data drawings are subsequently deemed necessary by the Contractor, details of such departures and the reasons thereof shall be submitted in writing to the Contracting Officer's Representative for approval before the initiation of work.
6. Packaging: The Contractor shall organize the submissions according to the following packaging requirements.
   a. Binders: For each manual, provide heavy duty, commercial quality, durable three (3) ring vinyl covered loose leaf binders, sized to receive 8.5 x 11 in paper, and appropriate capacity to accommodate the contents. Provide a clear plastic sleeve on the spine to hold labels describing the contents. Provide pockets in the covers to receive folded sheets.
      1) Where two (2) or more binders are necessary to accommodate data; correlate data in each binder into related groupings according to the Project Manual table of contents. Cross-referencing other binders where necessary to provide essential information for communication of proper operation and/or maintenance of the component or system.
      2) Identify each binder on the front and spine with printed binder title, Project title or name, and subject matter covered. Indicate the volume number if applicable.
   b. Dividers: Provide heavy paper dividers with celluloid tabs for each Section. Mark each tab to indicate contents.

c. Protective Plastic Jackets: Provide protective transparent plastic jackets designed to enclose diagnostic software for computerized electronic equipment.

d. Text Material: Where written material is required as part of the manual use the manufacturer's standard printed material, or if not available, specially prepared data, neatly typewritten on 8.5 inches by 11 inches 20 pound white bond paper.

e. Drawings: Where drawings and/or diagrams are required as part of the manual, provide reinforced punched binder tabs on the drawings and bind them with the text.

   1) Where oversized drawings are necessary, fold the drawings to the same size as the text pages and use as a foldout.

   2) If drawings are too large to be used practically as a foldout, place the drawing, neatly folded, in the front or rear pocket of the binder. Insert a type written page indicating the drawing title, description of contents and drawing location at the appropriate location of the manual.

   3) Drawings shall be sized to ensure details and text is of legible size. Text shall be no less than 1/16” tall.

f. Manual Content: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

   1) Maintenance and Operation Manuals: Submit as required for systems and equipment specified in the technical sections. Furnish four copies, bound in hardback binders, (manufacturer's standard binders) or an approved equivalent. Furnish one complete manual as specified in the technical section but in no case later than prior to performance of systems or equipment test, and furnish the remaining manuals prior to contract completion.

   2) Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, equipment, building, name of Contractor, and contract number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the system or equipment.

3) The manuals shall include:
   a) Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
   b) A control sequence describing start-up, operation, and shutdown.
   c) Description of the function of each principal item of equipment.
   d) Installation and maintenance instructions.
   e) Safety precautions.
   f) Diagrams and illustrations.
   g) Testing methods.
   h) Performance data.
   i) Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare parts, and name of servicing organization.
   j) Appendix; list qualified permanent servicing organizations for support of the equipment, including addresses and certified qualifications.

g. Binder Organization: Organize each manual into separate sections for each piece of related equipment. At a minimum, each manual shall contain a title page, table of contents, copies of Product Data supplemented by drawings and written text, and copies of each warranty, bond, certifications, and service Contract issued. Refer to Group I through V Technical Data Package Submittal requirements for required section content.

h. Title Page: Provide a title page as the first sheet of each manual to include the following information; project name and address, subject matter covered by the manual, name and address of the Project, date of the submittal, name, address, and telephone number of the Contractor, and cross references to related systems in other operating and/or maintenance manuals.

i. Table of Contents: After the title page, include a type written table of contents for each volume, arranged systematically

according to the Project Manual format. Provide a list of each product included, identified by product name or other appropriate identifying symbols and indexed to the content of the volume. Where more than one (1) volume is required to hold data for a particular system, provide a comprehensive table of contents for all volumes in each volume of the set.

j. General Information Section: Provide a general information section immediately following the table of contents, listing each product included in the manual, identified by product name. Under each product, list the name, address, and telephone number of the installer and maintenance Contractor. In addition, list a local source for replacement parts and equipment.

k. Drawings: Provide specially prepared drawings where necessary to supplement the manufacturers printed data to illustrate the relationship between components of equipment or systems, or provide control or flow diagrams. Coordinate these drawings with information contained in Project Record Drawings to assure correct illustration of the completed installation.

l. Manufacturer's Data: Where manufacturer's standard printed data is included in the manuals, include only those sheets that are pertinent to the part or product installed. Mark each sheet to identify each part or product included in the installation. Where more than one (1) item in tabular format is included, identify each item, using appropriate references from the Contract Documents. Identify data that is applicable to the installation and delete references to information which is not applicable.

m. Where manufacturer's standard printed data is not available and the information is necessary for proper operation and maintenance of equipment or systems, or it is necessary to provide additional information to supplement the data included in the manual, prepare written text to provide the necessary information. Organize the text in a consistent format under a separate heading for different procedures. Where necessary, provide a logical sequence of instruction for each operating or maintenance procedure. Where similar or more than one product is listed on

the submittal the Contractor shall differentiate by highlighting the specific product to be utilized.

n. Calculations: Provide a section for circuit and panel calculations.

o. Loading Sheets: Provide a section for DGP Loading Sheets.

p. Certifications: Provide section for Contractor's manufacturer certifications.

7. Contractor Review: Review submittals prior to transmittal. Determine and verify field measurements and field construction criteria. Verify manufacturer's catalog numbers and conformance of submittal with requirements of contract documents. Return non-conforming or incomplete submittals with requirements of the work and contract documents. Apply Contractor's stamp with signature certifying the review and verification of products occurred, and the field dimensions, adjacent construction, and coordination of information is in accordance with the requirements of the contract documents.

8. Resubmission: Revise and resubmit submittals as required within 15 calendar days of return of submittal. Make resubmissions under procedures specified for initial submittals. Identify all changes made since previous submittal.

9. Product Data: Within 15 calendar days after execution of the contract, the Contractor shall submit for approval a complete list of all of major products proposed for use. The data shall include name of manufacturer, trade name, model number, the associated contract document section number, paragraph number, and the referenced standards for each listed product.

F. Group 1 Technical Data Package: Group I Technical Data Package shall be one submittal consisting of the following content and organization. Refer to VA Special Conditions Document for drawing format and content requirements. The data package shall include the following:

1. Section I – Drawings:

a. General – Drawings shall conform to VA CAD Standards Guide. All text associated with security details shall be 1/8" tall and meet VA text standard for AutoCAD™ drawings.

b. Cover Sheet – Cover sheet shall consist of Project Title and Address, Project Number, Area and Vicinity Maps.
c. General Information Sheets – General Information Sheets shall consist of General Notes, Abbreviations, Symbols, Wire and Cable Schedule, Project Phasing, and Sheet Index.
d. Floor Plans – Floor plans shall be produced from the Architectural backgrounds issued in the Construction Documents. The contractor shall receive floor plans from the prime A/E to develop these drawing sets. Security devices shall be placed on drawings in scale. All text associated with security details shall be 1/8” tall and meet VA text standard for AutoCAD™ drawings. Floor plans shall identify the following:
   1) Security devices by symbol,
   2) The associated device point number (derived from the loading sheets),
   3) Wire & cable types and counts
   4) Conduit sizing and routing
   5) Conduit riser systems
   6) Device and area detail call outs
e. Architectural details – Architectural details shall be produced for each device mounting type (door details for , Camera mounting,
f. Riser Diagrams – Contractor shall provide a riser diagram indicating riser architecture and distribution of the SMS throughout the facility (or area in scope).
g. Block Diagrams – Contractor shall provide a block diagram for the entire system architecture and interconnections with SMS subsystems. Block diagram shall identify SMS subsystem (e.g., electronic entry control, closed circuit television, and other associated subsystems) integration; and data transmission and media conversion methodologies.
h. Interconnection Diagrams – Contractor shall provide interconnection diagram for each sensor, and device component. Interconnection diagram shall identify termination locations, standard wire detail to include termination schedule. Diagram

shall also identify interfaces to other systems such as fire alarm systems.

i. Security Details:
   1) Panel Assembly Detail – For each panel assembly, a panel assembly details shall be provided identifying individual panel component size and content.
   2) Panel Details – Provide security panel details identify general arrangement of the security system components, backboard size, wire through size and location, and power circuit requirements.
   3) Device Mounting Details – Provide mounting detailed drawing for each security device (physical access control system, and video surveillance systems) for each type of wall and ceiling configuration in project. Device details shall include device, mounting detail, wiring and conduit routing.
   4) Details of connections to power supplies and grounding
   5) Details of surge protection device installation
   6) Sensor detection patterns – Each system sensor shall have associated detection patterns.

j. Electrical Panel Schedule – Electrical Panel Details shall be provided for all SMS systems electrical power circuits. Panel details shall be provided identifying panel type (Standard, Emergency Power, Emergency/Uninterrupted Power Source, and Uninterrupted Power Source Only), panel location, circuit number, and circuit amperage rating.

k. Door Schedule – A door schedule shall be developed for each door equipped with electronic security components. At a minimum, the door schedule shall be coordinated with Division 08 work and include the following information:
   1) Item Number
   2) Door Number (Derived from A/E Drawings)
   3) Floor Plan Sheet Number
   4) Standard Detail Number
   5) Door Description (Derived from Loading Sheets)
   6) Data Gathering Panel Input Number
   7) Door Position or Monitoring Device Type & Model Number

8) Lock Type, Model Number & Power Input/Draw (standby/active)
9) Card Reader Type & Model Number
10) Shunting Device Type & Model Number
11) Sounder Type & Model Number
12) Manufacturer
13) Misc. devices as required
    a) Camera
    b) Electric Transfer Hinge
14) Remarks column indicating special notes or door configurations

2. Camera Schedule – A camera schedule shall be developed for each camera. Contractors shall coordinate with the Contracting Officer's Representative to determine camera starting numbers and naming conventions. All drawings shall identify wire and cable standardization methodology. Color coding of all wiring conductors and jackets is required and shall be communicated consistently throughout the drawings package submittal. At a minimum, the camera schedule shall include the following information:
   a. Item Number
   b. Camera Number
   c. Naming Conventions
   d. Description of Camera Coverage
   e. Camera Location
   f. Floor Plan Sheet Number
   g. Camera Type
   h. Mounting Type
   i. Standard Detail Reference
   j. Power Input & Draw
   k. Power Panel Location
   l. Remarks Column for Camera
3. Section II – Data Gathering Panel Documentation Package
   a. Contractor shall provide Data Gathering Panel (DGP) input and output documentation packages for review at the Shop Drawing submittal stage and also with the as-built documentation package. The documentation packages shall be provided in both printed and magnetic form at both review stages.

b. The Contractor shall provide loading sheet documentation package for the associated DGP, including input and output boards for all field panels associated with the project. Documentation shall be provided in current version Microsoft Excel spreadsheets following the format currently utilized by VA. A separate spreadsheet file shall be generated for each DGP and associated field panels.

c. The spreadsheet names shall follow a sequence that shall display the spreadsheets in numerical order according to the DGP system number. The spreadsheet shall include the prefix in the file name that uniquely identifies the project site. The spreadsheet shall detail all connected items such as card readers, alarm inputs, and relay output connections. The spreadsheet shall include an individual section (row) for each panel input, output and card reader. The spreadsheet shall automatically calculate the system numbers for card readers, inputs, and outputs based upon data entered in initialization fields.

d. All entries must be verified against the field devices. Copies of the floor plans shall be forwarded under separate cover.

e. The DGP spreadsheet shall include an entry section for the following information:

   1) DGP number
   2) First Reader Number
   3) First Monitor Point Number
   4) First Relay Number
   5) DGP, input or output Location
   6) DGP Chain Number
   7) DGP Cabinet Tamper Input Number
   8) DGP Power Fail Input Number
   9) Number of Monitor Points Reserved For Expansion Boards
   10) Number of Control Points (Relays) Reserved For Expansion Boards

f. The DGP, input module and output module spreadsheets shall automatically calculate the following information based upon the associated entries in the above fields:

   1) System Numbers for Card Readers

2) System Numbers for Monitor Point Inputs
3) System Numbers for Control Points (Relays)
4) Next DGP or input module First Monitor Point Number
5) Next DGP or output module First Control Point Number

g. The DGP spreadsheet shall provide the following information for each card reader:
1) DGP Reader Number
2) System Reader Number
3) Cable ID Number
4) Description Field (Room Number)
5) Description Field (Device Type i.e.: In Reader, Out Reader, etc.)
6) Description Field
7) DGP Input Location
8) Date Test
9) Date Passed
10) Cable Type
11) Camera Numbers (of cameras viewing the reader location)

h. The DGP and input module spreadsheet shall provide the following information for each monitor point (alarm input).
1) DGP Monitor Point Input Number
2) System Monitor Point Number
3) Cable ID Number
4) Description Field (Room Number)
5) Description Field (Device Type i.e.: Door Contact, , etc.)
7) DGP or input module Input Location
8) Date Test
9) Date Passed
10) Cable Type
11) Camera Numbers (of associated alarm event preset call-ups)

i. The DGP and output module spreadsheet shall provide the following information for each control point (output relay).
1) DGP Control Point (Relay) Number
2) System (Control Point) Number
3) Cable ID Number
4) Description Field (Room Number)

5) Description Field (Device: Lock Control, Local Sounder, etc.)
6) Description Field
7) DGP or OUTPUT MODULE Output Location
8) Date Test
9) Date Passed Cable Type
10) Camera Number (of associated alarm event preset call-ups)

j. The DGP, input module and output module spreadsheet shall include the following information or directions in the header and footer:
1) Header
a) DGP Input and Output Worksheet
b) Enter Beginning Reader, Input, and Output Starting Numbers and Sheet Will Automatically Calculate the Remaining System Numbers.
2) Footer
a) File Name
b) Date Printed
c) Page Number

4. Section IV – Manufacturers' Data: The data package shall include manufacturers' data for all materials and equipment, including sensors, local processors and console equipment provided under this specification.
5. Section V – System Description and Analysis: The data package shall include system descriptions, analysis, and calculations used in sizing equipment required by these specifications. Descriptions and calculations shall show how the equipment will operate as a system to meet the performance requirements of this specification. The data package shall include the following:
a. Central processor memory size; communication speed and protocol description; rigid disk system size and configuration; flexible disk system size and configuration; back-up media size and configuration; alarm response time calculations; command response time calculations; start-up operations; expansion capability and method of implementation; sample copy of each report specified; and color photographs representative of typical graphics.

b. Software Data: The data package shall consist of descriptions of the operation and capability of the system, and application software as specified.

c. Overall System Reliability Calculations: The data package shall include all manufacturers' reliability data and calculations required to show compliance with the specified reliability.

7. Section VI - Certifications & References: All specified manufacturer's certifications shall be included with the data package. Contractor shall provide Project references as outlined in Paragraph 1.4 "Quality Assurance".

G. Group II Technical Data Package

1. The Contractor shall prepare a report of "Current Site Conditions" and submit a report to the Contracting Officer's Representative documenting changes to the site, particularly those conditions that affect performance of the system to be installed. The Contractor shall provide specification sheets, or written functional requirements to support the findings, and a cost estimate to correct those site changes or conditions which affect the installation of the system or its performance. The Contractor shall not correct any deficiency without written permission from the COR.

2. System Configuration and Functionality: The contractor shall provide the results of the meeting with VA to develop system requirements and functionality including but not limited to:

a. Baseline configuration

b. Access levels

c. Schedules (physical access control, holidays, etc.)

d. System monitoring and reporting (unit level and central control)

e. Naming conventions and descriptors

H. Group III Technical Data Package

1. Development of Test Procedures: The Contractor will prepare performance test procedures for the system testing. The test procedures shall follow the format of the VA Testing procedures and be customized to the contract requirements. The Contractor will deliver the test procedures to the Contracting Officer's Representative for approval at least 60 calendar days prior to the requested test date.

I. Group IV Technical Data Package

1. Performance Verification Test

a. Based on the successful completion of the pre-delivery test, the Contractor shall finalize the test procedures and report forms for the performance verification test (PVT) and the endurance test. The PVT shall follow the format, layout and content of the pre-delivery test. The Contractor shall deliver the PVT and endurance test procedures to the Contracting Officer's Representative for approval. The Contractor may schedule the PVT after receiving written approval of the test procedures. The Contractor shall deliver the final PVT and endurance test reports within 14 calendar days from completion of the tests. Refer to Part 3 of this section for System Testing and Acceptance requirements.

2. Training Documentation

a. New Facilities and Major Renovations: Familiarization training shall be provided for new equipment or systems. Training can include site familiarization training for VA technicians and administrative personnel. Training shall include general information on new system layout including closet locations, turnover of the completed system including all documentation, including manuals, software, key systems, and full system administration rights. Lesson plans and training manuals training shall be oriented to type of training to be provided.

3. System Configuration and Data Entry:

a. The contractor is responsible for providing all system configuration and data entry for the SMS and subsystems. All data entry shall be performed per VA standards & guidelines. The Contractor is responsible for participating in all meetings with the client to compile the information needed for data entry. These meetings shall be established at the beginning of the project and incorporated in to the project schedule as a milestone task. The contractor shall be responsible for all data collection, data entry, and system configuration. The contractor shall collect, enter, & program and/or configure the following components:

1) Physical Access control system components,

2) Video surveillance, control and recording systems,

3) All other security subsystems shown in the contract documents.

b. Refer to Part 3 for system programming requirements and planning guidelines.

4. Graphics: Based on CAD as-built drawings developed for the construction project, create all map sets showing locations of all alarms and field devices. Graphical maps of all alarm points installed under this contract including perimeter and exterior alarm points shall be delivered with the system. The Contractor shall create and install all graphics needed to make the system operational. The Contractor shall utilize data from the contract documents, Contractor's field surveys, and all other pertinent information in the Contractor's possession to complete the graphics. The Contractor shall identify and request from the COR, any additional data needed to provide a complete graphics package. Graphics shall have sufficient level of detail for the system operator to assess the alarm. The Contractor shall supply hard copy, color examples at least 203.2 x 254 mm (8 x 10 in) of each type of graphic to be used for the completed Security system. The graphics examples shall be delivered to the Contracting Officer's Representative for review and approval at least 90 calendar days prior to the scheduled date the Contractor requires them.

J. Group V Technical Data Package: Final copies of the manuals shall be delivered to the Contracting Officer's Representative as part of the acceptance test. The draft copy used during site testing shall be updated with any changes required prior to final delivery of the manuals. Each manual's contents shall be identified on the cover. The manual shall include names, addresses, and telephone numbers of each sub-contractor installing equipment or systems, as well as the nearest service representatives for each item of equipment for each system. The manuals shall include a table of contents and tab sheets. Tab sheets shall be placed at the beginning of each chapter or section and at the beginning of each appendix. The final copies delivered after completion of the endurance test shall include all modifications made during installation, checkout, and acceptance. Six (6) hard-copies and

one (1) soft copy on CD of each item listed below shall be delivered as a part of final systems acceptance.

1. Functional Design Manual: The functional design manual shall identify the operational requirements for the entire system and explain the theory of operation, design philosophy, and specific functions. A description of hardware and software functions, interfaces, and requirements shall be included for all system operating modes. Manufacturer developed literature may be used; however, shall be produced to match the project requirements.
2. Equipment Manual: A manual describing all equipment furnished including:
   a. General description and specifications; installation and checkout procedures; equipment electrical schematics and layout drawings; system schematics and layout drawings; alignment and calibration procedures; manufacturer's repair list indicating sources of supply; and interface definition.
3. Software Manual: The software manual shall describe the functions of all software and include all other information necessary to enable proper loading, testing, and operation. The manual shall include:
   a. Definition of terms and functions; use of system and applications software; procedures for system initialization, start-up, and shutdown; alarm reports; reports generation, database format and data entry requirements; directory of all disk files; and description of all communications protocols including data formats, command characters, and a sample of each type of data transfer.
5. Maintenance Manual: The maintenance manual shall include descriptions of maintenance for all equipment including inspection, recommend schedules, periodic preventive maintenance, fault diagnosis, and repair or replacement of defective components.
6. Spare Parts & Components Data: At the conclusion of the Contractor's work, the Contractor shall submit to the Contracting Officer's Representative a complete list of the manufacturer's recommended spare parts and components required to satisfactorily

maintain and service the systems, as well as unit pricing for those parts and components.

7. Operation, Maintenance & Service Manuals: The Contractor shall provide two (2) complete sets of operating and maintenance manuals in the form of an instructional manual for use by the VA Security Guard Force personnel. The manuals shall be organized into suitable sets of manageable size. Where possible, assemble instructions for similar equipment into a single binder. If multiple volumes are required, each volume shall be fully indexed and coordinated.
8. Equipment and Systems Maintenance Manual: The Contractor shall provide the following descriptive information for each piece of equipment, operating system, and electronic system:
   a. Equipment and/or system function.
   b. Operating characteristics.
   c. Limiting conditions.
   d. Performance curves.
   e. Engineering data and test.
   f. Complete nomenclature and number of replacement parts.
   g. Provide operating and maintenance instructions including assembly drawings and diagrams required for maintenance and a list of items recommended to stock as spare parts.
   h. Provide information detailing essential maintenance procedures including the following: routine operations, trouble shooting guide, disassembly, repair and re-assembly, alignment, adjusting, and checking.
   i. Provide information on equipment and system operating procedures, including the following; start-up procedures, routine and normal operating instructions, regulation and control procedures, instructions on stopping, shut-down and emergency instructions, required sequences for electric and electronic systems, and special operating instructions.
   j. Manufacturer equipment and systems maintenance manuals are permissible.
9. Project Redlines: During construction, the Contractor shall maintain an up-to-date set of construction redlines detailing current location and configuration of the project components. The

redline documents shall be marked with the words 'Master Redlines' on the cover sheet and be maintained by the Contractor in the project office. The Contractor will provide access to redline documents anytime during the project for review and inspection by the Contracting Officer's Representative or authorized Office of Protection Services representative. Master redlines shall be neatly maintained throughout the project and secured under lock and key in the contractor's onsite project office. Any project component or assembly that is not installed in strict accordance with the drawings shall be so noted on the drawings. Prior to producing Record Construction Documents, the contractor will submit the Master Redline document to the Contracting Officer's Representative for review and approval of all changes or modifications to the documents. Each sheet shall have Contracting Officer's Representative initials indicating authorization to produce "As Built" documents. Field drawings shall be used for data gathering & field changes. These changes shall be made to the master redline documents daily. Field drawings shall not be considered "master redlines".

10. Record Specifications: The Contractor shall maintain one (1) copy of the Project Specifications, including addenda and modifications issued, for Project Record Documents. The Contractor shall mark the Specifications to indicate the actual installation where the installation varies substantially from that indicated in the Contract Specifications and modifications issued. (Note related Project Record Drawing information where applicable). The Contractor shall pay particular attention to substitutions, selection of product options, and information on concealed installations that would be difficult to identify or measure and record later. Upon completion of the mark ups, the Contractor shall submit record Specifications to the COR. As with master relines, Contractor shall maintain record specifications for Contracting Officer's Representative review and inspection at anytime.
11. Record Product Data: The Contractor shall maintain one (1) copy of each Product Data submittal for Project Record Document purposes. The Data shall be marked to indicate the actual product installed

where the installation varies substantially from that indicated in the Product Data submitted. Significant changes in the product delivered to the site and changes in manufacturer's instructions and recommendations for installation shall be included. Particular attention will be given to information on concealed products and installations that cannot be readily identified or recorded later. Note related Change Orders and mark up of Record Construction Documents, where applicable. Upon completion of mark up, submit a complete set of Record Product Data to the COR.

12. Miscellaneous Records: The Contractor shall maintain one (1) copy of miscellaneous records for Project Record Document purposes. Refer to other Specifications for miscellaneous record-keeping requirements and submittals concerning various construction activities. Before substantial completion, complete miscellaneous records and place in good order, properly identified and bound or filed, ready for use and reference. Categories of requirements resulting in miscellaneous records include a minimum of the following:
    a. Certificates received instead of labels on bulk products.
    b. Testing and qualification of tradesmen. (“Contractor’s Qualifications”)
    c. Documented qualification of installation firms.
    d. Load and performance testing.
    e. Inspections and certifications.
    f. Final inspection and correction procedures.
    g. Project schedule
13. Record Construction Documents (Record As-Built)
    a. Upon project completion, the contractor shall submit the project master redlines to the Contracting Officer’s Representative prior to development of Record construction documents. The Contracting Officer’s Representative shall be given a minimum of a thirty (30) day review period to determine the adequacy of the master redlines. If the master redlines are found suitable by the Contracting Officer’s Representative, the Contracting Officer’s Representative will initial and date each sheet and turn redlines over to the contractor for as built development.

b. The Contractor shall provide the Contracting Officer's Representative a complete set of "as-built" drawings and original master redlined marked "as-built" blue-line in the latest version of AutoCAD drawings unlocked on CD or DVD. The as-built drawing shall include security device number, security closet connection location, data gathering panel number, and input or output number as applicable. All corrective notations made by the Contractor shall be legible when submitted to the COR. If, in the opinion of the COR, any redlined notation is not legible, it shall be returned to the Contractor for re-submission at no extra cost to the Owner. The Contractor shall organize the Record Drawing sheets into manageable sets bound with durable paper cover sheets with suitable titles, dates, and other identifications printed on the cover. The submitted as built shall be in editable formats and the ownership of the drawings shall be fully relinquished to the owner.

c. Where feasible, the individual or entity that obtained record data, whether the individual or entity is the installer, sub-contractor, or similar entity, is required to prepare the mark up on Record Drawings. Accurately record the information in a comprehensive drawing technique. Record the data when possible after it has been obtained. For concealed installations, record and check the mark up before concealment. At the time of substantial completion, submit the Record Construction Documents to the COR. The Contractor shall organize into bound and labeled sets for the COR's continued usage. Provide device, conduit, and cable lengths on the conduit drawings. Exact in-field conduit placement/routings shall be shown. All conduits shall be illustrated in their entire length from termination in security closets; no arrowed conduit runs shall be shown. Pull box and junction box sizes are to be shown if larger than 100mm (4 inch).

K. FIPS 201 Compliance Certificates

1. Provide Certificates for all software components and device types utilizing credential verification. Provide certificates for:

a. Card Readers

b. PIV Middelware

c. Template Matcher

d. Electromagnetically Opaque Sleeve

e. Certificate Management

1) CAK Authentication System

2) PIV Authentication System

3) Certificate Validator

4) Cryptographic Module

L. Approvals will be based on complete submission of manuals together with shop drawings.

M. After approval and prior to installation, furnish the Contracting Officer's Representative with one sample of each of the following:

1. A 300 mm (12 inch) length of each type and size of wire and cable along with the tag from the coils of reels from which the samples were taken.
2. Each type of conduit and pathway coupling, bushing and termination fitting.
3. Conduit hangers, clamps and supports.
4. Duct sealing compound.

N. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 28 08 00 COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.

O. In addition to the requirement of SUBMITTALS, the VA reserves the right to request the manufacturer to arrange for a VA representative to see typical active systems in operation, when there has been no prior experience with the manufacturer or the type of equipment being submitted.

1.7 APPLICABLE PUBLICATIONS

A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American National Standards Institute (ANSI)/ International Code Council (ICC):

A117.1.....Standard on Accessible and Usable Buildings and Facilities

C. American National Standards Institute (ANSI)/ Security Industry Association (SIA):

AC-03.....Access Control: Access Control Guideline Dye Sublimation Printing Practices for PVC Access Control Cards

CP-01-00.....Control Panel Standard-Features for False Alarm Reduction

PIR-01-00.....Passive Infrared Motion Detector Standard - Features for Enhancing False Alarm Immunity

TVAC-01.....CCTV to Access Control Standard - Message Set for System Integration

D. American National Standards Institute (ANSI)/Electronic Industries Alliance (EIA):

330-09.....Electrical Performance Standards for CCTV Cameras

375A-76.....Electrical Performance Standards for CCTV Monitors

E. American National Standards Institute (ANSI):

ANSI S3.2-99.....Method for measuring the Intelligibility of Speech over Communications Systems

F. American Society for Testing and Materials (ASTM)

B1-07.....Standard Specification for Hard-Drawn Copper Wire

B3-07.....Standard Specification for Soft or Annealed Copper Wire

B8-04.....Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft

C1238-97 (R03).....Standard Guide for Installation of Walk-Through Metal Detectors

D2301-04.....Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape

G. Architectural Barriers Act (ABA), 1968

H. Department of Justice: American Disability Act (ADA)
28 CFR Part 36-2010 ADA Standards for Accessible Design

I. Department of Veterans Affairs:
VHA National CAD Standard Application Guide, 2006
VA BIM Guide, V1.0 10

J. Federal Communications Commission (FCC):
(47 CFR 15) Part 15 Limitations on the Use of Wireless Equipment/Systems

K. Federal Information Processing Standards (FIPS):
FIPS-201-1.....Personal Identity Verification (PIV) of Federal Employees and Contractors

L. Federal Specifications (Fed. Spec.):
A-A-59544-08.....Cable and Wire, Electrical (Power, Fixed Installation)

M. Government Accountability Office (GAO):
GAO-03-8-02.....Security Responsibilities for Federally Owned and Leased Facilities

N. Homeland Security Presidential Directive (HSPD):
HSPD-12.....Policy for a Common Identification Standard for Federal Employees and Contractors

O. Institute of Electrical and Electronics Engineers (IEEE):
81-1983.....IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System
802.3af-08.....Power over Ethernet Standard
802.3at-09 .....Power over Ethernet (PoE) Plus Standard
C2-07.....National Electrical Safety Code
C62.41-02.....IEEE Recommended Practice on Surge Voltages in Low-Voltage AC Power Circuits
C95.1-05.....Standards for Safety Levels with Respect to Human Exposure in Radio Frequency Electromagnetic Fields

P. International Organization for Standardization (ISO):
7810.....Identification cards - Physical characteristics
7811.....Physical Characteristics for Magnetic Stripe Cards

7816-1.....Identification cards - Integrated circuit(s) cards with contacts - Part 1: Physical characteristics

7816-2.....Identification cards - Integrated circuit cards - Part 2: Cards with contacts -Dimensions and location of the contacts

7816-3.....Identification cards - Integrated circuit cards - Part 3: Cards with contacts - Electrical interface and transmission protocols

7816-4.....Identification cards - Integrated circuit cards - Part 11: Personal verification through biometric methods

7816-10.....Identification cards - Integrated circuit cards - Part 4: Organization, security and commands for interchange

14443.....Identification cards - Contactless integrated circuit cards; Contactless Proximity Cards Operating at 13.56 MHz in up to 5 inches distance

15693.....Identification cards -- Contactless integrated circuit cards - Vicinity cards; Contactless Vicinity Cards Operating at 13.56 MHz in up to 50 inches distance

19794.....Information technology - Biometric data interchange formats

Q. National Electrical Contractors Association

303-2005.....Installing Closed Circuit Television (CCTV) Systems

R. National Electrical Manufactures Association (NEMA):

250-08.....Enclosures for Electrical Equipment (1000 Volts Maximum)

TC-3-04.....PVC Fittings for Use with Rigid PVC Conduit and Tubing

FB1-07.....Fittings, Cast Metal Boxes and Conduit Bodies for Conduit, Electrical Metallic Tubing and Cable

S. National Fire Protection Association (NFPA):

70-23..... National Electrical Code (NEC)

731-23.....Standards for the Installation of Electric Premises Security Systems

99-2024.....Health Care Facilities

T. National Institute of Justice (NIJ)

0601.02-03.....Standards for Walk-Through Metal Detectors for use in Weapons Detection

0602.02-03.....Hand-Held Metal Detectors for Use in Concealed Weapon and Contraband Detection

U. National Institute of Standards and Technology (NIST):

IR 6887 V2.1.....Government Smart Card Interoperability Specification (GSC-IS)

Special Pub 800-37.....Guide for Applying the Risk Management Framework to Federal Information Systems

Special Pub 800-63.....Electronic Authentication Guideline

Special Pub 800-73-3....Interfaces for Personal Identity Verification (4 Parts)

.....Pt. 1- End Point PIV Card Application Namespace, Data Model & Representation

.....Pt. 2- PIV Card Application Card Command Interface

.....Pt. 3- PIV Client Application Programming Interface

.....Pt. 4- The PIV Transitional Interfaces & Data Model Specification

Special Pub 800-76-1....Biometric Data Specification for Personal Identity Verification

Special Pub 800-78-2....Cryptographic Algorithms and Key Sizes for Personal Identity Verification

Special Pub 800-79-1....Guidelines for the Accreditation of Personal Identity Verification Card Issuers

Special Pub 800-85B-1...DRAFTPIV Data Model Test Guidelines

Special Pub 800-85A-2...PIV Card Application and Middleware Interface Test Guidelines (SP 800-73-3 compliance)

Special Pub 800-96.....PIV Card Reader Interoperability Guidelines

Special Pub 800-104A....Scheme for PIV Visual Card Topography

V. Occupational and Safety Health Administration (OSHA):

29 CFR 1910.97.....Nonionizing radiation

W. Section 508 of the Rehabilitation Act of 1973

X. Security Industry Association (SIA):

AG-01 .....Security CAD Symbols Standards

Y. Underwriters Laboratories, Inc. (UL):

1-05.....Flexible Metal Conduit

5-04.....Surface Metal Raceway and Fittings

6-07.....Rigid Metal Conduit

44-05.....Thermoset-Insulated Wires and Cables

50-07.....Enclosures for Electrical Equipment

83-08.....Thermoplastic-Insulated Wires and Cables

294-99.....The Standard of Safety for Access Control System Units

305-08.....Standard for Panic Hardware

360-09.....Liquid-Tight Flexible Steel Conduit

444-08.....Safety Communications Cables

464-09.....Audible Signal Appliances

467-07.....Electrical Grounding and Bonding Equipment

486A-03.....Wire Connectors and Soldering Lugs for Use with Copper Conductors

486C-04.....Splicing Wire Connectors

486D-05.....Insulated Wire Connector Systems for Underground Use or in Damp or Wet Locations

486E-00.....Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors

493-07.....Thermoplastic-Insulated Underground Feeder and Branch Circuit Cable

514A-04.....Metallic Outlet Boxes

514B-04.....Fittings for Cable and Conduit

51-05.....Schedule 40 and 80 Rigid PVC Conduit

609-96.....Local Burglar Alarm Units and Systems

634-07.....Standards for Connectors with Burglar-Alarm Systems

636-01.....Standard for Holdup Alarm Units and Systems

639-97.....Standard for Intrusion-Detection Units

651-05.....Schedule 40 and 80 Rigid PVC Conduit

651A-07.....Type EB and A Rigid PVC Conduit and HDPE Conduit

752-05.....Standard for Bullet-Resisting Equipment

797-07.....Electrical Metallic Tubing

827-08.....Central Station Alarm Services

1037-09.....Standard for Anti-theft Alarms and Devices

1635-10.....Digital Alarm Communicator System Units

1076-95.....Standards for Proprietary Burglar Alarm Units and Systems

1242-06.....Intermediate Metal Conduit

1479-03.....Fire Tests of Through-Penetration Fire Stops

1981-03.....Central Station Automation System

2058-05.....High Security Electronic Locks

60950.....Safety of Information Technology Equipment

60950-1.....Information Technology Equipment - Safety - Part 1: General Requirements

Z. Uniform Federal Accessibility Standards (UFAS) 1984

AA. United States Department of Commerce:

Special Pub 500-101 ....Care and Handling of Computer Magnetic Storage Media

1.8 COORDINATION

A. Coordinate arrangement, mounting, and support of electronic safety and security equipment:

1. To allow maximum possible headroom unless specific mounting heights that reduce headroom are indicated.
2. To provide for ease of disconnecting the equipment with minimum interference to other installations.
3. To allow right of way for piping and conduit installed at required slope.
4. So connecting raceways, cables, wireways, cable trays, and busways will be clear of obstructions and of the working and access space of other equipment.

B. Coordinate installation of required supporting devices and set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.

C. Coordinate location of access panels and doors for electronic safety and security items that are behind finished surfaces or otherwise concealed.

1.9 MAINTENANCE & SERVICE

A. General Requirements

1. The Contractor shall provide all services required and equipment necessary to maintain the entire integrated electronic security system in an operational state as specified for a period of one (1) year after formal written acceptance of the system. The Contractor shall provide all necessary material required for performing scheduled adjustments or other non-scheduled work. Impacts on facility operations shall be minimized when performing scheduled adjustments or other non-scheduled work. See also General Project Requirements.

B. Description of Work

1. The adjustment and repair of the security system includes all software updates, panel firmware, and the following new items computers equipment, communications transmission equipment and data transmission media (DTM), local processors, security system sensors, physical access control equipment, facility interface, signal transmission equipment, and video equipment.

C. Personnel

1. Service personnel shall be certified in the maintenance and repair of the selected type of equipment and qualified to accomplish all work promptly and satisfactorily. The Contracting Officer's Representative shall be advised in writing of the name of the designated service representative, and of any change in personnel. The Contracting Officer's Representative shall be provided copies of system manufacturer certification for the designated service representative.

D. Schedule of Work

1. The work shall be performed during regular working hours, Monday through Friday, excluding federal holidays.

E. System Inspections

1. These inspections shall include:

a. The Contractor shall perform two (2) minor inspections at six (6) month intervals or more if required by the manufacturer, and two (2) major inspections offset equally between the minor inspections to effect quarterly inspection of alternating magnitude.

1) Minor Inspections shall include visual checks and operational tests of all console equipment, peripheral equipment, local processors, sensors, electrical and mechanical controls, and adjustments on printers.

2) Major Inspections shall include all work described for Minor Inspections and the following: clean all system equipment and local processors including interior and exterior surfaces; perform diagnostics on all equipment; operational tests of the CPU, switcher, peripheral equipment, recording devices, monitors, picture quality from each camera; check, walk test, and calibrate each sensor; run all system software diagnostics and correct all problems; and resolve any previous outstanding problems.

F. Emergency Service

1. The owner shall initiate service calls whenever the system is not functioning properly. The Contractor shall provide the Owner with an emergency service center telephone number. The emergency service center shall be staffed 24 hours a day 365 days a year. The Owner shall have sole authority for determining catastrophic and non-catastrophic system failures within parameters stated in General Project Requirements.

a. For catastrophic system failures, the Contractor shall provide same day four (4) hour service response with a defect correction time not to exceed eight (8) hours from notification. Catastrophic system failures are defined as any system failure that the Owner determines will place the facility(s) at increased risk.

b. For non-catastrophic failures, the Contractor within eight (8) hours with a defect correction time not to exceed 24 hours from notification.

G. Operation

1. Performance of scheduled adjustments and repair shall verify operation of the system as demonstrated by the applicable portions of the performance verification test.

H. Records & Logs

1. The Contractor shall maintain records and logs of each task and organize cumulative records for each component and for the complete system chronologically. A continuous log shall be submitted for all devices. The log shall contain all initial settings, calibration, repair, and programming data. Complete logs shall be maintained and available for inspection on site, demonstrating planned and systematic adjustments and repairs have been accomplished for the system.

I. Work Request

1. The Contractor shall separately record each service call request, as received. The record shall include the serial number identifying the component involved, its location, date and time the call was received, specific nature of trouble, names of service personnel assigned to the task, instructions describing the action taken, the amount and nature of the materials used, and the date and time of commencement and completion. The Contractor shall deliver a record of the work performed within five (5) working days after the work was completed.

J. System Modifications

1. The Contractor shall make any recommendations for system modification in writing to the Contracting Officer’s Representative. No system modifications, including operating parameters and control settings, shall be made without prior written approval from the Contracting Officer’s Representative. Any modifications made to the system shall be incorporated into the operation and maintenance manuals and other documentation affected.

K. Software

1. The Contractor shall provide all software updates when approved by the Owner from the manufacturer during the installation and 12-month warranty period and verify operation of the system. These updates shall be accomplished in a timely manner, fully coordinated with the system operators, and incorporated into the operations and maintenance manuals and software documentation. There shall be at least one (1) scheduled update near the end of the first year's warranty period, at which time the Contractor shall install and validate the latest released version of the Manufacturer's software. All software changes shall be recorded in a log maintained in the unit control room. An electronic copy of the software update shall be maintained within the log. At a minimum, the contractor shall provide a description of the modification, when the modification occurred, and name and contact information of the individual performing the modification. The log shall be maintained in a white 3 ring binder and the cover marked "SOFTWARE CHANGE LOG".

1.10 MINIMUM REQUIREMENTS

A. References to industry and trade association standards and codes are minimum installation requirement standards.

B. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.

1.11 DELIVERY, STORAGE, & HANDLING

A. Equipment and materials shall be protected during shipment and storage against physical damage, dirt, moisture, cold and rain:

1. During installation, enclosures, equipment, controls, controllers, circuit protective devices, and other like items, shall be protected against entry of foreign matter; and be vacuum cleaned both inside and outside before testing and operating and repainting if required.
2. Damaged equipment shall be, as determined by the Contracting Officer's Representative, placed in first class operating condition or be returned to the source of supply for repair or replacement.
3. Painted surfaces shall be protected with factory installed removable heavy craft paper, sheet vinyl or equal.

4. Damaged paint on equipment and materials shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

1.12 PROJECT CONDITIONS

A. Environmental Conditions: System shall be capable of withstanding the following environmental conditions without mechanical or electrical damage or degradation of operating capability:
   1. Interior, Controlled Environment: System components, except central-station control unit, installed in temperature-controlled interior environments shall be rated for continuous operation in ambient conditions of 2 to 50 deg C (36 to 122 deg F) dry bulb and 20 to 90 percent relative humidity, non-condensing. NEMA 250, Type 1 enclosure.
   2. Interior, Uncontrolled Environment: System components installed in non-temperature-controlled interior environments shall be rated for continuous operation in ambient conditions of -18 to 50 deg C (0 to 122 deg F) dry bulb and 20 to 90 percent relative humidity, non-condensing. NEMA 250, Type 4X enclosures.

B. Security Environment: Use vandal resistant enclosures in high-risk areas where equipment may be subject to damage.

C. Console: All console equipment shall, unless noted otherwise, be rated for continuous operation under ambient environmental conditions of 15.6 to 29.4 deg C (60 to 85 deg F) and a relative humidity of 20 to 80 percent.

1.13 EQUIPMENT AND MATERIALS

A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.

B. When more than one unit of the same class of equipment is required, such units shall be the product of a single manufacturer.

C. Equipment Assemblies and Components:
   1. Components of an assembled unit need not be products of the same manufacturer.

2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
3. Components shall be compatible with each other and with the total assembly for the intended service.
4. Constituent parts which are similar shall be the product of a single manufacturer.

D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.

E. When Factory Testing Is Specified:

1. The Government shall have the option of witnessing factory tests. The contractor shall notify the VA through the Contracting Officer's Representative a minimum of 15 working days prior to the manufacturers making the factory tests.
2. Four copies of certified test reports containing all test data shall be furnished to the Contracting Officer's Representative prior to final inspection and not more than 90 days after completion of the tests.
3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the Government.

1.14 ELECTRICAL POWER

A. Electrical power of 120 Volts Alternating Current (VAC) shall be indicated on the Division 26 drawings. Additional locations requiring primary power required by the security system shall be shown as part of these contract documents. Primary power for the security system shall be configured to switch to emergency backup sources automatically if interrupted without degradation of any critical system function. Alarms shall not be generated as a result of power switching, however, an indication of power switching on (on-line source) shall be provided to the alarm monitor. The Security Contractor shall provide an interface (dry contact closure) between the PACS and the Uninterruptible Power Supply (UPS) system so the UPS trouble signals and main power fail appear on the PACS operator terminal as alarms.

B. Failure of any on-line battery shall be detected and reported as a fault condition. Battery backed-up power supplies shall be provided

sized for 8 hours of operation at actual connected load. Requirements for additional power or locations shall be included with the contract to support equipment and systems offered. The following minimum requirements shall be provided for power sources and equipment.

1. Uninterruptible Power Supply (UPS) on Emergency Power
   a. The following 120VAC circuits shall be provided by others. The Security Contractor shall coordinate exact locations with the Electrical Contractor:
      1) Communications equipment: Control Equipment Room and various sites.

1.15 TRANSIENT VOLTAGE SUPPRESSION, POWER SURGE SUPPLESION, & GROUNDING

A. Transient Voltage Surge Suppression: All cables and conductors extending beyond building façade, except fiber optic cables, which serve as communication, control, or signal lines shall be protected against Transient Voltage surges and have Transient Voltage Surge Suppression (TVSS) protection. The TVSS device shall be UL listed in accordance with Standard TIA 497B installed at each end. Lighting and surge suppression shall be a multi-strike variety and include a fault indicator. Protection shall be furnished at the equipment and additional triple solid state surge protectors rated for the application on each wire line circuit shall be installed within 914.4 mm (3 ft) of the building cable entrance. Fuses shall not be used for surge protection. The inputs and outputs shall be tested in both normal mode and common mode to verify there is no interference.
   1. A 10-microsecond rise time by 1000 microsecond pulse width waveform with a peak voltage of 1500 volts and a peak current of 60 amperes.
   2. An 8-microsecond rise time by 20-microsecond pulse width waveform with a peak voltage of 1000 volts and a peak current of 500 amperes.
   3. Maximum series current: 2 AMPS. Provide units manufactured by Advanced Protection Technologies, model # TE/FA 10B or TE/FA 20B.
   4. Operating Temperature and Humidity: -40 to 85 deg C (-40 to 185 deg F), 0 to 95 percent relative humidity.

B. Grounding and Surge Suppression
   1. The Security Contractor shall provide grounding and surge suppression to stabilize the voltage under normal operating conditions. To ensure the operation of over current devices, such

as fuses, circuit breakers, and relays, under ground-fault conditions.

2. Security Contractor shall engineer and provide proper grounding and surge suppression as required by local jurisdiction and prevailing codes and standards referenced in this document.
3. Principal grounding components and features. Include main grounding buses and grounding and bonding connections to service equipment.
4. Locations and sizes of grounding conductors and grounding buses in electrical, data, and communication equipment rooms and closets.
5. AC power receptacles are not to be used as a ground reference point.
6. Any cable that is shielded shall require a ground in accordance with the best practices of the trade and manufactures installation instructions.
7. Protection should be provided at both ends of cabling.

1.16 COMPONENT ENCLOSURES

A. Construction of Enclosures

1. Consoles, power supply enclosures, detector control and terminal cabinets, control units, wiring gutters, and other component housings, collectively referred to as enclosures, shall be so formed and assembled as to be sturdy and rigid.
2. Thickness of metal in-cast and sheet metal enclosures of all types shall not be less than those in Tables I and II, UL 611. Sheet steel used in fabrication of enclosures shall be not less than 14 gauge. Consoles shall be 16-gauge.
3. Doors and covers shall be flanged. Enclosures shall not have pre-punched knockouts. Where doors are mounted on hinges with exposed pins, the hinges shall be of the tight pin type or the ends of hinge pins shall be tack welded to prevent removal. Doors having a latch edge length of less than 609.6 mm (24 in) shall be provided with a single construction core. Where the latch edge of a hinged door is more than 609.6 mm (24 in) or more in length, the door shall be provided with a three-point latching device with construction core; or alternatively with two, one located near each end.
4. Any ventilator openings in enclosures and cabinets shall conform to the requirements of UL 611. Unless otherwise indicated, sheet metal enclosures shall be designed for wall mounting with tip holes

slotted. Mounting holes shall be in positions that remain accessible when all major operating components are in place and the door is open, but shall be in accessible when the door is closed.

5. Covers of pull and junction boxes provided to facilitate initial installation of the system shall be held in place by tamper proof Torx Center post security screws. Stenciled or painted labels shall be affixed to such boxes indicating they contain no connections. These labels shall not indicate the box is part of the Electronic Security System (ESS).

B. Tamper Provisions and Tamper Switches:

1. Enclosures, cabinets, housings, boxes and fittings or every product description having hinged doors or removable covers and which contain circuits, or the integrated security system and its power supplies shall be provided with cover operated, corrosion-resistant tamper switches.
2. Tamper switches shall be arranged to initiate an alarm signal that will report to the monitoring station when the door or cover is moved. Tamper switches shall be mechanically mounted to maximize the defeat time when enclosure covers are opened or removed. It shall take longer than 1 second to depress or defeat the tamper switch after opening or removing the cover. The enclosure and tamper switch shall function together in such a manner as to prohibit direct line of sign to any internal component before the switch activates.
3. Tamper switches shall be inaccessible until the switch is activated. Have mounting hardware concealed so the location of the switch cannot be observed from the exterior of the enclosure. Be connected to circuits which are under electrical supervision at all times, irrespective of the protection mode in which the circuit is operating. Be spring-loaded and held in the closed position by the door or cover and be wired so they break the circuit when the door cover is disturbed. Tamper circuits shall be adjustable type screw sets and shall be adjusted by the contractor to eliminate nuisance alarms associated with incorrectly mounted tamper device shall annunciate prior to the enclosure door opening (within 1/4 " tolerance. The tamper device or its components shall not be visible

or accessing with common tools to bypass when the enclosure is in the secured mode.

4. The single gang junction boxes for the portrait alarming and pull boxes with less than 102 square mm will not require tamper switches.
5. All enclosures over 305 square mm shall be hinged with an enclosure lock.
6. Control Enclosures: Maintenance/Safety switches on control enclosures, which must be opened to make routing maintenance adjustments to the system and to service the power supplies, shall be push/pull-set automatic reset type.
7. Provide one (1) enclosure tamper switch for each 609 linear mm of enclosure lock side opening evenly spaced.
8. All security screws shall be Torx-Post Security Screws.
9. The contractor shall provide the owner with two (2) torx-post screwdrivers.

1.17 ELECTRONIC COMPONENTS

A. All electronic components of the system shall be of the solid-state type, mounted on printed circuit boards conforming to UL 796. Boards shall be plug-in, quick-disconnect type. Circuitry shall not be so densely placed as to impede maintenance. All power-dissipating components shall incorporate safety margins of not less than 25 percent with respect to dissipation ratings, maximum voltages, and current-carrying capacity.

1.18 SUBSTITUTE MATERIALS & EQUIPMENT

A. Where variations from the contract requirements are requested in accordance with the GENERAL CONDITIONS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

B. In addition to this Section the Security Contractor shall also reference Section II, Products and associated divisions. The Contracting Officer’s Representative shall have final authority on the authorization or refusal of substitutions. If there are no proposed substitutions, a statement in writing from the Contractor shall be

submitted to the Contracting Officer's Representative stating same. In the preparation of a list of substitutions, the following information shall be included, as a minimum:

1. Identity of the material or devices specified for which there is a proposed substitution.
2. Description of the segment of the specification where the material or devices are referenced.
3. Identity of the proposed substitute by manufacturer, brand name, catalog or model number and the manufacturer's product name.
4. A technical statement of all operational characteristic expressing equivalence to items to be substituted and comparison, feature-by-feature, between specification requirements and the material or devices called for in the specification; and Price differential.

C. Materials Not Listed: Furnish all necessary hardware, software, programming materials, and supporting equipment required to place the specified major subsystems in full operation. Note that some supporting equipment, materials, and hardware may not be described herein. Depending on the manufacturers selected by the COR, some equipment, materials and hardware may not be contained in either the Contract Documents or these written specifications, but are required by the manufacturer for complete operation according to the intent of the design and these specifications. In such cases, the Contracting Officer's Representative shall be given the opportunity to approve the additional equipment, hardware and materials that shall be fully identified in the bid and in the equipment list submittal. The Contracting Officer's Representative shall be consulted in the event there is any question about which supporting equipment, materials, or hardware is intended to be included.

D. Response to Specification: The Contractor shall submit a point-by-point statement of compliance with each paragraph of the security specification. The statement of compliance shall list each paragraph by number and indicate "COMPLY" opposite the number for each paragraph where the Contractor fully complies with the specification. Where the proposed system cannot meet the requirements of the paragraph, and does not offer an equivalent solution, the offers shall indicate "DOES NOT COMPLY" opposite the paragraph number. Where the proposed system does

not comply with the paragraph as written, but the bidder feels it will accomplish the intent of the paragraph in a manner different from that described, the offers shall indicate "COMPARABLE". The offers shall include a statement fully describing the "comparable" method of satisfying the requirement. Where a full and concise description is not provided, the offered system shall be considered as not complying with the specification. Any submission that does not include a point-by-point statement of compliance, as described above, shall be disqualified. Submittals for products shall be in precise order with the product section of the specification. Submittals not in proper sequence will be rejected.

1.19 LIKE ITEMS

A. Where two or more items of equipment performing the same function are required, they shall be exact duplicates produced by one manufacturer. All equipment provided shall be complete, new, and free of any defects.

1.20 WARRANTY

A. The Contractor shall, as a condition precedent to the final payment, execute a written guarantee (warranty) to the COR certifying all contract requirements have been completed according to the final specifications. Contract drawings and the warranty of all materials and equipment furnished under this contract are to remain in satisfactory operating condition (ordinary wear and tear, abuse and causes beyond his control for this work accepted) for one (1) year from the date the Contactor received written notification of final acceptance from the COR. Demonstration and training shall be performed prior to system acceptance. All defects or damages due to faulty materials or workmanship shall be repaired or replaced without delay, to the COR's satisfaction, and at the Contractor's expense. The Contractor shall provide quarterly inspections during the warranty period. The contractor shall provide written documentation to the COR on conditions and findings of the system and device(s). In addition, the contractor shall provide written documentation of test results and stating what was done to correct any deficiencies. The first inspection shall occur 90 calendar days after the acceptance date. The last inspection shall occur 30 calendar days prior to the end of the

warranty. The warranty period shall be extended until the last inspection and associated corrective actions are complete. When equipment and labor covered by the Contractor's warranty, or by a manufacturer's warranty, have been replaced or restored because of it's failure during the warranty period, the warranty period for the replaced or repaired equipment or restored work shall be reinstated for a period equal to the original warranty period, and commencing with the date of completion of the replacement or restoration work. In the event any manufacturer customarily provides a warranty period greater than one (1) year, the Contractor's warranty shall be for the same duration for that component.

1.22 SINGULAR NUMBER

Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

PART 2 - PRODUCTS

2.1 EQUIPMENT AND MATERIALS

A. All equipment associated within the Security Control Room, Security Console and Security Equipment Room shall be UL 827, UL 1981, and UL 60950 compliant and rated for continuous operation. Environmental conditions (i.e. temperature, humidity, wind, and seismic activity) shall be taken under consideration at each facility and site location prior to installation of the equipment.

B. All equipment shall operate on a 120 or 240 volts alternating current (VAC); 50 Hz or 60 Hz AC power system unless documented otherwise in subsequent sections listed within this specification. All equipment shall have a back-up source of power that will provide a minimum of 8 hours of run time in the event of a loss of primary power to the facility.

C. The system shall be designed, installed, and programmed in a manner that will allow for ease of operation, programming, servicing, maintenance, testing, and upgrading of the system.

D. All equipment and materials for the system will be compatible to ensure correct operation.

2.2 EQUIPMENT ITEMS

A. The Security Management System shall provide full interface with all components of the security subsystem as follows:
   1. Shall allow for communication between the Physical Access Control System and Database Management and all subordinate work and monitoring stations, enrollment centers for badging and biometric devices as part of the PACS, local annunciation centers, the electronic Security Management System (SMS), and all other VA redundant or backup command center or other workstations locations.
   2. Shall provide automatic continuous communication with all systems that are monitored by the SMS, and shall automatically annunciate any communication failures or system alarms to the SMS operator providing identification of the system, nature of the alarm, and location of the alarm.
   3. Controlling devices shall be utilized to interface the SMS with all field devices.
   4. The Security control room and security console will be supported by an uninterrupted power supply (UPS) or dedicated backup generator power circuit.

B. Wires and Cables:
   1. Shall meet or exceed the manufactures recommendation for power and signals.
   2. Shall be carried in an enclosed conduit system, utilizing electromagnetic tubing (EMT) to include the equivalent in flexible metal, rigid galvanized steel (RGS) to include the equivalent of liquid tight, polyvinylchloride (PVC) schedule 40 or 80.
   3. All conduits will be sized and installed per the NEC. All security system signal and power cables that traverse or originate in a high security office space will contained in either EMT or RGS conduit.
   4. All conduit, pull boxes, and junction boxes shall be marked with colored permanent tape or paint that will allow it to be distinguished from all other infrastructure conduit.
   5. Conduit fills shall not exceed 50 percent unless otherwise documented.
   6. A pull string shall be pulled along and provided with signal and power cables to assist in future installations.

7. At all locations where there is a wall penetration or core drilling is conducted to allow for conduit to be installed, fire stopping materials shall be applied to that area.
8. High voltage and signal cables shall not share the same conduit and shall be kept separate up to the point of connection. High voltage for the security subsystems shall be any cable or sets of cables carrying 30 VDC/VAC or higher.

2.3 FIBER OPTIC EQUIPMENT (NOT USED)

2.4 TRANSIENT VOLTAGE SURGE SUPPRESSION DEVICES (TVSS) AND SURGE SUPPRESION

A. Transient Voltage Surge Suppression

1. All cables and conductors extending beyond building perimeter, except fiber optic cables, which serve as communication, control, or signal lines shall be protected against Transient Voltage surges and have Transient Voltage surge suppression protection (TVSS) UL listed in accordance with Standard 497B installed at each end. Lighting and surge suppression shall be a multi-strike variety and include a fault indicator. Protection shall be furnished at the equipment and additional triple solid state surge protectors rated for the application on each wire line circuit shall be installed within 915 mm (36 in) of the building cable entrance. Fuses shall not be used for surge protection. The inputs and outputs shall be tested in both normal mode and common mode using the following waveforms:
   a. A 10-microsecond rise time by 1000 microsecond pulse width waveform with a peak voltage of 1500 volts and a peak current of 60 amperes.
   b. An 8-microsecond rise time by 20-microsecond pulse width waveform with a peak voltage of 1000 volts and a peak current of 500 amperes.
   c. Maximum series current: 2 AMPS. Provide units manufactured by Advanced Protection Technologies, model # TE/FA 10B or TE/FA 20B or approved equivalent.
   d. Operating Temperature and Humidity: -40 to + 85 deg C (-40 to 185 deg F), and 0 to 95 percent relative humidity, non-condensing.

B. Physical Access Control Systems

1. Suppressors shall be installed on AC power at the point of service and shall meet the following criteria:
   a. UL1449 2nd Edition, 2007, listed
   b. UL1449 S.V.R. of 400 Volts or lower
   c. Status Indicator Light(s)
   d. Minimum Surge Current Capacity: 40,000 Amps (8 x 20 µsec)
   e. Maximum Continuous Current: 15 Amps
   f. MCOV: 125 VAC
   g. Service Voltage: 110-120 VAC
2. Suppressors shall be installed on the Low Voltage circuit at both the point of entrance and exit of the building. Suppressors shall meet the following criteria:
   a. UL 497B
   b. Minimum Surge Current Capacity: 2,000 Amps per pair
   c. Maximum Continuous Current: 5 Amps
   d. MCOV: 33 Volts
   e. Service Voltage: 24Volts
3. Suppressors shall be installed on the communication circuit between the access controller and card reader at both the entrance and exit of the building. Suppressors shall meet the following criteria:
   a. Conforms with UL497B standards (where applicable)
   b. Clamp level for 12 and 24V power: 18VDC / 38VDC
   c. Clamp level for Data/LED: 6.8VDC
   d. Service Voltage for Power: 12VDC/24VDC
   e. Service Voltage for Data/LED: <5VDC
   f. Clamp level – PoE Access Power: 72V
   g. Clamp level – PoE Access Data: 7.9V
   h. Service Voltage – PoE Access: 48VAC – 54VAC
   i. Service Voltage – PoE Data: <5VDC

C. Video Surveillance System
1. Protectors shall be installed on coaxial cable systems on points of entry and exit from separate buildings. SPDs shall protect all modes herein mentioned and contain all modes in a single unit system. Protection for all systems mentioned above shall be incorporated at the head end equipment. Protectors shall meet the following criteria:

a. Camera Power
   1) Minimum Surge Current Capacity: 1,000 Amps (8X20µsec); 240 Amps for IP Video/PoE cameras
   2) Screw Terminal Connection
   3) All protection modes L-G (all Lines)
   4) MCOV <40VAC

b. Video And Data
   1) Surge Current Capacity 1,000 Amps per conductor
   2) "BNC" Connection (Coax)
   3) Protection modes: L-G (Data), Center Pin-G, Shield-G (Coax)
   4) Band Pass 0-2GHz
   5) Insertion Loss <0.3dB

D. Grounding and Surge Suppression
   1. The Security Contractor shall provide grounding and surge suppression to stabilize the voltage under normal operating conditions. This is to ensure the operation of over current devices, such as fuses, circuit breakers, and relays, underground-fault conditions.
   2. The Contractor shall engineer, provide, ad install proper grounding and surge suppression as required by local jurisdiction and prevailing codes and standards, referenced in this document.
   3. Principal grounding components and features shall include: main grounding buses, grounding, and bonding connections to service equipment.
   4. The Contractor shall provide details of locations and sizes of grounding conductors and grounding buses in electrical, data, and communication equipment rooms and closets.
   5. AC power receptacles are not to be used as a ground reference point.
   6. Any cable that is shielded shall require a ground in accordance with applicable codes, the best practices of the trade, and all manufactures' installation instructions.

E. 120 VAC Surge Suppression
   1. Continuous Current: Unlimited (parallel connection)
   2. Max Surge Current: 13,500 Amps
   3. Protection Modes: L - N, L - G, N - G
   4. Warranty: Ten Year Limited Warranty

5. Dimension: 73.7 x 41.1 x 52.1 mm (2.90 x 1.62 x 2.05 in)
6. Weight: 2.88 g (0.18 lbs)
7. Housing: ABS

2.5 INSTALLATION KIT

A. General:

1. The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. All unused and partially opened installation kit boxes, and twisted pair cable reels, conduit, cable tray, , wire rolls, physical installation hardware shall be turned over to the Contracting Officer. The following sections outline the minimum required installation sub-kits to be used:
2. System Grounding:
   a. The grounding kit shall include all cable and installation hardware required. All head end equipment and power supplies shall be connected to earth ground via internal building wiring, according to the NEC.
   b. This includes, but is not limited to:
      1) Control Cable Shields
      2) Data Cable Shields
      3) Conduits
      4) Cable Duct blocks
      5) Cable Trays
      6) Power Panels
      7) Grounding
      8) Connector Panels
3. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.

4. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
5. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
6. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to label each subsystem according to the OEM requirements, as-installed drawings, and this document.
7. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to provide the system documentation as required by this document and explained herein.

PART 3 - EXECUTION

3.1 COMMON REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATION

A. Comply with NECA 1.
B. Measure indicated mounting heights to bottom of unit for suspended items and to center of unit for wall-mounting items.
C. Headroom Maintenance: If mounting heights or other location criteria are not indicated, arrange and install components and equipment to provide maximum possible headroom consistent with these requirements.
D. Equipment: Install to facilitate service, maintenance, and repair or replacement of components of both electronic safety and security equipment and other nearby installations. Connect in such a way as to facilitate future disconnecting with minimum interference with other items in the vicinity.
E. Right of Way: Give to piping systems installed at a required slope.
F. Equipment location shall be as close as practical to locations shown on the drawings.
G. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
2. "Conveniently accessible" is defined as being capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

3.2 FIRESTOPPING

A. Apply firestopping to penetrations of fire-rated floor and wall assemblies for electronic safety and security installations to restore original fire-resistance rating of assembly. Firestopping materials and installation requirements are specified in Division 07 Section 07 84 00 "Firestopping."

3.3 COMMISIONING

A. Provide commissioning documentation in accordance with the requirements of Section 28 08 00 – COMMISIONIN OF ELECTRONIC SAFETY AND SECURITY SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.

B. Components provided under this section of the specification will be tested as part of a larger system. Refer to section 28 08 00 – COMMISIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.4 DEMONSTRATION AND TRAINING

A. Training shall be provided in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

B. Training shall be provided for the particular equipment or system as required in each associated specification.

C. A training schedule shall be developed and submitted by the contractor and approved by the Contracting Officer’s Representative at least 30 days prior to the planned training.

D. Provide services of manufacturer’s technical representative for 4 hours to instruct VA personnel in operation and maintenance of units.

E. Submit training plans and instructor qualifications in accordance with the requirements of Section 28 08 00 - COMMISIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.

3.5 WORK PERFORMANCE

A. Job site safety and worker safety is the responsibility of the contractor.

B. For work on existing stations, arrange, phase and perform work to assure electronic safety and security service for other buildings at all times. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.

C. New work shall be installed and connected to existing work neatly and carefully. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.

D. Coordinate location of equipment and conduit with other trades to minimize interferences. See the GENERAL CONDITIONS.

3.6 SYSTEM PROGRAMMING

A. General Programming Requirements

1. This following section shall be used by the contractor to identify the anticipated level of effort (LOE) required setup, program, and configure the Electronic Security System (ESS). The contractor shall be responsible for providing all setup, configuration, and programming to include data entry for the Security Management System (SMS) and subsystems. System programming for existing or new SMS servers shall not be conducted at the project site.

B. Level of Effort for Programming

1. The Contractor shall perform and complete system programming (including all data entry) at an offsite location using the Contractor’s own copy of the SMS software. The Contractor’s copy of the SMS software shall be of the Owners current version. Once system programming has been completed, the Contractor shall deliver the data to the Contracting Officer’s Representative on data entry forms and an approved electronic medium, utilizing data from the contract documents. The completed forms shall be delivered to the Contracting Officer’s Representative for review and approval at

least 90 calendar days prior to the scheduled date the Contractor requires it. The Contractor shall not upload system programming until the Contracting Officer's Representative has provided written approval. The Contractor is responsible for backing up the system prior to uploading new programming data. Additional programming requirements are provided as follows:

2. The Contractor shall identify and request from the Contracting Officer's Representative, any additional data needed to provide a complete and operational system as described in the contract documents.
3. Contractor and Contracting Officer's Representative coordination on programming requires a high level of coordination to ensure programming is performed in accordance with VA requirements and programming uploads do not disrupt existing systems functionality. The contractor shall anticipate a minimum a weekly coordination meeting. Contractor shall ensure data uploading is performed without incident of loss of function or data loss. The following Level of Effort Chart is provided to communicate the expected level of effort required by contractors on VA ESS projects. Calculations to determine actual levels of effort shall be confirmed by the contractor before project award.

	Description of Tasks						
Description of Systems	Develop System Loading Sheets	Coordination	Initial Set-up Configuration	Graphic Maps	System Programming	Final Checks	Level of Effort (Typical Tasks)

CCTV Systems	e.g., programming call-ups recording	e.g., confirming device configurations, naming conventions	e.g., enter data from loading sheets; camera naming convention, sequences, configure components)		e.g., programming call-ups recording	e.g., confirm area of coverage, call-up per event generated and recording rates	e.g., setting up cameras points, recording ratios (e.g., normal, alarm event) timed recording, linkages, maps placements, call-ups
Note: Programming tasks are supported through the contractor's development of the Technical Data Package Submittals.							

Table 1 Contractor Level of Effort

3.7 TESTING AND ACCEPTANCE

A. Performance Requirements

1. General:

a. The Contractor shall perform contract field, performance verification, and endurance testing and make adjustments of the completed security system when permitted. The Contractor shall provide all personnel, equipment, instrumentation, and supplies necessary to perform all testing. Written notification of planned testing shall be given to the Contracting Officer's Representative at least 60 calendar days prior to the test and after the Contractor has received written approval of the specific test procedures.

b. The COR shall witness all testing and system adjustments during testing. Written permission shall be obtained from the Contracting Officer's Representative before proceeding with the next phase of testing. Original copies of all data produced during performance verification and endurance testing shall be turned over to the Contracting Officer's Representative at the conclusion of each phase of testing and prior to Contracting Officer's Representative approval of the test.

2. Test Procedures and Reports: The test procedures, compliant w/ VA standard test procedures, shall explain in detail, step-by-step actions and expected results demonstrating compliance with the requirements of the specification. The test reports shall be used to document results of the tests. The reports shall be delivered to the Contracting Officer's Representative within seven (7) calendar days after completion of each test.

B. Pre-Delivery Testing

1. The purpose of the pre-delivery test is to establish that a system is suitable for installation. As such, pre-delivery test shall be a mock-up of the system as planned in the contract documents. The Contractor shall assemble the Security Test System at the Contractors local project within 50-miles of the project site, and perform tests to demonstrate the performance of the system complies with the contract requirements in accordance with the approved pre-delivery test procedures. The tests shall take place during regular

daytime working hours on weekdays. Model numbers of equipment tested shall be identical to those to be delivered to the site. Original copies of all data produced during pre-delivery testing, including results of each test procedure, shall be documented and delivered to the Contracting Officer's Representative at the conclusion of pre-delivery testing and prior to Contracting Officer's Representative's approval of the test. The test report shall be arranged so all commands, stimuli, and responses are correlated to allow logical interpretation. For Existing System modifications, the contractor shall provide their own server with loaded applicable software to support PDT.

2. Test Setup: The pre-delivery test setup shall include the following:
   a. All console equipment.
      1) At least one of each type of data transmission media (DTM) and associated equipment to provide a fully integrated PACS.
      2) The number of local processors shall equal the amount required by the site design.
      3) Enough sensor simulators to provide alarm signal inputs to the system equal to the number of sensors required by the design. The alarm signals shall be manually or software generated.
      4) Contractor to prove to owner all systems are appropriately sized and configured as sized.
      5) Integration of VASS, intercom systems, other subsystems.
3. During the bidding process the contractor shall submit a request for information to the Owner to determine if a pre-delivery test will be required. If a pre-delivery test is not required, the contractor shall provide a written notification that the Pre-delivery Test is not required in their shop drawings submission.

C. The inspection and test will be conducted by a factory-certified contractor representative and witnessed by a Government Representative. The results of the inspection will be officially recorded by a designated Government Representative and maintained on file by the Contracting Officer's Representative (COR), until completion of the entire project. The results will be compared to the Acceptance Test results.

D. Contractor's Field Testing (CFT)

1. The Contractor shall calibrate and test all equipment, verify DTM operation, place the integrated system in service, and test the integrated system. Ground rods installed by this Contractor within the base of camera poles shall be tested as specified in IEEE STD 142. The Contractor shall test all security systems and equipment, and provide written proof of a 100% operational system before a date is established for the system acceptance test. Documentation package for CFT shall include completed (fully annotated details of test details) for each device and system tested, and annotated loading sheets documenting complete testing to Contracting Officer's Representative approval. CFT test documentation package shall conform to submittal requirements outlined in this Section. The Contractor's field testing procedures shall be identical to the Contracting Officer's Representative's acceptance testing procedures. The Contractor shall provide the Contracting Officer's Representative with a written listing of all equipment and software indicating all equipment and components have been tested and passed. The Contractor shall deliver a written report to the Contracting Officer's Representative stating the installed complete system has been calibrated, tested, and is ready to begin performance verification testing; describing the results of the functional tests, diagnostics, and calibrations; and the report shall also include a copy of the approved acceptance test procedure. Performance verification testing shall not take place until written notice by contractor is received certifying that a contractors field test was successful.

E. Performance Verification Test (PVT)

1. Test team:

a. After the system has been pretested and the Contractor has submitted the pretest results and certification to the Contracting Officer's Representative, then the Contractor shall schedule an acceptance test to date and give the Contracting Officer's Representative written, notice as described herein, prior to the date the acceptance test is expected to begin. The system shall be tested in the presence of a Government

Representative, an OEM certified representative, representative of the Contractor and other approved by the Contracting Officer's Representative. The system shall be tested utilizing the approved test equipment to certify proof of performance, FCC, UL and Emergency Service compliance. The test shall verify that the total system meets all the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.

2. The Contractor shall demonstrate the completed Physical Access Control System PACS complies with the contract requirements. In addition, the Contractor shall provide written certification that the system is 100% operational prior to establishing a date for starting PVT. Using approved test procedures, all physical and functional requirements of the project shall be demonstrated and shown. The PVT will be stopped and aborted as soon as 10 technical deficiencies are found requiring correction. The Contractor shall be responsible for all travel and lodging expenses incurred for out-of-town personnel required to be present for resumption of the PVT. If the acceptance test is aborted, the re-test will commence from the beginning with a retest of components previously tested and accepted.
3. The PVT, as specified, shall not begin until receipt of written certification that the Contractors Field Testing was successful. This shall include certification of successful completion of testing as specified in paragraph "Contractor's Field Testing", and upon successful completion of testing at any time when the system fails to perform as specified. Upon termination of testing by the Contracting Officer's Representative or Contractor, the Contractor shall commence an assessment period as described for Endurance Testing Phase II.
4. Upon successful completion of the acceptance test, the Contractor shall deliver test reports and other documentation, as specified, to the Contracting Officer's Representative prior to commencing the endurance test.
5. Additional Components of the PVT shall include:

   a. System Inventory

1) All Device equipment
2) All Software
3) All Logon and Passwords
4) All Cabling System Matrices
5) All Cable Testing Documents
6) All System and Cabinet Keys

b. Inspection
1) Contractor shall record an inspection punch list noting all system deficiencies. The contractor shall prepare an inspection punch list format for Contracting Officer's Representatives approval.
2) As a minimum the punch list shall include a listing of punch list items, punch list item location, description of item problem, date noted, date corrected, and details of how item was corrected.

6. Partial PVT – At the discretion of Contracting Officer's Representative, the Performance Verification Test may be performed in part should a 100% compliant CFT be performed. In the event that a partial PVT will be performed instead of a complete PVT; the partial PVT shall be performed by testing 10% of the system. The contractor shall perform a test of each procedure on select devices or equipment.

F. Endurance Test
1. The Contractor shall demonstrate the specified probability of detection and false alarm rate requirements of the completed system. The endurance test shall be conducted in phases as specified below. The endurance test shall not be started until the Contracting Officer's Representative notifies the Contractor, in writing, that the performance verification test is satisfactorily completed, training as specified has been completed, and correction of all outstanding deficiencies has been satisfactorily completed. VA shall operate the system 24 hours per day, including weekends and holidays, during Phase I and Phase III endurance testing. VA will maintain a log of all system deficiencies. The Contracting Officer's Representative may terminate testing at any time the system fails to perform as specified. Upon termination of testing,

the Contractor shall commence an assessment period as described for Phase II. During the last day of the test, the Contractor shall verify the appropriate operation of the system. Upon successful completion of the endurance test, the Contractor shall deliver test reports and other documentation as specified to the Contracting Officer's Representative prior to acceptance of the system.

2. Phase I (Testing): The test shall be conducted 24 hours per day for 15 consecutive calendar days, including holidays, and the system shall operate as specified. The Contractor shall make no repairs during this phase of testing unless authorized in writing by the Contracting Officer's Representative. If the system experiences no failures, the Contractor may proceed directly to Phase III testing after receiving written permission from the Contracting Officer's Representative.
3. Phase II (Assessment):
   a. After the conclusion of Phase I, the Contractor shall identify all failures, determine causes of all failures, repair all failures, and deliver a written report to the Contracting Officer's Representative. The report shall explain in detail the nature of each failure, corrective action taken, results of tests performed, and recommend the point at which testing should be resumed.
   b. After delivering the written report, the Contractor shall convene a test review meeting at the job site to present the results and recommendations to the Contracting Officer's Representative. The meeting shall not be scheduled earlier than five (5) business days after the Contracting Officer's Representative receives the report. As part of this test review meeting, the Contractor shall demonstrate all failures have been corrected by performing appropriate portions of the performance verification test. Based on the Contractor's report and the test review meeting, the Contracting Officer's Representative will provide a written determine of either the restart date or require Phase I be repeated.
4. Phase III (Testing): The test shall be conducted 24 hours per day for 15 consecutive calendar days, including holidays, and the system

shall operate as specified. The Contractor shall make no repairs during this phase of testing unless authorized in writing by the COR.

5. Phase IV (Assessment):
   1. After the conclusion of Phase III, the Contractor shall identify all failures, determine causes of all failures, repair all failures, and deliver a written report to the COR. The report shall explain in detail the nature of each failure, corrective action taken, results of tests performed, and recommend the point at which testing should be resumed.
   2. After delivering the written report, the Contractor shall convene a test review meeting at the job site to present the results and recommendations to the COR. The meeting shall not be scheduled earlier than five (5) business days after receipt of the report by the COR. As a part of this test review meeting, the Contractor shall demonstrate that all failures have been corrected by repeating appropriate portions for the performance verification test. Based on the review meeting the test should not be scheduled earlier than five (5) business days after the Contracting Officer’s Representative receives the report. As a part of this test review meeting, the Contractor shall demonstrate all failures have been corrected by repeating appropriate portions of the performance verification test. Based on the Contractor’s report and the test review meeting, the Contracting Officer’s Representative will provide a written determine of either the restart date or require Phase III be repeated. After the conclusion of any re-testing which the Contracting Officer’s Representative may require, the Phase IV assessment shall be repeated as if Phase III had just been completed.

G. Exclusions
   1. The Contractor will not be held responsible for failures in system performance resulting from the following:
      a. An outage of the main power in excess of the capability of any backup power source provided the automatic initiation of all

backup sources was accomplished and that automatic shutdown and restart of the PACS performed as specified.

b. Failure of an Owner furnished equipment or communications link, provided the failure was not due to Contractor furnished equipment, installation, or software.

c. Failure of existing Owner owned equipment, provided the failure was not due to Contractor furnished equipment, installation, or software.

- - - E N D - - -

SECTION 28 05 13
CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the finishing, installation, connection, testing and certification the conductors and cables required for a fully functional for electronic safety and security (ESS) system.

1.2 RELATED WORK

A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.

B. Section 07 84 00 - FIRESTOPPING. Requirements for firestopping application and use.

C. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. Requirements for general requirements that are common to more than one section in Division 28.

D. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

E. Section 28 05 28.33 - CONDUITS AND BOXES FOR ELECTRONIC SECURITY AND SAFETY. Requirements for infrastructure.

F. Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS. Requirements for commissioning.

1.3 DEFINITIONS

A. BICSI: Building Industry Consulting Service International.

B. EMI: Electromagnetic interference.

C. IDC: Insulation displacement connector.

D. Low Voltage: As defined in NFPA 70 for circuits and equipment operating at less than 50 V or for remote-control and signaling power-limited circuits.

E. Open Cabling: Passing telecommunications cabling through open space (e.g., between the studs of a wall cavity).

F. RCDD: Registered Communications Distribution Designer.

G. Solid-Bottom or Nonventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal side rails, and a bottom without ventilation openings.

H. Trough or Ventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal rails and a bottom having openings sufficient for the passage of air and using 75 percent or less of the plan area of the surface to support cables.

I. UTP: Unshielded twisted pair.

1.4 QUALITY ASSURANCE

A. See section 28 05 00, Paragraph 1.4.

1.5 SUBMITTALS

A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:

1. Manufacturer's Literature and Data: Showing each cable type and rating.
2. Certificates: Two weeks prior to final inspection, deliver to the Contracting Officer’s Representative four copies of the certification that the material is in accordance with the drawings and specifications and diagrams for cable management system.
3. Shop Drawings: Cable tray layout, showing cable tray route to scale, with relationship between the tray and adjacent structural, electrical, and mechanical elements. Include the following:
   a. Vertical and horizontal offsets and transitions.
   b. Clearances for access above and to side of cable trays.
   d. Load calculations to show dead and live loads as not exceeding manufacturer's rating for tray and its support elements.
   e. System labeling schedules, including electronic copy of labeling schedules that are part of the cable and asset identification system of the software specified in Parts 2 and 3.
4. Wiring Diagrams. Show typical wiring schematics including the following.
5. Cable Administration Drawings: As specified in Part 3 "Identification" Article.
6. Project planning documents as specified in Part 3.
7. Maintenance Data: For wire and cable to include in maintenance manuals.

1.6 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent

referenced. Publications are reference in the text by the basic designation only.

B. American Society of Testing Material (ASTM):

D2301-04.....Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape

C. Federal Specifications (Fed. Spec.):

A-A-59544-08.....Cable and Wire, Electrical (Power, Fixed Installation)

D. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

E. Underwriters Laboratories, Inc. (UL):

44-05.....Thermoset-Insulated Wires and Cables

83-08.....Thermoplastic-Insulated Wires and Cables

467-07.....Electrical Grounding and Bonding Equipment

486A-03.....Wire Connectors and Soldering Lugs for Use with Copper Conductors

486C-04.....Splicing Wire Connectors

486D-05.....Insulated Wire Connector Systems for Underground Use or in Damp or Wet Locations

486E-00.....Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors

493-07.....Thermoplastic-Insulated Underground Feeder and Branch Circuit Cable

514B-04.....Fittings for Cable and Conduit

1479-03.....Fire Tests of Through-Penetration Fire Stops//

1.7 DELIVERY, STORAGE, AND HANDLING

A. Test cables upon receipt at Project site.

1. Test each pair of UTP cable for open and short circuits.

1.8 PROJECT CONDITIONS

A. Environmental Limitations: Do not deliver or install UTP and connecting materials until wet work in spaces is complete and dry, and temporary HVAC system is operating and maintaining ambient temperature and humidity conditions at occupancy levels during the remainder of the construction period.

PART 2 - PRODUCTS

2.1 GENERAL

A. Support of Open Cabling: NRTL labeled for support of Category 6A cabling, designed to prevent degradation of cable performance and pinch points that could damage cable.
   1. Support brackets with cable tie slots for fastening cable ties to brackets.
   2. Lacing bars and spools.
   3. Straps and other devices.

B. Conduit and Boxes: Comply with requirements in Division 28 Section "Conduits and Backboxes for Electrical Systems." Flexible metal conduit shall not be used.
   1. Outlet boxes shall be no smaller than 2 inches (50 mm) wide, 3 inches (75 mm) high, and 2-1/2 inches (64 mm) deep.

2.2 BACKBOARDS (NOT USED)

2.3 UTP CABLE

A. Description: 100-ohm, 4-pair UTP, formed into 25-pair binder groups covered with a blue thermoplastic jacket.
   1. Comply with ICEA S-90-661 for mechanical properties.
   2. Comply with TIA/EIA-568-B.1 for performance specifications.
   3. Comply with TIA/EIA-568-B.2, Category 6A.
   4. Listed and labeled by an NRTL acceptable to authorities having jurisdiction as complying with UL 444 and NFPA 70 for the following types:
      a. Communications, General Purpose: Type CM or CMG .
      b. Communications, Plenum Rated: Type CMP, complying with NFPA 262.
      c. Communications, Riser Rated: Type CMR , complying with UL 1666.
      d. Communications, Limited Purpose: Type CMX.
      e. Multipurpose: Type MP or MPG.
      f. Multipurpose, Plenum Rated: Type MPP, complying with NFPA 262.
      g. Multipurpose, Riser Rated: Type MPR, complying with UL 1666.

2.4 UTP CABLE HARDWARE

A. UTP Cable Connecting Hardware: IDC type, using modules designed for punch-down caps or tools. Cables shall be terminated with connecting hardware of the same category or higher.

2.5 OPTICAL FIBER CABLE (NOT USED)

2.6 RS-232 CABLE (NOT USED)

2.7 RS-485 CABLE

A. Standard Cable: NFPA 70, Type CM.
   1. Paired, 2 pairs, twisted, No. 22 AWG, stranded (7x30) tinned copper conductors.
   2. PVC insulation.
   3. Unshielded.
   4. PVC jacket.
   5. Flame Resistance: Comply with UL 1581.

B. Plenum-Rated Cable: NFPA 70, Type CMP.
   1. Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors.
   2. Fluorinated ethylene propylene insulation.
   3. Unshielded.
   4. Fluorinated ethylene propylene jacket.
   5. Flame Resistance: NFPA 262, Flame Test.

2.8 LOW-VOLTAGE CONTROL CABLE

A. Paired Lock Cable: NFPA 70, Type CMG.
   1. 1 pair, twisted, No. 16 AWG, stranded (19x29) tinned copper conductors.
   2. PVC insulation.
   3. Unshielded.
   4. PVC jacket.
   5. Flame Resistance: Comply with UL 1581.

B. Plenum-Rated, Paired Lock Cable: NFPA 70, Type CMP.
   1. 1 pair, twisted, No. 16 AWG, stranded (19x29) tinned copper conductors.
   2. PVC insulation.
   3. Unshielded.
   4. PVC jacket.
   5. Flame Resistance: Comply with NFPA 262.

C. Paired Lock Cable: NFPA 70, Type CMG.
   1. 1 pair, twisted, No. 18 AWG, stranded (19x30) tinned copper conductors.
   2. PVC insulation.

3. Unshielded.
4. PVC jacket.
5. Flame Resistance: Comply with UL 1581.

D. Plenum-Rated, Paired Lock Cable: NFPA 70, Type CMP.
1. 1 pair, twisted, No. 18 AWG, stranded (19x30) tinned copper conductors.
2. Fluorinated ethylene propylene insulation.
3. Unshielded.
4. Plastic jacket.
5. Flame Resistance: NFPA 262, Flame Test.

2.9 CONTROL-CIRCUIT CONDUCTORS

A. Class 1 Control Circuits: Stranded copper, Type THHN-THWN, in raceway complying with UL 83.

B. Class 2 Control Circuits: Stranded copper, Type THHN-THWN, in raceway complying with UL 83.

C. Class 3 Remote-Control and Signal Circuits: Stranded copper, Type TW or TF, complying with UL 83.

2.10 FIRE ALARM WIRE AND CABLE

A. General Wire and Cable Requirements: NRTL listed and labeled as complying with NFPA 70, Article 760.

B. Signaling Line Circuits: Twisted, shielded pair, not less than No. 18 AWG, and size as recommended by system manufacturer.
1. Circuit Integrity Cable: Twisted shielded pair, NFPA 70, Article 760, Classification CI, for power-limited fire alarm signal service Type FPL. NRTL listed and labeled as complying with UL 1424 and UL 2196 for a 2-hour rating.

C. Non-Power-Limited Circuits: Solid-copper conductors with 600-V rated, 75 deg C, color-coded insulation.
1. Low-Voltage Circuits: No. 16 AWG, minimum.
2. Line-Voltage Circuits: No. 12 AWG, minimum.
3. Multiconductor Armored Cable: NFPA 70, Type MC, copper conductors, Type TFN/THHN conductor insulation, copper drain wire, copper armor[with outer jacket] with red identifier stripe, NTRL listed for fire alarm and cable tray installation, plenum rated, and complying with requirements in UL 2196 for a 2-hour rating.

2.11 IDENTIFICATION PRODUCTS

A. Comply with UL 969 for a system of labeling materials, including label stocks, laminating adhesives, and inks used by label printers.

2.12 SOURCE QUALITY CONTROL

A. Testing Agency: Engage a qualified testing agency to evaluate cables.

B. Factory test UTP cables according to TIA/EIA-568-B.2.

C. Factory sweep test coaxial cables at frequencies from 5 MHz to 1 GHz. Sweep test shall test the frequency response, or attenuation over frequency, of a cable by generating a voltage whose frequency is varied through the specified frequency range and graphing the results.

D. Cable will be considered defective if it does not pass tests and inspections.

E. Prepare test and inspection reports.

2.13 WIRE LUBRICATING COMPOUND

A. Suitable for the wire insulation and conduit it is used with, and shall not harden or become adhesive.

B. Shall not be used on wire for isolated type electrical power systems.

2.14 FIREPROOFING TAPE

A. The tape shall consist of a flexible, conformable fabric of organic composition coated one side with flame-retardant elastomer.

B. The tape shall be self-extinguishing and shall not support combustion. It shall be arc-proof and fireproof.

C. The tape shall not deteriorate when subjected to water, gases, salt water, sewage, or fungus and be resistant to sunlight and ultraviolet light.

D. The finished application shall withstand a 200-ampere arc for not less than 30 seconds.

E. Securing tape: Glass cloth electrical tape not less than 0.18 mm (7 mils) thick, and 19 mm (3/4 inch) wide.

PART 3 - EXECUTION

3.1 INSTALLATION OF CONDUCTORS AND CABLES

A. Comply with NECA 1.

B. General Requirements for Cabling:

1. Comply with TIA/EIA-568-B.1.

2. Comply with BICSI ITSIM, Ch. 6, "Cable Termination Practices."

3. Install 110-style IDC termination hardware unless otherwise indicated.
4. Terminate all conductors; no cable shall contain un-terminated elements. Make terminations only at indicated outlets, terminals, and cross-connect and patch panels.
5. Cables may not be spliced. Secure and support cables at intervals not exceeding 30 inches (760 mm) and not more than 6 inches (150 mm) from cabinets, boxes, fittings, outlets, racks, frames, and terminals.
6. Bundle, lace, and train conductors to terminal points without exceeding manufacturer's limitations on bending radii, but not less than radii specified in BICSI ITSIM, "Cabling Termination Practices" Chapter. Install lacing bars and distribution spools.
7. Do not install bruised, kinked, scored, deformed, or abraded cable. Do not splice cable between termination, tap, or junction points. Remove and discard cable if damaged during installation and replace it with new cable.
8. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used for heating.
9. Pulling Cable:
   a. Comply with BICSI ITSIM, Ch. 4, "Pulling Cable." Monitor cable pull tensions.
   b. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling of cables.
   c. Use ropes made of nonmetallic material for pulling feeders.
   d. Attach pulling lines for feeders by means of either woven basket grips or pulling eyes attached directly to the conductors, as approved by the Contracting Officer’s Representative
   e. Pull in multiple cables together in a single conduit.

C. Splice cables and wires where necessary only in outlet boxes, junction boxes, or pull boxes.
   1. Splices and terminations shall be mechanically and electrically secure.
   2. Where the Government determines that unsatisfactory splices or terminations have been installed, remove the devices and install approved devices at no additional cost to the Government.

D. Unless otherwise specified in other sections install wiring and connect to equipment/devices to perform the required functions as shown and specified.

E. Except where otherwise required, install a separate power supply circuit for each system so that malfunctions in any system will not affect other systems.

F. Where separate power supply circuits are not shown, connect the systems to the nearest panel boards of suitable voltages, which are intended to supply such systems and have suitable spare circuit breakers or space for installation.

G. Install a red warning indicator on the handle of the branch circuit breaker for the power supply circuit for each system to prevent accidental de-energizing of the systems.

H. System voltages shall be 120 volts or lower where shown on the drawings or as required by the NEC.

I. UTP Cable Installation:
   1. Comply with TIA/EIA-568-B.2.
   2. Do not untwist UTP cables more than 1/2 inch (12 mm) from the point of termination to maintain cable geometry.

J. Open-Cable Installation:
   1. Install cabling with horizontal and vertical cable guides in telecommunications spaces with terminating hardware and interconnection equipment.
   2. Suspend copper cable not in a wireway or pathway a minimum of 8 inches (200 mm) above ceilings by cable supports not more than 60 inches (1525 mm) apart.
   3. Cable shall not be run through structural members or in contact with pipes, ducts, or other potentially damaging items.

K. Separation from EMI Sources:
   1. Comply with BICSI TDMM and TIA/EIA-569-A recommendations for separating unshielded copper voice and data communication cable from potential EMI sources, including electrical power lines and equipment.
   2. Separation between open communications cables or cables in nonmetallic raceways and unshielded power conductors and electrical equipment shall be as follows:

a. Electrical Equipment Rating Less Than 2 kVA: A minimum of 5 inches (127 mm).
b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 12 inches (300 mm).
c. Electrical Equipment Rating More Than 5 kVA: A minimum of 24 inches (600 mm).

3. Separation between communications cables in grounded metallic raceways and unshielded power lines or electrical equipment shall be as follows:
   a. Electrical Equipment Rating Less Than 2 kVA: A minimum of 2-1/2 inches (64 mm).
   b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 6 inches (150 mm).
   c. Electrical Equipment Rating More Than 5 kVA: A minimum of 12 inches (300 mm).
4. Separation between communications cables in grounded metallic raceways and power lines and electrical equipment located in grounded metallic conduits or enclosures shall be as follows:
   a. Electrical Equipment Rating Less Than 2 kVA: No requirement.
   b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 3 inches (75 mm).
   c. Electrical Equipment Rating More Than 5 kVA: A minimum of 6 inches (150 mm).
5. Separation between Cables and Electrical Motors and Transformers, 5 kVA or HP and Larger: A minimum of 48 inches (1200 mm).

3.2 FIRE ALARM WIRING INSTALLATION

A. Comply with NECA 1 and NFPA 72.
B. Wiring Method: Install wiring in metal raceway according to Division 28 Section CONDUITS AND BACKBOXES FOR ELECTRICAL SYSTEMS."
   1. Install plenum cable in environmental air spaces, including plenum ceilings.
   2. Fire alarm circuits and equipment control wiring associated with the fire alarm system shall be installed in a dedicated raceway system. This system shall not be used for any other wire or cable.
C. Wiring Method:

1. Cables and raceways used for fire alarm circuits, and equipment control wiring associated with the fire alarm system, may not contain any other wire or cable.
2. Fire-Rated Cables: Use of 2-hour, fire-rated fire alarm cables, NFPA 70, Types MI and CI, is[not] permitted.
3. Signaling Line Circuits: Power-limited fire alarm cables shall not be installed in the same cable or raceway as signaling line circuits.

D. Wiring within Enclosures: Separate power-limited and non-power-limited conductors as recommended by manufacturer. Install conductors parallel with or at right angles to sides and back of the enclosure. Bundle, lace, and train conductors to terminal points with no excess. Connect conductors that are terminated, spliced, or interrupted in any enclosure associated with the fire alarm system to terminal blocks. Mark each terminal according to the system's wiring diagrams. Make all connections with approved crimp-on terminal spade lugs, pressure-type terminal blocks, or plug connectors.

E. Cable Taps: Use numbered terminal strips in junction, pull, and outlet boxes, cabinets, or equipment enclosures where circuit connections are made.

F. Color-Coding: Color-code fire alarm conductors differently from the normal building power wiring. Use one color-code for alarm circuit wiring and another for supervisory circuits. Color-code audible alarm-indicating circuits differently from alarm-initiating circuits. Use different colors for visible alarm-indicating devices. Paint fire alarm system junction boxes and covers red.

G. Risers: Install at least two vertical cable risers to serve the fire alarm system. Separate risers in close proximity to each other with a minimum one-hour-rated wall, so the loss of one riser does not prevent the receipt or transmission of signals from other floors or zones.

H. Wiring to Remote Alarm Transmitting Device: 1-inch (25-mm) conduit between the fire alarm control panel and the transmitter. Install number of conductors and electrical supervision for connecting wiring as needed to suit monitoring function.

3.3 CONTROL CIRCUIT CONDUCTORS

A. Minimum Conductor Sizes:

1. Class 1 remote-control and signal circuits, No. 14 AWG.
2. Class 2 low-energy, remote-control and signal circuits, No. 16 AWG.
3. Class 3 low-energy, remote-control, alarm and signal circuits, No. 12 AWG.

3.4 CONNECTIONS

A. Comply with requirements in Division 28 Section, PHYSICAL ACCESS CONTROL for connecting, terminating, and identifying wires and cables.

B. Comply with requirements in Division 28 Section "VIDEO SURVEILLANCE" for connecting, terminating, and identifying wires and cables.

C. Comply with requirements in Division 28 Section "FIRE DETECTION AND ALARM" for connecting, terminating, and identifying wires and cables.

3.5 FIRESTOPPING

A. Comply with requirements in Division 07 Section "PENETRATION FIRESTOPPING."

B. Comply with TIA/EIA-569-A, "Firestopping" Annex A.

C. Comply with BICSI TDMM, "Firestopping Systems" Article.

3.6 GROUNDING

A. For communications wiring, comply with ANSI-J-STD-607-A and with BICSI TDMM, "Grounding, Bonding, and Electrical Protection" Chapter.

B. For low-voltage wiring and cabling, comply with requirements in Division 28 Section "GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY."

3.7 IDENTIFICATION

A. Identify system components, wiring, and cabling complying with TIA/EIA-606-A.

B. Install a permanent wire marker on each wire at each termination.

C. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.

D. Wire markers shall retain their markings after cleaning.

3.8 FIELD QUALITY CONTROL

A. Testing Agency: Engage a qualified testing agency to perform tests and inspections.

B. Perform tests and inspections.

C. Tests and Inspections:

1. Visually inspect UTP cable jacket materials for UL or third-party certification markings. Inspect cabling terminations to confirm

color-coding for pin assignments, and inspect cabling connections to confirm compliance with TIA/EIA-568-B.1.

2. Visually inspect cable placement, cable termination, grounding and bonding, equipment and patch cords, and labeling of all components.
3. Test UTP cabling for DC loop resistance, shorts, opens, intermittent faults, and polarity between conductors. Test operation of shorting bars in connection blocks. Test cables after termination but not cross connection.
   a. Test instruments shall meet or exceed applicable requirements in TIA/EIA-568-B.2. Perform tests with a tester that complies with performance requirements in "Test Instruments (Normative)" Annex, complying with measurement accuracy specified in "Measurement Accuracy (Informative)" Annex. Use only test cords and adapters that are qualified by test equipment manufacturer for channel or link test configuration.

D. Document data for each measurement. Print data for submittals in a summary report that is formatted using Table 10.1 in BICSI TDMM as a guide, or transfer the data from the instrument to the computer, save as text files, print, and submit.

E. End-to-end cabling will be considered defective if it does not pass tests and inspections.

F. Prepare test and inspection reports.

3.9 EXISITNG WIRING

A. Unless specifically indicated on the plans, existing wiring shall not be reused for the new installation. Only wiring that conforms to the specifications and applicable codes may be reused. If existing wiring does not meet these requirements, existing wiring may not be reused and new wires shall be installed.

- - - E N D - - -

SECTION 28 05 26
GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY

PART 1 – GENERAL

1.1 DESCRIPTION

A. This section specifies the finishing, installation, connection, testing and certification of the grounding and bonding required for a fully functional Electronic Safety and Security (ESS) system.

B. "Grounding electrode system" refers to all electrodes required by NEC, as well as including made, supplementary, grounding electrodes.

C. The terms "connect" and "bond" are used interchangeably in this specification and have the same meaning

1.2 RELATED WORK

A. Section 01 00 00 – GENERAL REQUIREMENTS. For General Requirements.

B. Section 28 05 00 – REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS. For general electrical requirements, quality assurance, coordination, and project conditions that are common to more than one section in Division 28.

C. Section 28 05 13 – CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for low voltage power and lighting wiring.

D. Section 28 08 00 – COMMISIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS. Requirements for commissioning.

1.3 SUBMITTALS

A. Submit in accordance with Section 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.

B. Shop Drawings:

1. Clearly present enough information to determine compliance with drawings and specifications.
2. Include the location of system grounding electrode connections and the routing of aboveground and underground grounding electrode conductors.

C. Test Reports: Provide certified test reports of ground resistance.

D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the Contracting Officer's Representative:

1. Certification that the materials and installation are in accordance with the drawings and specifications.

2. Certification by the contractor that the complete installation has been properly installed and tested.

1.4 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. American Society for Testing and Materials (ASTM):

B1-07.....Standard Specification for Hard-Drawn Copper Wire

B3-07.....Standard Specification for Soft or Annealed Copper Wire

B8-04.....Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft

C. Institute of Electrical and Electronics Engineers, Inc. (IEEE):

81-2025.....IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System

C2-23.....National Electrical Safety Code

D. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

99-2024.....Health Care Facilities

E. Underwriters Laboratories, Inc. (UL):

44-19 .....Thermoset-Insulated Wires and Cables

83-16 .....Thermoplastic-Insulated Wires and Cables

467-22 .....Grounding and Bonding Equipment

486A-486B-23 .....Wire Connectors

PART 2 - PRODUCTS

2.1 GROUNDING AND BONDING CONDUCTORS

A. Equipment grounding conductors shall be UL 83 insulated stranded copper, except that sizes 6 mm² (10 AWG) and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes 25 mm² (4 AWG) and larger shall be permitted to be identified per NEC.

B. Bonding conductors shall be ASTM B8 bare stranded copper, except that sizes 6 mm² (10 AWG) and smaller shall be ASTM B1 solid bare copper wire.

2.2 SPLICES AND TERMINATION COMPONENTS

A. Components shall meet or exceed UL 467 and be clearly marked with the manufacturer, catalog number, and permitted conductor size(s).2.4 ground connections

B. Listed and labeled by an NRTL acceptable to authorities having jurisdiction for applications in which used and for specific types, sizes, and combinations of conductors and other items connected.

2.3 EQUIPMENT RACK AND CABINET GROUND BARS (NOT USED)

2.4 GROUND TERMINAL BLOCKS

A. At any equipment mounting location (e.g., backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide screw lug-type terminal blocks.

2.5 SPLICE CASE GROUND ACCESSORIES

A. Splice case grounding and bonding accessories shall be supplied by the splice case manufacturer when available. Otherwise, use 16 mm² (6 AWG) insulated ground wire with shield bonding connectors.

PART 3 - EXECUTION

3.1 GENERAL

A. Ground in accordance with the NEC, as shown on drawings, and as specified herein.

B. System Grounding:

1. Secondary service neutrals: Ground at the supply side of the secondary disconnecting means and at the related transformers.
2. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.

C. Equipment Grounding: Metallic structures, including ductwork and building steel, enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits, shall be bonded and grounded.

3.2 INACCESSIBLE GROUNDING CONNECTIONS (NOT USED)

3.3 CORROSION INHIBITORS

A. When making ground and ground bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

3.4 CONDUCTIVE PIPING (NOT USED)

3.5 COMPUTER ROOM/SECURITY EQUIPMENT ROOM GROUNDING (NOT USED)

3.6 WIREWAY GROUNDING

A. Ground and Bond Metallic Wireway Systems as follows:

1. Bond the metallic structures of wireway to provide 100 percent electrical continuity throughout the wireway system by connecting a 16 mm² (6 AWG) bonding jumper at all intermediate metallic enclosures and across all section junctions.
2. Install insulated 16 mm² (6 AWG) bonding jumpers between the wireway system bonded as required in paragraph 1 above, and the closest building ground at each end and approximately every 16 meters (50 feet).
3. Use insulated 16 mm² (6 AWG) bonding jumpers to ground or bond metallic wireway at each end at all intermediate metallic enclosures and cross all section junctions.
4. Use insulated 16 mm² (6 AWG) bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 15 meters.

3.7 GROUND RESISTANCE

A. Grounding system resistance to ground shall not exceed 5 ohms. Make any modifications or additions to the grounding electrode system necessary for compliance without additional cost to the Government. Final tests shall ensure that this requirement is met.

B. Resistance of the grounding electrode system shall be measured using a four-terminal fall-of-potential method as defined in IEEE 81. Ground resistance measurements shall be made before the electrical distribution system is energized and shall be made in normally dry conditions not fewer than 48 hours after the last rainfall. Resistance measurements of separate grounding electrode systems shall be made before the systems are bonded together below grade. The combined resistance of separate systems may be used to meet the required

resistance, but the specified number of electrodes must still be provided.

C. Services at power company interface points shall comply with the power company ground resistance requirements.

D. Below-grade connections shall be visually inspected by the Contracting Officer's Representative prior to backfilling. The contractor shall notify the Contracting Officer's Representative 24 hours before the connections are ready for inspection.

3.8 LABELING

A. Comply with requirements in Division 26 Section "ELECTRICAL IDENTIFICATION" Article for instruction signs. The label or its text shall be green.

B. Install labels at the telecommunications bonding conductor and grounding equalizer.

1. Label Text: "If this connector or cable is loose or if it must be removed for any reason, notify the facility manager."

3.9 FIELD QUALITY CONTROL

A. Perform tests and inspections.

B. Tests and Inspections:

1. After installing grounding system but before permanent electrical circuits have been energized, test for compliance with requirements.
2. Inspect physical and mechanical condition. Verify tightness of accessible, bolted, electrical connections with a calibrated torque wrench according to manufacturer's written instructions.

C. Grounding system will be considered defective if it does not pass tests and inspections.

D. Prepare test and inspection reports.

E. Report measured ground resistances that exceed the following values:

1. Power Distribution Units or Panel boards Serving Electronic Equipment: 3 ohm(s).

F. Excessive Ground Resistance: If resistance to ground exceeds specified values, notify Architect promptly and include recommendations to reduce ground resistance.

- - - E N D - - -

SECTION 28 05 28.33
CONDUITS AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the finishing, installation, connection, testing certification of the conduit, fittings, and boxes to form a complete, coordinated, raceway system(s). Conduits and when approved separate UL Certified and Listed partitioned telecommunications raceways are required for a fully functional Electronic Safety and Security (ESS) system. Raceways are required for all electronic safety and security cabling unless shown or specified otherwise.

B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

1.2 RELATED WORK

A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.

B. Section 06 10 00 - ROUGH CARPENTRY. Requirements for mounting board for communication closets.

C. Section 07 84 00 - FIRESTOPPING. Requirements for sealing around penetrations to maintain the integrity of fire rated construction.

D. Section 07 60 00 - FLASHING AND SHEET METAL. Requirements for fabrications for the deflection of water away from the building envelope at penetrations.

E. Section 07 92 00 - JOINT SEALANTS. Requirements for sealing around conduit penetrations through the building envelope to prevent moisture migration into the building.

F. Section 09 91 00 - PAINTING. Requirements for identification and painting of conduit and other devices.

G. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. For general electrical requirements, general arrangement of the contract documents, coordination, quality assurance, project conditions, equipment and materials, and items that is common to more than one section of Division 28.

H. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

I. Section 28 08 00 - COMMISIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS. Requirements for commissioning - systems readiness checklists, and training.

1.3 DEFINITIONS

A. EMT: Electrical metallic tubing.

B. ENT: Electrical nonmetallic tubing.

C. EPDM: Ethylene-propylene-diene terpolymer rubber.

D. FMC: Flexible metal conduit.

E. IMC: Intermediate metal conduit.

F. LFMC: Liquidtight flexible metal conduit.

G. LFNC: Liquidtight flexible nonmetallic conduit.

H. NBR: Acrylonitrile-butadiene rubber.

I. RNC: Rigid nonmetallic conduit.

1.4 QUALITY ASSURANCE

A. Refer to Paragraph 1.4 Quality Assurance, in Section 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.

1.5 SUBMITTALS

A. Submit in accordance with Section 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Furnish the following:

B. Shop Drawings:

1. Size and location of main feeders;
2. Size and location of panels and pull boxes
3. Layout of required conduit penetrations through structural elements.
4. The specific item proposed and its area of application shall be identified on the catalog cuts.

C. Certification: Prior to final inspection, deliver to the Contracting Officer's Representative four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.

D. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 28 08 00 COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.

E. Product Data: For surface raceways, wireways and fittings, floor boxes, hinged-cover enclosures, and cabinets.

F. Shop Drawings: For the following raceway components. Include plans, elevations, sections, details, and attachments to other work.
   1. Custom enclosures and cabinets.

G. Coordination Drawings: Conduit routing plans, drawn to scale, on which the following items are shown and coordinated with each other, based on input from installers of the items involved:
   1. Structural members in the paths of conduit groups with common supports.
   2. HVAC and plumbing items and architectural features in the paths of conduit groups with common supports.

H. Manufacturer Seismic Qualification Certification: Submit certification that enclosures and cabinets and their mounting provisions, including those for internal components, will withstand seismic forces defined in Division 16 Section "Electrical Supports and Seismic Restraints." Include the following:
   1. Basis for Certification: Indicate whether withstand certification is based on actual test of assembled components or on calculation.
      a. The term "withstand" means "the cabinet or enclosure will remain in place without separation of any parts when subjected to the seismic forces specified [and the unit will retain its enclosure characteristics, including its interior accessibility, after the seismic event]."
   2. Dimensioned Outline Drawings of Equipment Unit: Identify center of gravity and locate and describe mounting and anchorage provisions.
   3. Detailed description of equipment anchorage devices on which the certification is based and their installation requirements.

I. Source quality-control test reports.

1.6 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.

B. National Electrical Manufacturers Association (NEMA):

TC-3-04.....PVC Fittings for Use with Rigid PVC Conduit and Tubing

FB1-07.....Fittings, Cast Metal Boxes and Conduit Bodies for Conduit, Electrical Metallic Tubing and Cable

C. National Fire Protection Association (NFPA):

70-23.....National Electrical Code (NEC)

D. Underwriters Laboratories, Inc. (UL):

1-05.....Flexible Metal Conduit

5-04.....Surface Metal Raceway and Fittings

6-07.....Rigid Metal Conduit

50-07.....Enclosures for Electrical Equipment

360-09.....Liquid-Tight Flexible Steel Conduit

467-07.....Grounding and Bonding Equipment

514A-04.....Metallic Outlet Boxes

514B-04.....Fittings for Cable and Conduit

514C-02.....Nonmetallic Outlet Boxes, Flush-Device Boxes and Covers

651-05.....Schedule 40 and 80 Rigid PVC Conduit

651A-07.....Type EB and A Rigid PVC Conduit and HDPE Conduit

797-07.....Electrical Metallic Tubing

1242-06.....Intermediate Metal Conduit

PART 2 - PRODUCTS

2.1 GENERAL

A. Conduit Size: In accordance with the NEC, but not less than 20 mm (3/4 inch) unless otherwise shown.

2.2 CONDUIT

A. Rigid galvanized steel: Shall Conform to UL 6, ANSI C80.1.

B. Rigid intermediate steel conduit (IMC): Shall Conform to UL 1242, ANSI C80.6.

C. Electrical metallic tubing (EMT): Shall Conform to UL 797, ANSI C80.3. Maximum size not to exceed 105 mm (4 inches) and shall be permitted only with cable rated 600 volts or less.

D. Flexible galvanized steel conduit: Shall Conform to UL 1.

E. Liquid-tight flexible metal conduit: Shall Conform to UL 360.

2.3.WIREWAYS AND RACEWAYS

A. Surface metal raceway: Shall Conform to UL 5.

2.4.CONDUIT FITTINGS

A. Rigid steel and IMC conduit fittings:

1. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
2. Standard threaded couplings, locknuts, bushings, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
3. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
4. Bushings: Metallic insulating type, consisting of an insulating insert molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
5. Erickson (union-type) and set screw type couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
6. Sealing fittings: Threaded cast iron type. Use continuous drain type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.

B. Electrical metallic tubing fittings:

1. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
2. Only steel or malleable iron materials are acceptable.
3. Couplings and connectors: Concrete tight and rain tight, with connectors having insulated throats. Use gland and ring compression type couplings and connectors for conduit sizes 50 mm (2 inches) and smaller. Use set screw type couplings with four set screws each for conduit sizes over 50 mm (2 inches). Use set screws of case-hardened steel with hex head and cup point to firmly seat in wall of conduit for positive grounding.
4. Indent type connectors or couplings are prohibited.

5. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.

C. Flexible steel conduit fittings:
1. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
2. Clamp type, with insulated throat.

D. Liquid-tight flexible metal conduit fittings:
1. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
2. Only steel or malleable iron materials are acceptable.
3. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.

E. Surface metal raceway fittings: As recommended by the raceway manufacturer.

F. Expansion and deflection couplings:
1. Conform to UL 467 and UL 514B.
2. Accommodate, 19 mm (0.75 inch) deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
3. Include internal flexible metal braid sized to guarantee conduit ground continuity and fault currents in accordance with UL 467, and the NEC code tables for ground conductors.
4. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat resistant molded rubber material with stainless steel jacket clamps.

2.5 CONDUIT SUPPORTS

A. Parts and hardware: Zinc-coat or provide equivalent corrosion protection.

B. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.

C. Multiple conduit (trapeze) hangers: Not less than 38 mm by 38 mm (1-1/2 by 1-1/2 inch), 12 gage steel, cold formed, lipped channels; with not less than 9 mm (3/8 inch) diameter steel hanger rods.

D. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.

2.6 OUTLET, JUNCTION, AND PULL BOXES

A. UL-50 and UL-514A.

B. Cast metal where required by the NEC or shown, and equipped with rustproof boxes.

C. Nonmetallic Outlet and Device Boxes: NEMA OS 2.

D. Metal Floor Boxes: Cast or sheet metal, semi-adjustable, rectangular.

E. Sheet metal boxes: Galvanized steel, except where otherwise shown.

F. Flush mounted wall or ceiling boxes shall be installed with raised covers so that front face of raised cover is flush with the wall. Surface mounted wall or ceiling boxes shall be installed with surface style flat or raised covers.

2.7 WIREWAYS

A. Equip with hinged covers, except where removable covers are shown.

2.8 SLEEVES FOR RACEWAYS

A. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, galvanized steel, plain ends.

B. Sleeves for Rectangular Openings: Galvanized sheet steel with minimum 0.052- or 0.138-inch (1.3- or 3.5-mm) thickness as indicated and of length to suit application.

C. Coordinate sleeve selection and application with selection and application of firestopping specified in Division 07 84 00 "FIRESTOPPING."

PART 3 - EXECUTION

3.1 PENETRATIONS

A. Cutting or Holes:

1. Locate holes in advance where they are proposed in the structural sections such as ribs or beams. Obtain the approval of the Contracting Officer's Representative prior to drilling through structural sections.
2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammer, impact electric, hand or manual hammer type drills are not allowed, except where permitted by the Contracting Officer's Representative as required by limited working space.

B. Fire Stop: Where conduits, wireways, and other electronic safety and security raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in

Section 07 84 00, FIRESTOPPING, with rock wool fiber or silicone foam sealant only. Completely fill and seal clearances between raceways and openings with the fire stop material.

3.2 INSTALLATION, GENERAL

A. Install conduit as follows:

1. In complete runs before pulling in cables or wires.
2. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new undamaged material.
3. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
4. Cut square with a hacksaw, ream, remove burrs, and draw up tight.
5. Mechanically continuous.
6. Independently support conduit at 2.4 m (8 foot) on center. Do not use other supports i.e., (suspended ceilings, suspended ceiling supporting members, lighting fixtures, conduits, mechanical piping, or mechanical ducts).
7. Support within 300 mm (12 inches) of changes of direction, and within 300 mm (12 inches) of each enclosure to which connected.
8. Close ends of empty conduit with plugs or caps at the rough-in stage to prevent entry of debris, until wires are pulled in.
9. Conduit installations under fume and vent hoods are prohibited.
10. Secure conduits to cabinets, junction boxes, pull boxes and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
11. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, "FLASHING AND SHEET METAL".
12. Unless otherwise indicated on the drawings or specified herein, all conduits shall be installed concealed within finished walls, floors and ceilings.

B. Conduit Bends:

1. Make bends with standard conduit bending machines.
2. Conduit hickey may be used for slight offsets, and for straightening stubbed out conduits.
3. Bending of conduits with a pipe tee or vise is prohibited.

C. Layout and Homeruns:
   1. Install conduit with wiring, including homeruns, as shown.
   2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted approved by the Contracting Officer's Representative.

D. Fire Alarm:
   1. Fire alarm conduit shall be painted red (a red "top-coated" conduit from the conduit manufacturer may be used in lieu of painted conduit) in accordance with the requirements of Section 28 31 00, "FIRE DETECTION AND ALARM".

3.3 CONCEALED WORK INSTALLATION

A. Furred or Suspended Ceilings and in Walls:
   1. Conduit for conductors above 600 volts:
      a. Rigid steel.
   2. Conduit for conductors 600 volts and below:
      a. Rigid steel, IMC, or EMT. Different type conduits mixed indiscriminately in the same system is prohibited.
   3. Align and run conduit parallel or perpendicular to the building lines.
   4. Tightening set screws with pliers is prohibited.

3.4 EXPOSED WORK INSTALLATION

A. Unless otherwise indicated on the drawings, exposed conduit is only permitted in mechanical and electrical rooms.

B. Conduit for Conductors 600 volts and below:
   1. Rigid steel, IMC, or EMT. Different type of conduits mixed indiscriminately in the system is prohibited.

C. Align and run conduit parallel or perpendicular to the building lines.

D. Install horizontal runs close to the ceiling or beams and secure with conduit straps.

E. Support horizontal or vertical runs at not over 2400 mm (eight foot) intervals.

F. Surface metal raceways: Use only where shown.

G. Painting:
   1. Paint exposed conduit as specified in Section09 91 00, "PAINTING".

3.5 EXPANSION JOINTS

A. Conduits 75 mm (3 inches) and larger, that are secured to the building structure on opposite sides of a building expansion joint, require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.

B. Provide conduits smaller than 75 mm (3 inches) with junction boxes on both sides of the expansion joint. Connect conduits to junction boxes with sufficient slack of flexible conduit to produce 125 mm (5 inch) vertical drop midway between the ends. Flexible conduit shall have a copper green ground bonding jumper installed. In lieu of this flexible conduit, expansion and deflection couplings as specified above for 375 mm (15 inches) and larger conduits are acceptable.

C. Install expansion and deflection couplings where shown.

D. Seismic Areas: In seismic areas, provide conduits rigidly secured to the building structure on opposite sides of a building expansion joint with junction boxes on both sides of the joint. Connect conduits to junction boxes with 375 mm (15 inches) of slack flexible conduit. Flexible conduit shall have a copper green ground bonding jumper installed.

3.6 CONDUIT SUPPORTS, INSTALLATION

A. Safe working load shall not exceed 1/4 of proof test load of fastening devices.

B. Use pipe straps or individual conduit hangers for supporting individual conduits. Maximum distance between supports is 2.5 m (8 foot) on center.

C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and 90 kg (200 pounds). Attach each conduit with U-bolts or other approved fasteners.

D. Support conduit independently of junction boxes, pull boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.

E. Fasteners and Supports in Solid Masonry and Concrete:

1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
2. Existing Construction:

a. Steel expansion anchors not less than 6 mm (1/4 inch) bolt size and not less than 28 mm (1-1/8 inch) embedment.

b. Power set fasteners not less than 6 mm (1/4 inch) diameter with depth of penetration not less than 75 mm (3 inches).

c. Use vibration and shock resistant anchors and fasteners for attaching to concrete ceilings.

F. Hollow Masonry: Toggle bolts are permitted.

G. Bolts supported only by plaster or gypsum wallboard are not acceptable.

H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.

I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.

J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.

K. Spring steel type supports or fasteners are prohibited for all uses except: Horizontal and vertical supports/fasteners within walls.

L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

3.7 BOX INSTALLATION

A. Boxes for Concealed Conduits:

1. Flush mounted.
2. Provide raised covers for boxes to suit the wall or ceiling, construction and finish.

B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling in operations.

C. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.

D. Outlet boxes in the same wall mounted back-to-back are prohibited. A minimum 600 mm (24 inch), center-to-center lateral spacing shall be maintained between boxes).

E. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1".

F. On all Branch Circuit junction box covers, identify the circuits with black marker.

3.8 ELECTRONIC SAFETY AND SECURITY CONDUIT

A. Install the electronic safety and security raceway system as shown on drawings.

B. Minimum conduit size of 19 mm (3/4 inch), but not less than the size shown on the drawings.

C. All conduit ends shall be equipped with insulated bushings.

D. All 100 mm (four inch) conduits within buildings shall include pull boxes after every two 90 degree bends. Size boxes per the NEC.

E. Vertical conduits/sleeves through closets floors shall terminate not less than 75 mm (3 inches) below the floor and not less than 75 mm (3 inches) below the ceiling of the floor below.

F. Terminate conduit runs to/from a backboard in a closet or interstitial space at the top or bottom of the backboard. Conduits shall enter communication closets next to the wall and be flush with the backboard.

G. Where drilling is necessary for vertical conduits, locate holes so as not to affect structural sections such as ribs or beams.

H. All empty conduits located in communications closets or on backboards shall be sealed with a standard non-hardening duct seal compound to prevent the entrance of moisture and gases and to meet fire resistance requirements.

I. Conduit runs shall contain no more than four quarter turns (90 degree bends) between pull boxes/backboards. Minimum radius of communication conduit bends shall be as follows (special long radius):

Sizes of Conduit Trade Size	Radius of Conduit Bends mm, Inches
¾	150 (6)
1	230 (9)
1-1/4	350 (14)
1-1/2	430 (17)
2	525 (21)
2-1/2	635 (25)
3	775 (31)
3-1/2	900 (36)
4	1125 (45)

J. Furnish and install 19 mm (3/4 inch) thick fire retardant plywood specified in on the wall of communication closets where shown on drawings . Mount the plywood with the bottom edge 300 mm (one foot) above the finished floor.

K. Furnish and pull wire in all empty conduits. (Sleeves through floor are exceptions).

3.9 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 28 08 00 – "COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS" for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.

B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 28 08 00, "COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS" and related sections for contractor responsibilities for system commissioning.

- - - E N D - - -

SECTION 28 08 00

COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS

PART 1 – GENERAL

1.1 DESCRIPTION

A. The requirements of this Section apply to all sections of Division 28.

B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned is specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIRMENTS. A Commissioning Agent (CxA) appointed by the VA will manage the commissioning process.

1.2 RELATED WORK

A. Section 01 00 00 GENERAL REQUIREMENTS.

B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.3 SUMMARY

A. This Section includes requirements for commissioning the Facility electronic safety and security systems, related subsystems and related equipment. This Section supplements the general requirements specified in Section 01 91 00 General Commissioning Requirements.

B. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more details regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

1.4 DEFINITIONS

A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

1.5 COMMISSIONED SYSTEMS

A. Commissioning of a system or systems specified in Division 28 is part of the construction process. Documentation and testing of these systems, as well as training of the VA's Operation and Maintenance personnel in accordance with the requirements of Section 01 91 00 and of Division 28, is required in cooperation with the VA and the Commissioning Agent.

B. The Facility exterior closure systems commissioning will include the systems listed in Section 01 91 00 General Commissioning Requirements:

1.6 SUBMITTALS

A. The commissioning process requires review of selected Submittals that pertain to the systems to be commissioned. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.

B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

PART 2 – PRODUCTS (NOT USED)

PART 3 – EXECUTION

3.1 CONSTRUCTION INSPECTIONS

A. Commissioning of Electronic Safety and Security systems will require inspection of individual elements of the electronic safety and security systems throughout the construction period. The Contractor shall coordinate with the Commissioning Agent in accordance with Section 01 91 00 and the Commissioning plan to schedule electronic safety and security systems inspections as required to support the Commissioning Process.

3.2 PRE-FUNCTIONAL CHECKLISTS

A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed

checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

3.3 CONTRACTORS TESTS

A. Contractor tests as required by other sections of Division 28 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. All testing shall be incorporated into the project schedule. Contractor shall provide no less than 7 calendar days' notice of testing. The Commissioning Agent will witness selected Contractor tests at the sole discretion of the Commissioning Agent. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

3.4 SYSTEMS FUNCTIONAL PERFORMANCE TESTING

A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the Contracting Officer's Representative. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

3.5 TRAINING OF VA PERSONNEL

A. Training of the VA operation and maintenance personnel is required in cooperation with the Contracting Officer's Representative and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel

concerning the location, operation, and troubleshooting of the installed systems. Contractor shall submit training agendas and trainer resumes in accordance with the requirements of Section 01 91 00. The instruction shall be scheduled in coordination with the VA Contracting Officer's Representative after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 28 Sections for additional Contractor training requirements.

----- END -----

SECTION 28 13 00
PHYSICAL ACCESS CONTROL SYSTEM

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies the finishing, installation, connection, testing and certification of a complete and fully operating Physical Access Control System, hereinafter referred to as the PACS.

B. This Section includes a Physical Access Control System consisting of a system server, one or more networked workstation computers, operating system and application software, and field-installed Controllers connected by a high-speed electronic data transmission network. The PACS shall have the following:

1. Physical Access Control:
   a. Regulating access through doors
   b. Anti-passback
   c. Visitor assignment
   d. Surge and tamper protection
   e. Secondary alarm annunciator
   f. Credential readers
   g. RS-232 ASCII interface
   h. Credential creation and credential holder database and management
   i. Monitoring of field-installed devices
   j. Reporting

C. System Architecture:

1. Criticality, operational requirements, and/or limiting points of failure may dictate the development of an enterprise and regional server architecture as opposed to system capacity. Provide server and workstation configurations with all necessary connectors, interfaces and accessories as shown.

D. PACS shall provide secure and reliable identification of Federal employees and contractors by utilizing credential authentication per FIPS-201.

E. Physical Access Control System (PACS) shall consist of:

1. Head-End equipment server,
2. One or more networked PC-based workstations,
3. Physical Access Control System and Database Management Software,

4. Credential validation software/hardware,
5. Field installed controllers,
6. PIV Middelware,
7. Card readers,
10. Supportive information system,
11. Door locks and sensors,
12. Power supplies,
13. Interfaces with:
    a. Fire Protection System,
    b. Building Management System,

G. Information system supporting PACS shall comply with FIPS 200 requirements (Minimum Security Requirements for Federal Information and Information Systems)and NIST Special Publication 800-53 (Recommended Security Controls for Federal Information Systems).

H. PACS system shall support:
1. Multiple credential authentication modes,
2. Bidirectional communication with the reader,
3. Incident response policy implementation capability; system shall have capability to automatically change access privileges for certain user groups to high security areas in case of incident/emergency.
4. Visitor management,

I. All security relevant decisions shall be made on "secure side of the door". Secure side processing shall include;
1. Challenge/response management,
2. PKI path discovery and validation,
3. Credential identifier processing,
4. Authorization decisions.

J. For locations where secure side processing is not applicable the tamper switches and certified cryptographic processing shall be provided per FIPS-140-2.

K. System Software: Based on operating system central-station, workstation operating system, server operating system, and application software.

L. Software and controllers shall be capable of matching full 56 bit FASC-N plus minimum of 32 bits of public key certificate data.

M. Software shall have the following capabilities:
   1. Multiuser multitasking to allow for independent activities and monitoring to occur simultaneously at different workstations.
   2. Support authentication and enrolment;
      a. PIV verification,
      b. Expiration date check,
      e. Validate digital signatures of data objects (Objects are signed by the Trusted Authority
      f. Private key challenge (CAK & PAK to verify private key public key pairs exist and card is not a clone)
   3. Support CRL validation via OCSP or SCVP on a scheduled basis and automatically deny access to any revoked credential in the system.
   4. Graphical user interface to show pull-down menus and a menu tree format that complies with interface guidelines of Microsoft Windows operating system.
   5. System license shall be for the entire system and shall include capability for future additions that are within the indicated system size limits specified in this Section.
   6. System shall have open architecture that allows importing and exporting of data and interfacing with other systems that are compatible with operating system.
   7. Operator login and access shall be utilized via integrated smart card reader and password protection.

N. Systems Networks:
   1. A standalone system network shall interconnect all components of the system. This network shall include communications between a central station and any peer or subordinate workstations, enrollment stations, local annunciation stations, portal control stations or redundant central stations.

O. Number of points:
   1. PACS shall support multiple autonomous regional servers that can connect to a master command and controller server.
   2. Unlimited number of access control readers, unlimited number of inputs or outputs, unlimited number of client workstations, unlimited number of cardholders.

3. Total system solution to enable enterprise-wide, networked, multi-user access to all system resources via a wide range of options for connectivity with the customer's existing LAN and WAN.

P. Network(s) connecting PCs and Controllers shall comply with NIST Special Publication 800-53 (Recommended Security Controls for Federal Information Systems) and consist of one or more of the following:
   1. Local area, IEEE 802.3 Fast Ethernet [10 BASE-T] [100 BASE-TX], star topology network based on TCP/IP.
   2. Direct-connected, RS-232 cable from the COM port of the Central Station to the first Controller, then RS-485 to interconnect the remainder of the Controllers at that Location.

1.2 RELATED WORK

A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
B. Section 07 84 00 - FIRESTOPPING. Requirements for firestopping application and use.
C. Section 08 71 00 - DOOR HARDWARE. Requirements for door installation.
D. Section 10 14 00 - SIGNAGE. Requirements for labeling and signs.
E. Section 26 05 11 - REQUIREMENTS FOR ELECTRICAL INSTALLATIONS. Requirements for connection of high voltage.
F. Section 26 05 19 - LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Requirements for power cables.
G. Section 26 05 33 - RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS. Requirements for infrastructure.
H. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. For general requirements that are common to more than one section in Division 28.
I. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.
J. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.
K. Section 28 05 28.33 - CONDUITS AND BOXES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for infrastructure.
L. Section 28 08 00 - COMMISIONING OF ELECTRONIC SAFETY AND SECURITY. For requirements for commissioning, systems readiness checklists, and training.

M. Section 28 23 00 – VIDEO SURVEILLANCE. Requirements for security camera systems.

N. Section 28 31 00 – FIRE DETECTION AND ALARM. Requirements for integration with fire detection and alarm system.

1.3 QUALITY ASSURANCE

A. The Contractor shall be responsible for providing, installing, and the operation of the PACS as shown. The Contractor shall also provide certification as required.

B. The security system will be installed and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the security system is stand-alone or a part of a complete Information Technology (IT) computer network.

C. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.

D. Product Qualifications:

1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.

E. Contractor Qualifications:

1. The Contractor or security sub-contractor shall be a licensed security Contractor with a minimum of five (5) years experience installing and servicing systems of similar scope and complexity. The Contractor shall be an authorized regional representative of the Security Management System’s (PACS) manufacturer. The Contractor shall provide four (4) current references from clients with systems of similar scope and complexity which became operational in the past three (3) years. At least three (3) of the references shall be utilizing the same system components, in a similar configuration as the proposed system. The references must include a current point of contact, company or agency name, address, telephone number, complete

system description, date of completion, and approximate cost of the project. The owner reserves the option to visit the reference sites, with the site owner's permission and representative, to verify the quality of installation and the references' level of satisfaction with the system. The Contractor shall provide copies of system manufacturer certification for all technicians. The Contractor shall only utilize factory-trained technicians to install, program, and service the PACS. The Contractor shall only utilize factory-trained technicians to install, terminate and service controller/field panels and reader modules. The technicians shall have a minimum of five (5) continuous years of technical experience in electronic security systems. The Contractor shall have a local service facility. The facility shall be located within 60 miles of the project site. The local facility shall include sufficient spare parts inventory to support the service requirements associated with this contract. The facility shall also include appropriate diagnostic equipment to perform diagnostic procedures. The Contracting Officer's Representative reserves the option of surveying the company's facility to verify the service inventory and presence of a local service organization.

a. The Contractor shall provide proof project superintendent with BICSI Certified Commercial Installer Level 1, Level 2, or Technician to provide oversight of the project.
b. Cable installer must have on staff a Registered Communication Distribution Designer (RCDD) certified by Building Industry Consulting Service International. The staff member shall provide consistent oversight of the project cabling throughout design, layout, installation, termination and testing.

F. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

1.4 SUBMITTALS

A. Submit below items in conjunction with Master Specification Sections 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, Section 02 41 00,

DEMOLITION, and Section 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.

B. Provide certificates of compliance with Section 1.3, Quality Assurance.

C. Provide a complete and thorough pre-installation and as-built design package in both electronic format and on paper, minimum size 48 x 48 inches (1220 x 1220 millimeters); drawing submittals shall be per the established project schedule.

D. Shop drawing and as-built packages shall include, but not be limited to:

1. Index Sheet that shall:
   a. Define each page of the design package to include facility name, building name, floor, and sheet number.
   b. Provide a complete list of all security abbreviations and symbols.
   c. Reference all general notes that are utilized within the design package.
   d. Specification and scope of work pages for all individual security systems that are applicable to the design package that will:
      1) Outline all general and job specific work required within the design package.
      2) Provide a detailed device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
2. Drawing sheets that will be plotted on the individual floor plans or site plans shall:
   a. Include a title block as defined above.
   b. Clearly define the drawings scale in both standard and metric measurements.
   c. Provide device identification and location.
   d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements (e.g., barriers, etc.).
   e. Identify all pull box and conduit locations, sizes, and fill capacities.
   f. Address all general and drawing specific notes for a particular drawing sheet.

3. A detailed riser drawing for each applicable security subsystem shall:
   a. Indicate the sequence of operation.
   b. Relationship of integrated components on one diagram.
   c. Include the number, size, identification, and maximum lengths of interconnecting wires.
   d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.
4. A detailed system drawing for each applicable security system shall:
   a. Clearly identify how all equipment within the system, from main panel to device, shall be laid out and connected.
   b. Provide full detail of all system components wiring from point-to-point.
   c. Identify wire types utilized for connection, interconnection with associate security subsystems.
   d. Show device locations that correspond to the floor plans.
   e. All general and drawing specific notes shall be included with the system drawings.
5. A detailed schedule for all of the applicable security subsystems shall be included. All schedules shall provide the following information:
   a. Device ID.
   b. Device Location (e.g. site, building, floor, room number, location, and description).
   c. Mounting type (e.g. flush, wall, surface, etc.).
   d. Power supply or circuit breaker and power panel number.
   e. In addition, for the PACS, provide the door ID, door type (e.g. wood or metal), locking mechanism (e.g. strike or electromagnetic lock) and control device (e.g. card reader or biometrics).
6. Detail and elevation drawings for all devices that define how they were installed and mounted.

E. Pre-installation design packages shall go through a full review process conducted by the Contractor along with a VA representative to ensure all work has been clearly defined and completed. All reviews shall be conducted in accordance with the project schedule. There shall be four (4) stages to the review process:
   1. 35 percent
   2. 65 percent
   3. 90 percent
   4. 100 percent

F. Provide manufacturer security system product cut-sheets. Submit for approval at least 30 days prior to commencement of formal testing, a Security System Operational Test Plan. Include procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.

G. Submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing as specified. Provide all maintenance and operating manuals per Section 01 00 00, GENERAL REQUIREMENTS, and Section 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.

H. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 28 08 00 COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.

I. General: Submittals shall be in full compliance of the Contract Documents. All submittals shall be provided in accordance with this section. Submittals lacking the breath or depth these requirements will be considered incomplete and rejected. Submissions are considered multidisciplinary and shall require coordination with applicable divisions to provide a complete and comprehensive submission package. Additional general provisions are as follows:
   1. The Contractor shall schedule submittals in order to maintain the project schedule. For coordination drawings refer to Specification Section 01 33 10 - DESIGN SUBMITTAL PROCEDURES, which outline basic submittal requirements and coordination. Section 01 33 10 shall be used in conjunction with this section.

2. The Contractor shall identify variations from requirements of Contract Documents and state product and system limitations, which may be detrimental to successful performance of the completed work or system.
3. Each package shall be submitted at one (1) time for each review and include components from applicable disciplines (e.g., electrical work, architectural finishes, door hardware, etc.) which are required to produce an accurate and detailed depiction of the project.
4. Manufacturer's information used for submittal shall have pages with items for approval tagged, items on pages shall be identified, and capacities and performance parameters for review shall be clearly marked through use of an arrow or highlighting. Provide space for Contracting Officer's Representative and Contractor review stamps.
5. Technical Data Drawings shall be in the latest version of AutoCAD®, drawn accurately, and in accordance with VA CAD Standards. FREEHAND SKETCHES OR COPIED VERSIONS OF THE CONSTRUCTION DOCUMENTS WILL NOT BE ACCEPTED. The Contractor shall not reproduce Contract Documents or copy standard information as the basis of the Technical Data Drawings. If departures from the technical data drawings are subsequently deemed necessary by the Contractor, details of such departures and the reasons thereof shall be submitted in writing to the Contracting Officer's Representative for approval before the initiation of work.
6. Packaging: The Contractor shall organize the submissions according to the following packaging requirements.
   a. Binders: For each manual, provide heavy duty, commercial quality, durable three (3) ring vinyl covered loose leaf binders, sized to receive 8.5 x 11 in paper, and appropriate capacity to accommodate the contents. Provide a clear plastic sleeve on the spine to hold labels describing the contents. Provide pockets in the covers to receive folded sheets.
      1) Where two (2) or more binders are necessary to accommodate data, correlate data in each binder into related groupings according to the Project Manual table of contents. Cross-referencing other binders where necessary to provide essential

information for communication of proper operation and or maintenance of the component or system.

2) Identify each binder on the front and spine with printed binder title, Project title or name, and subject matter covered. Indicate the volume number if applicable.

b. Dividers: Provide heavy paper dividers with celluloid tabs for each Section. Mark each tab to indicate contents.

c. Protective Plastic Jackets: Provide protective transparent plastic jackets designed to enclose diagnostic software for computerized electronic equipment.

d. Text Material: Where written material is required as part of the manual use the manufacturer's standard printed material, or if not available, specially prepared data, neatly typewritten on 8.5 inches by 11 inches 20 pound white bond paper.

e. Drawings: Where drawings and/or diagrams are required as part of the manual, provide reinforced punched binder tabs on the drawings and bind them with the text.

1) Where oversized drawings are necessary, fold the drawings to the same size as the text pages and use as a foldout.

2) If drawings are too large to be used practically as a foldout, place the drawing, neatly folded, in the front or rear pocket of the binder. Insert a type written page indicating the drawing title, description of contents and drawing location at the appropriate location of the manual.

3) Drawings shall be sized to ensure details and text is of legible size. Text shall be no less than 1/16” tall.

f. Manual Content: In each manual include information specified in the individual Specification section, and the following information for each major component of building equipment and controls:

1) General system or equipment description.

2) Design factors and assumptions.

3) Copies of applicable Shop Drawings and Product Data.

4) System or equipment identification including: manufacturer, model and serial numbers of each component, operating instructions, emergency instructions, wiring diagrams,

inspection and test procedures, maintenance procedures and schedules, precautions against improper use and maintenance, repair instructions, sources of required maintenance materials and related services, and a manual index.

g. Binder Organization: Organize each manual into separate sections for each piece of related equipment. At a minimum, each manual shall contain a title page, table of contents, copies of Product Data supplemented by drawings and written text, and copies of each warranty, bond, certifications, and service Contract issued. Refer to Group I through V Technical Data Package Submittal requirements for required section content.

h. Title Page: Provide a title page as the first sheet of each manual to include the following information; project name and address, subject matter covered by the manual, name and address of the Project, date of the submittal, name, address, and telephone number of the Contractor, and cross references to related systems in other operating and/or maintenance manuals.

i. Table of Contents: After the title page, include a type written table of contents for each volume, arranged systematically according to the Project Manual format. Provide a list of each product included, identified by product name or other appropriate identifying symbols and indexed to the content of the volume. Where more than one (1) volume is required to hold data for a particular system, provide a comprehensive table of contents for all volumes in each volume of the set.

j. General Information Section: Provide a general information section immediately following the table of contents, listing each product included in the manual, identified by product name. Under each product, list the name, address, and telephone number of the installer and maintenance Contractor. In addition, list a local source for replacement parts and equipment.

k. Drawings: Provide specially prepared drawings where necessary to supplement the manufacturers printed data to illustrate the relationship between components of equipment or systems, or provide control or flow diagrams. Coordinate these drawings with

information contained in Project Record Drawings to assure correct illustration of the completed installation.

l. Manufacturer's Data: Where manufacturer's standard printed data is included in the manuals, include only those sheets that are pertinent to the part or product installed. Mark each sheet to identify each part or product included in the installation. Where more than one (1) item in tabular format is included, identify each item, using appropriate references from the Contract Documents. Identify data that is applicable to the installation and delete references to information which is not applicable.

m. Where manufacturer's standard printed data is not available and the information is necessary for proper operation and maintenance of equipment or systems, or it is necessary to provide additional information to supplement the data included in the manual, prepare written text to provide the necessary information. Organize the text in a consistent format under a separate heading for different procedures. Where necessary, provide a logical sequence of instruction for each operating or maintenance procedure. Where similar or more than one product is listed on the submittal the Contractor shall differentiate by highlighting the specific product to be utilized.

n. Calculations: Provide a section for circuit and panel calculations.

o. Loading Sheets: Provide a section for DGP Loading Sheets.

p. Certifications: Provide section for Contractor's manufacturer certifications.

7. Contractor Review: Review submittals prior to transmittal. Determine and verify field measurements and field construction criteria. Verify manufacturer's catalog numbers and conformance of submittal with requirements of contract documents. Return non-conforming or incomplete submittals with requirements of the work and contract documents. Apply Contractor's stamp with signature certifying the review and verification of products occurred, and the field dimensions, adjacent construction, and coordination of

information is in accordance with the requirements of the contract documents.

8. Resubmission: Revise and resubmit submittals as required within 15 calendar days of return of submittal. Make resubmissions under procedures specified for initial submittals. Identify all changes made since previous submittal.
9. Product Data: Within 15 calendar days after execution of the contract, the Contractor shall submit for approval a complete list of all of major products proposed for use. The data shall include name of manufacturer, trade name, model number, the associated contract document section number, paragraph number, and the referenced standards for each listed product.

J. Group 1 Technical Data Package: Group I Technical Data Package shall be one submittal consisting of the following content and organization. Refer to VA Special Conditions Document for drawing format and content requirements. The data package shall include the following:

1. Section I – Drawings:
   a. General – Drawings shall conform to VA Special Conditions and CAD Standards Documents. All text associated with security details shall be 1/8” tall and meet VA text standard for AutoCAD™ drawings.
   b. Cover Sheet – Cover sheet shall consist of Project Title and Address, Project Number, Area and Vicinity Maps.
   c. General Information Sheets – General Information Sheets shall consist of General Notes, Abbreviations, Symbols, Wire and Cable Schedule, Project Phasing, and Sheet Index.
   d. Floor Plans – Floor plans shall be produced from the Architectural backgrounds issued in the Construction Documents. The contractor shall receive floor plans from the prime A/E to develop these drawing sets. Security devices shall be placed on drawings in scale. All text associated with security details shall be 1/8” tall and meet VA text standard for AutoCAD™ drawings. Floor plans shall identify the following:
      1) security devices by symbol,
      2) the associated device point number (derived from the loading sheets),

3) wire & cable types and counts
4) conduit sizing and routing
5) conduit riser systems
6) device and area detail call outs

e. Architectural details – Architectural details shall be produced for each device mounting type (door details for doors with physical access control, reader pedestals and mounts, security panel and power supply details).

f. Riser Diagrams – Contractor shall provide a riser diagram indicating riser architecture and distribution of the physical access control system throughout the facility (or area in scope).

g. Block Diagrams – Contractor shall provide a block diagram for the entire system architecture and interconnections with SMS subsystems. Block diagram shall identify SMS subsystem (e.g., physical access control, intrusion detection, closed circuit television, intercom, and other associated subsystems) integration; and data transmission and media conversion methodologies.

h. Interconnection Diagrams – Contractor shall provide interconnection diagram for each sensor, and device component. Interconnection diagram shall identify termination locations, standard wire detail to include termination schedule. Diagram shall also identify interfaces to other systems such as elevator control, fire alarm systems, and security management systems.

i. Security Details:
   1) Panel Assembly Detail – For each panel assembly, a panel assembly details shall be provided identifying individual panel component size and content.
   2) Panel Details – Provide security panel details identify general arrangement of the security system components, backboard size, wire through size and location, and power circuit requirements.
   3) Device Mounting Details – Provide mounting detailed drawing for each security device (physical access control system) for each type of wall and ceiling configuration in project.

Device details shall include device, mounting detail, wiring and conduit routing.

4) Details of connections to power supplies and grounding
5) Details of surge protection device installation
6) Sensor detection patterns – Each system sensor shall have associated detection patterns.

j. Electrical Panel Schedule – Electrical Panel Details shall be provided for all SMS systems electrical power circuits. Panel details shall be provided identifying panel type (Standard, Emergency Power, Emergency/Uninterrupted Power Source, and Uninterrupted Power Source Only), panel location, circuit number, and circuit amperage rating.

k. Door Schedule – A door schedule shall be developed for each door equipped with electronic security components. At a minimum, the door schedule shall be coordinated with Division 08 work and include the following information:

1) Item Number
2) Door Number (Derived from A/E Drawings)
3) Floor Plan Sheet Number
4) Standard Detail Number
5) Door Description (Derived from Loading Sheets)
6) Data Gathering Panel Input Number
7) Door Position or Monitoring Device Type & Model Number
8) Lock Type, Model Number & Power Input/Draw (standby/active)
9) Card Reader Type & Model Number
10) Shunting Device Type & Model Number
11) Sounder Type & Model Number
12) Manufacturer
13) Misc. devices as required
    a) Electric Transfer Hinge
    b) Electric Pass-through device
14) Remarks column indicating special notes or door configurations

3. Section II – Data Gathering Panel Documentation Package

a. Contractor shall provide Data Gathering Panel (DGP) input and output documentation packages for review at the Shop Drawing submittal stage and also with the as-built documentation package.

The documentation packages shall be provided in both printed and magnetic form at both review stages.

b. The Contractor shall provide loading sheet documentation package for the associated DGP, including input and output boards for all field panels associated with the project. Documentation shall be provided in current version Microsoft Excel spreadsheets following the format currently utilized by VA. A separate spreadsheet file shall be generated for each DGP and associated field panels.

c. The spreadsheet names shall follow a sequence that shall display the spreadsheets in numerical order according to the DGP system number. The spreadsheet shall include the prefix in the file name that uniquely identifies the project site. The spreadsheet shall detail all connected items such as card readers, alarm inputs, and relay output connections. The spreadsheet shall include an individual section (row) for each panel input, output and card reader. The spreadsheet shall automatically calculate the system numbers for card readers, inputs, and outputs based upon data entered in initialization fields.

d. All entries must be verified against the field devices. Copies of the floor plans shall be forwarded under separate cover.

e. The DGP spreadsheet shall include an entry section for the following information:

1) DGP number
2) First Reader Number
3) First Monitor Point Number
4) First Relay Number
5) DGP, input or output Location
6) DGP Chain Number
7) DGP Cabinet Tamper Input Number
8) DGP Power Fail Input Number
9) Number of Monitor Points Reserved For Expansion Boards
10) Number of Control Points (Relays) Reserved For Expansion Boards

f. The DGP, input module and output module spreadsheets shall automatically calculate the following information based upon the associated entries in the above fields:
   1) System Numbers for Card Readers
   2) System Numbers for Monitor Point Inputs
   3) System Numbers for Control Points (Relays)
   4) Next DGP or input module First Monitor Point Number
   5) Next DGP or output module First Control Point Number

g. The DGP spreadsheet shall provide the following information for each card reader:
   1) DGP Reader Number
   2) System Reader Number
   3) Cable ID Number
   4) Description Field (Room Number)
   5) Description Field (Device Type i.e.: In Reader, Out Reader, etc.)
   6) Description Field
   7) DGP Input Location
   8) Date Test
   9) Date Passed
   10) Cable Type
   11) Camera Numbers (of cameras viewing the reader location)

h. The DGP and input module spreadsheet shall provide the following information for each monitor point (alarm input).
   1) DGP Monitor Point Input Number
   2) System Monitor Point Number
   3) Cable ID Number
   4) Description Field (Room Number)
   5) Description Field (Device Type i.e.: Door Contact, etc.)
   6) DGP or input module Input Location
   7) Date Test
   8) Date Passed
   9) Cable Type

i. The DGP and output module spreadsheet shall provide the following information for each control point (output relay).
   1) DGP Control Point (Relay) Number

2) System (Control Point) Number
3) Cable ID Number
4) Description Field (Room Number)
5) Description Field (Device: Lock Control, Local Sounder, etc.)
6) Description Field
7) DGP or OUTPUT MODULE Output Location
8) Date Test
9) Date Passed Cable Type

j. The DGP, input module and output module spreadsheet shall include the following information or directions in the header and footer:
1) Header
a) DGP Input and Output Worksheet
b) Enter Beginning Reader, Input, and Output Starting Numbers and Sheet Will Automatically Calculate the Remaining System Numbers.
2) Footer
a) File Name
b) Date Printed
c) Page Number

4. Section IV – Manufacturers' Data: The data package shall include manufacturers' data for all materials and equipment, including sensors, local processors and console equipment provided under this specification.
5. Section VI – Certifications & References: All specified manufacturer's certifications shall be included with the data package. Contractor shall provide Project references as outlined in Paragraph 1.4 "Quality Assurance".

K. Group II Technical Data Package
1. The Contractor shall prepare a report of "Current Site Conditions" and submit a report to the Contracting Officer's Representative documenting changes to the site, particularly those conditions that affect performance of the system to be installed. The Contractor shall provide specification sheets, or written functional requirements to support the findings, and a cost estimate to correct those site changes or conditions which affect the installation of

the system or its performance. The Contractor shall not correct any deficiency without written permission from the COR.

2. System Configuration and Functionality: The contractor shall provide the results of the meeting with VA to develop system requirements and functionality including but not limited to:
   a. Baseline configuration
   b. Access levels
   c. Schedules (physical access control, holidays, etc.)
   e. System monitoring and reporting (unit level and central control)
   f. Naming conventions and descriptors

L. Group III Technical Data Package
   1. Development of Test Procedures: The Contractor will prepare performance test procedures for the system testing. The test procedures shall follow the format of the VA Testing procedures and be customized to the contract requirements. The Contractor will deliver the test procedures to the Contracting Officer's Representative for approval at least 60 calendar days prior to the requested test date.

M. Group IV Technical Data Package
   1. Performance Verification Test
      a. Based on the successful completion of the pre-delivery test, the Contractor shall finalize the test procedures and report forms for the performance verification test (PVT) and the endurance test. The PVT shall follow the format, layout and content of the pre-delivery test. The Contractor shall deliver the PVT and endurance test procedures to the Contracting Officer's Representative for approval. The Contractor may schedule the PVT after receiving written approval of the test procedures. The Contractor shall deliver the final PVT and endurance test reports within 14 calendar days from completion of the tests. Refer to Part 3 of this section for System Testing and Acceptance requirements.
   3. System Configuration and Data Entry:
      a. The Contractor is responsible for compiling the card access database for the VA employees, including programming reader

configurations, access shifts, schedules, exceptions, card classes and card enrollment databases.

b. Refer to Part 3 for system programming requirements and planning guidelines.

4. Graphics: Based on CAD as-built drawings developed for the construction project, create all map sets showing locations of all alarms and field devices. Graphical maps of all alarm points installed under this contract including perimeter and exterior alarm points shall be delivered with the system. The Contractor shall create and install all graphics needed to make the system operational. The Contractor shall utilize data from the contract documents, Contractor's field surveys, and all other pertinent information in the Contractor's possession to complete the graphics. The Contractor shall identify and request from the COR, any additional data needed to provide a complete graphics package. Graphics shall have sufficient level of detail for the system operator to assess the alarm. The Contractor shall supply hard copy, color examples at least 203.2 x 254 mm (8 x 10 in) of each type of graphic to be used for the completed Security system. The graphics examples shall be delivered to the Contracting Officer's Representative for review and approval at least 90 calendar days prior to the scheduled date the Contractor requires them.

N. Group V Technical Data Package: Final copies of the manuals shall be delivered to the Contracting Officer's Representative as part of the acceptance test. The draft copy used during site testing shall be updated with any changes required prior to final delivery of the manuals. Each manual's contents shall be identified on the cover. The manual shall include names, addresses, and telephone numbers of each sub-contractor installing equipment or systems, as well as the nearest service representatives for each item of equipment for each system. The manuals shall include a table of contents and tab sheets. Tab sheets shall be placed at the beginning of each chapter or section and at the beginning of each appendix. The final copies delivered after completion of the endurance test shall include all modifications made during installation, checkout, and acceptance. Six (6) hard-copies and

one (1) soft copy on CD of each item listed below shall be delivered as a part of final systems acceptance.

1. Functional Design Manual: The functional design manual shall identify the operational requirements for the entire system and explain the theory of operation, design philosophy, and specific functions. A description of hardware and software functions, interfaces, and requirements shall be included for all system operating modes. Manufacturer developed literature may be used; however, shall be produced to match the project requirements.
2. Equipment Manual: A manual describing all equipment furnished including:
   a. General description and specifications; installation and checkout procedures; equipment electrical schematics and layout drawings; system schematics and layout drawings; alignment and calibration procedures; manufacturer's repair list indicating sources of supply; and interface definition.
3. Software Manual: The software manual shall describe the functions of all software and include all other information necessary to enable proper loading, testing, and operation. The manual shall include:
   a. Definition of terms and functions; use of system and applications software; procedures for system initialization, start-up, and shutdown; alarm reports; reports generation, database format and data entry requirements; directory of all disk files; and description of all communications protocols including data formats, command characters, and a sample of each type of data transfer.
4. Operator's Manual: The operator's manual shall fully explain all procedures and instructions for the operation of the system, including:
   a. Computers and peripherals; system start-up and shutdown procedures; use of system, command, and applications software; recovery and restart procedures; graphic alarm presentation; use of report generator and generation of reports; data entry; operator commands' alarm messages, and printing formats; and system access requirements.

5. Maintenance Manual: The maintenance manual shall include descriptions of maintenance for all equipment including inspection, recommend schedules, periodic preventive maintenance, fault diagnosis, and repair or replacement of defective components.
6. Spare Parts & Components Data: At the conclusion of the Contractor's work, the Contractor shall submit to the Contracting Officer's Representative a complete list of the manufacturer's recommended spare parts and components required to satisfactorily maintain and service the systems, as well as unit pricing for those parts and components.
7. Operation, Maintenance & Service Manuals: The Contractor shall provide two (2) complete sets of operating and maintenance manuals in the form of an instructional manual for use by the VA Security Guard Force personnel. The manuals shall be organized into suitable sets of manageable size. Where possible, assemble instructions for similar equipment into a single binder. If multiple volumes are required, each volume shall be fully indexed and coordinated.
8. Equipment and Systems Maintenance Manual: The Contractor shall provide the following descriptive information for each piece of equipment, operating system, and electronic system:
   a. Equipment and/or system function.
   b. Operating characteristics.
   c. Limiting conditions.
   d. Performance curves.
   e. Engineering data and test.
   f. Complete nomenclature and number of replacement parts.
   g. Provide operating and maintenance instructions including assembly drawings and diagrams required for maintenance and a list of items recommended to stock as spare parts.
   h. Provide information detailing essential maintenance procedures including the following: routine operations, trouble shooting guide, disassembly, repair and re-assembly, alignment, adjusting, and checking.
   i. Provide information on equipment and system operating procedures, including the following; start-up procedures, routine and normal operating instructions, regulation and control procedures,

instructions on stopping, shut-down and emergency instructions, required sequences for electric and electronic systems, and special operating instructions.

j. Manufacturer equipment and systems maintenance manuals are permissible.

9. Project Redlines: During construction, the Contractor shall maintain an up-to-date set of construction redlines detailing current location and configuration of the project components. The redline documents shall be marked with the words 'Master Redlines' on the cover sheet and be maintained by the Contractor in the project office. The Contractor will provide access to redline documents anytime during the project for review and inspection by the Contracting Officer's Representative or authorized Office of Protection Services representative. Master redlines shall be neatly maintained throughout the project and secured under lock and key in the contractor's onsite project office. Any project component or assembly that is not installed in strict accordance with the drawings shall be so noted on the drawings. Prior to producing Record Construction Documents, the contractor will submit the Master Redline document to the Contracting Officer's Representative for review and approval of all changes or modifications to the documents. Each sheet shall have Contracting Officer's Representative initials indicating authorization to produce "As Built" documents. Field drawings shall be used for data gathering & field changes. These changes shall be made to the master redline documents daily. Field drawings shall not be considered "master redlines".
10. Record Specifications: The Contractor shall maintain one (1) copy of the Project Specifications, including addenda and modifications issued, for Project Record Documents. The Contractor shall mark the Specifications to indicate the actual installation where the installation varies substantially from that indicated in the Contract Specifications and modifications issued. (Note related Project Record Drawing information where applicable). The Contractor shall pay particular attention to substitutions, selection of product options, and information on concealed

installations that would be difficult to identify or measure and record later. Upon completion of the mark ups, the Contractor shall submit record Specifications to the COR. As with master relines, Contractor shall maintain record specifications for Contracting Officer's Representative review and inspection at anytime.

11. Record Product Data: The Contractor shall maintain one (1) copy of each Product Data submittal for Project Record Document purposes. The Data shall be marked to indicate the actual product installed where the installation varies substantially from that indicated in the Product Data submitted. Significant changes in the product delivered to the site and changes in manufacturer's instructions and recommendations for installation shall be included. Particular attention will be given to information on concealed products and installations that cannot be readily identified or recorded later. Note related Change Orders and mark up of Record Construction Documents, where applicable. Upon completion of mark up, submit a complete set of Record Product Data to the COR.
12. Miscellaneous Records: The Contractor shall maintain one (1) copy of miscellaneous records for Project Record Document purposes. Refer to other Specifications for miscellaneous record-keeping requirements and submittals concerning various construction activities. Before substantial completion, complete miscellaneous records and place in good order, properly identified and bound or filed, ready for use and reference. Categories of requirements resulting in miscellaneous records include, a minimum of the following:
    a. Certificates received instead of labels on bulk products.
    b. Testing and qualification of tradesmen. ("Contractor's Qualifications")
    c. Documented qualification of installation firms.
    d. Load and performance testing.
    e. Inspections and certifications.
    f. Final inspection and correction procedures.
    g. Project schedule
13. Record Construction Documents (Record As-Built)

a. Upon project completion, the contractor shall submit the project master redlines to the Contracting Officer's Representative prior to development of Record construction documents. The Contracting Officer's Representative shall be given a minimum of a thirty (30) day review period to determine the adequacy of the master redlines. If the master redlines are found suitable by the Contracting Officer's Representative, the Contracting Officer's Representative will initial and date each sheet and turn redlines over to the contractor for as built development.

b. The Contractor shall provide the Contracting Officer's Representative a complete set of "as-built" drawings and original master redlined marked "as-built" blue-line in the latest version of AutoCAD drawings unlocked on CD or DVD. The as-built drawing shall include security device number, security closet connection location, data gathering panel number, and input or output number as applicable. All corrective notations made by the Contractor shall be legible when submitted to the COR. If, in the opinion of the COR, any redlined notation is not legible, it shall be returned to the Contractor for re-submission at no extra cost to the Owner. The Contractor shall organize the Record Drawing sheets into manageable sets bound with durable paper cover sheets with suitable titles, dates, and other identifications printed on the cover. The submitted as built shall be in editable formats and the ownership of the drawings shall be fully relinquished to the owner.

c. Where feasible, the individual or entity that obtained record data, whether the individual or entity is the installer, sub-contractor, or similar entity, is required to prepare the mark up on Record Drawings. Accurately record the information in a comprehensive drawing technique. Record the data when possible after it has been obtained. For concealed installations, record and check the mark up before concealment. At the time of substantial completion, submit the Record Construction Documents to the COR. The Contractor shall organize into bound and labeled sets for the COR's continued usage. Provide device, conduit, and cable lengths on the conduit drawings. Exact in-field conduit

placement/routings shall be shown. All conduits shall be illustrated in their entire length from termination in security closets; no arrowed conduit runs shall be shown. Pull box and junction box sizes are to be shown if larger than 100mm (4 inch).

O. FIPS 201 Compliance Certificates

1. Provide Certificates for all software components and device types utilizing credential verification. Provide certificates for:
   a. Card Readers
   b. PIV Middelware
   c. Template Matcher
   d. Electromagnetically Opaque Sleeve
   e. Certificate Management
      1) CAK Authentication System
      2) PIV Authentication System
      3) Certificate Validator
      4) Cryptographic Module

P. Approvals will be based on complete submission of manuals together with shop drawings.

Q. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 28 08 00 COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.

1.5 APPLICABLE PUBLICATIONS

A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American National Standards Institute (ANSI)/ Security Industry Association (SIA):

AC-03.....Access Control: Access Control Guideline Dye Sublimation Printing Practices for PVC Access Control Cards

C. American National Standards Institute (ANSI)/ International Code Council (ICC):

A117.1.....Standard on Accessible and Usable Buildings and Facilities

D. Department of Justice American Disability Act (ADA)

28 CFR Part 36.....ADA Standards for Accessible Design 2010

E. Department of Veterans Affairs (VA):

PACS-R: Physical Access Control System (PACS) Requirements

VA Handbook 0730 Security and Law Enforcement

F. Government Accountability Office (GAO):

GAO-03-8-02 Security Responsibilities for Federally Owned and Leased Facilities

G. National Electrical Manufactures Association (NEMA):

250-08.....Enclosures for Electrical Equipment (1000 Volts Maximum)

H. National Fire Protection Association (NFPA):

70-23..... National Electrical Code

I. Underwriters Laboratories, Inc. (UL):

294-99.....The Standard of Safety for Access Control System Units

305-08.....Standard for Panic Hardware

639-97.....Standard for Intrusion-Detection Units

752-05.....Standard for Bullet-Resisting Equipment

827-08.....Central Station Alarm Services

1076-95.....Standards for Proprietary Burglar Alarm Units and Systems

1981-03.....Central Station Automation System

2058-05.....High Security Electronic Locks

J. Homeland Security Presidential Directive (HSPD):

HSPD-12.....Policy for a Common Identification Standard for Federal Employees and Contractors

K. Federal Communications Commission (FCC):

(47 CFR 15) Part 15 Limitations on the Use of Wireless Equipment/Systems

L. Federal Information Processing Standards (FIPS):

FIPS-201-1.....Personal Identity Verification (PIV) of Federal Employees and Contractors

M. National Institute of Standards and Technology (NIST):

IR 6887 V2.1.....Government Smart Card Interoperability Specification (GSC-IS)

Special Pub 800-63.....Electronic Authentication Guideline

Special Pub 800-96.....PIV Card Reader Interoperability Guidelines

Special Pub 800-73-3....Interfaces for Personal Identity Verification (4 Parts)

.....Pt. 1- End Point PIV Card Application Namespace, Data Model & Representation

.....Pt. 2- PIV Card Application Card Command Interface

.....Pt. 3- PIV Client Application Programming Interface

.....Pt. 4- The PIV Transitional Interfaces & Data Model Specification

Special Pub 800-76-1....Biometric Data Specification for Personal Identity Verification

Special Pub 800-78-2....Cryptographic Algorithms and Key Sizes for Personal Identity Verification

Special Pub 800-79-1....Guidelines for the Accreditation of Personal Identity Verification Card Issuers

Special Pub 800-85B-1...DRAFTPIV Data Model Test Guidelines

Special Pub 800-85A-2...PIV Card Application and Middleware Interface Test Guidelines (SP 800-73-3 compliance)

Special Pub 800-96.....PIV Card Reader Interoperability Guidelines

Special Pub 800-37.....Guide for Applying the Risk Management Framework to Federal Information Systems

Special Pub 800-96.....PIV Card Reader Interoperability Guidelines

Special Pub 800-96.....PIV Card Reader Interoperability Guidelines

Special Pub 800-104A....Scheme for PIV Visual Card Topography

Special Pub 800-116.....Recommendation for the Use of PIV Credentials in Physical Access Control Systems (PACS)

N. Institute of Electrical and Electronics Engineers (IEEE):

C62.41.....IEEE Recommended Practice on Surge Voltages in Low-Voltage AC Power Circuits

O. International Organization for Standardization (ISO):

7810.....Identification cards - Physical characteristics

7811.....Physical Characteristics for Magnetic Stripe Cards

7816-1.....Identification cards - Integrated circuit(s) cards with contacts - Part 1: Physical characteristics

7816-2.....Identification cards - Integrated circuit cards - Part 2: Cards with contacts -Dimensions and location of the contacts

7816-3.....Identification cards - Integrated circuit cards - Part 3: Cards with contacts - Electrical interface and transmission protocols

7816-4.....Identification cards - Integrated circuit cards - Part 11: Personal verification through biometric methods

7816-10.....Identification cards - Integrated circuit cards - Part 4: Organization, security and commands for interchange

14443.....Identification cards - Contactless integrated circuit cards; Contactless Proximity Cards Operating at 13.56 MHz in up to 5 inches distance

15693.....Identification cards -- Contactless integrated circuit cards - Vicinity cards; Contactless Vicinity Cards Operating at 13.56 MHz in up to 50 inches distance

19794.....Information technology - Biometric data interchange formats

P. Uniform Federal Accessibility Standards (UFAS) 1984

Q. ADA Standards for Accessible Design 2010

R. Section 508 of the Rehabilitation Act of 1973

1.6 DEFINITIONS

A. ABA Track: Magnetic stripe that is encoded on track 2, at 75-bpi density in binary-coded decimal format; for example, 5-bit, 16-character set.

B. Access Control List: A list of (identifier, permissions) pairs associated with a resource or an asset. As an expression of security policy, a person may perform an operation on a resource or asset if and only if the person's identifier is present in the access control list (explicitly or implicitly), and the permissions in the (identifier, permissions) pair include the permission to perform the requested operation.

C. Access Control: A function or a system that restricts access to authorized persons only.

D. API Application Programming Interface

E. Assurance Level (or E-Authentication Assurance Level): A measure of trust or confidence in an authentication mechanism defined in OMB Memorandum M-04-04 and NIST Special Publication (SP) 800-63, in terms of four levels: [M-04-04]

1. Level 1: LITTLE OR NO confidence
2. Level 2: SOME confidence
3. Level 3: HIGH confidence
4. Level 4: VERY HIGH confidence

F. Authentication: A process that establishes the origin of information, or determines an entity's identity. In this publication, authentication often means the performance of a PIV authentication mechanism.

G. Authenticator: A memory, possession, or quality of a person that can serve as proof of identity, when presented to a verifier of the appropriate kind. For example, passwords, cryptographic keys, and fingerprints are authenticators.

H. Authorization: A process that associates permission to access a resource or asset with a person and the person's identifier(s).

I. BIO or BIO-A: A FIPS 201 authentication mechanism that is implemented by using a Fingerprint data object sent from the PIV Card to the PACS. Note that the short-hand "BIO (-A)" is used throughout the document to represent both BIO and BIO-A authentication mechanisms.

J. Biometric: An authenticator produced from measurable qualities of a living person.

K. CAC EP – CAC End Point with end point PIV applet

L. CAC NG – CAC Next Generation with transitional PIV applet

M. Card Authentication Key (CAK): A PIV authentication mechanism (or the PIV Card key of the same name) that is implemented by an asymmetric or symmetric key challenge/response protocol. The CAK is an optional mechanism defined in NIST SP 800-73. SP800-73 NIST strongly recommends that every PIV Card contain an asymmetric CAK and corresponding certificate, and that agencies use the asymmetric CAK protocol, rather than a symmetric CAK protocol, whenever the CAK authentication mechanism is used with PACS.

N. P: Closed-circuit television.

O. Central Station: A PC with software designated as the main controlling PC of the PACS. Where this term is presented with initial capital letters, this definition applies.

P. Controller: An intelligent peripheral control unit that uses a computer for controlling its operation. Where this term is presented with an initial capital letter, this definition applies.

Q. CPU: Central processing unit.

R. Credential: Data assigned to an entity and used to identify that entity.

S. File Server: A PC in a network that stores the programs and data files shared by users.

T. FIPS Federal Information Processing Standards

U. FRAC – First Responder Authentication Credential

V. HSPD Homeland Security Presidential Directive

W. I/O: Input/Output.

X. Identifier: A credential card, keypad personal identification number or code, biometric characteristic, or other unique identification entered as data into the entry-control database for the purpose of identifying an individual. Where this term is presented with an initial capital letter, this definition applies.

Y. IEC International Electrotechnical Commission

Z. ISO International Organization for Standardization

AA. KB Kilobyte

BB. kbit/s Kilobits / second

CC. LAN: Local area network.

DD. LED: Light-emitting diode.

EE. Legacy CAC – Contact only Common Access Card with v1 and v2 applets

FF. Location: A Location on the network having a PC-to-Controller communications link, with additional Controllers at the Location connected to the PC-to-Controller link with RS-485 communications loop. Where this term is presented with an initial capital letter, this definition applies.

GG. NIST: National Institute of Standards and Technology

HH. PACS: Physical Access Control System

II. PC/SC: Personal Computer / Smart Card

JJ. PC: Personal computer. This acronym applies to the Central Station, workstations, and file servers.

KK. PCI Bus: Peripheral component interconnect; a peripheral bus providing a high-speed data path between the CPU and peripheral devices (such as monitor, disk drive, or network).

LL. PDF: (Portable Document Format.) The file format used by the Acrobat document exchange system software from Adobe.

MM. PIV: Personal Identification Verification

NN. PIV-I – PIV Interoperable credential

OO. PPS: Protocol and Parameters Selection

PP. RF: Radio frequency.

QQ. ROM: Read-only memory. ROM data are maintained through losses of power.

RR. RS-232: An TIA/EIA standard for asynchronous serial data communications between terminal devices. This standard defines a 25-pin connector and certain signal characteristics for interfacing computer equipment.

SS. RS-485: An TIA/EIA standard for multipoint communications.

TT. TCP/IP: Transport control protocol/Internet protocol incorporated into Microsoft Windows.

UU. TPDU: Transport Protocol Data Unit

VV. TWIC – Transportation Worker Identification Credential

WW. UPS: Uninterruptible power supply.

XX. Vcc: Voltage at the Common Collector

YY. WAN: Wide area network.

ZZ. WAV: The digital audio format used in Microsoft Windows.

AAA. Wiegand: Patented magnetic principle that uses specially treated wires embedded in the credential card.

BBB. Windows: Operating system by Microsoft Corporation.

CCC. Workstation: A PC with software that is configured for specific limited security system functions.

1.7 COORDINATION

A. Coordinate arrangement, mounting, and support of electronic safety and security equipment:

1. To allow maximum possible headroom unless specific mounting heights that reduce headroom are indicated.
2. To provide for ease of disconnecting the equipment with minimum interference to other installations.
3. To allow right of way for piping and conduit installed at required slope.
4. So connecting raceways, cables, wireways, cable trays, and busways will be clear of obstructions and of the working and access space of other equipment.

B. Coordinate installation of required supporting devices and set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.

C. Coordinate location of access panels and doors for electronic safety and security items that are behind finished surfaces or otherwise concealed.

1.8 MAINTENANCE & SERVICE

A. General Requirements

1. The Contractor shall provide all services required and equipment necessary to maintain the entire integrated electronic security system in an operational state as specified for a period of one (1) year after formal written acceptance of the system. The Contractor shall provide all necessary material required for performing scheduled adjustments or other non-scheduled work. Impacts on facility operations shall be minimized when performing scheduled adjustments or other non-scheduled work. See also General Project Requirements.

B. Description of Work

1. The adjustment and repair of the security system includes all software updates, panel firmware, and the following new items computers equipment, communications transmission equipment and data transmission media (DTM), local processors, security system sensors, physical access control equipment, facility interface, signal transmission equipment, and video equipment.

C. Personnel

1. Service personnel shall be certified in the maintenance and repair of the selected type of equipment and qualified to accomplish all work promptly and satisfactorily. The Contracting Officer's Representative shall be advised in writing of the name of the designated service representative, and of any change in personnel. The Contracting Officer's Representative shall be provided copies of system manufacturer certification for the designated service representative.

D. Schedule of Work

1. The work shall be performed during regular working ours, Monday through Friday, excluding federal holidays. These inspections shall include:
   a) The Contractor shall perform two (2) minor inspections at six (6) month intervals or more if required by the manufacturer, and two (2) major inspections offset equally between the minor inspections to effect quarterly inspection of alternating magnitude.
      1) Minor Inspections shall include visual checks and operational tests of all console equipment, peripheral equipment, local processors, sensors, electrical and mechanical controls, and adjustments on printers.
      2) Major Inspections shall include all work described for Minor Inspections and the following: clean all system equipment and local processors including interior and exterior surfaces; perform diagnostics on all equipment; operational tests of the CPU, switcher, peripheral equipment, recording devices, monitors, picture quality from each camera; check, walk test, and calibrate each sensor; run all system software diagnostics

and correct all problems; and resolve any previous outstanding problems.

E. Emergency Service

1. The owner shall initiate service calls whenever the system is not functioning properly. The Contractor shall provide the Owner with an emergency service center telephone number. The emergency service center shall be staffed 24 hours a day 365 days a year. The Owner shall have sole authority for determining catastrophic and non-catastrophic system failures within parameters stated in General Project Requirements.
   a. For catastrophic system failures, the Contractor shall provide same day four (4) hour service response with a defect correction time not to exceed eight (8) hours from [notification] [arrival on site]. Catastrophic system failures are defined as any system failure that the Owner determines will place the facility(s) at increased risk.
   b. For non-catastrophic failures, the Contractor within eight (8) hours with a defect correction time not to exceed 24 hours from notification.

F. Operation

1. Performance of scheduled adjustments and repair shall verify operation of the system as demonstrated by the applicable portions of the performance verification test.

G. Records & Logs

1. The Contractor shall maintain records and logs of each task and organize cumulative records for each component and for the complete system chronologically. A continuous log shall be submitted for all devices. The log shall contain all initial settings, calibration, repair, and programming data. Complete logs shall be maintained and available for inspection on site, demonstrating planned and systematic adjustments and repairs have been accomplished for the system.

H. Work Request

1. The Contractor shall separately record each service call request, as received. The record shall include the serial number identifying the component involved, its location, date and time the call was

received, specific nature of trouble, names of service personnel assigned to the task, instructions describing the action taken, the amount and nature of the materials used, and the date and time of commencement and completion. The Contractor shall deliver a record of the work performed within five (5) working days after the work was completed.

I. System Modifications

1. The Contractor shall make any recommendations for system modification in writing to the COR. No system modifications, including operating parameters and control settings, shall be made without prior written approval from the COR. Any modifications made to the system shall be incorporated into the operation and maintenance manuals and other documentation affected.

J. Software

1. The Contractor shall provide all software updates when approved by the Owner from the manufacturer during the installation and 12-month warranty period and verify operation of the system. These updates shall be accomplished in a timely manner, fully coordinated with the system operators, and incorporated into the operations and maintenance manuals and software documentation. There shall be at least one (1) scheduled update near the end of the first year's warranty period, at which time the Contractor shall install and validate the latest released version of the Manufacturer's software. All software changes shall be recorded in a log maintained in the unit control room. An electronic copy of the software update shall be maintained within the log. At a minimum, the contractor shall provide a description of the modification, when the modification occurred, and name and contact information of the individual performing the modification. The log shall be maintained in a white 3 ring binder and the cover marked "SOFTWARE CHANGE LOG".

1.9 PERFORMANCE REQUIREMENTS

A. PACS shall provide support for multiple authentication modes and bidirectional communication with the reader. PACS shall provide implementation capability for enterprise security policy and incident response.

B. All processing of authentication information must occur on the "safe side" of a door

C. Physical Access Control System shall provide access to following Security Areas:
   1. Controlled
   2. Limited
   3. Exclusion

D. PACS shall provide:
   1. One authentication factor for access to Controlled security areas
   2. Two authentication factors for access to Limited security areas
   3. Three authentication factors for access to Exclusion security areas

E. PACS shall provide Credential Validation and Path Validation per NIST 800-116.

F. The PACS System shall have an Enterprise Path Validation Module (PVM) component that processes X.509 certification paths composed of X.509 v3 certificates and X.509 v2 CRLs. The PVM component MUST support the following features:
   1. Name chaining;
   2. Signature chaining;
   3. Certificate validity;
   4. Key usage, basic constraints, and certificate policies certificate extensions;
   5. Full CRLs; and
   6. CRLs segmented on names.

G. Distributed Processing: System shall be a fully distributed processing system so that information, including time, date, valid codes, access levels, and similar data, is downloaded to Controllers so that each Controller makes access-control decisions for that Location. Do not use intermediate Controllers for physical access control. If communications to Central Station are lost, all Controllers shall automatically buffer event transactions until communications are restored, at which time buffered events shall be uploaded to the Central Station.

H. Number of Locations: Support unlimited number of separate Locations using a single PC with combinations of direct-connect, dial-up, or TCP/IP LAN connections to each Location.

1. Each Location shall have its own database and history in the Central Station. Locations may be combined to share a common database.

I. Data Capacity:

1. 130 different card-reader formats.
2. 999 comments.
3. 16 graphic file types for importing maps.

J. Location Capacity:

1. 128 reader-controlled doors.
2. 50,000 total access credentials.
3. 2048 supervised alarm inputs.
4. 2048 programmable outputs.
5. 32,000 custom action messages per Location to instruct operator on action required when alarm is received.

K. System Network Requirements:

1. Interconnect system components and provide automatic communication of status changes, commands, field-initiated interrupts, and other communications required for proper system operation.
2. Communication shall not require operator initiation or response, and shall return to normal after partial or total network interruption such as power loss or transient upset.
3. System shall automatically annunciate communication failures to the operator and identify the communication link that has experienced a partial or total failure.
4. Communications Controller may be used as an interface between the Central Station display systems and the field device network. Communications Controller shall provide functions required to attain the specified network communications performance.

L. Central Station shall provide operator interface, interaction, display, control, and dynamic and real-time monitoring. Central Station shall control system networks to interconnect all system components, including workstations and field-installed Controllers.

M. Field equipment shall include Controllers, sensors, and controls. Controllers shall serve as an interface between the Central Station and sensors and controls. Data exchange between the Central Station and the Controllers shall include down-line transmission of commands, software, and databases to Controllers. The up-line data exchange from

the Controller to the Central Station shall include status data such as intrusion alarms, status reports, and entry-control records. Controllers are classified as alarm-annunciation or entry-control type.

N. System Response to Alarms: Field device network shall provide a system end-to-end response time of 1 second(s) or less for every device connected to the system. Alarms shall be annunciated at the Central Station within 1 second of the alarm occurring at a Controller or device controlled by a local Controller, and within 100 ms if the alarm occurs at the Central Station. Alarm and status changes shall be displayed within 100 ms after receipt of data by the Central Station. All graphics shall be displayed, including graphics-generated map displays, on the console monitor within 5 seconds of alarm receipt at the security console.[This response time shall be maintained during system heavy load.]

O. False Alarm Reduction: The design of Central Station and Controllers shall contain features to reduce false alarms. Equipment and software shall comply with SIA CP-01.

P. Error Detection: A cyclic code error detection method shall be used between Controllers and the Central Station, which shall detect single- and double-bit errors, burst errors of eight bits or less, and at least 99 percent of all other multibit and burst error conditions. Interactive or product error detection codes alone will not be acceptable. A message shall be in error if one bit is received incorrectly. System shall retransmit messages with detected errors. A two-digit decimal number shall be operator assignable to each communication link representing the number of retransmission attempts. When the number of consecutive retransmission attempts equals the assigned quantity, the Central Station shall print a communication failure alarm message. System shall monitor the frequency of data transmission failure for display and logging.

Q. Data Line Supervision: System shall initiate an alarm in response to opening, closing, shorting, or grounding of data transmission lines.

R. Door Hardware Interface: Coordinate with Division 08 Sections that specify door hardware required to be monitored or controlled by the PACS. The Controllers in this Section shall have electrical characteristics that match the signal and power requirements of door

hardware. Integrate door hardware specified in Division 08 Sections to function with the controls and PC-based software and hardware in this Section.

S. References to industry and trade association standards and codes are minimum installation requirement standards.

T. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.

1.10 EQUIPMENT AND MATERIALS

A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.

B. When more than one unit of the same class of equipment is required, such units shall be the product of a single manufacturer.

C. Equipment Assemblies and Components:

1. Components of an assembled unit need not be products of the same manufacturer.
2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
3. Components shall be compatible with each other and with the total assembly for the intended service.
4. Constituent parts which are similar shall be the product of a single manufacturer.

D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.

E. When Factory Testing Is Specified:

1. The Government shall have the option of witnessing factory tests. The contractor shall notify the VA through the Contracting Officer's Representative a minimum of 15 working days prior to the manufacturers making the factory tests.
2. Four copies of certified test reports containing all test data shall be furnished to the Contracting Officer's Representative prior to final inspection and not more than 90 days after completion of the tests.

3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the Government.

1.11 WARRANTY OF CONSTRUCTION.

A. Warrant PACS work subject to the Article "Warranty of Construction" of FAR clause 52.246-21.

B. Demonstration and training shall be performed prior to system acceptance.

1.12 GENERAL REQUIREMENTS

A. For general requirements that are common to more than one section in Division 28 refer to Section 28 05 00, REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS.

B. General requirements applicable to this section include:

1. General Arrangement Of Contract Documents,
2. Delivery, Handling and Storage,
3. Project Conditions,
4. Electrical Power,
5. Lightning, Power Surge Suppression, and Grounding,
6. Electronic Components,
7. Substitute Materials and Equipment, and
8. Like Items.

PART 2 - PRODUCTS

2.1 GENERAL

A. All equipment and materials for the system will be compatible to ensure correct operation as outlined in FIPS 201, March 2006 and HSPD-12.

B. The security system characteristics listed in this section will serve as a guide in selection of equipment and materials for the PACS. If updated or more suitable versions are available then the Contracting Officer will approve the acceptance of prior to an installation.

C. PACS equipment shall meet or exceed all requirements listed below.

D. A PACS shall be comprised of, but not limited to, the following components:

1. Physical Access Control System
2. Application Software
3. System Database
4. Surge and Tamper Protection

5. Controllers (Data Gathering Panel)
6. Secondary Alarm Annunciator
7. Card Readers
8. System Sensors and Related Equipment
9. Push Button Switches
10. Interfaces
11. Door Hardware interface
12. RS-232 ASCII Interface
13. Floor Select Elevator Control
14. Cables
15. Transformers

2.2 SECURITY MANAGEMENT SYSTEM (SMS) (NOT USED)

2.3 APPLICATION SOFTWARE

A. Controller Software:

1. Controllers shall operate as an autonomous intelligent processing unit. Controllers shall make decisions about physical access control, alarm monitoring, linking functions, and door locking schedules for its operation, independent of other system components. Controllers shall be part of a fully distributed processing control network. The portion of the database associated with a Controller and consisting of parameters, constraints, and the latest value or status of points connected to that Controller, shall be maintained in the Controller.
2. Functions: The following functions shall be fully implemented and operational within each Controller:
   a. Monitoring inputs.
   b. Controlling outputs.
   c. Automatically reporting alarms to the Central Station.
   d. Reporting of sensor and output status to Central Station on request.
   e. Maintaining real time, automatically updated by the Central Station at least once a day.
   f. Communicating with the Central Station.
   g. Executing Controller resident programs.
   h. Diagnosing.
   i. Downloading and uploading data to and from the Central Station.

3. Controller Operations at a Location:
   a. Location: Up to 64 Controllers connected to RS-485 communications loop. Globally operating I/O linking and anti-passback functions between Controllers within the same Location without central-station or workstation intervention. Linking and anti-passback shall remain fully functional within the same Location even when the Central Station or workstations are off line.
   b. In the event of communications failure between the Central Station and a Location, there shall be no degradation in operations at the Controllers at that Location. The Controllers at each Location shall be connected to a memory buffer with a capacity to store up to 10,000 events; there shall be no loss of transactions in system history files until the buffer overflows.
   c. Buffered events shall be handled in a first-in-first-out mode of operation.
4. Individual Controller Operation:
   a. Controllers shall transmit alarms, status changes, and other data to the Central Station when communications circuits are operable. If communications are not available, Controllers shall function in a stand-alone mode and operational data, including the status and alarm data normally transmitted to the Central Station, shall be stored for later transmission to the Central Station. Storage capacity for the latest 1024 events shall be provided at each Controller.
   b. Card-reader ports of a Controller shall be custom configurable for at least 120 different card-reader or keypad formats. Multiple reader or keypad formats may be used simultaneously at different Controllers or within the same Controller.
   c. Controllers shall provide a response to card-readers or keypad entries in less than 0.25 seconds, regardless of system size.
   d. Controllers that are reset, or powered up from a nonpowered state, shall automatically request a parameter download and reboot to its proper working state. This shall happen without any operator intervention.

e. Initial Startup: When Controllers are brought on-line, database parameters shall be automatically downloaded to them. After initial download is completed, only database changes shall be downloaded to each Controller.

f. Failure Mode: On failure for any reason, Controllers shall perform an orderly shutdown and force Controller outputs to a predetermined failure mode state, consistent with the failure modes shown and the associated control device.

g. Startup After Power Failure: After power is restored, startup software shall initiate self-test diagnostic routines, after which Controllers shall resume normal operation.

h. Startup After Controller Failure: On failure, if the database and application software are no longer resident, Controllers shall not restart, but shall remain in the failure mode until repaired. If database and application programs are resident, Controllers shall immediately resume operation. If not, software shall be restored automatically from the Central Station.

5. Communications Monitoring:

a. System shall monitor and report status of RS-485 communications loop [TCP/IP communication status] of each Location.

b. Communication status window shall display which Controllers are currently communicating, a total count of missed polls since midnight, and which Controller last missed a poll.

c. Communication status window shall show the type of CPU, the type of I/O board, and the amount of RAM memory for each Controller.

6. Operating systems shall include a real-time clock function that maintains seconds, minutes, hours, day, date, and month. The real-time clock shall be automatically synchronized with the Central Station at least once a day to plus or minus 10 seconds. The time synchronization shall be automatic, without operator action and without requiring system shutdown.

B. PC-to-Controller Communications:

1. Central-station or workstation communications shall use the following:

a. Direct connection using serial ports of the PC.

b. TCP/IP LAN network interface cards.

c. Dial-up modems for connections to Locations.

2. Serial Port Configuration: Each serial port used for communications shall be individually configurable for "direct communications," "modem communications incoming and outgoing," or "modem communications incoming only"; or as an ASCII output port.
3. Multiport Communications Board: Use if more than two serial ports are needed.
   a. Expandable and modular design. Use a 4-, 8-, or 16-serial port configuration that is expandable to 32 or 64 serial ports.
   b. Connect the first board to an internal PCI bus adapter card.
4. Direct serial, TCP/IP, and dial-up communications shall be alike in the monitoring or control of system, except for the connection that must first be made to a dial-up Location.
5. TCP/IP network interface card shall have an option to set the poll frequency and message response time-out settings.
6. PC-to-Controller and Controller-to-Controller communications (direct, dial-up, or TCP/IP) shall use a polled-communication protocol that checks sum and acknowledges each message. All communications shall be verified and buffered and retransmitted if not acknowledged.

C. Direct Serial or TCP/IP PC-to-Controller Communications:
1. Communication software on the PC shall supervise the PC-to-Controller communications link.
2. Loss of communications to any Controller shall result in an alarm at all PCs running the communications software.
3. When communications are restored, all buffered events shall automatically upload to the PC, and any database changes shall be automatically sent to the Controller.

D. Database Downloads:
1. All data transmissions from PCs to a Location, and between Controllers at a Location, shall include a complete database checksum to check the integrity of the transmission. If the data checksum does not match, a full data download shall be automatically retransmitted.
2. If a Controller is reset for any reason, it shall automatically request and receive a database download from the PC. The download

shall restore data stored at the Controller to their normal working state and shall take place with no operator intervention.

E. Operator Interface:

1. Inputs in system shall have two icon representations, one for the normal state and one for the abnormal state.
2. When viewing and controlling inputs, displayed icons shall automatically change to the proper icon to display the current system state in real time. Icons shall also display the input's state, whether armed or bypassed, and if the input is in the armed or bypassed state due to a time zone or a manual command.
3. Outputs in system shall have two icon representations, one for the secure (locked) state and one for the open (unlocked) state.
4. Icons displaying status of the I/O points shall be constantly updated to show their current real-time condition without prompting by the operator.
5. The operator shall be able to scroll the list of I/Os and press the appropriate toolbar button, or right click, to command the system to perform the desired function.
6. Graphic maps or drawings containing inputs, outputs, and override groups shall include the following:
   a. Database to import and store full-color maps or drawings and allow for input, output, and override group icons to be placed on maps.
   b. Maps to provide real-time display animation and allow for control of points assigned to them.
   c. System to allow inputs, outputs, and override groups to be placed on different maps.
   d. Software to allow changing the order or priority in which maps will be displayed.
7. Override Groups Containing I/Os:
   a. System shall incorporate override groups that provide the operator with the status and control over user-defined "sets" of I/Os with a single icon.
   b. Icon shall change automatically to show the live summary status of points in that group.

c. Override group icon shall provide a method to manually control or set to time zone points in the group.

d. Override group icon shall allow the expanding of the group to show icons representing the live status for each point in the group, individual control over each point, and the ability to compress the individual icons back into one summary icon.

8. Schedule Overrides of I/Os and Override Groups:

a. To accommodate temporary schedule changes that do not fall within the holiday parameters, the operator shall have the ability to override schedules individually for each input, output, or override group.

b. Each schedule shall be composed of a minimum of two dates with separate times for each date.

c. The first time and date shall be assigned the override state that the point shall advance to, when the time and date become current.

d. The second time and date shall be assigned the state that the point shall return to, when the time and date become current.

9. Copy command in database shall allow for like data to be copied and then edited for specific requirements, to reduce redundant data entry.

F. Operator Access Control:

1. Control operator access to system controls through three password-protected operator levels. System operators and managers with appropriate password clearances shall be able to change operator levels for operators.

2. Three successive attempts by an operator to execute functions beyond their defined level during a 24-hour period shall initiate a software tamper alarm.

3. A minimum of 32 passwords shall be available with the system software. System shall display the operator's name or initials in the console's first field. System shall print the operator's name or initials, action, date, and time on the system printer at login and logoff.

4. The password shall not be displayed or printed.

5. Each password shall be definable and assignable for the following:

a. Commands usable.
b. Access to system software.
c. Access to application software.
d. Individual zones that are to be accessed.
e. Access to database.

G. Operator Commands:
1. Command Input: Plain-language words and acronyms shall allow operators to use the system without extensive training or data-processing backgrounds. System prompts shall be a word, a phrase, or an acronym.
2. Command inputs shall be acknowledged and processing shall start in not less than 1 second(s).
3. Tasks that are executed by operator's commands shall include the following:
a. Acknowledge Alarms: Used to acknowledge that the operator has observed the alarm message.
b. Place Zone in Access: Used to remotely disable intrusion alarm circuits emanating from a specific zone. System shall be structured so that console operator cannot disable tamper circuits.
c. Place Zone in Secure: Used to remotely activate intrusion alarm circuits emanating from a specific zone.
d. System Test: Allows the operator to initiate a system-wide operational test.
e. Zone Test: Allows the operator to initiate an operational test for a specific zone.
f. Print reports.
g. Change Operator: Used for changing operators.
h. Security Lighting Controls: Allows the operator to remotely turn on/off security lights.
i. Display Graphics: Used to display any graphic displays implemented in the system. Graphic displays shall be completed within 20 seconds from time of operator command.
j. Run system tests.
k. Generate and format reports.
l. Request help with the system operation.

1) Include in main menus.
2) Provide unique, descriptive, context-sensitive help for selections and functions with the press of one function key.
3) Provide navigation to specific topic from within the first help window.
4) Help shall be accessible outside the applications program.

m. Entry-Control Commands:

1) Lock (secure) or unlock (open) each controlled entry and exit up to four times a day through time-zone programming.
2) Arm or disarm each monitored input up to four times a day through time-zone programming.
3) Enable or disable readers or keypads up to twice a day through time-zone programming.
4) Enable or disable cards or codes up to four times per day per entry point through access-level programming.

4. Command Input Errors: Show operator input assistance when a command cannot be executed because of operator input errors. Assistance screen shall use plain-language words and phrases to explain why the command cannot be executed. Error responses that require an operator to look up a code in a manual or other document are not acceptable. Conditions causing operator assistance messages include the following:

a. Command entered is incorrect or incomplete.
b. Operator is restricted from using that command.
c. Command addresses a point that is disabled or out of service.
d. Command addresses a point that does not exist.
e. Command is outside the system's capacity.

H. Alarms:

1. System Setup:

a. Assign manual and automatic responses to incoming point status change or alarms.
b. Automatically respond to input with a link to other inputs, outputs, operator-response plans, unique sound with use of WAV files, and maps or images that graphically represent the point location.
c. 60-character message field for each alarm.

d. Operator-response-action messages shall allow message length of at least 65,000 characters, with database storage capacity of up to 32,000 messages. Setup shall assign messages to access point zone sensor.

e. Secondary messages shall be assignable by the operator for printing to provide further information and shall be editable by the operator.

f. Allow 25 secondary messages with a field of 4 lines of 60 characters each.

g. Store the most recent 1000 alarms for recall by the operator using the report generator.

2. Software Tamper:

a. Annunciate a tamper alarm when unauthorized changes to system database files are attempted. Three consecutive unsuccessful attempts to log onto system shall generate a software tamper alarm.

b. Annunciate a software tamper alarm when an operator or other individual makes three consecutive unsuccessful attempts to invoke functions beyond their authorization level.

c. Maintain a transcript file of the last 5000 commands entered at the each Central Station to serve as an audit trail. System shall not allow write access to system transcript files by any person, regardless of their authorization level.

d. Allow only acknowledgment of software tamper alarms.

3. Read access to system transcript files shall be reserved for operators with the highest password authorization level available in system.

4. Animated Response Graphics: Highlight alarms with flashing icons on graphic maps; display and constantly update the current status of alarm inputs and outputs in real time through animated icons.

5. Multimedia Alarm Annunciation: WAV files to be associated with alarm events for audio annunciation or instructions.

6. Alarm Handling: Each input may be configured so that an alarm cannot be cleared unless it has returned to normal, with options of requiring the operator to enter a comment about disposition of

alarm. Allow operator to silence alarm sound when alarm is acknowledged.

7. Alarm Automation Interface: High-level interface to Central Station alarm automation software systems. Allows input alarms to be passed to and handled by automation systems in same manner as burglar alarms, using an RS-232 ASCII interface.

I. Alarm Monitoring: Monitor sensors, Controllers, and DTS circuits and notify operators of an alarm condition. Display higher-priority alarms first and, within alarm priorities, display the oldest unacknowledged alarm first. Operator acknowledgment of one alarm shall not be considered acknowledgment of other alarms nor shall it inhibit reporting of subsequent alarms.

1. Displayed alarm data shall include type of alarm, location of alarm, and secondary alarm messages.
2. Printed alarm data shall include type of alarm, location of alarm, date and time (to nearest second) of occurrence, and operator responses.
3. Maps shall automatically display the alarm condition for each input assigned to that map, if that option is selected for that input location.
4. Alarms initiate a status of "pending" and require the following two handling steps by operators:
   a. First Operator Step: "Acknowledged." This action shall silence sounds associated with the alarm. The alarm remains in the system "Acknowledged" but "Un-Resolved."
   b. Second Operator Step: Operators enter the resolution or operator comment, giving the disposition of the alarm event. The alarm shall then clear.
5. Each workstation shall display the total pending alarms and total unresolved alarms.
6. Each alarm point shall be programmable to disallow the resolution of alarms until the alarm point has returned to its normal state.
7. Alarms shall transmit to Central Station in real time, except for allowing connection time for dial-up locations.
8. Alarms shall be displayed and managed from a minimum of four different windows.

a. Input Status Window: Overlay status icon with a large red blinking icon. Selecting the icon will acknowledge the alarm.
b. History Log Transaction Window: Display name, time, and date in red text. Selecting red text will acknowledge the alarm.
c. Alarm Log Transaction Window: Display name, time, and date in red. Selecting red text will acknowledge the alarm.
d. Graphic Map Display: Display a steady colored icon representing each alarm input location. Change icon to flashing red when the alarm occurs. Change icon from flashing red to steady red when the alarm is acknowledged.

9. Once an alarm is acknowledged, the operator shall be prompted to enter comments about the nature of the alarm and actions taken. Operator's comments may be manually entered or selected from a programmed predefined list, or a combination of both.
10. For locations where there are regular alarm occurrences, provide programmed comments. Selecting that comment shall clear the alarm.
11. The time and name of the operator who acknowledged and resolved the alarm shall be recorded in the database.
12. Identical alarms from same alarm point shall be acknowledged at same time the operator acknowledges the first alarm. Identical alarms shall be resolved when the first alarm is resolved.
13. Alarm functions shall have priority over downloading, retrieving, and updating database from workstations and Controllers.
14. When a reader-controlled output (relay) is opened, the corresponding alarm point shall be automatically bypassed.

J. System test software enables operators to initiate a test of the entire system or of a particular portion of the system.
1. Test Report: The results of each test shall be stored for future display or printout. The report shall document the operational status of system components.

K. Report Generator Software: Include commands to generate reports for displaying, printing, and storing on disk and tape. Reports shall be stored by type, date, and time. Report printing shall be the lowest priority activity. Report generation mode shall be operator selectable but set up initially as periodic, automatic, or on request. Include

time and date printed and the name of operator generating the report. Report formats may be configured by operators.

1. Automatic Printing: Setup shall specify, modify, or inhibit the report to be generated; the time the initial report is to be generated; the time interval between reports; the end of period; and the default printer.
2. Printing on Requests: An operator may request a printout of any report.
3. Alarm Reports: Reporting shall be automatic as initially set up. Include alarms recorded by system over the selected time and information about the type of alarm [(such as door alarm, intrusion alarm, tamper alarm, etc.)] <Insert alarm types>, the type of sensor, the location, the time, and the action taken.
4. Access and Secure Reports: Document zones placed in access, the time placed in access, and the time placed in secure mode.
5. Custom Reports: Reports tailored to exact requirements of who, what, when, and where. As an option, custom report formats may be stored for future printing.
6. Automatic History Reports: Named, saved, and scheduled for automatic generation.
7. Cardholder Reports: Include data, or selected parts of the data, as well as the ability to be sorted by name, card number, imprinted number, or by any of the user-defined fields.
8. Cardholder by Reader Reports: Based on who has access to a specific reader or group of readers by selecting the readers from a list.
9. Cardholder by Access-Level Reports: Display everyone that has been assigned to the specified access level.
10. Who Is In (Muster) Report:
    a. Emergency Muster Report: One click operation on toolbar launches report.
    b. Cardholder Report. Contain a count of persons that are "In" at a selected Location and a count with detailed listing of name, date, and time of last use, sorted by the last reader used or by the group assignment.
11. Panel Labels Reports: Printout of control-panel field documentation including the actual location of equipment, programming parameters,

and wiring identification. Maintain system installation data within system database so that they are available on-site at all times.

12. Activity and Alarm On-Line Printing: Activity printers for use at workstations; prints all events or alarms only.
13. History Reports: Custom reports that allows the operator to select any date, time, event type, device, output, input, operator, Location, name, or cardholder to be included or excluded from the report.
    a. Initially store history on the hard disk of the host PC.
    b. Permit viewing of the history on workstations or print history to any system printer.
    c. The report shall be definable by a range of dates and times with the ability to have a daily start and stop time over a given date range.
    d. Each report shall depict the date, time, event type, event description, device, or I/O name, cardholder group assignment, and cardholder name or code number.
    e. Each line of a printed report shall be numbered to ensure that the integrity of the report has not been compromised.
    f. Total number of lines of the report shall be given at the end of the report. If the report is run for a single event such as "Alarms," the total shall reflect how many alarms occurred during that period.
14. Reports shall have the following four options:
    a. View on screen.
    b. Print to system printer. Include automatic print spooling and "Print To" options if more than one printer is connected to system.
    c. "Save to File" with full path statement.
    d. System shall have the ability to produce a report indicating status of system inputs and outputs or of inputs and outputs that are abnormal, out of time zone, manually overridden, not reporting, or in alarm.
15. Custom Code List Subroutine: Allow the access codes of system to be sorted and printed according to the following criteria:
    a. Active, inactive, or future activate or deactivate.

b. Code number, name, or imprinted card number.

c. Group, Location, access levels.

d. Start and stop code range.

e. Codes that have not been used since a selectable number of days.

f. In, out, or either status.

g. Codes with trace designation.

16. The reports of system database shall allow options so that every data field may be printed.
17. The reports of system database shall be constructed so that the actual position of the printed data shall closely match the position of the data on the data-entry windows.

L. Anti-Passback:

1. System shall have global and local anti-passback features, selectable by Location. System shall support hard and soft anti-passback.
2. Hard Anti-Passback: Once a credential holder is granted access through a reader with one type of designation (IN or OUT), the credential holder may not pass through that type of reader designation until the credential holder passes though a reader of opposite designation.
3. Soft Anti-Passback: Should a violation of the proper IN or OUT sequence occur, access shall be granted, but a unique alarm shall be transmitted to the control station, reporting the credential holder and the door involved in the violation. A separate report may be run on this event.
4. Timed Anti-Passback: A Controller capability that prevents an access code from being used twice at the same device (door) within a user-defined amount of time.
5. Provide four separate zones per Location that can operate without requiring interaction with the host PC (done at Controller). Each reader shall be assignable to one or all four anti-passback zones. In addition, each anti-passback reader can be further designated as "Hard," "Soft," or "Timed" in each of the four anti-passback zones. The four anti-passback zones shall operate independently.
6. The anti-passback schemes shall be definable for each individual door.

7. The Master Access Level shall override anti-passback.
8. System shall have the ability to forgive (or reset) an individual credential holder or the entire credential holder population anti-passback status to a neutral status.

M. Visitor Assignment:

1. Provide for and allow an operator to be restricted to only working with visitors. The visitor badging subsystem shall assign credentials and enroll visitors. Allow only access levels that have been designated as approved for visitors.
2. Provide an automated log of visitor name, time and doors accessed, and whom visitor contacted.
3. Allow a visitor designation to be assigned to a credential holder.
4. PACS shall be able to restrict the access levels that may be assigned to credentials that are issued to visitors.
5. Allow operator to recall visitors' credential holder file, once a visitor is enrolled in the system.
6. The operator may designate any reader as one that deactivates the credential after use at that reader. The history log shall show the return of the credential.
7. System shall have the ability to use the visitor designation in searches and reports. Reports shall be able to print all or any visitor activity.

N. Time and Attendance:

1. Time and attendance reporting shall be provided to match IN and OUT reads and display cumulative time in for each day and cumulative time in for length of the report.
2. Shall be provided to match IN and OUT reads and display cumulative time in for each day and cumulative time in for length of the report.
3. System software setup shall allow designation of selected access-control readers as time and attendance hardware to gather the clock-in and clock-out times of the users at these readers.
   a. Reports shall show in and out times for each day, total in time for each day, and a total in time for period specified by the user.

b. Allow the operator to view and print the reports, or save the report to a file.

c. Alphabetically sort reports on the person's last name, by Location or location group. Include all credential holders or optionally select individual credential holders for the report.

O. Training Software: Enables operators to practice system operation including alarm acknowledgment, alarm assessment, response force deployment, and response force communications. System shall continue normal operation during training exercises and shall terminate exercises when an alarm signal is received at the console.

P. System Redundancy & High Availability: The system shall provide multiple levels of communications redundancy and failover for all PACS hosted controllers, digital video recorders, and client workstations. The PACS shall be capable of automatically re-routing communications to alternate computers across the system without operator intervention.

1. PACS system configuration with a single application/ database server shall provide at a minimum the following redundancy and failover capability:

a. The PACS shall provide communications redundancy and failover for network-attached devices. Each network attached device shall have one or more alternative communication sever(s) that can provide hosting in case of primary communications server failure.

b. In case of primary communications server failure, the system shall automatically re-route network-attached devices to their designated backup communications servers to allow continuous system operations without loss of alarm and event transaction processing during failover.

c. Network-attached devices which transition to backup communications servers, shall be able to be redirected back to their default primary servers, once the primary communications servers have been restored.

2. PACS system configuration with multiple regional application/ database servers shall provide at a minimum the following redundancy and failover capability:

a) The PACS shall support the same level of communications redundancy and failover for network-attached devices per regional

application/database server, allowable to span across regional application/database servers in the event of a regional application/database server failure.

b) In case of a regional application/database server failure, client workstations shall be able to failover to their designated backup regional application/database server to allow continuous system operations.

c) In case of a regional application/database server failure, upon server restoration, the ISMS shall automatically update and synchronize the regional application/database server.

d) Client workstations which transition to a backup regional application/database server, shall be able to be redirected back to their default regional application/database server, once the regional application/database server functions have been restored.

2.4 SURGE AND TAMPER PROTECTION

A. Refer to 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY

B. Surge Protection: Protect components from voltage surges originating external to equipment housing and entering through power, communication, signal, control, or sensing leads. Include surge protection for external wiring of each conductor-entry connection to components.

1. Minimum Protection for Power Connections 120 V and More: Auxiliary panel suppressors complying with requirements in Division 26 Section "Transient-Voltage Suppression for Low-Voltage Electrical Power Circuits."
2. Minimum Protection for Communication, Signal, Control, and Low-Voltage Power Connections: Comply with requirements in Division 26 Section "Transient-Voltage Suppression for Low-Voltage Electrical Power Circuits" as recommended by manufacturer for type of line being protected.

C. Tamper Protection: Tamper switches on enclosures, control units, pull boxes, junction boxes, cabinets, and other system components shall initiate a tamper-alarm signal when unit is opened or partially

disassembled. Control-station control-unit alarm display shall identify tamper alarms and indicate locations.

2.5 PACS SERVER HARDWARE (NOT USED)

2.6 STANDARD WORKSTATION HARDWARE (NOT USED)

2.7 COMMUNICATIONS WORKSTATION (NOT USED)

2.8 CONTROLLERS

A. Controllers: Intelligent peripheral control unit, complying with UL 294, that stores time, date, valid codes, access levels, and similar data downloaded from the Central Station or workstation for controlling its operation.

B. Subject to compliance with requirements in this Article, manufacturers may use multipurpose Controllers.

C. Battery Backup: Sealed, lead acid; sized to provide run time during a power outage of 90 minutes, complying with UL 924.

D. Alarm Annunciation Controller:

1. The Controller shall automatically restore communication within 10 seconds after an interruption with the field device network with dc line supervision on each of its alarm inputs.
   a. Inputs: Monitor dry contacts for changes of state that reflect alarm conditions. Provides at least eight alarm inputs, which are suitable for wiring as normally open or normally closed contacts for alarm conditions.
   b. Alarm-Line Supervision:
      1) Supervise the alarm lines by monitoring each circuit for changes or disturbances in the signal, and for conditions as described in UL 1076 for line security equipment by monitoring for abnormal open, grounded, or shorted conditions using dc change measurements. System shall initiate an alarm in response to an abnormal current, which is a dc change of 5 percent or more for longer than 500 ms.
      2) Transmit alarm-line-supervision alarm to the Central Station during the next interrogation cycle after the abnormal current condition.
   c. Outputs: Managed by Central Station software.
2. Auxiliary Equipment Power: A GFI service outlet inside the Controller enclosure.

E. Entry-Control Controller:

1. Function: Provide local entry-control functions including one- and two-way communications with access-control devices such as card readers, keypads, door strikes, and door operators.
   a. Operate as a stand-alone portal Controller using the downloaded database during periods of communication loss between the Controller and the field-device network.
   b. Accept information generated by the entry-control devices; automatically process this information to determine valid identification of the individual present at the portal:
      1) On authentication of the credentials or information presented, check privileges of the identified individual, allowing only those actions granted as privileges.
      2) Privileges shall include, but not be limited to, time of day control, day of week control, group control, and visitor escort control.
   c. Maintain a date-, time-, and Location-stamped record of each transaction. A transaction is defined as any successful or unsuccessful attempt to gain access through a controlled portal by the presentation of credentials or other identifying information.
2. Inputs:
   a. Data from entry-control devices; use this input to change modes between access and secure.
   b. Database downloads and updates from the Central Station that include enrollment and privilege information.
3. Outputs:
   a. Indicate success or failure of attempts to use entry-control devices and make comparisons of presented information with stored identification information.
   b. Grant or deny entry by sending control signals to portal-control devices[and mask intrusion alarm annunciation from sensors stimulated by authorized entries].
   c. Maintain a date-, time-, and Location-stamped record of each transaction and transmit transaction records to the Central Station.

d. Door Prop Alarm: If a portal is held open for longer than [20 seconds] [time listed in a schedule], alarm sounds.

4. With power supplies sufficient to power at voltage and frequency required for field devices and portal-control devices.
5. Data Line Problems: For periods of loss of communications with Central Station, or when data transmission is degraded and generating continuous checksum errors, the Controller shall continue to control entry by accepting identifying information, making authentication decisions, checking privileges, and controlling portal-control devices.
   a. Store up to 1000 transactions during periods of communication loss between the Controller and access-control devices for subsequent upload to the Central Station on restoration of communication.
6. Controller Power: NFPA 70, Class II power supply transformer, with 12- or 24-V ac secondary, backup battery and charger.
   a. Backup Battery: Premium, valve-regulated, recombinant-sealed, lead-calcium battery; spill proof; with a full 1-year warranty and a pro rata 19-year warranty. With single-stage, constant-voltage-current, limited battery charger, comply with battery manufacturer's written instructions for battery terminal voltage and charging current recommendations for maximum battery life.
   b. Backup Battery: Valve-regulated, recombinant-sealed, lead-acid battery; spill proof. With single-stage, constant-voltage-current, limited battery charger, comply with battery manufacturer's written instructions for battery terminal voltage and charging current recommendations for maximum battery life.
   c. Backup Power Supply Capacity: 90 minutes of battery supply. Submit battery and charger calculations.
   d. Power Monitoring: Provide manual dynamic battery load test, initiated and monitored at the control center; with automatic disconnection of the Controller when battery voltage drops below Controller limits. Report by using local Controller-mounted LEDs and by communicating status to Central Station. Indicate normal power on and battery charger on trickle charge. Indicate and report the following:

1) Trouble Alarm: Normal power off load assumed by battery.
2) Trouble Alarm: Low battery.
3) Alarm: Power off.

2.9 PIV MIDDLEWARE (NOT USED)

2.10 CARD READERS

A. Power: Card reader shall be powered from its associated Controller, including its standby power source.

B. Response Time: Card reader shall respond to passage requests by generating a signal that is sent to the Controller. Response time shall be 800ms or less, from the time the card reader finishes reading the credential card until a response signal is generated.

C. Enclosure: Suitable for surface, semiflush, or pedestal mounting. Mounting types shall additionally be suitable for installation in the following locations:
   1. Indoors, controlled environment.
   2. Indoors, uncontrolled environment.

D. Display: LED or other type of visual indicator display shall provide visual and audible status indications and user prompts. Indicate power on/off, whether user passage requests have been accepted or rejected, and whether the door is locked or unlocked.

E. Shall be utilized for controlling the locking hardware on a door and allows for reporting back to the main control panel with the time/date the door was accessed, the name of the person accessing the point of entry, and its location.

F. Will be fully programmable and addressable, locally and remotely, and hardwired to the system.

G. Shall be individually home run to the main panel.

H. Shall be installed in a manner that they comply with:
   1. The Uniform Federal Accessibility Standards (UFAS)
   2. The Americans with Disabilities Act (ADA)
   3. The ADA Standards for Accessible Design

I. Shall support a variety of card readers that must encompass a wide functional range. The PACS may combine any of the card readers described below for installations requiring multiple types of card reader capability (i.e., card only, supervised inputs, etc.). These card readers shall be available in the approved technology to meet FIPS

201, and is ISO 14443 A or B, ISO/IEC 7816 compliant. The reader output can be Wiegand, RS-22, 485 or TCP/IP.

J. Shall be housed in an aluminum bezel with a wide lead-in for easy card entry.

K. Shall contain read head electronics, and a sender to encode digital door control signals.

L. LED's shall be utilized to indicate card reader status and access status.

M. Shall be able to support a user defined downloadable off-line mode of operation (e.g. locked, unlocked), which will go in effect during loss of communication with the main control panel.

N. Shall provide audible feedback to indicate access granted/denied decisions. Upon a card swipe, two audible tones or beeps shall indicate access granted and three tones or beeps shall indicate access denied. All keypad buttons shall provide tactile audible feedback.

O. Shall have a minimum of two programmable inputs and two programmable outputs.

P. All card readers that utilize keypad controls along with a reader and shall meet the following specifications:

1. Entry control keypads shall use a unique combination of alphanumeric and other symbols as an identifier. Keypads shall contain an integral alphanumeric/special symbols keyboard with symbols arranged in ascending ASCII code ordinal sequence. Communications protocol shall be compatible with the local processor.

Q. Shall include a Light Emitting Diode (LED) or other type of visual indicator display and provide visual or visual and audible status indications and user prompts. The display shall indicate power on/off, and whether user passage requests have been accepted or rejected. The design of the keypad display or keypad enclosure shall limit the maximum horizontal and vertical viewing angles of the keypad. The maximum horizontal viewing angle shall be plus and minus five (5) degrees or less off a vertical plane perpendicular to the plane of the face of the keypad display. The maximum vertical viewing angle shall be plus and minus 15 degrees or less off a horizontal plane perpendicular to the plane of the face of the keypad display.

1. Shall respond to passage requests by generating a signal to the local processor. The response time shall be 800 milliseconds or less from the time the last alphanumeric symbol is entered until a response signal is generated.
2. Shall be powered from the source as designed and shall not dissipate more than 150 Watts.
3. Shall be suitable for surface, semi-flush, pedestal, or weatherproof mounting as required.
4. Shall provide a means for users to indicate a duress situation by entering a special code.

R. PIV Contact Card Reader

1. Application Protocol Data Unit (APDU) Support: At a minimum, the contact interface shall support all card commands for contact based access specified in Section 7, End-point PIV Card Application Card Command Interface of SP 800-73-1, Interfaces for Personal Identity Verification.
2. Buffer Size: The reader must contain a buffer large enough to receive the maximum size frame permitted by International Organization for Standardization International Electrotechnical Commission (ISO/IEC) 7816-3:1997, Section 9.4.
3. Programming Voltage: PIV Readers shall not generate a Programming Voltage.
4. Support for Operating Class: PIV Readers shall support cards with Class A Vccs as defined in ISO/IEC 7816-3:1997 and ISO/IEC 7816-3:1997/Amd 1:2002.
5. Retrieval Time: Retrieval time[1] for 12.5 kilobytes (KB) of data through the contact interface of the reader shall not exceed 2.0 seconds.
6. Transmission Protocol: The PIV Reader shall support both the character-based T=0 protocol and block-based T=1 protocol as defined in ISO/IEC 7816-3:1997.
7. Support for PPS Procedure: The reader shall support Protocol and Parameters Selection (PPS) procedure by having the ability to read

character TA1 of the Answer to Reset (ATR) sent by the card as defined in ISO/IEC 7816-3:1997.

S. Contactless Smart Cards and Readers

1. Smart card readers shall read credential cards whose characteristics of size and technology meet those defined by ISO/IEC 7816, 14443, 15693.
2. The readers shall have "flash" download capability to accommodate card format changes.
3. The card reader shall have the capability of reading the card data and transmitting the data to the main monitoring panel.
4. The card reader shall be contactless and meet or exceed the following technical characteristics:
   a. Data Output Formats: FIPS 201 low outputs the FASC-N in an assortment of Wiegand bit formats from 40 - 200 bits. FIPS 201 medium outputs a combination FASC-N and HMAC in an assortment of Wiegand bit formats from 32 - 232 bits. All Wiegand formats or the upgradeability from Low to Medium Levels can be field configured with the use of a command card.
   b. FIPS 201 readers shall be able to read, but not be limited to, DESfire and iCLASS cards.
   c. Reader range shall comply with ISO standards 7816, 14443, and 15693, and also take into consideration conditions, are at a minimum 1” to 2” (2.5 - 5 cm).
   d. APDU Support: At a minimum, the contactless interface shall support all card commands for contactless based access specified in Section 7, End-point PIV Card Application Card Command Interface of SP 800-73-1, Interfaces for Personal Identity Verification.
   e. Buffer Size: The reader shall contain a buffer large enough to receive the maximum size frame permitted by ISO/IEC 7816-3, Section 9.4.
   f. ISO 14443 Support: The PIV Reader shall support parts (1 through 4) of ISO/IEC 14443 as amended in the References of this publication.
   g. Type A and B Communication Signal Interfaces: The contactless interface of the reader shall support both the Type A and Type B

communication signal interfaces as defined in ISO/IEC 14443-2:2001.

h. Type A and B Initialization and Anti-Collision The contactless interface of the reader shall support both Type A and Type B initialization and anti-collision methods as defined in ISO/IEC 14443-3:2001.

i. Type A and B Transmission Protocols: The contactless interface of the reader shall support both Type A and Type B transmission protocols as defined in ISO/IEC 14443-4:2001.

j. Retrieval Time: Retrieval time for 4 KB of data through the contactless interface of the reader shall not exceed 2.0 seconds.

k. Transmission Speeds: The contactless interface of the reader shall support bit rates of fc/128 (~106 kbits/s), fc/64(~212 kbits/s), and configurable to allow activation/deactivation.

l. Readibility Range: The reader shall not be able to read PIV card more than 10cm(4inch) from the reader

2.11 BIOMETRIC IDENTITY VERIFICATION EQUIPMENT (NOT USED)

2.11 KEYPADS (NOT USED)

2.12 CREDENTIAL CARDS (NOT USED)

2.13 SYSTEM SENSORS AND RELATED EQUIPMENT

A. The PACS (Physical Access Control System) and related Equipment provided by the Contractor shall meet or exceed the following performer specifications:

B. Request to Exit Detectors:

1. Passive Infrared Request to Exit Motion Detector (REX PIR) (1) The Contractor shall provide a surface mounted motion detector to signal the physical access control system request to exit input. The motion detector shall be a passive infrared sensor designed for wall or ceiling mounting 2134 to 4572 mm (7 to 15 ft) height. The detector shall provide two (2) form "C" (SPDT) relays rated one (1) Amp. @ 30 VDC for DC resistive loads. The detectors relays shall be user adjustable with a latch time from 1-60 seconds. The detector shall also include a selectable relay reset mode to follow the timer or absence of motion. The detection pattern shall be adjustable plus or minus fourteen (± 14) degrees. The detector shall operate on 12 VDC with approximately 26 mA continuous current draw. The

detector shall have an externally visible activation LED. The motion detector shall measure approximately 38 mm H x 158 mm W x 38 mm D (1.5 x 6.25 x 1.5 in). The detector shall be immune to radio frequency interference. The detector shall not activate or set-up on critical frequencies in the range 26 to 950 Megahertz using a 50 watt transmitter located 30.5 cm (1 ft) from the unit or attached wiring. The detector shall be available on gray or black enclosures. The color of the housing shall be coordinated with the surrounding surface.

C. Crash Bar:

1. Emergency Exit with Alarm (Panic):
   a. Entry control portals shall include panic bar emergency exit hardware as designed.
   b. Panic bar emergency exit hardware shall provide an alarm shunt signal to the PACS and SMS.
   c. The panic bar shall include a conspicuous warning sign with one (1) inch (2.5 cm) high, red lettering notifying personnel that an alarm will be annunciated if the panic bar is operated.
   d. Operation of the panic bar hardware shall generate an intrusion alarm that reports to both the SMS and Intrusion Detection System. The use of a micro switch installed within the panic bar shall be utilized for this.
   e. The panic bar shall utilize a fully mechanical connection only and shall not depend upon electric power for operation.
   f. The panic bar shall be compatible with mortise or rim mount door hardware and shall operate by retracting the bolt manually by either pressing the panic bar or with a key by-pass. Refer to Section 2.2.I.9 for key-bypass specifications.
   g. Normal Exit:
      1) Entry control portals shall include panic bar non-emergency exit hardware as designed.
      2) Panic bar non-emergency exit hardware shall be monitored by and report to the SMS.
      3) Operation of the panic bar hardware shall not generate a locally audible or an intrusion alarm within the IDS.

4) When exiting, the panic bar shall depend upon a mechanical connection only. The exterior, non-secure side of the door shall be provided with an electrified thumb latch or lever to provide access after the credential I.D. authentication by the SMS.
5) The panic bar shall be compatible with mortise or rim mount door hardware and shall operate by retracting the bolt manually by either pressing the panic bar or with a key by-pass. Refer to Section 2.2.I.9 for key-bypass specifications. The strikes/bolts shall include a micro switch to indicate to the system when the bolt is not engaged or the strike mechanism is unlocked. The signal switches shall report a forced entry to the system in the event the door is left open or accessed without the identification credentials.

D. Key Bypass:
1. Shall be utilized for all doors that have a mortise or rim mounted door hardware.
2. Each door shall be individually keyed with one master key per secured area.
3. Cylinders shall be six (6)-pin and made of brass or equivalent. Keys for the cylinders shall be constructed of solid material and produced and cut by the same distributor. Keys shall not be purchased, cut, and supplied by multiple dealers.
4. All keys shall have a serial number cut into the key. No two serial numbers shall be the same.
5. All keys and cylinders shall be stored in a secure area that is monitored by the Intrusion Detection System.

E. Automatic Door Opener and Closer:
1. Shall be low energy operators.
2. Door closing force shall be adjustable to ensure adequate closing control.
3. Shall have an adjustable back-check feature to cushion the door opening speed if opened violently.
4. Motor assist shall be adjustable from 0 to 30 seconds in five (5) second increments. Motor assist shall restart the time cycle with each new activation of the initiating device.

5. Unit shall have a three-position selector mode switch that shall permit unit to be switched "ON" to monitor for function activation, switched to "H/O" for indefinite hold open function or switched to "OFF," which shall deactivate all control functions but will allow standard door operation by means of the internal mechanical closer.
6. Door control shall be adjustable to provide compliance with the requirements of the Americans with Disabilities Act (ADA) and ANSI standards A117.1.
7. All automatic door openers and closers shall:
   a. Meet UL standards.
   b. Be fire rated.
   c. Have push and go function to activate power operator or power assist function.
   d. Have push button controls for setting door close and door open positions.
   e. Have open obstruction detection and close obstruction detection built into the unit.
   f. Have door closer assembly with adjustable spring size, back-check valve, sweep valve, latch valve, speed control valve and pressure adjustment valve to control door closing.
   g. Have motor start-up delay, vestibule interface delay; electric lock delay and door hold open delay up to 30 seconds. All operators shall close door under full spring power when power is removed.
   h. Are to be hard wired with power input of 120 VAC, 60Hz and connected to a dedicated circuit breaker located on a power panel reserved for security equipment.

F. Door Status Indicators:
   1. Shall monitor and report door status to the SMS.
   2. Door Position Sensor:
      a. Shall provide an open or closed indication for all doors operated on the PACS and report directly to the SMS.
      b. Shall also provide alarm input to the Intrusion Detection System for all doors operated by the PACS and all other doors that require monitoring by the intrusion detection system.

c. Switches for doors operated by the PACS shall be double pole double throw (DPDT). One side of the switch shall monitor door position and the other side if the switch shall report to the intrusion detection system. For doors with electromagnetic locks a magnetic bonding sensor (MBS) can be used in place of one side of a DPDT switch, in turn allowing for the use of a single pole double throw (SPDT) switch in it place of a DPDT switch.

d. Switches for doors not operated by the PACS shall be SPDT and report directly to the IDS.

e. Shall be surface or flush mounted and wide gap with the ability to operate at a maximum distance of up to 2” (5 cm).

2.14 PUSH BUTTON SWITCHES (NOT USED)

2.15 PORTAL CONTROL DEVICES

A. Shall be used to assist the PACS.

B. Such devices shall:

1. Provide a means of monitoring the doors status.
2. Allow for exiting a space via either a push button, request to exit, or panic/crash bar.
3. Provide a means of override to the PACS via a keypad or key bypass.
4. Assist door operations utilizing automatic openers and closures.
5. Provide a secondary means of access to a space via a keypad.

C. Shall be connected to and monitored by the main PACS panel.

D. Shall be installed in a manner that they comply with:

1. The Uniform Federal Accessibility Standards (UFAS)
2. The Americans with Disabilities Act (ADA)
3. The ADA Standards for Accessible Design

E. Shall provide a secondary means of physical access control within a secure area.

F. Push-Button Switches:

1. Shall be momentary contact, back lighted push buttons, and stainless steel switch enclosures for each push button as shown. Buttons are to be utilized for secondary means of releasing a locking mechanism.
   a. In an area where a push button is being utilized for remote access of the locking device then no more than two (2) buttons shall operate one door from within one secure space. Buttons will not be wired in series with one other.

b. In an area where locally stationed guards control entry to multiple secure points via remote switches. An interface board shall be designed and constructed for only the amount of buttons it shall house. These buttons shall be flush mounted and clearly labeled for ease of use. All buttons shall be connected to the PACS and SMS system for monitoring purposes.
c. Shall have double-break silver contacts that will make 720 VA at 60 amperes and break 720 VA at 10 amperes.

G. Entry Control Devices:
1. Shall be hardwired to the PACS main control panel and operated by either a card reader or a biometric device via a relay on the main control panel.
2. Shall be fail-safe in the event of power failure to the PACS system.
3. Shall operate at 24 VCD, with the exception of turnstiles and be powered by a separate power supply dedicated to the door control system. Each power supply shall be rated to operate a minimum of two doors simultaneously without error to the system or overload the power supply unit.
4. Shall have a diode or metal-oxide veristor (MOV) to protect the controller and power supply from reverse current surges or back-check.
5. Electric Strikes/Bolts: Shall be:
a. Made of heavy-duty construction and tamper resistant design.
b. Tested to over one million cycles.
c. Rated for a minimum of 1000 lbs. holding strength.
d. Utilize an actuating solenoid for the strike/bolt. The solenoid shall move from fully open to fully closed position and back in not more than 500 milliseconds and be rated for continuous duty.
e. Utilize a signal switch that will indicate to the system if the strike/bolt is not engaged or is unlocked when it should be secured.
f. Flush mounted within the door frame.
6. Electric Mortise Locks: Shall be installed within the door and an electric transfer hinge shall be utilized to allow the wires to be transferred from the door frame to the lock. If utilized with a

double door then the lock shall be installed inside the active leaf.

Electric Mortise Locks shall:

a. These locks shall be provided and installed by the Division 8 "DOOR HARDWARE" Contractor.

b. Have integrated Request to Exit switch for new doors receiving physical access control devices.

b. Provide integration of the Electric Mortise Locks with the PACS for:

1) Lock Power

7. Electromagnetic Locks:

a. These locks shall be without mechanical linkage utilizing no moving parts, and securing the door to its frame solely on electromagnetic force.

b. Shall be comprised of two pieces, the mag-lock and the door plate. The electromagnetic locks shall be surface mounted to the door frame and the door plate shall be surface mounted to the door.

c. Ensure a diode is installed in line with the DC voltage supplying power to the unit in order to prevent back-check on the system when the electromagnetic lock is powered.

2.16 SECONDARY ALARM ANNUNCIATOR

A. Secondary Alarm Annunciation Site: A workstation with limited I/O capacity, consisting of a secondary alarm annunciation workstation [to allow the operator to duplicate functions of the main operator interface, and to show system status changes] [to display alarms or system status changes only].

2.17 INTERFACES

A. Power Supplies:

1. Shall be UL rated and able to adequately power (enter number) entry control devices on a continuous base without failure.

2. Shall meet the following minimum technical characteristics:

INPUT POWER	110 VAC 60 HZ (enter amperage)A
OUTPUT VOLTAGE	12 VDC Nominal (13.8 VDC) 24 VDC Nominal (27.6 VDC) Filtered and Regulated

BATTERY	Dependant on Output Voltage shall provide up to 8 Ah
OUTPUT CURRENT	[10] amp max. @ 13.8 VDC [5] amp max. @ 27.6 VDC
PRIMARY FUSE SIZE	6.3 amp (non-removable)
BATTERY FUSE SIZE	12 amp, 3AG
CHARGING CIRCUIT	Built-in standard

2.18 FLOOR SELECT ELEVATOR CONTROL (NOT USED)

2.19 AFTER-HOURS HVAC CONTROL (NOT USED)

2.20 REAL TIME GUARD TOUR (NOT USED)

2.21 VIDEO AND CAMERA CONTROL (NOT USED)

2.22 WIRES AND CABLES

A. Comply with Division 28 Section "CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY."

B. PVC-Jacketed, RS-232 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, polypropylene insulation, and individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage; PVC jacket. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.
   1. NFPA 70, Type CM.
   2. Flame Resistance: UL 1581 Vertical Tray.

C. Plenum-Type, RS-232 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, plastic insulation, and individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage; plastic jacket. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.
   1. NFPA 70, Type CMP.
   2. Flame Resistance: NFPA 262 Flame Test.

D. RS-485 communications require 2 twisted pairs, with a distance limitation of 4000 feet (1220 m).

E. PVC-Jacketed, RS-485 Cable: Paired, 2 pairs, twisted, No. 22 AWG, stranded (7x30) tinned copper conductors, PVC insulation, unshielded, PVC jacket, and NFPA 70, Type CMG.

F. Plenum-Type, RS-485 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, fluorinated-ethylene-propylene insulation, unshielded, and fluorinated-ethylene-propylene jacket.
   1. NFPA 70, Type CMP.
   2. Flame Resistance: NFPA 262 Flame Test.

G. Multiconductor, Readers and Wiegand Keypads Cables: No. 22 AWG, paired and twisted multiple conductors, stranded (7x30) tinned copper conductors, semirigid PVC insulation, overall aluminum foil-polyester tape shield with 100 percent shield coverage, plus tinned copper braid shield with 65 percent shield coverage, and PVC jacket.
   1. NFPA 70, Type CMG.
   2. Flame Resistance: UL 1581 Vertical Tray.
   3. For TIA/EIA-RS-232 applications.

H. Paired Readers and Wiegand Keypads Cables: Paired, 3 pairs, twisted, No. 22 AWG, stranded (7x30) tinned copper conductors, polypropylene insulation, individual aluminum foil-polyester tape shielded pairs each with No. 22 AWG, stranded tinned copper drain wire, 100 percent shield coverage, and PVC jacket.
   1. NFPA 70, Type CM.
   2. Flame Resistance: UL 1581 Vertical Tray.

I. Paired Readers and Wiegand Keypads Cable: Paired, 3 pairs, twisted, No. 20 AWG, stranded (7x28) tinned copper conductors, polyethylene (polyolefin) insulation, individual aluminum foil-polyester tape shielded pairs each with No. 22 AWG, stranded (19x34) tinned copper drain wire, 100 percent shield coverage, and PVC jacket.
   1. NFPA 70, Type CM.
   2. Flame Resistance: UL 1581 Vertical Tray.

J. Plenum-Type, Paired, Readers and Wiegand Keypads Cable: Paired, 3 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, plastic insulation, individual aluminum foil-polypropylene tape shielded pairs each with No. 22 AWG, stranded tinned copper drain wire, 100 percent shield coverage, and fluorinated-ethylene-propylene jacket.
   1. NFPA 70, Type CMP.
   2. Flame Resistance: NFPA 262 Flame Test.

K. Plenum-Type, Multiconductor, Readers and Keypads Cable: 6 conductors, No. 20 AWG, stranded (7x28) tinned copper conductors, fluorinated-

ethylene-propylene insulation, overall aluminum foil-polyester tape shield with 100 percent shield coverage plus tinned copper braid shield with 85 percent shield coverage, and fluorinated-ethylene-propylene jacket.

1. NFPA 70, Type CMP.
2. Flame Resistance: NFPA 262 Flame Test.

L. Paired Lock Cable: 1 pair, twisted, No. 16 AWG, stranded (19x29) tinned copper conductors, PVC insulation, unshielded, and PVC jacket.

1. NFPA 70, Type CMG.
2. Flame Resistance: UL 1581 Vertical Tray.

M. Plenum-Type, Paired Lock Cable: 1 pair, twisted, No. 16 AWG, stranded (19x29) tinned copper conductors, PVC insulation, unshielded, and PVC jacket.

1. NFPA 70, Type CMP.
2. Flame Resistance: NFPA 262 Flame Test.

N. Paired Lock Cable: 1 pair, twisted, No. 18 AWG, stranded (19x30) tinned copper conductors, PVC insulation, unshielded, and PVC jacket.

1. NFPA 70, Type CMG.
2. Flame Resistance: UL 1581 Vertical Tray.

O. Plenum-Type, Paired Lock Cable: 1 pair, twisted, No. 18 AWG, stranded (19x30) tinned copper conductors, fluorinated-ethylene-propylene insulation, unshielded, and plastic jacket.

1. NFPA 70, Type CMP.
2. Flame Resistance: NFPA 262 Flame Test.

P. Paired Input Cable: 1 pair, twisted, No. 22 AWG, stranded (7x30) tinned copper conductors, polypropylene insulation, overall aluminum foil-polyester tape shield with No. 22 AWG, stranded (7x30) tinned copper drain wire, 100 percent shield coverage, and PVC jacket.

1. NFPA 70, Type CMR.
2. Flame Resistance: UL 1666 Riser Flame Test.

Q. Plenum-Type, Paired Input Cable: 1 pair, twisted, No. 22 AWG, stranded (7x30) tinned copper conductors, fluorinated-ethylene-propylene insulation, aluminum foil-polyester tape shield (foil side out), with No. 22 AWG drain wire, 100 percent shield coverage, and plastic jacket.

1. NFPA 70, Type CMP.
2. Flame Resistance: NFPA 262 Flame Test.

R. Paired AC Transformer Cable: 1 pair, twisted, No. 18 AWG, stranded (7x26) tinned copper conductors, PVC insulation, unshielded, and PVC jacket.
   1. NFPA 70, Type CMG.

S. Plenum-Type, Paired AC Transformer Cable: 1 pair, twisted, No. 18 AWG, stranded (19x30) tinned copper conductors, fluorinated-ethylene-propylene insulation, unshielded, and plastic jacket.
   1. NFPA 70, Type CMP.
   2. Flame Resistance: NFPA 262 Flame Test.

T. LAN (Ethernet) Cabling: Comply with Division 28 Section "Conductors and Cables for Electronic Safety and Security."

PART 3 - EXECUTION

3.1 GENERAL

A. The Contractor shall install all system components and appurtenances in accordance with the manufacturers' instructions, ANSI C2, and shall furnish all necessary interconnections, services, and adjustments required for a complete and operable system as specified. Control signals, communications, and data transmission lines grounding shall be installed as necessary to preclude ground loops, noise, and surges from affecting system operation. Equipment, materials, installation, workmanship, inspection, and testing shall be in accordance with manufacturers' recommendations and as modified herein.

B. Consult the manufacturers' installation manuals for all wiring diagrams, schematics, physical equipment sizes, etc., before beginning system installation. Refer to the Riser/Connection diagram for all schematic system installation/termination/wiring data.

C. All equipment shall be attached to walls and ceiling/floor assemblies and shall be held firmly in place (e.g., sensors shall not be supported solely by suspended ceilings). Fasteners and supports shall be adequate to support the required load.

3.2 CURRENT SITE CONDITIONS

A. The Contractor shall visit the site and verify that site conditions are in agreement with the design package. The Contractor shall report all changes to the site or conditions which will affect performance of the system to the Owner in a report as defined in paragraph Group II

Technical Data Package. The Contractor shall not take any corrective action without written permission from the Owner.

3.3 EXAMINATION

A. Examine pathway elements intended for cables. Check raceways, cable trays, and other elements for compliance with space allocations, installation tolerances, hazards to cable installation, and other conditions affecting installation.

B. Examine roughing-in for LAN and control cable conduit systems to PCs, Controllers, card readers, and other cable-connected devices to verify actual locations of conduit and back boxes before device installation.

C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.4 PREPARATION

A. Comply with recommendations in SIA CP-01.

B. Comply with EIA/TIA-606, "Administration Standard for the Telecommunications Infrastructure of Commercial Buildings."

C. Obtain detailed Project planning forms from manufacturer of access-control system; develop custom forms to suit Project. Fill in all data available from Project plans and specifications and publish as Project planning documents for review and approval.

1. Record setup data for control station and workstations.
2. For each Location, record setup of Controller features and access requirements.
3. Propose start and stop times for time zones and holidays, and match up access levels for doors.
4. Set up groups, linking, and list inputs and outputs for each Controller.
5. Assign action message names and compose messages.
6. Set up alarms. Establish interlocks between alarms, intruder detection, and video surveillance features.
7. Prepare and install alarm graphic maps.
8. Develop user-defined fields.
9. Develop screen layout formats.
10. Propose setups for guard tours and key control.
11. Discuss badge layout options; design badges.
12. Complete system diagnostics and operation verification.

13. Prepare a specific plan for system testing, startup, and demonstration.
14. Develop acceptance test concept and, on approval, develop specifics of the test.
15. Develop cable and asset management system details; input data from construction documents. Include system schematics and Technical Drawings.

D. In meetings with Architect and Owner, present Project planning documents and review, adjust, and prepare final setup documents. Use final documents to set up system software.

3.5 CABLING

A. Comply with NECA 1, "Good Workmanship in Electrical Contracting."

B. Install cables and wiring according to requirements in Division 28 Section "Conductors and Cables for Electronic Safety and Security."

C. Wiring Method: Install wiring in raceway and cable tray except within consoles, cabinets, desks, and counters. Conceal raceway and wiring except in unfinished spaces.

D. Wiring Method: Install wiring in raceway and cable tray except within consoles, cabinets, desks, and counters and except in accessible ceiling spaces and in gypsum board partitions where unenclosed wiring method may be used. Use NRTL-listed plenum cable in environmental air spaces, including plenum ceilings. Conceal raceway and cables except in unfinished spaces.

E. Install LAN cables using techniques, practices, and methods that are consistent with Category 6A rating of components and that ensure Category 5E performance of completed and linked signal paths, end to end.

F. Install cables without damaging conductors, shield, or jacket.

G. Boxes and enclosures containing security system components or cabling, and which are easily accessible to employees or to the public, shall be provided with a lock. Boxes above ceiling level in occupied areas of the building shall not be considered to be accessible. Junction boxes and small device enclosures below ceiling level and easily accessible to employees or the public shall be covered with a suitable cover plate and secured with tamperproof screws.

H. Install end-of-line resistors at the field device location and not at the Controller or panel location.

3.6 CABLE APPLICATION

A. Comply with EIA/TIA-569, "Commercial Building Standard for Telecommunications Pathways and Spaces."

B. Cable application requirements are minimum requirements and shall be exceeded if recommended or required by manufacturer of system hardware.

C. RS-232 Cabling: Install at a maximum distance of 50 feet (15 m).

D. RS-485 Cabling: Install at a maximum distance of 4000 feet (1220 m).

E. Card Readers and Keypads:

1. Install number of conductor pairs recommended by manufacturer for the functions specified.
2. Unless manufacturer recommends larger conductors, install No. 22 AWG wire if maximum distance from Controller to the reader is 250 feet (75 m), and install No. 20 AWG wire if maximum distance is 500 feet (150 m).
3. For greater distances, install "extender" or "repeater" modules recommended by manufacturer of the Controller.
4. Install minimum No. 18 AWG shielded cable to readers and keypads that draw 50 mA or more.

F. Install minimum No. 16 AWG cable from Controller to electrically powered locks. Do not exceed 250 feet.

G. Install minimum No. 18 AWG ac power wire from transformer to Controller, with a maximum distance of 25 feet.

3.7 GROUNDING

A. Comply with Division 26 Section "Grounding and Bonding for Electrical Systems."

B. Comply with IEEE 1100, "Power and Grounding Sensitive Electronic Equipment."

C. Ground cable shields, drain conductors, and equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments.

D. Signal Ground:

1. Terminal: Locate in each equipment room and wiring closet; isolate from power system and equipment grounding.
2. Bus: Mount on wall of main equipment room with standoff insulators.

3. Backbone Cable: Extend from signal ground bus to signal ground terminal in each equipment room and wiring closet.

3.8 INSTALLATION

A. System installation shall be in accordance with UL 294, manufacturer and related documents and references, for each type of security subsystem designed, engineered and installed.

B. Components shall be configured with appropriate "service points" to pinpoint system trouble in less than 30 minutes.

C. The Contractor shall install all system components including Government furnished equipment, and appurtenances in accordance with the manufacturer's instructions, documentation listed in Sections 1.4 and 1.5 of this document, and shall furnish all necessary connectors, terminators, interconnections, services, and adjustments required for a operable system.

D. The PACS will be designed, engineered, installed, and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the system is a stand

E. For programming purposes refer to the manufacturers requirements for correct system operations. Ensure computers being utilized for system integration meet or exceed the minimum system requirements outlined on the systems software packages.

F. The Contractor shall visit the site and verify that site conditions are in agreement with the design package. The Contractor shall report all changes to the site or conditions that will affect performance of the system. The Contractor shall not take any corrective action without written permission from the Government.

G. The Contractor shall visit the site and verify that site conditions are in agreement/compliance with the design package. The Contractor shall report all changes to the site or conditions that will affect performance of the system to the Contracting Officer in the form of a report. The Contractor shall not take any corrective action without written permission received from the Contracting Officer.

H. Existing Equipment:

1. The Contractor shall connect to and utilize existing door equipment, control signal transmission lines, and devices as outlined in the design package. Door equipment and signal lines that are usable in

their original configuration without modification may be reused with Contracting Officer approval.

2. The Contractor shall perform a field survey, including testing and inspection of all existing door equipment and signal lines intended to be incorporated into the PACS, and furnish a report to the Contracting Officer as part of the site survey report. For those items considered nonfunctioning, provide (with the report) specification sheets, or written functional requirements to support the findings and the estimated cost to correct the deficiency. As part of the report, the Contractor shall include a schedule for connection to all existing equipment.
3. The Contractor shall make written requests and obtain approval prior to disconnecting any signal lines and equipment, and creating equipment downtime. Such work shall proceed only after receiving Contracting Officer approval of these requests. If any device fails after the Contractor has commenced work on that device, signal or control line, the Contractor shall diagnose the failure and perform any necessary corrections to the equipment.
4. The Contractor shall be held responsible for repair costs due to Contractor negligence, abuse, or improper installation of equipment.
5. The Contracting Officer shall be provided a full list of all equipment that is to be removed or replaced by the Contractor, to include description and serial/manufacturer numbers where possible. The Contractor shall dispose of all equipment that has been removed or replaced based upon approval of the Contracting Officer after reviewing the equipment removal list. In all areas where equipment is removed or replaced the Contractor shall repair those areas to match the current existing conditions.

I. Enclosure Penetrations: All enclosure penetrations shall be from the bottom of the enclosure unless the system design requires penetrations from other directions. Penetrations of interior enclosures involving transitions of conduit from interior to exterior, and all penetrations on exterior enclosures shall be sealed with rubber silicone sealant to preclude the entry of water and will comply with VA Master Specification 07 84 00, Firestopping. The conduit riser shall terminate in a hot-dipped galvanized metal cable terminator. The terminator shall

be filled with an approved sealant as recommended by the cable manufacturer and in such a manner that the cable is not damaged.

J. Cold Galvanizing: All field welds and brazing on factory galvanized boxes, enclosures, and conduits shall be coated with a cold galvanized paint containing at least 95 percent zinc by weight.

K. Control Panels:

1. Connect power and signal lines to the controller.
2. Program the panel as outlined by the design and per the manufacturer's programming guidelines.

L. Card Readers:

1. Connect all signal inputs and outputs as shown and specified.
2. Terminate input signals as required.
3. Program and address the reader as per the design package.
4. Readers shall be surface or flushed mounted and all appropriate hardware shall be provided to ensure the unit is installed in an enclosed conduit system.

M. Door Status Indicators:

1. Install all signal input and output cables as well as all power cables.
2. RTE's shall be surface mounted and angled in a manner that they cannot be compromised from the non-secure side of a windowed door, or allow for easy release of the locking device from a distance no greater than 6 feet from the base of the door.
3. Door position sensors shall be surface or flush mounted and wide gap with the ability to operate at a maximum distance of up to 2" (5 cm).

N. Entry Control Devices:

1. Install all signal input and power cables.
2. Strikes and bolts shall be mounted within the door frame.
3. Mortise locks shall be mounted within the door and an electric transfer hinge shall be utilized to transfer the wire from within the door frame to the mortise lock inside the door.
4. Electromagnetic locks shall be installed with the mag-lock mounted to the door frame and the metal plate mounted to the door.

O. System Start-Up:

1. The Contractor shall not apply power to the PACS until the following items have been completed:
   a. PACS equipment items and have been set up in accordance with manufacturer's instructions.
   b. A visual inspection of the PACS has been conducted to ensure that defective equipment items have not been installed and that there are no loose connections.
   c. System wiring has been tested and verified as correctly connected as indicated.
   d. All system grounding and transient protection systems have been verified as installed and connected as indicated.
   e. Power supplies to be connected to the PACS have been verified as the correct voltage, phasing, and frequency as indicated.
2. Satisfaction of the above requirements shall not relieve the Contractor of responsibility for incorrect installation, defective equipment items, or collateral damage as a result of Contractor work efforts.
3. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the Contracting Officer’s Representative and Commissioning Agent. Provide a minimum of 7 days prior notice.

P. Supplemental Contractor Quality Control:
1. The Contractor shall provide the services of technical representatives who are familiar with all components and installation procedures of the installed PACS; and are approved by the Contracting Officer.
2. The Contractor will be present on the job site during the preparatory and initial phases of quality control to provide technical assistance.
3. The Contractor shall also be available on an as needed basis to provide assistance with follow-up phases of quality control.
4. The Contractor shall participate in the testing and validation of the system and shall provide certification that the system installed is fully operational as all construction document requirements have been fulfilled.

3.9 SYSTEM SOFTWARE

A. Install, configure, and test software and databases for the complete and proper operation of systems involved. Assign software license to Owner.

3.10 FIELD QUALITY CONTROL

A. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect, test, and adjust field-assembled components and equipment installation, including connections[, and to assist in field testing. Report results in writing.

B. Testing Agency: Engage a qualified testing and inspecting agency to perform field tests and inspections and prepare test reports:

C. Perform the following field tests and inspections and prepare test reports:

1. LAN Cable Procedures: Inspect for physical damage and test each conductor signal path for continuity and shorts. Use Class 2, bidirectional, Category 5 tester. Test for faulty connectors, splices, and terminations. Test according to TIA/EIA-568-1, "Commercial Building Telecommunications Cabling Standards - Part 1 General Requirements." Link performance for UTP cables must comply with minimum criteria in TIA/EIA-568-B.
2. Test each circuit and component of each system. Tests shall include, but are not limited to, measurements of power supply output under maximum load, signal loop resistance, and leakage to ground where applicable. System components with battery backup shall be operated on battery power for a period of not less than 10 percent of the calculated battery operating time. Provide special equipment and software if testing requires special or dedicated equipment.
3. Operational Test: After installation of cables and connectors, demonstrate product capability and compliance with requirements. Test each signal path for end-to-end performance from each end of all pairs installed. Remove temporary connections when tests have been satisfactorily completed.

3.11 PROTECTION

A. Maintain strict security during the installation of equipment and software. Rooms housing the control station, and workstations that have been powered up shall be locked and secured, with an activated

burglar alarm and access-control system reporting to a Central Station complying with UL 1610, "Central-Station Burglar-Alarm Units," during periods when a qualified operator in the employ of Contractor is not present.

3.12 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 28 08 00 – COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.

B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 28 08 00 – COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.13 DEMONSTRATION AND TRAINING

A. Provide services of manufacturer’s technical representative for four hours to instruct VA personnel in operation and maintenance of units.

B. Submit training plans and instructor qualifications in accordance with the requirements of Section 28 08 00 – COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.

C. Develop separate training modules for the following:

1. Computer system administration personnel to manage and repair the LAN and databases and to update and maintain software.
2. Operators who prepare and input credentials to man the control station and workstations and to enroll personnel.
3. Security personnel.
4. Hardware maintenance personnel.
5. Corporate management.

D. All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

-----END----

SECTION 28 23 00
VIDEO SURVEILLANCE

PART 1 - GENERAL

1.1 DESCRIPTION

A. Provide and install a complete Video Surveillance System, which is identified as the Video Assessment and Surveillance System hereinafter referred to as the VASS System as specified in this section.

B. This Section includes video surveillance system consisting of cameras, data transmission wiring, and a control station with its associated equipment.

1.2 RELATED WORK

A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.

B. Section 07 84 00 - FIRESTOPPING. Requirements for firestopping application and use.

C. Section 10 14 00 - SIGNAGE. Requirements for labeling and signs.

D. Section 26 05 11 - REQUIREMENTS FOR ELECTRICAL INSTALLATIONS. Requirements for connection of high voltage.

E. Section 26 05 19 - LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Requirements for power cables.

F. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. Requirements for general requirements that are common to more than one section in Division 28.

G. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.

H. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.

I. Section 28 05 28.33 - CONDUITS AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for infrastructure.

J. Section 28 08 00 - COMMISIONING OF ELECTRONIC SAFETY AND SECURITY. Requirements for commissioning, systems readiness checklists, and training.

1.3 DEFINITIONS

A. AGC: Automatic gain control.

B. B/W: Black and white.

C. CCD: Charge-coupled device.

D. CIF: Common Intermediate Format CIF images are 352 pixels wide and 88/240 (PAL/NTSC) pixels tall (352 x 288/240).

E. 4CIF: resolution is 704 pixels wide and 576/480 (PAL/NTSC) pixels tall (704 x 576/480).

F. H.264 (also known as MPEG4 Part 10): a encoding format that compresses video much more effectively than older (MPEG4) standards.

G. ips: Images per second.

H. MPEG: Moving picture experts group.

I. MPEG4: a video encoding and compression standard that uses inter-frame encoding to significantly reduce the size of the video stream being transmitted.

J. NTSC: National Television System Committee.

K. UPS: Uninterruptible power supply.

1.4 QUALITY ASSURANCE

A. The Contractor shall be responsible for providing, installing, and the operation of the VASS System as shown. The Contractor shall also provide certification as required.

B. The security system shall be installed and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the security system is stand-alone or a part of a complete Information Technology (IT) computer network.

C. The Contractor or security sub-contractor shall be a licensed security Contractor as required within the state or jurisdiction of where the installation work is being conducted.

D. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.

E. Product Qualification:

1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.

2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.

F. Contractor Qualification:

1. The Contractor or security sub-contractor shall be a licensed security Contractor with a minimum of five (5) years experience installing and servicing systems of similar scope and complexity. The Contractor shall be an authorized regional representative of the Video Assessment and Surveillance System's (VASS) manufacturer. The Contractor shall provide four (4) current references from clients with systems of similar scope and complexity which became operational in the past three (3) years. At least three (3) of the references shall be utilizing the same system components, in a similar configuration as the proposed system. The references must include a current point of contact, company or agency name, address, telephone number, complete system description, date of completion, and approximate cost of the project. The owner reserves the option to visit the reference sites, with the site owner's permission and representative, to verify the quality of installation and the references' level of satisfaction with the system. The Contractor shall provide copies of system manufacturer certification for all technicians. The Contractor shall only utilize factory-trained technicians to install, program, and service the VASS. The Contractor shall only utilize factory-trained technicians to install, terminate and service cameras, control, and recording equipment. The technicians shall have a minimum of five (5) continuous years of technical experience in electronic security systems. The Contractor shall have a local service facility. The facility shall be located within 60 miles of the project site. The local facility shall include sufficient spare parts inventory to support the service requirements associated with this contract. The facility shall also include appropriate diagnostic equipment to perform diagnostic procedures. The COR reserves the option of surveying the company's facility to verify the service inventory and presence of a local service organization.
2. The Contractor shall provide proof project superintendent with BICSI Certified Commercial Installer Level 1, Level 2, or Technician to provide oversight of the project.

3. Cable installer must have on staff a Registered Communication Distribution Designer (RCDD) certified by Building Industry Consulting Service International. The staff member shall provide consistent oversight of the project cabling throughout design, layout, installation, termination and testing.

G. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

1.5 SUBMITTALS

A. Submit below items in conjunction with Master Specification Sections 01 33 23, Shop Drawings, Product Data, and Samples, and Section 02 41 00, Demolition Drawings.

B. Provide certificates of compliance with Section 1.4, Quality Assurance.

C. Provide a pre-installation and as-built design package in both electronic format and on paper, minimum size 1220 x 1220 millimeters (48 x 48 inches); drawing submittals shall be per the established project schedule.

D. Pre-installation design and as-built packages shall include, but not be limited to:

1. Index Sheet that shall:
   a. Define each page of the design package to include facility name, building name, floor, and sheet number.
   b. Provide a list of all security abbreviations and symbols.
   c. Reference all general notes that are utilized within the design package.
   d. Specification and scope of work pages for all security systems that are applicable to the design package that will:
      1) Outline all general and job specific work required within the design package.
      2) Provide a device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
2. Floor plans and enlarged plans shall:
   a. Include a title block as defined above.

b. Define the drawings scale in both standard and metric measurements.
c. Provide device identification and location.
d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements (e.g., barriers, etc.).
e. Identify all pull box and conduit locations, sizes, and fill capacities.
f. Address all general and drawing specific notes for a particular drawing sheet.

3. A riser drawing for each applicable security subsystem shall:
   a. Indicate the sequence of operation.
   b. Relationship of integrated components on one diagram.
   c. Include the number, size, identification, and maximum lengths of interconnecting wires.
   d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer’s name and part number for the wire/cable being installed.
4. A system drawing for each applicable security system shall:
   a. Identify how all equipment within the system, from main panel to device, shall be laid out and connected.
   b. Provide full detail of all system components wiring from point-to-point.
   c. Identify wire types utilized for connection, interconnection with associate security subsystems.
   d. Show device locations that correspond to the floor plans.
   e. All general and drawing specific notes shall be included with the system drawings.
5. A schedule for all of the applicable security subsystems shall be included. All schedules shall provide the following information:
   a. Device ID.
   b. Device Location (e.g. site, building, floor, room number, location, and description).

c. Mounting type (e.g. flush, wall, surface, etc.).

d. Power supply or circuit breaker and power panel number.

e. In addition, for the VASS Systems, provide the camera ID, camera type (e.g. fixed or pan/tilt/zoom (P/T/Z), lens type (e.g. for fixed cameras only) and housing model number.

6. Detail and elevation drawings for all devices that define how they were installed and mounted.

E. Pre-installation design packages shall be reviewed by the Contractor along with a VA representative to ensure all work has been clearly defined and completed. All reviews shall be conducted in accordance with the project schedule. There shall be four (4) stages to the review process:

1. 35 percent
2. 65 percent
3. 90 percent
4. 100 percent

F. Provide manufacturer security system product cut-sheets. Submit for approval at least 30 days prior to commencement of formal testing, a Security System Operational Test Plan. Include procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.

G. Submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing as specified. Provide all maintenance and operating manuals per the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

H. Submit completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 28 08 00 COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.

1.6 APPLICABLE PUBLICATIONS

A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American National Standards Institute (ANSI)/Electronic Industries Alliance (EIA):

330-09.....Electrical Performance Standards for CCTV Cameras

375A-76.....Electrical Performance Standards for CCTV Monitors

C. Institute of Electrical and Electronics Engineers (IEEE):

C62.41-02.....IEEE Recommended Practice on Surge Voltages in Low-Voltage AC Power Circuits

802.3af-08.....Power over Ethernet Standard

D. Federal Communications Commision (FCC):

(47 CFR 15) Part 15 Limitations on the Use of Wireless Equipment/Systems

E. National Electrical Contractors Association (NECA):

303-2005.....Installing Closed Circuit Television (CCTV) Systems

F. National Fire Protection Association (NFPA):

70-23.....Article 780-National Electrical Code

G. Federal Information Processing Standard (FIPS):

140-2-02.....Security Requirements for Cryptographic Modules

H. Underwriters Laboratories, Inc. (UL):

983-06.....Standard for Surveillance Camera Units

3044-01.....Standard for Surveillance Closed Circuit Television Equipment

1.7 COORDINATION

A. Coordinate arrangement, mounting, and support of video surveillance equipment:

1. To allow maximum possible headroom unless specific mounting heights that reduce headroom are indicated.
2. To provide for ease of disconnecting the equipment with minimum interference to other installations.
3. To allow right of way for piping and conduit installed at required slope.
4. So connecting raceways, cables, wireways, cable trays, and busways will be clear of obstructions and of the working and access space of other equipment.

B. Coordinate installation of required supporting devices and set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.

C. Coordinate location of access panels and doors for video surveillance items that are behind finished surfaces or otherwise concealed.

1.8 WARRANTY OF CONSTRUCTION

A. Warrant VASS System work subject to the Article "Warranty of Construction" of FAR clause 52.246-21.

B. Demonstration and training shall be performed prior to system acceptance.

PART 2 - PRODUCTS

2.1 GENERAL

A. Surge Protection: Protect components from voltage surges originating external to equipment housing and entering through power, communication, signal, control, or sensing leads. Include surge protection for external wiring of each conductor entry connection to components.

B. Power Connections: Comply with requirements in Section 28 05 00 COMMON WORK REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY, Part 2, as recommended by manufacturer for type of line being protected.

C. Tamper Protection: Tamper switches on enclosures, control units, pull boxes, junction boxes, cabinets, and other system components shall initiate a tamper-alarm signal when unit is opened or partially disassembled. Control-station, control-unit alarm display shall identify tamper alarms and indicate locations.

2.2 CAMERAS

A. All Cameras will be EIA 330 and UL 1. Minimum Protection for Power Connections 120 V and more: Auxiliary panel suppressors shall comply with requirements in Section 28 05 00 COMMON WORK REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY, Part 2.

B. Minimum Protection for Communication, Signal, Control, and Low-Voltage 983 compliant as well as:

1. Fixed cameras shall be color and the primary choice for monitoring following the activities described below.
2. Shall be powered over Ethernet. Network switches supporting PoE cameras shall have a back-up power source to ensure cameras are

still operational in the event of loss of primary power to the VASS System.

3. Shall be rated for continuous operation under the environmental conditions listed in Part 1, Project Conditions.
4. Each function and activity shall be addressed within the system by a unique user defined name, with minimum of twenty (20) characters. The use of codes or mnemonics identifying the VASS action shall not be accepted.
5. Shall come with built-in video motion detection that shall automatically monitor and process information from each camera. The camera motion detection shall detect motion within the camera's field of view and provide automatic visual, remote alarms as a result of detected motion.
6. Shall be programmed to digitally flip from color to black and white at dusk and vice versa at low light conditions.
7. Will be fitted with AI/DC lenses to ensure the image quality under different light conditions.
8. Dummy or fake cameras will not be utilized at any time.
9. Appropriate signage shall be designed, provided, and posted that notifies people that an area is under camera surveillance.

2.3 VIDEO MANAGEMENT SYSTEM (ANALOG)- NOT USED

2.3 DIGITAL BASED VIDEO MANAGEMENT SYSTEM

A. Key Features

1. Open Platform: Open API/SDK, supports seamless integration with third party applications.
2. Multi-server and multi-site video surveillance solution: Unlimited recording of video from IP cameras, IP video encoders and selected DVRs with analog cameras.
3. Optimized Recording Storage Management: Unique data storage and archiving solution that combines superior performance and scalability and cost efficient long-term video storage
4. Wide IP camera and device support: Supports connection of more than 839 IP cameras, IP video encoders and selected NVR models from over 79 different vendors through dedicated device integration
5. ONVIF™ and PSIA compliant: Supports ONVIF™ and PSIA compliant cameras and devices

6. Wide compression technology support: Supports the news compression methods; MPEG4 ASP, MxPEG and H.264, besides MJEPG and MPEG4
7. System configuration wizards: Guides the user through the process of adding cameras, configuring video and recording, adjustment of motion detection and user configuration
8. Sequence Explorer: Displaying sequences and time intervals in thumbnail pre-views, the Sequence Explorer gives unparalleled visual overview of recorded video combined with smooth navigation
9. Overlay buttons: Intuitive control of cameras, camera-integrated devices and other integrated systems- directly from the camera view
10. Independent Playback: Instant and independent playback function allows you to independently playback recorded video for one or more cameras, while in live viewing or playback mode
11. Built-in Video Motion Detection: Independent of camera model and supporting up to 64 cameras simultaneously per server
12. Multiple language support: Let operators use the system in their native language with support for 20 different languages
13. Multi-channel, two-way audio: Communicate with people at gates/entrances or broadcast messages to many people at once with multichannel, two-way audio
14. Fast evidence export: Quickly deliver authentic evidence to public authorities by exporting video to various formats, including video from multiple cameras with viewer, logs, and user notes included

B. Administration Features

1. Single Management Application: A new Management Application provides a consolidated single point management access to Recording Servers.
2. System configuration wizards: Guides the user through the process of adding cameras, configuring video and recording, adjustment of motion detection and user configuration.
3. Automated device discovery: Enables fast discovery of camera devices using methods such as Universal Plug And Play, Broadcast and IP Range scanning.
4. Smart bulk configuration option: Change settings across multiple devices simultaneously and in a very few clicks.
5. Adaptable application behavior: Guides novice users, while expert users can optimize the application for efficient use.

6. Export/import of system and user configuration data: System backup for reliable system operation and fast system recovery. System cloning for efficient rollout of multiple systems with the same, or similar, configuration.
7. Import of off-line configuration data: Enabling off-line editing of configuration data, including camera and device definitions.
8. Automatic system restore points: A 'Restore Point' is created each time a configuration change is confirmed.
9. Enables easy rollback to previously defined system configuration points and enables cancelation of undesired configuration changes and restoration of earlier valid configurations.

C. Integration Options
1. Open Software Development Kit (SDK) makes it possible to video enable your business processes, through seamless integration of third party applications, such as video analytics, access systems, etc.
2. Compatible with Central for alarm overviews and operational status in larger video surveillance installations.
3. Integrate with physical access control systems, alarms, gates, building management systems, etc. using hardware I/O, internal events and TCP/IP events
4. Create, import and use HTML pages for navigation between views or to trigger a Smart Wall preset
5. Develop third party plug-ins for the Smart Client to expand with new functionality

D. Server Modules
1. Recording Server
a. Simultaneous digital multi-channel video and audio recording and live viewing (relaying).
b. Two-way audio enables integrated control of microphones and speakers connected to IP devices.
c. Bandwidth optimized multi-streaming by splitting a single camera video stream to differentiated streams for live view and recording, where each can be optimized independently with respect to frame rate and resolution.

d. Connectivity to cameras, video encoders and selected DVRs supports MJPEG, MPEG4, MPEG4 ASP*, H.264* and MxPEG.

e. Auto-detect camera models during setup.

2. Flexible multi-site, multi-server license structure charged per camera.
3. Unlimited number of installed cameras; simultaneous recording and live view of up to 64 cameras per server.
4. Recording technology: secure high speed database holding JPEG images or MPEG4 and MxPEG streams including audio.
5. Recording speed: 30+ frames per second per camera, limited only by hardware.
6. Recording quality depends entirely on camera and video encoder capabilities: no software limitation.
7. Start cameras on live view requests from clients.
8. Unlimited recording capacity with multiple archives possible per day.
9. Hourly to daily database archiving with optional automatic move to network drive saves storage capacity on the local server – with images still available transparently for playback
10. Built-in, real-time, camera independent motion detection (VMD); fully adjustable sensitivity, zone exclusions, recording activation with frame rate speed up, and alert activation through email or SMS.
11. Start recording on event.
12. Client initiated start of recording based on pre-defined recording time and access privileges.
13. Set multiple patrolling schedules per camera per day: i.e. different for day/night/weekend.
14. On pre-defined events Matrix remote commands are automatically sent to display live video remotely on computers running the Matrix Monitor or the Smart
15. Client with Matrix Plug-in.

a. Flexible notification (sound, e-mail and SMS) and camera patrolling scheduling, triggered by time or event.

E. Recording Server Manager

1. Local console management of the Recording Server accessible from the notification area.

2. Start and stop Recording Server service.
3. Access to Recording Server configuration settings.
4. Access to Recording Server help system.
5. View system status and log information.

F. Image Server
1. Remote access for Smart and Remote Clients.
2. Built-in web server for download and launch of clients and plug-ins.
3. Set up one Master and multiple Slave Servers.
4. Authenticate access based on Microsoft Active Directory user account, or user name and password.
5. Authorize access privileges per Microsoft Active Directory user account/group, user profile or grant full access.
6. User profiles control access to: Live view, Output control, Events, Listen to microphone, Talk to speaker, Manual recording; Playback, AVI export, JPG export, DB export, Sequences, Smart Search and audio. As well as Set up views, Edit private views and Edit shared public views.
7. Audit logs of exported evidence by user and file.
8. Audit logs of client user activity by time, locations and cameras.

G. Recording Viewer
1. Playback recorded video and audio locally on the

H. Recording Server.
1. View up to 16 cameras time-synched during playback.
2. Scrollable activity timeline with magnifying feature.
3. Instant search on recordings based on date/time and activity/alarm (Video Motion Detection).
4. ‘Smart Search’ for highlighted image zones and objects.
5. Evidence can be generated as a printed report, a JPEG image, an AVI film or in the native database format.
6. Export audio recordings in WAV or AVI format.
7. Export video digitally zoomed to view area of interest only and to minimize export footprint size.
8. Export ‘Evidence CD’ containing native database and Recording Viewer for instant, easy viewing by authorities.
9. Encryption & password protection option for exported recordings and files.

10. Ability to add comments to exported evidence, also encrypted.
11. Option to send email.
12. De-interlacing of video from analog cameras.

I. PDA Server

1. Remote access for PDA Client.
2. Handle login and session requests between PDA clients and Image Server.
3. Resize video surveillance images to fit the screen layout of PDA Client.

J. Smart Client Module

1. Smart Client includes all the features of Remote Client plus more:
2. Installed per default on Recording Server for local viewing and playback of video and audio.
3. Start recording on cameras for a pre-defined time (default 5 minutes). Subject to privileges set by administrator.
4. • Independent Playback capability allows for instant playback of recorded video for one or more cameras, while in live and playback mode
5. Live view digital zoom allows zoomed-out recordings while the operator digitally can zoom in to see details.
6. 'Update On Motion Only' optimizes CPU usage by letting motion detection control whether the image should be decoded and displayed or not. The visual effect is a still image in the view until motion is detected.
7. Shared and private camera views offer 1x1 up to 10x10 layouts in addition to asymmetric views.
8. Views optimized for both 4:3 and 16:9 screen ratios.
9. Multiple computer monitor support with a main window and any number of either windowed or full screen views.
10. Hotspot function for working in details with a camera selected from a view containing multiple cameras.
11. Carousel function allows a specified view to rotate between pre-defined cameras with individual timing and order with multiple appearances. Carousel function can be controlled allowing the operator to pause carousel function and to switch to previous or next camera.

12. Overlay buttons provides intuitive control of cameras, camera-integrated devices and other integrated systems- directly from the camera view
13. Matrix function to view live video from multiple cameras through the Image Server in any view layout with customizable rotation path, remotely controlled by Smart
14. Clients or Recording Servers sending Matrix remote commands
15. Send Matrix remote commands to display live video remotely on computers running the Matrix Monitor or the Smart Client with Matrix Plug-in.
16. Cameras' built-in audio sources available in live and in playback.
17. Separate pop-up window displaying sequences and time intervals in thumbnail pre-views, the Sequence Explorer gives unparalleled visual overview of recorded video combined with smooth navigation
18. Presents recorded sequences for individual cameras, or all cameras in a view
19. Seamlessly available in both Live and Playback modes
20. Smooth navigation with sliding preview and "drag-andthrow" function for video thumbnails
21. Instant playback of video sequences
22. Application Options allows users to adapt the layout and personalize the application to their particular preferences

K. Remote Client

1. View live video or playback recordings for 1-16 cameras simultaneously; from the same or different servers.
2. Advanced video navigation including fast/slow playback, jump to date/time, single step and video motion search.
3. Individual views can be user-defined in various layouts: view or playback camera images from multiple servers simultaneously in the same view.
4. Shared views can be managed centrally via the server with admin/user rights and user groups.
5. Import static or active HTML maps for fast navigation to cameras and good premise overviews.
6. Control output port relay operation, for example control of gates.
7. Quick overview of sequences with detected motion and preview window.

8. Quick overview of events/alerts.
9. IPIX 1x2 or 2x2 'Quad View' for viewing all 360° at once.
10. Optional video compression in streaming from server to client gives better use of bandwidth.
11. Create AVI files or save JPEG images.
12. Print incident reports with free-text user comments.
13. System logon using user name and password.
14. System logon using Microsoft Active Directory user accounts.

L. PDA Client

1. View live or playback video from a single server or from multiple servers in half-screen or full-screen formats.
2. To find recordings, you can jump to specific time/date or to next detected motion, or use motion detection sequence overviews.
3. When viewing recordings, you can playback at variable speed or single step image by image.
4. The PDA client shall connect to the VMS server using any IP connection; typically wireless LAN, GPRS, etc.
5. Video compression from the server to PDA optimizes bandwidth usage.
6. System logon using user name and password.

M. Matrix Monitor

1. Virtual Matrix showing live video directly from up to 4 cameras at a time triggered remotely by Matrix remote commands.
2. Camera view shifts by FIFO (first-in-first-out)
3. Multiple events can control a single Matrix monitor and single events can control multiple monitors.

N. Minimum System Requirements VMS Server

1. HW Platform:
   a. Minimum 2.4 GHz CPU and 1 GB RAM (2.4 GHz dual core processor and 2 GB RAM or more recommended).
   b. Minimum 1 GB disk space available, excluding space needed for recordings.
2. OS:
   a. Windows Server 2025 64 bit.
3. Software:
   a. Microsoft .NET 3.5 Framework SP1, or newer.

b. DirectX 9.12 Ultimate or newer required to run Playback Viewer application.

O. Minimum System Requirements VMS Client

1. HW Platform:
   a. Minimum 2.4 GHz CPU, 1 GB RAM (more powerful CPU and higher RAM recommended for Smart Clients running high number of cameras and multiple views and displays).
2. Graphics Card:
   a. AGP or PCI-Express, minimum 1024 x 768 (1280 x 1024 recommended), 16 bit colors.
3. OS:
   a. Windows Server 2025 64 bit.
4. Software:
   a. DirectX 9.0 or newer required to run Playback Viewer application.
   b. Microsoft .NET 3.5 Framework SP1, or newer.

P. Minimum System Requirements VMS Remote Client

1. HW Platform:
   a. Minimum 2.4 GHz CPU, RAM 1 GB (2 GB or higher recommended on Microsoft Windows Vista).
2. OS:
   a. Windows Server 202564 bit.
3. Software:
   a. DirectX 9.10 or newer required to run Playback Viewer Application Microsoft Edge, or newer, 64 bit version required

Q. Licensing Structure

1. Base Server License
   a. An VMS Base Server license is mandatory for installing the product.
2. The Base Server license contains:
   a. Unlimited numbers of Recording Server licenses
   b. Unlimited numbers of Smart Clients, Remote Clients, PDA Clients and Matrix Monitor licenses
3. Camera License
   a. To connect to a camera, a Device License per camera channel is required

b. In total, for all copies of the product installed under a given Base Server license, the product may only be used with as many cameras as you have purchased camera licenses for Video encoders and NVRs with multiple analog cameras require a license per channel to operate.

c. Camera Licenses can be purchased in any numbers. To extend the installation with additional Camera Licenses, the Base Server License number (SLC) is required when ordering.

4. Client License:

a. All client modules are not licensed and can be installed and used on any number of computers.

R. IP NETWORK DECODER

1. The unit shall be used for video monitoring and surveillance over IP networks. Network decoder shall decode MPEG-4 digital video to analog video.
2. The decoder shall use MPEG-4 compression for efficient distribution of images over a network.
3. The decoder shall be available as a standalone unit that can be horizontally or vertically mounted.
4. The decoder shall include, but not be limited to the following:

a. The decoder shall use “hybrid” technology in providing both analog and network connections with the purpose of allowing users to integrate existing equipment and digital IP products.

1) The decoder shall provide one composite video input and output connection.

2) The decoder shall provide one Ethernet connection.

b. The decoder shall have the following digital resolution:

1) D1: 720x576 (NTSC); 720x480 (PAL)

2) CIF: 352 x 288 (NTSC); 352 x 240 (PAL)

3) QCIF: 160 x 144 (NTSC); 160 x 112 (PAL)

c. The decoder shall have a digital frame rate of up to 30 frames per second (NTSC) at 720x480 resolution or 25 fps (PAL) at 720x586 resolution.

d. The decoder shall use the following protocols:

1) TCP/IP

2) UDP/IP

3) DHCP
4) Multicast
5) Data Throttle
6) Heart beat

e. The decoder shall have the following connectors:
1) Power connector: 3-pin male - for connecting the external power supply
2) I/O connector: 16-pin male - for connecting alarm, audio, RS-232, RS-485 input and output
3) Video I/O connector: SVHS style - for input and output connection of two composite monitors
4) Ethernet port: RJ-45 - for connecting to a network

f. The decoder shall have the following indicators:
1) Power LED
2) Link - indicates activity on the Ethernet port
3) Tx activity
4) Rx activity

5. The decoder shall have the following additional specifications:
a. Video
1) Video signal output: 1 V p-p into 75 ohms
2) Input termination: 75 ohm
3) Video compression standard: MPEG-4
4) Audio compression standard: MPEG-1 Layer 2

b. Audio
1) Audio input: 315 mV, 40 kOhms, unbalanced
2) Audio output: 315 mV, 600 ohms, unbalanced

c. Electrical
1) External power supply: 100 to 240 VAC
2) Output voltage: 13.5 V, 1.33 A
3) Power consumption: 0.5 W maximum

2.4 VIDEO DISPLAY EQUIPMENT - NOT USED

2.5 CONTROLLING EQUIPMENT

A. Shall be utilized to call up, operate, and program all cameras associated VASS System components.

B. Will have the ability to operate the cameras locally and remotely. A network server shall be utilized as the VASS System controller.

C. The controller shall be able to fit into a standard 47.5 cm (19 inch) equipment rack.

D. Control and programming keyboards shall be provided with its own type of switcher. All keyboards shall:

1. Be located at each monitoring station.
2. Be addressable for programming purposes.
3. Provide interface between the operator and the VASS System.
4. Provide full control and programming of the switcher.
5. Have the minimum following controls:
   a. programming
   b. switching
   c. lens function
   d. environmental housing
   e. annotation

2.6 VIDEO CAMERAS

A. The cameras shall be high-resolution color video cameras with wide dynamic range capturing capability.

B. The camera shall meet or exceed the following specifications:

1. The image capturing device shall be a 1/3-inch image sensor designed for capturing wide dynamic images.
   a. The image capturing device shall have a separate analog-to-digital converter for every pixel.
   b. The image capturing device shall sample each pixel multiple times per second.
   c. The dynamic range shall be 95 dB typical and 120 dB maximum.
3. The camera shall optimize each pixel independently.
4. The camera shall have onscreen display menus for programming of the camera's settings.

C. The camera shall come with a manual varifocal lens.

D. The video output shall be composite: 1.0 volts peak-to-peak at 75-ohm load.

E. Fixed Color Camera

1. The camera shall be a high-resolution color video camera with wide dynamic range capturing capability.
2. Comply with UL 639.
3. Pickup Device: 1/3 CCD interline transfer.

4. Signal-to-Noise Ratio: Not less than 50 dB, with the camera AGC off.
5. With AGC, manually selectable on or off.
6. Manually selectable modes for backlight compensation or normal lighting.
7. Scanning Synchronization: Determined by external synch over the coaxial cable. Camera shall revert to internally generated synchronization on loss of external synch signal.
8. White Balance: Auto-tracing white balance, with manually selectable fixed balance option.
9. Fixed Color Cameras Technical Characteristics:

Pickup device	1/3" interline transfer CCD
Resolution	5 MP
Sync. System	Internal Sync
S/N ratio	More than 48 dB
Electronic shutter	Auto 1/60 (1/50) ~1/100,000 sec.
Min. illumination	0.2 lux F2.0
White balance	Auto
Automatic gain control	ON
Lens type	Board lens/[DC]/[AI] varifocal lens
Focal length	3-12mm
Power source	DC12V/500mA or AC24/500mA
Power consumption	< 3W (Max)

10. Fixed color camera shall be enclosed in dome and have board mounted varifocal lens.
11. Camera accessories shall include:
    a. Surface mount adapter
    b. Wall mount adapter
    c. Flush mount adapter

2.7 AUTOMATIC COLOR DOME CAMERA – ANALOG (NOT USED)

2.8 POWER SUPPLIES

A. Power supplies shall be a low-voltage power supplies matched for voltage and current requirements of cameras and accessories, type as recommended by camera and lens manufacturer.

B. Technical specifications:

1. Input: 115VAC, 60Hz, 2.7 amps
2. Outputs:
   a. Number of outputs, 16
   b. Fuse/PTC protected, power limited
   c. Output voltage & power:
      1) 24VAC @ 12.5 amps (300VA) or 28VAC @ 10 amp (280VA) supply current
3. Illuminated power disconnect circuit breaker with manual reset
4. Surge suppression
5. Camera synchronization
6. Rack mount.
7. Enclosure: NEMA 250, Type 1.

2.9 INFRARED ILLUMINATORS (NOT USED)

2.10 NETWORK SERVER

A. Allow for the transmission of live video, data, and audio over either an existing Ethernet network or a dedicated security system network, requiring an IP address or Internet Explorer 5.5 or higher, or shall work as an analog-to-Ethernet "bridge" controlling matrices, and multiplexers. The network shall operate in a box-to-box configuration allowing for encoded video to be decoded and displayed on an analog monitor.

B. If a VASS System network is going to be utilized as the primary means of monitoring, operating, and recording cameras then the following equipment shall be required as part of the system:
   1. System Server
   2. Computer Workstation
   3. Recording Device
   4. Encoder/Decoder
   5. Monitor
   6. Hub/Switch
   7. Router
   8. Encryptor

C. Shall provide overall control, programming, monitoring, and recording of all cameras and associated devices within the VASS System.

D. All equipment on the network shall be IP addressable.

E. The VASS System network shall meet or exceed the following design and performance specifications:
   1. Two MPEG-4 video streams for a total of 40 images per second will be provided.
   2. PC Software that manages the installation and maintenance of all hardware transmitters and receivers on the network shall be provided.
   3. Video Source that supports any NTSC video source to the computer network shall be addressed.
   4. Receivers that could be used to display the video on a standard analog NTSC or PAL monitor will be addressed.

F. The system shall support the following network protocols:
   1. Internet connections: RTP, Real Time Control Protocol (RTCP), UDP, IP, TCP, ICMP, HTTP, Simple Network Management Protocol (SNMP), IGMP, DHCP, and ARP.
   2. Video Display: MPEG-4, M-JPEG in server push mode only.
   3. Have the ability to adjust bandwidth, image quality and image rate.
   4. Support image sizes of either 704 x 576 pixels or 352 x 288 pixels.
   5. Have an audio coding format of G.711 or G.728.
   6. Provide a video frame rate of at least 30 images per second.
   7. Support LAN Interface Ethernet 10/100/1000BaseT and be auto sensing.
   8. Have a LAN Data Rate of 9.6 Kbps to 5.0 Mbps.

G. All connections within the system shall be via CAT-6A cable and RJ-45 jacks. If analog equipment is used as part of the system, then either an encoder or a decoder will be utilized to convert the analog signal to a digital one.

H. The VASS network system shall conform to all VA agency wide security standards for administrator and operator use.

I. Server Technical Characteristics:

Hardware	Personal Computer
CPU	Pentium IV, 3.0 GHz or better
Hard Disk Interface	SATA
RAM	4GB
OS	Windows 11 Professional
Graphic Card	NVIDIA RTX PRO 6000 ATI RADEON RX 700 XTX or better

Ethernet Card	1000 Mb
Software	DirectX 9.0c
Free Memory	1 GB

J. Network Switch Technical Characteristics

Protocol and standard	IEEE802.3 IEEE802.3u IEEE802.3ab
Ports	24 10/100/1000M auto-negotiation RJ-45 ports with auto MDI/MDI-X
Network media	Cat 6A UTP for 1,000Mbps
Transmission method	store-and-forward
LED	indicator power, act/link, speed

K. Router Technical Characteristics

Network Standards	IEEE 802.3, 802.3u 10Base-T Ethernet (WAN) 100Base-T Ethernet (LAN) IEEE 802.3x Flow Control IEEE802.1p Priority Queue ANS/IEEE 802.3 NWay auto-negotiation
Protocol	CSMA/CD, TCP, IP, UDP, PPPoE, AND DHCP (client and server)
VPN Supported	PPTP, IPSec pass-through
Management	Browser
Ports	4 x 10/100/1000Base-T Auto sensing RJ45 ports, and an auto uplink RJ45port(s) 1 x 10Base-T RJ45 port, WAN
LEDs	Power, WAN Activity, LAN Link (10/100), LAN Activity

L. Encryptor Technical Characteristics:

Cryptography	Standard - Triple DES 168-bit (ANSI 9.52) Rijndael - AES (128, 192, 256)
Performance	Throughput (end-to-end) @ 100 Mbps line speed: >188 Mbps full duplex (large frames) >200 kfps full duplex (small frames) Latency (end-to-end) @ 100 Mbps
Key Management	Automatic KEK/DEK Exchange Using Signed Diffie-Hellman Unit Authentication Using X.509 Certificates
Physical Interfaces	10BaseT or 10/100/1000 BaseT Ethernet

	(Host and Network Ports) 10BaseT Ethernet Management Port Back and Front-Panel Serial Control Port
Device Management	THALES Element Manager, Front Panel Viewer, and Certificate Manager 10Base T (RJ-45) or 9-pin Serial Control Port SNMP Network Monitoring
Security Features	Tamper Proof Cryptographic Envelope Tamper Evident Chassis Hardware Random Number Generator
Management	Channel Encrypted Using Same Algorithm as Data Traffic
Security Certifications	FIPS 140-2 Level 3 CAPS Baseline and Enhanced Grades Common Criteria EAL4 and EAL5 (under evaluation)
Regulatory	EN60950, FCC, UL, CE, EN 50082-1, and EN 55022

2.11 RECORDING DEVICES

A. All cameras on the VASS System shall be recorded in real time using a Network Video Recorder (NVR), or attached storage. The type of recording device utilized should be determined by the size and type of VASS System designed and installed, and to what extent the system is to be utilized.

B. All recording devices shall be 47.5 cm (19 inch) rack-mountable.

C. All NVR's that are viewable over an Intranet or Internet will be routed through an encryptor.

D. Encryptors shall:

1. Comply with FIPS PUB 140-2.
2. Support TCP/IP.
3. Directly interfaces to low-cost commercial routers.
4. Provide packet-based crypto synchronization.
5. Encrypt source and destination IP addresses.
6. Support web browser based management requiring no additional software.
7. Have a high data sustained throughput — 1.544 Mbps (T1) full duplex data rate.
8. Provide for both bridging and routing network architecture support.
9. Support Electronic Key Management System (EKMS) compatible.
10. Have remote management ability.

11. Automatically reconfigure when secure network or wide area network changes.

E. Network Video Recorder (NVR)

1. Shall record video to a hard drive-based digital storage medium in MPEG, MPEG4 or H.264 format.
2. Shall meet the following minimum requirements:
   a. Record at minimum rate of 30 IPS.
   b. Have a minimum of eight (8) to 16 looping inputs.
   c. Have a minimum of eight (8) to 16 alarm inputs and two (2) relay outputs.
   d. Shall provide instantaneous playback of all recorded images.
   e. Be IP addressable, if part of a VASS network.
   f. Have built-in digital motion detection with masking and sensitivity adjustments.
   g. Easy playback and forward/reverse search capabilities.
   h. Complete audit trail database, with minimum of a six-month history that tracks all events related to the alarm; specifically who, what, where and when.
   i. NVR management capability providing automatic video routing to a back-up spare recorder in case of failure.
   j. Accessible locally and remotely via the internet, intranet, or a personal digital assistant (PDA).
   k. Records all alarm events in real time, ensuring 60 seconds before and after the event are included in the recording.
   l. Utilize RS-232 or fiber optic connections for integration with the SMS computer station via a remote port on a network hub.
   m. Allow for independently adjustable frame rate settings.
   n. Be compatible with the matrix switcher utilized to operate the cameras.
3. Technical Characteristics:

Hardware/CPU	Pentium III Xeon or IV, 1.8 GHz
HDD Interface	IDE or better; optional: SCSI II, SCSI Ultra, or Fiber Channel
RAM	1024 MB
Operating System	Windows 11Professional/Server 1
Graphic	Card HDMI

Ethernet Card	100/1000 MB
Memory	4GB
Software Setup	Centralized setup from each authorized PC; access via integrated web server
Storage Media	All storage media possible (e.g., HD, RAID), depending on operating system
Storage Mode	Linear mode, ring mode (capacity-based)
Recording Configuration	Camera name assignment, bandwidth limit, frame rate, video quality
Recording Content	Video and/or audio data
Search Parameters	Time, date, event
Playback	Playback via any IP network (LAN/WAN) simultaneous recording, playback, and backup
Network Interface	Ethernet (RJ-45, 10/100M)
Network Protocol	TCP/IP, DHCP, HTTP, UDP
Network Capabilities	Live/Playback/P/T/Z control
Recording Rate	30 ips for 720 x 240 (NTSC)
Password Protection	Menu Setup, Remote Access
Recording Capacity	160 (1 or 2 fixed HDD) 1 CD-RW
Power Interrupt	Auto recovered to recording mode

2.12 WIRES AND CABLES

A. Shall meet or exceed the manufactures recommendation for power and signal.

B. Will be carried in an enclosed conduit system, utilizing electromagnetic tubing (EMT) to include the equivalent in flexible metal, rigid galvanized steel (RGS) to include the equivalent of liquid tight.

C. All conduits will be sized and installed per the NEC. All security system signal and power cables that traverse or originate in a high security office space will contained in either EMT or RGS conduit.

D. All conduit, pull boxes, and junction boxes shall be clearly marked with colored permanent tape or paint that will allow it to be distinguished from all other conduit and infrastructure.

E. Conduit fills shall not exceed 40 percent unless otherwise documented.

F. A pull string shall be pulled along and provided with signal and power cables to assist in future installations.

G. At all locations where there is a wall penetration or core drilling is conducted to allow for conduit to be installed, fire stopping materials shall be applied to that area

H. High voltage and signal cables shall not share the same conduit and shall be kept separate up to the point of connection. High voltage for the security system shall be defined as any cable or sets of cables carrying 30 VDC/VAC or higher.

I. For all equipment that is carrying digital data between the Physical Access Control System and Database Management or at a remote monitoring station, shall not be less that 20 AWG and stranded copper wire for each conductor. The cable or each individual conductor within the cable shall have a shield that provides 100% coverage. Cables with a single overall shield shall have a tinned copper shield drain wire.

J. All cables and conductors, except fiber optic cables, that act as a control, communication, or signal lines shall include surge protection. Surge protection shall be furnished at the equipment end and additional triple electrode gas surge protectors rated for the application on each wire line circuit shall be installed within 1 m. (3 ft.) of the building cable entrance. The inputs and outputs shall be tested in both normal and common mode using the following wave forms:
   1. A 10 microsecond rise time by 1000 microsecond pulse width waveform with a peak voltage of 1500 watts and peak current of 60 amperes.
   2. An 8 microsecond rise time by 20 microsecond pulse width wave form with a peak voltage of 1000 volts and peak current of 500 amperes.

K. The surge suppression device shall not attenuate or reduce the video or sync signal under normal conditions. Fuses and relays shall not be used as a means of surge protection.
   1. Signal Cables:
      a. Signal wiring for PoE cameras depends on the distance the camera is being installed from either a hub or the server.
      b. If the camera is over 300 ft from a hub or server then utilize a multimode fiber optic cable with a minimum size of 50 microns.
      c. Provide a separate cable for power.
      d. CAT-6A Technical Characteristics:

Number of Pairs	4
Total Number of Conductors	8

AWG	23
Stranding	Solid
Conductor Material	BC – Bare Copper
Insulation Material	PO – Polyolefin
Overall Nominal Diameter	.230 in.
IEC Specification	11801 Category 6A
TIA/EIA Specification	568-B.2 Category 6A
Max. Capacitance Unbalance	(pF/300 m) 100 pF/100 m at 1kHZ
Nom. Velocity of Propagation	67 %
Max. Delay	(ns/100 m) 538 @ 100MHz
Max. Delay Skew	(ns/100m) 45 ns/100 m
Max. Conductor DC Resistance	9.38 Ohms/100 M AT 20°C
Max. DCR Unbalance@ 20°C	4 %
Max. Operating Voltage	UL 300 V RMS

2. Fiber Optic Cables Technical Characteristics:

Fiber Type	50 Micron
Number of Fibers	4
Core Diameter 6	2.5 +/- 2.5 microns
Core Non-Circularity	5% Maximum
Clad Diameter	125 +/- 2 microns
Clad Non-Circularity	1% Maximum
Core-clad Offset	1.5 Microns Maximum
Primary Coating Material	Acrylate
Primary Coating Diameter	245 +/- 10 microns
Secondary Coating Material	Engineering Thermoplastic
Secondary Coating Diameter	900 +/- 50 microns
Strength Member Material	Aramid Yarn
Outer Jacket Material	PVC
Outer Jacket Color	Orange
Overall Diameter	.200 in.
Numerical Aperture	.275
Maximum Gigabit Ethernet	300 meters
Maximum Gigabit Ethernet	550 meters

3. Power Cables
   a. Will be sized accordingly and shall comply with the NEC. High voltage power cables will be a minimum of three conductors, 14 AWG, stranded, and coated with a non-conductive polyvinylchloride (PVC) jacket. Low voltage cables will be a minimum of 18 AWG, stranded and non-conductive polyvinylchloride (PVC) jacket.
   b. Will be utilized for all components of the VASS System that require either a 110 VAC 60 Hz input. Each feed will be connected to a dedicated circuit breaker at a power panel that is primarily for the security system.
   c. All equipment connected to AC power shall be protected from surges. Equipment protection shall withstand surge test waveforms described in IEEE C62.41. Fuses shall not be used as a means of surge protection.
   d. Shall be rated for either 110 60 Hz, and shall comply with VA Master Spec 26 05 19 Low Voltage Electrical Power Conductors and Cables (600 Volts and Below).
   e. Low Voltage Power Cables
      1) Shall be a minimum of 18 AWG, Stranded and have a polyvinylchloride outer jacket.
      2) Cable size shall determined using a basic voltage over distance calculation and shall comply with the NEC's requirements for low voltage cables.

PART 3 – EXECUTION

3.1. GENERAL

A. Installation: The Contractor shall install all system components including Owner furnished equipment, and appurtenances in accordance with the manufacturer's instructions, ANSI C2 and as shown, and shall furnish all necessary connectors, terminators, interconnections, services, and adjustments required for a complete and operable data transmission system.

B. Identification and Labeling: The Contractor shall supply permanent identification labels for each cable at each end that will appear on the as-built drawings. The labeling format shall be identified and a complete record shall be provided to the Owner with the final documentation. Each cable shall be identified by type or signal being

carried and termination points. The labels shall be printed on letter size label sheets that are self laminated vinyl that can be printed from a computer data base or spread sheet. The labels shall be E-Z code WES12112 or equivalent.

1. The Contractor shall provide all personnel, equipment, instrumentation, and supplies necessary to perform all testing.

C. Transient Voltage Surge Suppressors (TVSS): The Contractor shall mount TVSS within 3 m (118 in) of equipment to be protected inside terminal cabinets or suitable NEMA 1 enclosures. Terminate off-premise conductors on input side of device. Connect the output side of the device to the equipment to be protected. Connect ground lug to a low impedance earth ground (less than 10 ohms) via Number 12 AWG insulated, stranded copper conductor.

D. Contractor's Field Test: The Contractor shall verify the complete operation of the data transmission system during the Contractor's Field Testing. Field test shall include a bit error rate test. The Contractor shall perform the test by sending a minimum of 1,000,000 bits of data on each DTM circuit and measuring the bit error rate. The bit error rate shall not be greater than one (1) bit out of each 100,000 bits sent for each dial-up DTM circuit, and one (1) bit out of 1,000,000 bits sent for each leased or private DTM circuit. The Contractor shall submit a report containing results of the field test.

E. Acceptance Test and Endurance Test: The wire line data transmission system shall be tested as a part of the completed IDS and EECS during the Acceptance test and Endurance Test as specified.

F. Identification and Labeling: The Contractor shall supply identification tags or labels for each cable. Cable shall be labeled at both end points and at intermediate hand holes, manholes, and junction boxes. The labeling format shall be identified and a complete record shall be provided to the Owner with the final documentation. Each cable shall be identified with type of signal being carried and termination points.

3.2 INSTALLATION

A. System installation shall be in accordance with NECA 303, manufacturer and related documents and references, for each type of security subsystem designed, engineered and installed.

B. Components shall be configured with appropriate "service points" to pinpoint system trouble in less than 30 minutes.

C. The Contractor shall install all system components including Government furnished equipment, and appurtenances in accordance with the manufacturer's instructions, documentation listed in Sections 1.5 of this document, and shall furnish all necessary connectors, terminators, interconnections, services, and adjustments required for a complete and operable system.

D. The VASS System will be designed, engineered, installed, and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the system is a stand alone or a complete network.

E. A complete VASS System shall be comprised of, but not limited to, the following components:

1. Cameras
2. Lenses
3. Camera Housings and Mounts
4. Controlling Equipment
5. Recording Devices
6. Wiring and Cables

F. The Contractor shall visit the site and verify that site conditions are in agreement/compliance with the design package. The Contractor shall report all changes to the site or conditions that will affect performance of the system to the Contracting Officer in the form of a report. The Contractor shall not take any corrective action without written permission received from the Contracting Officer.

G. Existing Equipment

1. The Contractor shall connect to and utilize existing video equipment, video and control signal transmission lines, and devices as outlined in the design package. Video equipment and signal lines that are usable in their original configuration without modification may be reused with Contracting Officer approval.
2. The Contractor shall perform a field survey, including testing and inspection of all existing video equipment and signal lines intended to be incorporated into the VASS System, and furnish a report to the Contracting Officer as part of the site survey report. For those

items considered nonfunctioning, provide (with the report) specification sheets, or written functional requirements to support the findings and the estimated cost to correct the deficiency. As part of the report, the Contractor shall include a schedule for connection to all existing equipment.

3. The Contractor shall make written requests and obtain approval prior to disconnecting any signal lines and equipment, and creating equipment downtime. Such work shall proceed only after receiving Contracting Officer approval of these requests. If any device fails after the Contractor has commenced work on that device, signal or control line, the Contractor shall diagnose the failure and perform any necessary corrections to the equipment.
4. The Contractor shall be held responsible for repair costs due to Contractor negligence, abuse, or incorrect installation of equipment.
5. The Contracting Officer shall be provided a full list of all equipment that is to be removed or replaced by the Contractor, to include description and serial/manufacturer numbers where possible. The Contractor shall dispose of all equipment that has been removed or replaced based upon approval of the Contracting Officer after reviewing the equipment removal list. In all areas where equipment is removed or replaced the Contractor shall repair those areas to match the current existing conditions.

H. Enclosure Penetrations: All enclosure penetrations shall be from the bottom of the enclosure unless the system design requires penetrations from other directions. Penetrations of interior enclosures involving transitions of conduit from interior to exterior, and all penetrations on exterior enclosures shall be sealed with rubber silicone sealant to preclude the entry of water and will comply with VA Master Specification 07 84 00, Firestopping. The conduit riser shall terminate in a hot-dipped galvanized metal cable terminator. The terminator shall be filled with an approved sealant as recommended by the cable manufacturer and in such a manner that the cable is not damaged.

I. Cold Galvanizing: All field welds and brazing on factory galvanized boxes, enclosures, and conduits shall be coated with a cold galvanized paint containing at least 95 percent zinc by weight.

J. Interconnection of Console Video Equipment: The Contractor shall connect signal paths between video equipment as specified by the OEM. Cables shall be as short as practicable for each signal path without causing strain at the connectors. Rack mounted equipment on slide mounts shall have cables of sufficient length to allow full extension of the slide rails from the rack.

K. Cameras:

1. Install the cameras with the focal length lens as indicated for each zone.
2. Connect power and signal lines to the camera.
3. Aim camera to give field of view as needed to cover the alarm zone.
4. Aim fixed mounted cameras installed outdoors facing the rising or setting sun sufficiently below the horizon to preclude the camera looking directly at the sun.
5. Focus the lens to give a sharp picture (to include checking for day and night focus and image quality) over the entire field of view
6. Synchronize all cameras so the picture does not roll on the monitor when cameras are selected.

L. Video Encoder/Decoder

1. Install the Video Encoder/Decoder per design and construction documents, and as specified by the OEM.
2. Connect analog camera inputs to video encoder.
3. Connect network camera to video decoder.
4. Connect video encoder to VASS network.
6. Connect unit to AC power (UPS).
7. Configure the video encoder/decoder per manufacturer’s recommendation and project requirements.

M. Video Server:

1. Install the video server per design and construction documents, and as specified by the OEM.
2. Connect video server to AC power (UPS).
3. Connect to VASS network.
4. Install operating system and Video Management Software.
5. Provide Video Management Software programming per VA guidance and the requirements provided by the Owner. Programming shall include:
   a. Camera names

b. Screen views
c. Camera recording schedules (continuous and event) driven recording. Events include alarms from other systems (sensors), manual input, and video motion detection.
d. Video detection zones for each camera requiring video motion detection
e. Alarm interface
f. Alarm outputs
g. GUI maps, views, icons and actions
h. Reports

N. Network Switch:
1. Install the network switch per design and construction documents, and as specified by the OEM.
2. Connect network switch to AC power (UPS).
3. Connect network cameras to network switch.
4. Configure the network switch per manufacturer’s recommendation and project requirements.

O. Network Recording Equipment
1. Install the NVR or video storage unit as shown in the design and construction documents, and as specified by the OEM.
2. Connect recording device to AC power (UPS).
3. Connect recording device to network switch as shown and specified.
4. Configure network connections
5. Provide recording unit programming per VA guidance and the requirements provided by the Owner. Programming shall include:
a. Camera names
b. Screen views
c. Camera recording schedules (continuous and event) driven recording. Events include alarms from other systems (sensors), manual input, and video motion detection.
d. Video detection zones for each camera requiring video motion detection
e. Alarm interface
f. Alarm outputs
g. GUI maps, views, icons and actions
h. Reports

P. Video Recording Equipment:

1. Install the video recording equipment as shown in the design and construction documents, and as specified by the OEM.
2. Connect video signal inputs and outputs as shown and specified.
3. Connect alarm signal inputs and outputs as shown and specified.
4. Connect video recording equipment to AC power.
5. Program the video recording equipment;
   a. Recording schedules

Q. Camera Housings and Mounts:

1. Install the camera housings and mounts as specified by the manufacturer and as shown, provide mounting hardware sized appropriately to secure each camera, housing and mount with maximum wind and ice loading encountered at the site.
4. Provide electrical and signal transmission cabling to the mount location via a hardened carrier system from the Physical Access Control System and Database Management to the device.
5. Connect signal lines and AC power to the housing interfaces.

3.3 SYSTEM START-UP

A. The Contractor shall not apply power to the VASS System until the following items have been completed:

1. VASS System equipment items and have been set up in accordance with manufacturer's instructions.
2. A visual inspection of the VASS System has been conducted to ensure that defective equipment items have not been installed and that there are no loose connections.
3. System wiring has been tested and verified as correctly connected as indicated.
4. All system grounding and transient protection systems have been verified as installed and connected as indicated.
5. Power supplies to be connected to the VASS System have been verified as the correct voltage, phasing, and frequency as indicated.

B. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the Contracting Officer’s Representative and Commissioning Agent. Provide a minimum of 7 days prior notice.

C. Satisfaction of the above requirements shall not relieve the Contractor of responsibility for incorrect installation, defective equipment items, or collateral damage as a result of Contractor work efforts.

3.4 SUPLEMENTAL CONTRACTOR QUIALITY CONTROL

A. The Contractor shall provide the services of technical representatives who are familiar with all components and installation procedures of the installed VASS System; and are approved by the Contracting Officer.

B. The Contractor will be present on the job site during the preparatory and initial phases of quality control to provide technical assistance.

C. The Contractor shall also be available on an as needed basis to provide assistance with follow-up phases of quality control.

D. The Contractor shall participate in the testing and validation of the system and shall provide certification that the system installed is fully operational as all construction document requirements have been fulfilled.

3.5 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of Section 28 08 00 – COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.

B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 28 08 00 – "COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS" and related sections for contractor responsibilities for system commissioning.

3.6 DEMONSTRATION AND TRAINING

A. All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, "GENERAL REQUIREMENTS".

B. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.

C. Submit training plans and instructor qualifications in accordance with the requirements of Section 28 08 00 – "COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS".

-----END----

SECTION 28 26 00
ELECTRONIC PERSONAL PROTECTION SYSTEM

PART 1 – GENERAL

1.1 DESCRIPTION

A. Provide and install complete Duress-Panic Alarms data transmission wiring and a control station with its associated equipment, hereafter referred to as EPPS System.

1.2 RELATED WORK

A. Section 01 00 00 – GENERAL REQUIREMENTS. For General Requirements.
B. Section 07 84 00 – FIRESTOPPING. Requirements for firestopping application and use.
C. Section 10 14 00 – SIGNAGE. Requirements for labeling and signs.
D. Section 26 05 19 – LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Requirements for power cables.
E. Section 26 05 33 – RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS. Requirements for infrastructure.
F. Section 28 05 00 – COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. Requirements for general requirements that are common to more than one section in Division 28.
G. Section 28 05 13 – CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.
H. Section 28 05 26 – GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.
I. Section 28 05 28.33 – CONDUITS AND BACK BOXES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for infrastructure.
J. Section 28 08 00 – COMMISIONING OF ELECTRONIC SAFETY AND SECURITY. Requirements for requirements for commissioning – systems readiness checklists, and training.

1.3 QUALITY ASSURANCE

A. The Contractor shall be responsible for providing, installing, and the operation of the EPPS System as shown. The Contractor shall also provide certification as required.
B. The security system shall be installed and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the security system is

stand-alone or a part of a complete Information Technology (IT) computer network.

C. The Contractor or security sub-contractor shall be a licensed security Contractor as required within the state or jurisdiction of where the installation work is being conducted.

D. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.

E. Product Qualification:

1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.

F. Contractor Qualification:

1. The Contractor or security sub-contractor shall be a licensed security Contractor with a minimum of five (5) years experience installing and servicing systems of similar scope and complexity. The Contractor shall be an authorized regional representative of the Security Management System’s (PACS) manufacturer. The Contractor shall provide four (4) current references from clients with systems of similar scope and complexity which became operational in the past three (3) years. At least three (3) of the references shall be utilizing the same system components, in a similar configuration as the proposed system. The references must include a current point of contact, company or agency name, address, telephone number, complete system description, date of completion, and approximate cost of the project. The owner reserves the option to visit the reference sites, with the site owner’s permission and representative, to verify the quality of installation and the references’ level of satisfaction with the system. The Contractor shall provide copies of system manufacturer certification for all technicians. The Contractor shall only utilize factory-trained technicians to install, program, and service the PACS. The Contractor shall only

utilize factory-trained technicians to install, terminate and service controller/field panels and reader modules. The technicians shall have a minimum of five (5) continuous years of technical experience in electronic security systems. The Contractor shall have a local service facility. The facility shall be located within 60 miles of the project site. The local facility shall include sufficient spare parts inventory to support the service requirements associated with this contract. The facility shall also include appropriate diagnostic equipment to perform diagnostic procedures. The COR reserves the option of surveying the company's facility to verify the service inventory and presence of a local service organization.

2. The Contractor shall provide proof project superintendent with BICSI Certified Commercial Installer Level 1, Level 2, or Technician to provide oversight of the project.
3. Cable installer must have on staff a Registered Communication Distribution Designer (RCDD) certified by Building Industry Consulting Service International. The staff member shall provide consistent oversight of the project cabling throughout design, layout, installation, termination and testing.

G. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

1.4 SUBMITALS

A. Submit below items in accordance with Section 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY and Master Specification Sections 01 33 23, SHOP DRAWING, PRODUCT DATA, AND SAMPLES, and Section 02 41 00, DEMOLITION.

B. Provide certificates of compliance with Section 1.3, Quality Assurance.

C. Provide a pre-installation and as-built design package in both electronic format and on paper, minimum size 48 x 48 inches (1220 x 1220 millimeters); drawing submittals shall be per the established project schedule.

D. Shop drawings and as-built packages shall include, but not be limited to:

1. Index Sheet that shall:
   a. Define each page of the design package to include facility name, building name, floor, and sheet number.
   b. Provide a list of all security abbreviations and symbols.
   c. Reference all general notes that are utilized within the design package.
   d. Specification and scope of work pages for all security systems that are applicable to the design package that will:
      1) Outline all general and job specific work required within the design package.
      2) Provide a device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
2. Drawing sheets that will be plotted on the individual floor plans or site plans shall:
   a. Include a title block as defined above.
   b. Define the drawings scale in both standard and metric measurements.
   c. Provide device identification and location.
   d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements (e.g., barriers, etc.).
   e. Identify all pull box and conduit locations, sizes, and fill capacities.
   f. Address all general and drawing specific notes for a particular drawing sheet.
3. A riser drawing for each applicable security subsystem shall:
   a. Indicate the sequence of operation.
   b. Relationship of integrated components on one diagram.
   c. Include the number, size, identification, and maximum lengths of interconnecting wires.
   d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1

Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.

4. A system drawing for each applicable security system shall:
   a. Identify how all equipment within the system, from main panel to device, shall be laid out and connected.
   b. Provide full detail of all system components wiring from point-to-point.
   c. Identify wire types utilized for connection, interconnection with associate security subsystems.
   d. Show device locations that correspond to the floor plans.
   e. All general and drawing specific notes shall be included with the system drawings.
5. A schedule for all of the applicable security subsystems shall be included. All schedules shall provide the following information:
   a. Device ID.
   b. Device Location (e.g. site, building, floor, room number, location, and description).
   c. Mounting type (e.g. flush, wall, surface, etc.).
   d. Power supply or circuit breaker and power panel number.
6. Detail and elevation drawings for all devices that define how they were installed and mounted.

E. Pre-installation design packages shall be reviewed by the Contractor along with a VA representative to ensure all work has been clearly defined and completed. All reviews shall be conducted in accordance with the project schedule. There shall be four (4) stages to the review process:
   1. 35 percent
   2. 65 percent
   3. 90 percent
   4. 100 percent

F. Provide manufacturer security system product cut-sheets. Submit for approval at least 30 days prior to commencement of formal testing, a Security System Operational Test Plan. Include procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.

G. Submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing as specified. Provide all maintenance and operating manuals per the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American National Standards Institute (ANSI):
ANSI S3.2-09.....Method for measuring the Intelligibility of Speech over Communications Systems

C. Department of Justice American Disability Act (ADA)
28 CFR Part 36.....2010 ADA Standards for Accessible Design

D. Federal Communications Commission (FCC):
(47 CFR 15) Part 15.....Limitations on the Use of Wireless Equipment/Systems

E. National Fire Protection Association (NFPA):
70-23.....National Electrical Code

F. National Electrical Manufactures Association (NEMA)
250-08.....Enclosures for Electrical Equipment (1000 Volts Maximum)

G. Underwriters Laboratories, Inc. (UL):
305-08.....Standard for Panic Hardware
444-08.....Safety Communications Cables
636-01.....Standard for Holdup Alarm Units and Systems

H. Uniform Federal Accessibility Standards (UFAS), 1984

1.6 COORDINATION

A. Coordinate arrangement, mounting, and support of electronic safety and security equipment:

1. To allow maximum possible headroom unless specific mounting heights that reduce headroom are indicated.
2. To provide for ease of disconnecting the equipment with minimum interference to other installations.
3. To allow right of way for piping and conduit installed at required slope.

4. So connecting raceways, cables, wireways, cable trays, and busways will be clear of obstructions and of the working and access space of other equipment.

B. Coordinate installation of required supporting devices and set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.

C. Coordinate location of access panels and doors for electronic safety and security items that are behind finished surfaces or otherwise concealed.

1.7 MAINTENANCE & SERVICE

A. General Requirements

1. The Contractor shall provide all services required and equipment necessary to maintain the entire integrated electronic security system in an operational state as specified for a period of one (1) year after formal written acceptance of the system. The Contractor shall provide all necessary material required for performing scheduled adjustments or other non-scheduled work. Impacts on facility operations shall be minimized when performing scheduled adjustments or other non-scheduled work. See also General Project Requirements.

B. Description of Work

1. The adjustment and repair of the security system includes all software updates, panel firmware, and the following new items computers equipment, communications transmission equipment and data transmission media (DTM), local processors, security system sensors, facility interface, and signal transmission equipment.

C. Personnel

1. Service personnel shall be certified in the maintenance and repair of the selected type of equipment and qualified to accomplish all work promptly and satisfactorily. The COR shall be advised in writing of the name of the designated service representative, and of any change in personnel. The COR shall be provided copies of system manufacturer certification for the designated service representative.

D. Schedule of Work

1. The work shall be performed during regular working ours, Monday through Friday, excluding federal holidays. These inspections shall include:
   a. The Contractor shall perform two (2) minor inspections at six (6) month intervals or more if required by the manufacturer, and two (2) major inspections offset equally between the minor inspections to effect quarterly inspection of alternating magnitude.
      1) Minor Inspections shall include visual checks and operational tests of all console equipment, peripheral equipment, local processors, sensors, electrical and mechanical controls, and adjustments on printers.
      2) Major Inspections shall include all work described for Minor Inspections and the following: clean all system equipment and local processors including interior and exterior surfaces; perform diagnostics on all equipment; operational tests of the CPU, switcher, peripheral equipment, check and calibrate each sensor; run all system software diagnostics and correct all problems; and resolve any previous outstanding problems.

E. Emergency Service
   1. The owner shall initiate service calls whenever the system is not functioning properly. The Contractor shall provide the Owner with an emergency service center telephone number. The emergency service center shall be staffed 24 hours a day 365 days a year. The Owner shall have sole authority for determining catastrophic and non-catastrophic system failures within parameters stated in General Project Requirements.
      a. For catastrophic system failures, the Contractor shall provide same day four (4) hour service response with a defect correction time not to exceed eight (8) hours from [notification] [arrival on site]. Catastrophic system failures are defined as any system failure that the Owner determines will place the facility(s) at increased risk.
      b. For non-catastrophic failures, the Contractor within eight (8) hours with a defect correction time not to exceed 24 hours from notification.

F. Operation

1. Performance of scheduled adjustments and repair shall verify operation of the system as demonstrated by the applicable portions of the performance verification test.

G. Records & Logs

1. The Contractor shall maintain records and logs of each task and organize cumulative records for each component and for the complete system chronologically. A continuous log shall be submitted for all devices. The log shall contain all initial settings, calibration, repair, and programming data. Complete logs shall be maintained and available for inspection on site, demonstrating planned and systematic adjustments and repairs have been accomplished for the system.

H. Work Request

1. The Contractor shall separately record each service call request, as received. The record shall include the serial number identifying the component involved, its location, date and time the call was received, specific nature of trouble, names of service personnel assigned to the task, instructions describing the action taken, the amount and nature of the materials used, and the date and time of commencement and completion. The Contractor shall deliver a record of the work performed within five (5) working days after the work was completed.

I. System Modifications

1. The Contractor shall make any recommendations for system modification in writing to the COR. No system modifications, including operating parameters and control settings, shall be made without prior written approval from the COR. Any modifications made to the system shall be incorporated into the operation and maintenance manuals and other documentation affected.

J. Software

1. The Contractor shall provide all software updates when approved by the Owner from the manufacturer during the installation and 12-month warranty period and verify operation of the system. These updates shall be accomplished in a timely manner, fully coordinated with the system operators, and incorporated into the operations and

maintenance manuals and software documentation. There shall be at least one (1) scheduled update near the end of the first year's warranty period, at which time the Contractor shall install and validate the latest released version of the Manufacturer's software. All software changes shall be recorded in a log maintained in the unit control room. An electronic copy of the software update shall be maintained within the log. At a minimum, the contractor shall provide a description of the modification, when the modification occurred, and name and contact information of the individual performing the modification. The log shall be maintained in a white 3 ring binder and the cover marked "SOFTWARE CHANGE LOG".

1.8 WARRANTY OF CONSTRUCTION.

A. Warrant EPPS System work subject to the Article "Warranty of Construction" of FAR clause 52.246-21.

B. Demonstration and training shall be performed prior to system acceptance.

1.9 GENERAL REQUIREMENTS

A. For general requirements that are common to more than one section in Division 28 refer to Section 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.

B. General requirements applicable to this section include:

1. Performance Requirements,
2. Delivery, Handling and Storage,
3. Project Conditions,
4. Equipment and Materials,
5. Electrical Power,
6. Lightning, Power Surge Suppression, and Grounding,
7. Electronic Components,
8. Substitute Materials and Equipment, and
9. Like Items.

PART 2 - PRODUCTS

2.1 EQUIPMENT AND MATERIALS

A. General:

1. All equipment shall be rated for continuous operation. Environmental conditions (i.e. temperature, humidity, wind, and

seismic activity) shall be taken under consideration at each facility and site location prior to installation of the equipment.

2. All equipment shall operate on a 120 alternating current (VAC); 60 Hz Alternating Current (AC) power system unless documented otherwise in subsequent sections listed within this spec. All equipment shall have a battery back-up source of power that will provide 12 hours (hrs.) of run time in the event of a loss of primary power to the security systems until a backup generator comes on-line.
3. The EPPS systems shall be designed, installed, and programmed in a manner that will allow for easy of operation, programming, servicing, maintenance, testing, and upgrading of the system.
4. All EPPS components located in designated "HAZARDOUS ENVIRONMENT" areas where fire or explosion could occur due to the presence of natural gases or vapors, flammable liquids, combustible residue, or ignitable fibers or debris, shall be rated Class II, Division I, Group F, and installed in accordance with National Fire Protection Association (NFPA) 70, National Electrical Code Chapter 5.
5. The Contractor shall provide the Contracting Officer with written verification, that the type of wire/cable being provided is recommended and approved by the OEM. Cabling shall meet the interconnecting wiring requirements of NFPA 70, National Electrical Code. The Contractor is responsible for providing the correct protection cable duct and/or conduit and wiring.
6. When interfacing with other communications or security subsystems the Contractor shall utilize interfacing methods that are approved by the Contracting Officer. At a minimum, an acceptable interfacing method requires not only a physical and mechanical connection; but also a matching of signal, voltage, and processing levels with regard to signal quality and impedance. The interface point must adhere to all standards described herein.
7. Systems shall be scaleable, not vendor specific, and allow expansion as required.
8. Wireless systems shall use ultrasonic, infrared and radio frequency waves to link distributed transmitters and receivers. Specific characteristics of particular facility will determine best application. Contractor is responsible for determining best system

using prediction program to determine where readable signals can be obtained and identify "dead spots".

9. All hardwired alarms, switches, and junction boxes shall be protected from tampering and include line supervision.

2.2 EQUIPMENT ITEMS

A. All systems shall be designed to provide continuous electrical supervision of the complete and entire system.

C. All alarm and initiating and signaling circuits shall be supervised for open circuits, short circuits, and system grounds. Main and Uninterrupted Power Supply (UPS) power circuits shall be supervised for any change in operating conditions (e.g. low battery, primary to back up battery, and UPS online). When an open, short or ground occurs in any system circuit, an audible and visual fault alarm signal shall be initiated at the master control station and all remote locations.

D. Control Unit: Shall consist of the components to constantly monitor and verify alarm activation; identify zone of activation and location of activation.

E. Audible Signal Device for Duress-Panic: Provides alarm activation and audible sound for alarms, as well as supervisory and trouble signals that shall be distinctive.

F. Assessment: This capability shall consist of electronic devices required to visually and audibly verify the validity of alarms. Assessment also includes providing indication of tampering, fail-safe, low battery, and power losses.

G. Alarm Monitoring and Reporting: Shall annunciate information to at least two (2) separate locations. The alarms shall maintain the capability to respond with local and remote visible and audible signals upon activation of an alarm. The alarms shall have the capability of operating in a silent mode, alerting personnel monitoring the system that the device has been activated.

H. Duress-Panic Alarms:

1. Housing shall be a rugged corrosion-resistant housing of stainless steel or Acrylonitrile Butadiene Styrene (ABS) molded plastic or similar material that is weather and dust proof.
2. Actuating device shall include a minimum of a plunger button whose head is recessed from the face/front edge of the housing and be

designed to avoid accidental activation using switch guard or multiple buttons (i.e., requires pressing two (2) buttons simultaneously)

3. Wireless stationary devices will meet the same specifications as Personal Duress/Panic Alarms.
4. Alarm switch/button shall lock-in upon activation until manually reset with key or manufacture provided device.
5. The switch shall be a positive-acting, double-pole, and double-throw switch.
6. Duress/Panic alarms shall meet UL 305 Standard for Panic Alarms. To reduce the possibility of false alarms and ensure installation functionality UL 636 Standard for Holdup Alarms standards shall be met.
7. Alarms used for concealed application requires silent alarm notification to a monitoring station. They shall annunciate at the Physical Access Control System and Database Management, monitored by a central station or direct connect to local police, depending on local ordinance requirements.
8. Shall be capable of being mounted for hand or foot use in a manner that is unable to be viewed by the public. Larger systems use a computer that intercepts and processes alarms and displays them on a monitor. The central computer can make an announcement over facility hand held radios, pagers or telephones, or at the Physical Access Control System and Database Management so that the other security personnel can be immediately notified. These systems shall be hardwired.
9. Components:
   a. Transmitter
   b. Locator subsystem
   c. Receiver
   d. Software
10. Wiring will be four (4) conductor #18 American Wire Gauge (AWG).
11. Duress-Panic Alarm Technical Characteristics:

Temperature Range	0° to 110°F (-17.8°C to 43.3°C)
Nominal Voltage	12 V DC @ 6 mA
Current	Max 8 mA

Operational Voltage	7 V DC to 15 V DC
Operational life	Rated for 0,000 activations
Battery Activations	500
Actuator	Dual button plunger with activation lock
LED	Bi-color - on and activated

2.3 INSTALLATION KIT

A. General: A kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, barrier strips, wiring blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, etc., required to accomplish a neat and secure installation. Unfinished or unlabeled wire connections will not be allowed. Contractor shall turn over to the Contracting Officer all unused and partially opened installation kit boxes, coaxial cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, and physical installation hardware. This is an acceptable alternate to the individual spare equipment requirement as long as the minimum spare items are provided in this count. The following installation sub-kits are required as a minimum:

B. System Grounding:

1. The grounding kit shall include all cable in accordance with UL 444 Communications Cables, and installation hardware required. All grounding will be according to the NEC.
2. This includes, but is not limited to:
   a. Control Cable Shields
   b. Data Cable Shields
   c. Conduits
   d. Power Panels
   e. Connector Panels

c. Wire And Cable: The wire and cable kit shall include all connectors and terminals, barrier straps, wiring blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.

d. Equipment Interface: The equipment interface kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed

to interface Systems and Subsystems according to the OEM requirements and this specification.

e. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to label each subsystem according to the OEM requirements, as-installed drawings, and this specification.

f. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to correctly provide the system documentation as required by this document and explained herein.

PART 3 – EXECUTION

3.1 INSTALLATION

A. System installation shall be installed in accordance with NFPA 731 Standards for the Installation of Electric Premises Security Systems and appropriate installation manual for each type of subsystem designed, engineered, and installed.

B. The location and type of duress to be installed will be in accordance with physical security requirements unique to each VA facility.

C. Concealed duress/panic devices shall be mounted in such a way that their location is only known by the person having knowledge of the activating device location. No wiring shall be exposed to identify the location of the activation device.

D. Hard-wired switches shall be wired to individual alarm points within the Advanced Processing Controller (apC).

E. Wall and post mounted stations shall be mounted to meet UFAS/ADA requirements and use tamper proof bolts and screws. Testing will be finished before installation of fasteners.

F. Cleaning: Subsequent to installation, clean each system component of dust, dirt, grease, or oil incurred during installation in accordance to manufacture instructions.

G. Provisions shall be made for systems in high-noise areas or areas with electrical interference environments.

H. Adjustment/Alignment/Synchronization: Contractor shall prepare for system activation by following manufacturer’s recommended procedures for adjustment, alignment, or programming. Prepare each component in

accordance with appropriate provisions of the component's installation, operations, and maintenance instructions.

3.2 WIRELINE DATA TRANSMISSION

A. Installation: The Contractor shall install all system components including Owner furnished equipment, and appurtenances in accordance with the manufacturer's instructions, ANSI C2 and as shown, and shall furnish all necessary connectors, terminators, interconnections, services, and adjustments required for a complete and operable data transmission system.

B. Identification and Labeling: The Contractor shall supply permanent identification labels for each cable at each end that will appear on the as-built drawings. The labeling format shall be identified and a complete record shall be provided to the Owner with the final documentation. Each cable shall be identified by type or signal being carried and termination points. The labels shall be printed on letter size label sheets that are self laminated vinyl that can be printed from a computer data base or spread sheet. The labels shall be E-Z code WES12112 or equivalent.

C. The Contractor shall provide all personnel, equipment, instrumentation, and supplies necessary to perform all testing.

D. Transient Voltage Surge Suppressors (TVSS): The Contractor shall mount TVSS within 3 m (118 in) of equipment to be protected inside terminal cabinets or suitable NEMA 1 enclosures. Terminate off-premise conductors on input side of device. Connect the output side of the device to the equipment to be protected. Connect ground lug to a low impedance earth ground (less than 10 ohms) via Number 12 AWG insulated, stranded copper conductor.

E. Contractor's Field Test: The Contractor shall verify the complete operation of the data transmission system during the Contractor's Field Testing. Field test shall include a bit error rate test. The Contractor shall perform the test by sending a minimum of 1,000,000 bits of data on each DTM circuit and measuring the bit error rate. The bit error rate shall not be greater than one (1) bit out of each 100,000 bits sent for each dial-up DTM circuit, and one (1) bit out of 1,000,000 bits sent for each leased or private DTM circuit. The Contractor shall submit a report containing results of the field test.

F. Acceptance Test and Endurance Test: The wire line data transmission system shall be tested as a part of the completed IDS and EECS during the Acceptance test and Endurance Test as specified.

G. Identification and Labeling: The Contractor shall supply identification tags or labels for each cable. Cable shall be labeled at both end points and at intermediate hand holes, manholes, and junction boxes. The labeling format shall be identified and a complete record shall be provided to the Owner with the final documentation. Each cable shall be identified with type of signal being carried and termination points.

3.3 WIRING

A. Wiring Method: Install cables in raceways and as otherwise indicated. Conceal raceways and wiring except in unfinished spaces.

B. Wiring Method: Install cables concealed in accessible ceilings, walls, and floors where possible.

C. Wiring within Enclosures: Bundle, lace, and train conductors to terminal points with no excess and without exceeding manufacturer's limitations on bending radii. Provide and use lacing bars and distribution spools.

D. Splices, Taps, and Terminations: For power and control wiring, use numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A and UL 486B.

E. Grounding: Provide independent-signal circuit grounding recommended in writing by manufacturer.

3.4 FIELD QUALITY CONTROL

A. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect field-assembled components and equipment installation and supervise pretesting, testing, and adjusting of video surveillance equipment.

B. Inspection: Verify that units and controls are properly installed, connected, and labeled, and that interconnecting wires and terminals are identified.

C. Test Schedule: Schedule tests after pretesting has been successfully completed and system has been in normal functional operation for at least 14 days. Provide a minimum of 10 days' notice of test schedule.

D. Operational Tests: Perform operational system tests to verify that system complies with Specifications. Include all modes of system operation. Test equipment for proper operation in all functional modes.

E. Remove and replace malfunctioning items and retest as specified above.

F. Record test results for each piece of equipment.

G. Retest: Correct deficiencies identified by tests and observations and retest until specified requirements are met.

3.5 ADJUSTING (NOT USED)

3.6 CLEANING

A. Clean installed items using methods and materials recommended in writing by manufacturer.

3.7 DEMONSTRATION

A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain electronic personal protection system (EPSS) equipment.

1. Train Owner's maintenance personnel on procedures and schedules for troubleshooting, servicing, and maintaining equipment.
2. Demonstrate methods of determining optimum alignment and adjustment of components and settings for system controls.
3. Review equipment list and data in maintenance manuals.
4. Conduct a minimum of four hours' training.

3.8 COMMISIONING

A. Provide commissioning documentation in accordance with the requirements of Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.


B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.9 TESTS AND TRAINING

A. All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS and Section 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.

-----END----

SECTION 28 31 00
FIRE DETECTION AND ALARM

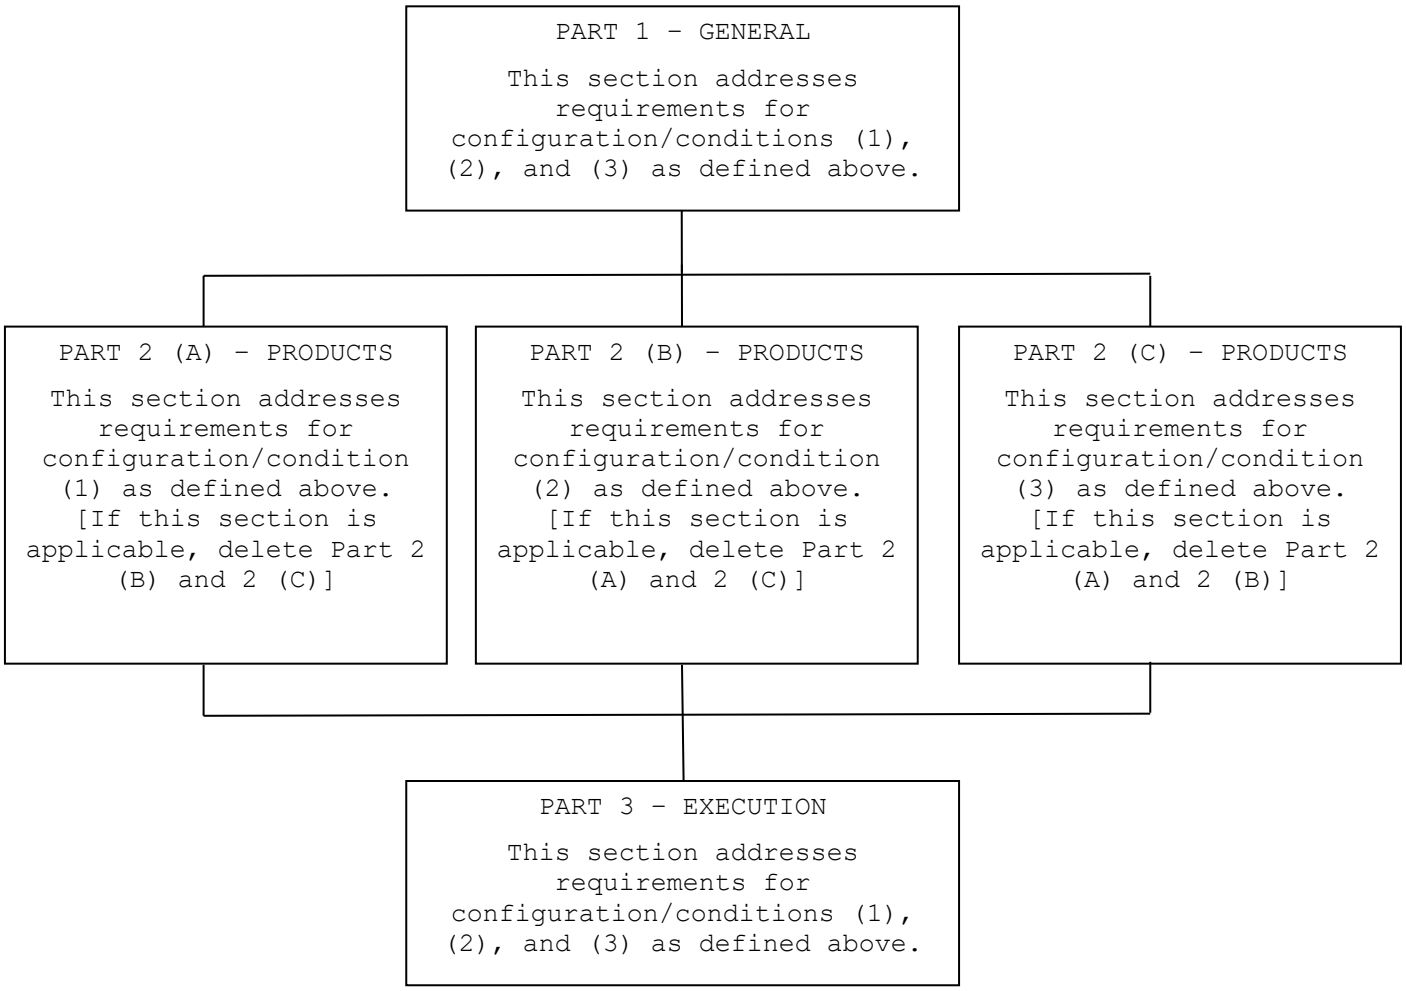

PART 1 - GENERAL

1.1 DESCRIPTION

A. Modify and expand the existing Edwards addressable fire alarm system at the VA Birmingham Eye Clinic to meet VA standards and NFPA 72 requirements. Include voice evacuation capability and integration with the Edwards system. It shall include, but not be limited to, alarm initiating devices, alarm notification appliances, control units, fire safety control devices, annunciators, power supplies, and wiring as shown on the drawings and specified. The fire alarm system shall not be combined with other systems such as building automation, energy management, security, etc.

Existing Edwards model numbers:

Pull Stations: EST 278

Speaker/strobes: Wheelock e90-24MCC-FW

Monitor Modules: Siga CT-1

B. Fire alarm systems shall comply with requirements of the most recent VA FIRE PROTECTION DESIGN MANUAL and NFPA 72 unless variations to NFPA 72 are specifically identified within these contract documents by the following notation: "variation". The design, system layout, document submittal preparation, and supervision of installation and testing shall be provided by a technician that is certified NICET level III or a registered fire protection engineer. The NICET certified technician shall be on site for the supervision and testing of the system. Factory engineers from the equipment manufacturer, thoroughly familiar and knowledgeable with all equipment utilized, shall provide additional technical support at the site as required by the COR/COTR or his authorized representative. Installers shall have a minimum of 2 years experience installing fire alarm systems.

C. Fire alarm signals:

1. Building(s) Eye Clinic at Birmingham VA Hospital shall have an automatic digitized voice fire alarm signal with emergency manual voice override to notify occupants to evacuate. The digitized voice

message shall identify the area of the building from which the alarm was initiated.

2. Building(s) Birmingham VA Hospital shall have a general evacuation fire alarm signal in accordance with ASA S3.41 to notify all occupants in the respective building to evacuate.

D. Alarm signals (by device), supervisory signals (by device) and system trouble signals (by device not reporting) shall be distinctly transmitted to the main fire alarm system control unit located in the security office.

E. The main fire alarm control unit shall automatically transmit alarm signals to a listed central station using a digital alarm communicator transmitter in accordance with NFPA 72. It is located in the Birmingham Veteran Affairs Medical Center, first floor, fire alarm control room.

1.2 SCOPE

A. A fully addressable fire alarm system shall be designed and installed in accordance with the specifications and drawings. Device location and wiring runs shown on the drawings are for reference only unless specifically dimensioned. Actual locations shall be in accordance with NFPA 72 and this specification. The area of work is the remodeled eye clinic.

B. All existing fire alarm equipment, wiring, devices and sub-systems that are not shown to be reused shall be removed. All existing fire alarm conduit not reused shall be removed.

C. Existing fire alarm bells, chimes, door holders, 120VAC duct smoke detectors, valve tamper switches and waterflow/pressure switches may be reused only as specifically indicated on the drawings and provided the equipment:

1. Meets this specification section
2. Is UL listed or FM approved
3. Is compatible with new equipment being installed
4. Is verified as operable through contractor testing and inspection
5. Is warranted as new by the contractor.

D. Existing 120 VAC duct smoke detectors, waterflow/pressure switches, and valve tamper switches reused by the Contractor shall be equipped with an addressable interface device compatible with the new equipment being installed.

E. Existing reused equipment shall be covered as new equipment under the Warranty specified herein.

F. Basic Performance:

1. Alarm and trouble signals from each building fire alarm control panel shall be digitally encoded by UL listed electronic devices onto a multiplexed communication system.
2. Response time between alarm initiation (contact closure) and recording at the main fire alarm control unit (appearance on alphanumeric read out) shall not exceed 5 seconds.
3. The signaling line circuits (SLC) between building fire alarm control units shall be wired Style 7 in accordance with NFPA 72. Isolation shall be provided so that no more than one building can be lost due to a short circuit fault.
4. Initiating device circuits (IDC) shall be wired Style C in accordance with NFPA 72.
5. Signaling line circuits (SLC) within buildings shall be wired Style 4 in accordance with NFPA 72. Individual signaling line circuits shall be limited to covering 22,500 square feet (2,090 square meters) of floor space or 3 floors whichever is less.
6. Notification appliance circuits (NAC) shall be wired Style Y in accordance with NFPA 72.

1.3 RELATED WORK

A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Requirements for procedures for submittals.

B. Section 07 84 00 - FIRESTOPPING. Requirements for fire proofing wall penetrations.

C. Section 08 71 00 - DOOR HARDWARE. For combination Closer-Holders.

D. Section 21 13 13 - WET-PIPE SPRINKLER SYSTEMS. Requirements for sprinkler systems.

E. Section 28 05 00 – COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. Requirements for general requirements that are common to more than one section in Division 28.

F. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.

G. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.

H. Section 28 05 28.33 - CONDUITS AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for infrastructure.

I. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.

J. Section 28 08 00, COMMISIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS. Requirements for commissioning - systems readiness checklists, and training.

K. Section 28 13 00, PHYSICAL ACCESS CONTROL SYSTEMS (PACS). Requirements for integration with physical access control system.

1.4 SUBMITTALS

A. General: Submit 5 copies in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

B. Drawings:

1. Prepare drawings using AutoCAD and include all contractors information. Layering shall be by VA criteria as provided by the Contracting Officer's Technical Representative (COTR). Bid drawing files on AutoCAD will be provided to the Contractor at the pre-construction meeting. The contractor shall be responsible for verifying all critical dimensions shown on the drawings provided by VA.

2. Floor plans: Provide locations of all devices (with device number at each addressable device corresponding to control unit programming), appliances, panels, equipment, junction/terminal cabinets/boxes, risers, electrical power connections, individual circuits and raceway routing, system zoning; number, size, and type of raceways and conductors in each raceway; conduit fill calculations with cross section area percent fill for each type and size of conductor and raceway. Only those devices connected and incorporated into the final system shall be on these floor plans. Do not show any removed

devices on the floor plans. Show all interfaces for all fire safety functions.

3. Riser diagrams: Provide, for the entire system, the number, size and type of riser raceways and conductors in each riser raceway and number of each type device per floor and zone. Show door holder interface, elevator control interface, HVAC shutdown interface, fire extinguishing system interface, and all other fire safety interfaces. Show wiring Styles on the riser diagram for all circuits. Provide diagrams both on a per building and campus wide basis.
4. Detailed wiring diagrams: Provide for control panels, modules, power supplies, electrical power connections, auxiliary relays and annunciators showing termination identifications, size and type conductors, circuit boards, LED lamps, indicators, adjustable controls, switches, ribbon connectors, wiring harnesses, terminal strips and connectors, spare zones/circuits. Diagrams shall be drawn to a scale sufficient to show spatial relationships between components, enclosures and equipment configuration.
5. Two weeks prior to final inspection, the Contractor shall deliver to the COTR 3 sets of as-built drawings and one set of the as-built drawing computer files using AutoCAD 2007 or later As-built drawings (floor plans) shall show all new and/or existing conduit used for the fire alarm system.

C. Manuals:

1. Submit simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals including technical data sheets for all items used in the system, power requirements, device wiring diagrams, dimensions, and information for ordering replacement parts.
   a. Wiring diagrams shall have their terminals identified to facilitate installation, operation, expansion and maintenance.
   b. Wiring diagrams shall indicate internal wiring for each item of equipment and the interconnections between the items of equipment.

c. Include complete listing of all software used and installation and operation instructions including the input/output matrix chart.
d. Provide a clear and concise description of operation that gives, in detail, the information required to properly operate, inspect, test and maintain the equipment and system. Provide all manufacturer's installation limitations including but not limited to circuit length limitations.
e. Complete listing of all digitized voice messages.
f. Provide standby battery calculations under normal operating and alarm modes. Battery calculations shall include the magnets for holding the doors open for one minute.
g. Include information indicating who will provide emergency service and perform post contract maintenance.
h. Provide a replacement parts list with current prices. Include a list of recommended spare parts, tools, and instruments for testing and maintenance purposes.
i. A computerized preventive maintenance schedule for all equipment. The schedule shall be provided on USB thumb drive in a computer format acceptable to the VAMC and shall describe the protocol for preventive maintenance of all equipment. The schedule shall include the required times for systematic examination, adjustment and cleaning of all equipment. A print out of the schedule shall also be provided in the manual. Provide the disk in a pocket within the manual.
j. Furnish manuals in 3 ring loose-leaf binder or manufacturer's standard binder.
k. A print out for all devices proposed on each signaling line circuit with spare capacity indicated.

2. Two weeks prior to final inspection, deliver 4 copies of the final updated maintenance and operating manual to the COTR.
   a. The manual shall be updated to include any information necessitated by the maintenance and operating manual approval.
   b. Complete "As installed" wiring and schematic diagrams shall be included that shows all items of equipment and their interconnecting wiring. Show all final terminal identifications.

c. Complete listing of all programming information, including all control events per device including an updated input/output matrix.

d. Certificate of Installation as required by NFPA 72 for each building. The certificate shall identify any variations from the National Fire Alarm Code.

e. Certificate from equipment manufacturer assuring compliance with all manufacturers installation requirements and satisfactory system operation.

D. Certifications:

1. Together with the shop drawing submittal, submit the technician's NICET level III fire alarm certification as well as certification from the control unit manufacturer that the proposed performer of contract maintenance is an authorized representative of the major equipment manufacturer. Include in the certification the names and addresses of the proposed supervisor of installation and the proposed performer of contract maintenance. Also include the name and title of the manufacturer’s representative who makes the certification.

2. Together with the shop drawing submittal, submit a certification from either the control unit manufacturer or the manufacturer of each component (e.g., smoke detector) that the components being furnished are compatible with the control unit.

3. Together with the shop drawing submittal, submit a certification from the major equipment manufacturer that the wiring and connection diagrams meet this specification, UL and NFPA 72 requirements.

1.5 WARRANTY

All work performed and all material and equipment furnished under this contract shall be free from defects and shall remain so for a period of one year from the date of acceptance of the entire installation by the Contracting Officer.

1.6 GUARANTY PERIOD SERVICES

A. Complete inspection, testing, maintenance and repair service for the fire alarm system shall be provided by a factory trained authorized representative of the manufacturer of the major equipment for a period

of 5 years from the date of acceptance of the entire installation by the Contracting Officer.

B. Contractor shall provide all necessary test equipment, parts and labor to perform required inspection, testing, maintenance and repair.

C. All inspection, testing, maintenance and permanent records required by NFPA 72, and recommended by the equipment manufacturer shall be provided by the contractor. Work shall include operation of sprinkler system alarm and supervisory devices as well as all reused existing equipment connected to the fire alarm system. It shall include all interfaced equipment including but not limited to elevators, HVAC shutdown, and extinguishing systems.

D. Maintenance and testing shall be performed in accordance with NFPA 72. A computerized preventive maintenance schedule shall be provided and shall describe the protocol for preventive maintenance of equipment. The schedule shall include a systematic examination, adjustment and cleaning of all equipment.

E. Non-included Work: Repair service shall not include the performance of any work due to improper use, accidents, or negligence for which the contractor is not responsible.

F. Service and emergency personnel shall report to the Engineering Office or their authorized representative upon arrival at the hospital and again upon the completion of the required work. A copy of the work ticket containing a complete description of the work performed and parts replaced shall be provided to the VA COR/COTR or his authorized representative.

G. Emergency Service:

1. Warranty Period Service: Service other than the preventative maintenance, inspection, and testing required by NFPA 72 shall be considered emergency call-back service and covered under the warranty of the installation during the first year of the warranty period, unless the required service is a result of abuse or misuse by the Government. Written notification shall not be required for emergency warranty period service and the contractor shall respond as outlined in the following sections on Normal and Overtime Emergency Call-Back Service. Warranty period service can be required

during normal or overtime emergency call-back service time periods at the discretion of the CO/COTR or his authorized representative.

2. Normal and overtime emergency call-back service shall consist of an on-site response within 2 hours of notification of a system trouble.
3. Normal emergency call-back service times are between the hours of 7:30 a.m. and 4:00 p.m., Monday through Friday, exclusive of federal holidays. Service performed during all other times shall be considered to be overtime emergency call-back service. The cost of all normal emergency call-back service for years 2 through 5 shall be included in the cost of this contract.
4. Overtime emergency call-back service shall be provided for the system when requested by the Government. The cost of the first 40 manhours per year of overtime call-back service during years 2 through 5 of this contract shall be provided under this contract. Payment for overtime emergency call-back service in excess of the 40 man hours per year requirement will be handled through separate purchase orders. The method of calculating overtime emergency call-back hours is based on actual time spent on site and does not include travel time.

H. The contractor shall maintain a log at each fire alarm control unit. The log shall list the date and time of all examinations and trouble calls, condition of the system, and name of the technician. Each trouble call shall be fully described, including the nature of the trouble, necessary correction performed, and parts replaced.

//I. In the event that VA modifies the fire alarm system post-Acceptance but during the 5 year Guaranty Period Service period, Contractor shall be required to verify that the system, as newly modified or added, is consistent with the manufacturer's requirements; any verification performed will be equitably adjusted under the Changes clause. The post-Acceptance modification or addition to the fire alarm system shall not void the continuing requirements under this contract set forth in the Guarantee Period Service provision for the fire alarm system as modified or added. The contract will be equitably adjusted under the Changes clause for such additional performance. //

1.7 APPLICABLE PUBLICATIONS

A. The publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. The publications are referenced in text by the basic designation only and the latest editions of these publications shall be applicable.

B. National Fire Protection Association (NFPA):

NFPA 13 .....Standard for the Installation of Sprinkler Systems, 2022 edition

NFPA 70.....National Electrical Code (NEC), 2023 edition

NFPA 72.....National Fire Alarm Code, 2022 edition

NFPA 90A.....Standard for the Installation of Air Conditioning and Ventilating Systems, 2024edition

NFPA 101.....Life Safety Code, 2024 edition

C. Underwriters Laboratories, Inc. (UL): Fire Protection Equipment Directory

E. American National Standards Institute (ANSI):

S3.41.....Audible Emergency Evacuation Signal, 1990 edition, reaffirmed 2008

F. International Code Council, International Building Code (IBC), 2024 edition

PART 2 A- PRODUCTS

2.1 EQUIPMENT AND MATERIALS, GENERAL

A. All equipment and components shall be new and the manufacturer's current model. All equipment shall be tested and listed by Underwriters Laboratories, Inc. or Factory Mutual Research Corporation for use as part of a fire alarm system. The authorized representative of the manufacturer of the major equipment shall certify that the installation complies with all manufacturers’ requirements and that satisfactory total system operation has been achieved.

2.2 CONDUIT, BOXES, AND WIRE

A. Conduit shall be in accordance with Section 28 05 28.33 CONDUIT AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY and as follows:

1. All new conduits shall be installed in accordance with NFPA 70.

2. Conduit fill shall not exceed 40 percent of interior cross sectional area.
3. All new conduits shall be 3/4 inch (19 mm) minimum.

B. Wire:

1. Wiring shall be in accordance with NEC article 760, Section 28 05 13, CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY, and as recommended by the manufacturer of the fire alarm system. All wires shall be color coded. Number and size of conductors shall be as recommended by the fire alarm system manufacturer, but not less than 18 AWG for initiating device circuits and 14 AWG for notification device circuits.
2. Addressable circuits and wiring used for the multiplex communication loop shall be twisted and shielded unless specifically excepted by the fire alarm equipment manufacturer in writing.
3. Any fire alarm system wiring that extends outside of a building shall have additional power surge protection to protect equipment from physical damage and false signals due to lightning, voltage and current induced transients. Protection devices shall be shown on the submittal drawings and shall be UL listed or in accordance with written manufacturer's requirements.
4. All wire or cable used in underground conduits including those in concrete shall be listed for wet locations.

C. Terminal Boxes, Junction Boxes, and Cabinets:

1. Shall be galvanized steel in accordance with UL requirements.
2. All boxes shall be sized and installed in accordance with NFPA 70.
3. covers shall be repainted red in accordance with Section 09 91 00, PAINTING and shall be identified with white markings as "FA" for junction boxes and as "FIRE ALARM SYSTEM" for cabinets and terminal boxes. Lettering shall be a minimum of 3/4 inch (19 mm) high.
4. Terminal boxes and cabinets shall have a volume 50 percent greater than required by the NFPA 70. Minimum sized wire shall be considered as 14 AWG for calculation purposes.
5. Terminal boxes and cabinets shall have identified pressure type terminal strips and shall be located at the base of each riser. Terminal strips shall be labeled as specified or as approved by the COTR.

2.6 VOICE COMMUNICATION SYSTEM (VCS)

A. General:
1. The project shall use the existing voice communication system installed.
2. Upon receipt of an alarm signal from the building fire alarm system, the VCS shall automatically transmit a pre-recorded fire alarm message throughout the building
3. A digitized voice module shall be used to store each prerecorded message.

5. The VCS shall supervise all speaker circuits, control equipment, remote audio control equipment, and amplifiers.

C. Speaker Circuit Arrangement:
1. Speaker circuits shall be arranged such that there is one speaker circuit per smoke zone.
2. Audio amplifiers and control equipment shall be electrically supervised for normal and abnormal conditions.
3. Speaker circuits shall be either 25 VRMS or 70.7 VRMS with a minimum of 50 percent spare power available.
4. Speaker circuits and control equipment shall be arranged such that loss of any one speaker circuit will not cause the loss of any other speaker circuit in the system.

D. Digitized Voice Module (DVM):
1. The Digitized Voice Module shall provide prerecorded digitized evacuation and instructional messages. The messages shall be professionally recorded and approved by the COTR prior to programming.
2. The DVM shall be configured to automatically output to the desired circuits following a 10-second slow whoop alert tone.
3. Prerecorded magnetic taped messages and tape players are not permitted.

4. The digitized message capacity shall be no less than 15 second in length.
5. The digitized message shall be transmitted 3 times.
6. The DVM shall be supervised for operational status.
7. Failure of the DVM shall result in the transmission of a constant alarm tone.
8. The DVM memory shall have a minimum 50 percent spare capacity after those messages identified in this section are recorded. Multiple DVM's may be used to obtain the required capacity.

E. Audio Amplifiers:

1. Audio Amplifiers shall provide a minimum of 50 Watts at either 25 or 70.7 VRMS output voltage levels.
2. Amplifiers shall be continuously supervised for operational status.
3. Amplifiers shall be configured for either single or dual channel application.
4. Each audio output circuit connection shall be configurable for Style X.
5. A minimum of 50 percent spare output capacity shall be available for each amplifier.

F. Tone Generator(s):

1. Tone Generator(s) shall be capable of providing a distinctive 3-pulse temporal pattern fire alarm signal as well as a slow whoop.
2. Tone Generator(s) shall be continuously supervised for operational status.

2.7 ALARM NOTIFICATION APPLIANCES

B. Speakers:

1. Shall operate on either 25 VRMS or 70.7 VRMS with field selectable output taps from 0.5 to 2.0W and originally installed at the 1/2 watt tap. Speakers shall provide a minimum sound output of 80 dBA at 10 feet (3,000 mm) with the 1/2 watt tap.
2. Frequency response shall be a minimum of 400 HZ to 4,000 HZ.
3. Four inches (100 mm) or 8 inches (200 mm) cone type speakers ceiling mounted with white colored baffles in areas with suspended ceilings and wall mounted in areas without ceilings.

C. Strobes:

1. Xenon flash tube type minimum 15 candela in toilet rooms and 75 candela in all other areas with a flash rate of 1 HZ. Strobes shall be synchronized where required by the National Fire Alarm Code (NFPA 72).
2. Backplate shall be red with 1/2 inch (13 mm) permanent red letters. Lettering to read "Fire", be oriented on the wall or ceiling properly, and be visible from all viewing directions.
3. Each strobe circuit shall have a minimum of 20 percent spare capacity.
4. Strobes may be combined with the audible notification appliances specified herein.

2.8 ALARM INITIATING DEVICES

A. Manual Fire Alarm Stations:

1. Shall be non-breakglass, address reporting type.
2. Station front shall be constructed of a durable material such as cast or extruded metal or high impact plastic. Stations shall be semi-flush type.
3. Stations shall be of single action pull down type with suitable operating instructions provided on front in raised or depressed letters, and clearly labeled "FIRE."
4. Operating handles shall be constructed of a durable material. On operation, the lever shall lock in alarm position and remain so until reset. A key shall be required to gain front access for resetting, or conducting tests and drills.
5. Unless otherwise specified, all exposed parts shall be red in color and have a smooth, hard, durable finish.

B. Smoke Detectors:

1. Smoke detectors shall be photoelectric type and UL listed for use with the fire alarm control unit being furnished.
2. Smoke detectors shall be addressable type complying with applicable UL Standards for system type detectors. Smoke detectors shall be installed in accordance with the manufacturer's recommendations and NFPA 72.

3. Detectors shall have an indication lamp to denote an alarm condition. Provide remote indicator lamps and identification plates where detectors are concealed from view. Locate the remote indicator lamps and identification plates flush mounted on walls so they can be observed from a normal standing position.
4. All spot type and duct type detectors installed shall be of the photoelectric type.
5. Photoelectric detectors shall be factory calibrated and readily field adjustable. The sensitivity of any photoelectric detector shall be factory set at 3.0 plus or minus 0.25 percent obscuration per foot.
6. Detectors shall provide a visual trouble indication if they drift out of sensitivity range or fail internal diagnostics. Detectors shall also provide visual indication of sensitivity level upon testing. Detectors, along with the fire alarm control units shall be UL listed for testing the sensitivity of the detectors.

D. Water Flow and Pressure Switches:

1. Wet pipe water flow switches and dry pipe alarm pressure switches for sprinkler systems shall be connected to the fire alarm system by way of an address reporting interface device.
2. All new water flow switches shall be of a single manufacturer and series and non-accumulative retard type. See Section 21 12 00, FIRE-SUPPRESSION STANDPIPES and Section 21 13 13, WET-PIPE SPRINKLER SYSTEMS for new switches added. Connect all switches shown on the approved shop drawings.3. All new switches shall have an alarm transmission delay time that is conveniently adjustable from 0 to 60 seconds. Initial settings shall be 30-45 seconds. Timing shall be recorded and documented during testing.

2.9 SUPERVISORY DEVICES

A. Duct Smoke Detectors:

1. Duct smoke detectors shall be provided and connected by way of an address reporting interface device. Detectors shall be provided with an approved duct housing mounted exterior to the duct, and shall have perforated sampling tubes extending across the full width of the duct (wall to wall). Detector placement shall be such that there is uniform airflow in the cross section of the duct.

2. Interlocking with fans shall be provided in accordance with NFPA 90A and as specified hereinafter under Part 3.2, "TYPICAL OPERATION".
3. Provide remote indicator lamps, key test stations and identification nameplates (e.g. "DUCT SMOKE DETECTOR AHU-X") for all duct detectors. Locate key test stations in plain view on walls or ceilings so that they can be observed and operated from a normal standing position.

B. Sprinkler and Standpipe System Supervisory Switches:
1. Each sprinkler system water supply control valve, riser valve or zone control valve, and each standpipe system riser control valve shall be equipped with a supervisory switch. Standpipe hose valves, and test and drain valves shall not be equipped with supervisory switches.
2. PIV (post indicator valve) or main gate valve shall be equipped with a supervisory switch.
3. Valve supervisory switches shall be connected to the fire alarm system by way of address reporting interface device. See Section 21 13 13, WET-PIPE SPRINKLER SYSTEMS for new switches to be added. Connect tamper switches for all control valves shown on the approved shop drawings.
4. The mechanism shall be contained in a weatherproof die-cast aluminum housing that shall provide a 3/4 inch (19 mm) tapped conduit entrance and incorporate the necessary facilities for attachment to the valves.
5. The entire installed assembly shall be tamper-proof and arranged to cause a switch operation if the housing cover is removed or if the unit is removed from its mounting.
6. Where dry-pipe sprinkler systems are installed, high and low air pressure switches shall be provided and monitored by way of an address reporting interface devices.
7. Fire supervisory signals required by NFPA 20 and monitored by the pump controller shall be provided and monitored by way of address reporting interface devices for the fire pump located dicate location.

2.10 ADDRESS REPORTING INTERFACE DEVICE

A. Shall have unique addresses that reports directly to the building fire alarm panel.

B. Shall be configurable to monitor normally open or normally closed devices for both alarm and trouble conditions.

C. Shall have terminal designations clearly differentiating between the circuit to which they are reporting from and the device that they are monitoring.

D. Shall be UL listed for fire alarm use and compatibility with the panel to which they are connected.

E. Shall be mounted in weatherproof housings if mounted exterior to a building.

2.11 SMOKE BARRIER DOOR CONTROL

A. Electromagnetic Door Holders:

1. New Door Holders shall be standard wall mounted electromagnetic type. In locations where doors do not come in contact with the wall when in the full open position, an extension post shall be added to the door bracket.
2. Operation shall be by 24 volt DC supplied from a battery located at the fire alarm control unit. Door holders shall be coordinated as to voltage, ampere drain, and voltage drop with the battery, battery charger, wiring and fire alarm system for operation as specified.

B. A maximum of twelve door holders shall be provided for each circuit. Door holders shall be wired to allow releasing doors by smoke zone.

C. Door holder control circuits shall be electrically supervised.

D. Smoke detectors shall not be incorporated as an integral part of door holders.

2.12 UTILITY LOCKS AND KEYS:

A. All key operated test switches, control units, annunciator panels and lockable cabinets shall be provided with a single standardized utility lock and key.

B. Key-operated manual fire alarm stations shall have a single standardized lock and key separate from the control equipment.

C. All keys shall be delivered to the COTR.

2.13 SPARE AND REPLACEMENT PARTS

E. Provide to the VA, all hardware, software, programming tools, license and documentation necessary to permanently modify the fire alarm system on site. The minimum level of modification includes addition and deletion of devices, circuits, zones and changes to system description, system operation, and digitized evacuation and instructional messages.

2.14 INSTRUCTION CHART:

Provide typewritten instruction card mounted behind a Lexan plastic or glass cover in a stainless steel or aluminum frame with a backplate. Install the frame in a conspicuous location observable from each control unit where operations are performed. The card shall show those steps to be taken by an operator when a signal is received under all conditions, normal, alarm, supervisory, and trouble. Provide an additional copy with the binder for the input output matrix for the sequence of operation. The instructions shall be approved by the COTR before being posted.

A. Provide spare and replacement parts as follows:
   1. Manual pull stations - 1
   4. Fire alarm speaker strobes - 2
   6. Smoke detectors - 2
   7. Duct smoke detectors with all appurtenances - 1
   8. Sprinkler system water flow switch - 1 of each size
   9. Sprinkler system water pressure switch - 1 of each type
   10. Sprinkler valve tamper switch - 1 of each type
   12. Control equipment keys - 3
   15. Monitor modules - 1
   16. Control modules - 1
   17. Fire alarm SLC cable (same as installed) – 500 feet (152 m)

B.

C. Spare and replacement parts shall be in original packaging and submitted to the COTR.

D. Furnish and install a storage cabinet of sufficient size and suitable for storing spare equipment. Doors shall include a pad locking device. Padlock to be provided by the VA. Location of cabinet to be determined by the COTR.

E. Provide to the VA, all hardware, software, programming tools, license and documentation necessary to permanently modify the fire alarm system on site. The minimum level of modification includes addition and deletion of devices, circuits, zones and changes to system description, system operation, and digitized evacuation and instructional messages.

2.13 INSTRUCTION CHART:

Provide a typewritten instruction card mounted behind a Lexan plastic or glass cover in a stainless steel or aluminum frame with a backplate. Install the frame in a conspicuous location observable from each control unit where operations are performed. The card shall show those steps to be taken by an operator when a signal is received under all conditions, normal, alarm, supervisory, and trouble. Provide an additional copy with the binder for the input output matrix for the sequence of operation. The instructions shall be approved by the COTR before being posted.

PART 3 - EXECUTION

3.1 INSTALLATION:

A. Installation shall be in accordance with NFPA 70, 72, 90A, and 101 as shown on the drawings, and as recommended by the major equipment manufacturer. Fire alarm wiring shall be installed in conduit. All conduit and wire shall be installed in accordance with, Section 28 05 13 CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY, Section 28 05 26 GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY, Section 28 05 28.33 CONDUIT AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY, and all penetrations of smoke and fire barriers shall be protected as required by Section 07 84 00, FIRESTOPPING.

B. All conduits, junction boxes, conduit supports and hangers shall be concealed in finished areas and may be exposed in unfinished areas.

C. All new and reused exposed conduits shall be painted in accordance with Section 09 91 00, PAINTING to match surrounding finished areas and red in unfinished areas.

D. All existing accessible fire alarm conduit not reused shall be removed.

E. All fire detection and alarm system devices, control units and remote annunciators shall be flush mounted when located in finished areas and may be surface mounted when located in unfinished areas. Exact locations are to be approved by the COTR.

F. Speakers shall be ceiling mounted and fully recessed in areas with suspended ceilings. Speakers shall be wall mounted and recessed in finished areas without suspended ceilings. Speakers may be surface mounted in unfinished areas.

G. Strobes shall be flush wall mounted with the bottom of the unit located 80 inches (2,000 mm) above the floor or 6 inches (150 mm) below ceiling, whichever is lower. Locate and mount to maintain a minimum 36 inches (900 mm) clearance from side obstructions.

H. Manual pull stations shall be installed not less than 42 inches (1,050 mm) or more than 48 inches (1,200 mm) from finished floor to bottom of device and within 60 inches (1,500 mm) of a stairway or an exit door.

I. Where possible, locate water flow and pressure switches a minimum of 12 inches (300 mm) from a fitting that changes the direction of the flow and a minimum of 36 inches (900 mm) from a valve.

J. Mount valve tamper switches so as not to interfere with the normal operation of the valve and adjust to operate within 2 revolutions toward the closed position of the valve control, or when the stem has moved no more than 1/5 of the distance from its normal position.

K. Connect flow and tamper switches installed under Section 21 13 13, WET-PIPE SPRINKLER SYSTEMS.

L. Connect combination closer-holders installed under Section 08 71 00, DOOR HARDWARE.

3.2 TYPICAL OPERATION

A. Activation of any manual pull station, water flow or pressure switch, heat detector, kitchen hood suppression system, gaseous suppression system, or smoke detector shall cause the following operations to occur:

1. Operate the emergency voice communication system in the entire hospital For sprinkler protected buildings, flash strobes continuously only in the zone of alarm. For buildings without sprinkler protection throughout, flash strobes continuously only on the floor of alarm.
2. Continuously sound a temporal pattern general alarm and flash all strobes in the building in alarm until reset at the local fire alarm control unit in the entire hospital
3. Release only the magnetic door holders in the entire hospital
4. Transmit a separate alarm signal, via the main fire alarm control unit to the fire department.
5. Unlock the electrically locked exit doors within the zone of alarm.

B. Operation of a smoke detector at a corridor door used for automatic closing shall also release only the magnetic door holders in that smoke zone .

C. Operation of duct smoke detectors shall cause a system supervisory condition and shut down the ventilation system and close the associated smoke dampers as appropriate.

D. Operation of any sprinkler or standpipe system valve supervisory switch, high/low air pressure switch, or fire pump alarm switch shall cause a system supervisory condition.

E. Alarm verification shall not be used for smoke detectors installed for the purpose of early warning.

3.3 TESTS

A. Provide the service of a NICET level III, competent, factory-trained engineer or technician authorized by the manufacturer of the fire alarm equipment to technically supervise and participate during all of the adjustments and tests for the system. Make all adjustments and tests in the presence of the COTR.

B. When the systems have been completed and prior to the scheduling of the final inspection, furnish testing equipment and perform the following tests in the presence of the COTR. When any defects are detected, make repairs or install replacement components, and repeat the tests until such time that the complete fire alarm systems meets all contract requirements. After the system has passed the initial test and been approved by the COTR, the contractor may request a final inspection.

1. Before energizing the cables and wires, check for correct connections and test for short circuits, ground faults, continuity, and insulation.
2. Test the insulation on all installed cable and wiring by standard methods as recommended by the equipment manufacturer.
3. Run water through all flow switches. Check time delay on water flow switches. Submit a report listing all water flow switch operations and their retard time in seconds.
4. Open each alarm initiating and notification circuit to see if trouble signal actuates.
5. Ground each alarm initiation and notification circuit and verify response of trouble signals.

3.4 FINAL INSPECTION AND ACCEPTANCE

A. Prior to final acceptance a minimum 30 day "burn-in" period shall be provided. The purpose shall be to allow equipment to stabilize and potential installation and software problems and equipment malfunctions to be identified and corrected. During this diagnostic period, all

system operations and malfunctions shall be recorded. Final acceptance will be made upon successful completion of the "burn-in" period and where the last 14 days is without a system or equipment malfunction.

B. At the final inspection a factory trained representative of the manufacturer of the major equipment shall repeat the tests in Article 3.3 TESTS and those required by NFPA 72. In addition, the representative shall demonstrate that the systems function properly in every respect. The demonstration shall be made in the presence of a VA representative.

3.5 INSTRUCTION

A. The manufacturer's authorized representative shall provide instruction and training to the VA as follows:

1. Six 1-hour sessions to engineering staff, security police and central attendant personnel for simple operation of the system. Two sessions at the start of installation, 2 sessions at the completion of installation and 2 sessions 3 months after the completion of installation.
2. Four 2-hour sessions to engineering staff for detailed operation of the system. Two sessions at the completion of installation and 2 sessions 3 months after the completion of installation.
3. Three 8-hour sessions to electrical technicians for maintaining, programming, modifying, and repairing the system at the completion of installation and one 8-hour refresher session 3 months after the completion of installation.

B. The Contractor and/or the Systems Manufacturer's representative shall provide a typewritten "Sequence of Operation" including a trouble shooting guide of the entire system for submittal to the VA. The sequence of operation will be shown for each input in the system in a matrix format and provided in a loose leaf binder. When reading the sequence of operation, the reader will be able to quickly and easily determine what output will occur upon activation of any input in the system. The INPUT/OUTPUT matrix format shall be as shown in Appendix A to NFPA 72.

C. Furnish the services of a competent instructor for instructing personnel in the programming requirements necessary for system

expansion. Such programming shall include addition or deletion of devices, zones, indicating circuits and printer/display text.

PART 4 - SCHEDULES

4.2 DIGITIZED VOICE MESSAGES:

A. Digitized voice messages shall be provided for each smoke zone of Buildings indicate buildings. The messages shall be arranged with a 3 second alert tone, a "Code Red" "Nurse Blaze" "Doctor Firestone" message and a description of the fire alarm area (building number, floor, level and smoke zone). A sample of such a message is as follows:

Alert Tone
Code Red
Building One, Second Floor, East Wing
Code Red
Building One, Second Floor, East Wing
Code Red
Building One, Second Floor, East Wing

4.3 LOCATION OF VOICE MESSAGES:

Upon receipt of an alarm signal from the building fire alarm system, the voice communication system shall automatically transmit a 3 second tone alert and a pre-recorded fire alarm message throughout the floor in alarm, the floor above and the floor below the building .

- - END - -